



**E-Tender No. MUM/N/EN/ROB/LC-49**

**For**

**Name of work :- Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway.**

**TECHNICAL BID  
(PACKET-A)**

**(PARTICIPATION THROUGH E-TENDER ONLY)**

**E-tendering site- [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL)**

Help: Please contact Tender wizard helpdesk at 011-49424365

**TENDER DOCUMENT  
April, 2020**

**Employer:  
CHIEF GENERAL MANAGER/NORTH/MUMBAI DEDICATED  
FREIGHT CORRIDOR CORPORATION OF INDIA LIMITED  
(A GOVERNMENT OF INDIA ENTERPRISE)  
Under  
MINISTRY OF RAILWAYS**

## INDEX

| <b>PART/CHAPTERS</b>  | <b>DESCRIPTION</b>   | <b>PAGE NO.</b> |
|-----------------------|--|-----------------|
| <b>PART – I</b>       | Important Instructions to Bidders (Tenderers) ITB before submitting their Tenders (Bids) through online. | <b>3</b>        |
| Chapter I             | Notice Inviting Tender   | <b>9</b>        |
| Chapter II            | General Information / Data sheet   | <b>14</b>       |
| Chapter III           | Preamble and General Instructions to Tenderers   | <b>17</b>       |
| Chapter IV            | General Conditions of Contract   | <b>39</b>       |
|                       | Pre-Contract Integrity Pact  | <b>98</b>       |
| Chapter V             | Special Conditions of Contract   | <b>107</b>      |
| <b>PART – II</b>      | Technical Specifications   | <b>122</b>      |
| <b>PART – III (A)</b> | Additional Technical Specifications – III (A)  | <b>209</b>      |
| <b>PART-III (B)</b>   | Additional Technical Specifications – III (B)  | <b>223</b>      |
| <b>PART-III (C)</b>   | Additional Technical Specifications – III (C)  | <b>242</b>      |
| <b>PART – IV</b>      |  |                 |
| Chapter I             | Milestones and Time Schedule   | <b>436</b>      |
| Chapter II            | Tender Forms (including Schedule of Prices)  | <b>439</b>      |
| <b>PART – V</b>       | Drawings   | <b>480</b>      |

**PART I  
GENERAL  
INSTRUCTIONS TO BIDDERS (ITB)**

1. **General:** All bidders must note that this being E-tender, bids received only through online on E-tendering portal [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) shall be considered as an offer. **Any bid submitted in paper form will not be received and opened and shall be summarily rejected.**

**Further, following instructions should be noted by bidders**

2. **Procedure for submission of E-tender:**

- 2.1 **Bid Document obtaining process:**

The Bidder who wish to view free Notification and tender documents can visit DFCCIL's website [www.dfccil.gov.in](http://www.dfccil.gov.in) OR [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) OR Central Procurement Portal [www.eprocure.gov.in](http://www.eprocure.gov.in).

Interested bidders who wish to participate should visit website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL), which is the ONLY website for bidding their offer. Further the procedure is as follows:

- Register yourself with M/s. Indian Telephone Industries (ITI) for obtaining Login ID and Password (after paying necessary charges). This is one time annual payment and applicable for bidding other tenders also.
- Obtain Class-III Digital Signature Certificate from ITI or any other digital signature issuing authority. In case bidder wish to obtain the digital signature certificate from ITI, they may contact Mobile numbers 7738875539/7666563870/7276698860.
- Using the login ID, password and digital signature enter the tender portal to purchase the tender document.
- The tender document charge has to be paid though DD/ BC drawing in favour of Dedicated Freight Corridor Corporation of India Limited payable at Mumbai and payment details to be filled uploaded along with the offer i.e. Bid in website.
- Pay processing fees through e-payment. This payment can be done only through e-payment gateway of ITI.

- With the payment of processing fee, the bidder can download the 'Technical bid' (Microsoft Excel file 'Technicalbid.xls') and 'financial bid' (Microsoft Excel file 'Financialbid.xls') by clicking the link "Show Form".
3. The tender document shall be submitted in online mode through website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL).
  4. The bidder must ensure that the tender document submission before the closing time as the tender submission shall stop accepting the offer at prescribed date and time.
  5. Bidder can anytime change quoted rates before date & time of closing of tender.
  6. This tender being E-tender, the digital signature obtained from approved Controller of Certificate Authorities (CCA) shall only be considered as authentic. The process of obtaining digital signature has been specified as above in para 2.1
  7. Tenderer should submit the Tender Document cost and original EMD in CHI-Mumbai's Office on/or before date **21.05.2020 up to 17.30 hrs.** duly mentioning the tender reference on the envelope. Scanned copy of Tender Document cost, EMD to be submitted with online tender. In case Tender Document cost, original EMD not received by the date **21.05.2020 up to 17.30 hrs.** the offer will be summarily rejected.
  8. The following statutory documents are to be submitted in physical form on/or before the date **21.05.2020 up to 17.30 hrs.** in enclosed envelope duly mentioning the tender reference, **Otherwise, the offer of the tender shall be considered as invalid offer.:**
    1. **Tender document cost**
    2. **Original EMD**
    3. **Documents related to Sole Proprietorship Firm (if applicable)**
      - a) Sole Proprietorship Firm Para 1.3.6.2(a) Sole Proprietorship Firm shall submit the notarized copy of the affidavit.
    4. **Documents related to Partnership Firm (if applicable)**
      - a) Self-attested copies of (i) registered / notarized Partnership Deed as per Para 1.3.6.2(b)(i) , (ii)Power of Attorney duly authorizing one or



more of the partners of the firm or any other person(s) as per Para 1.3.6.2(b)(ii).

**5. Documents related to JV firm. (if applicable)**

- a) Form 9, 11, 12 & 13 of the tender document,
- b) In case one or more of the members are JV firm then, 1) Notary certified copy of Partnership deed (Clause 65.15.1 (a)); 2) Consent of all the partners to enter into the Joint Venture Agreement on a stamp paper (Clause 65.15.1 (b)); C) Power of Attorney (duly registered as per prevailing law) in favour of one of the partners of the partnership firm to sign the JV (Clause 65.15.1 (c)).

In case one or more members of JV is/are Proprietary Firm or HUF then Affidavit on Stamp Paper of appropriate value declaring that his/her Concern is a Proprietary Concern and he/she is sole proprietor of the Concern OR he/she is in position of "KARTA" of Hindu Undivided Family (HUF) and he/she has the authority, power and consent given by other partners to act on behalf of HUF (Clause 65.15.2)

- c) In case one or more members is/are limited companies then, a) Notary certified copy of resolutions of the Directors of the Company, permitting the company to enter into a JV agreement (Clause 65.15.3 (a)); b) Power of Attorney (duly registered as per prevailing law) by the Company authorizing the person (Clause 65.15.3 (c))

**d) Form No 1 as per Chapter II of Part IV.**

- 9. It is to be ensured by the tenderer that the documents such as Tender document, scan copy of EMD, scan copy of Documents related to Sole Proprietorship Firm, Partnership Firm and Companies registered under Companies Act as mentioned in the Para 1.3.6 of the tender document and Documents related JV mentioned in Para 65 and Form 9, 11, 12, 13 of the tender document such as mentioned and other documents as applicable should be uploaded with tender online before the time and date of closure of the tender document.

**Note:** The documents are to be submitted in physical form shall be in enclosed envelope and write “Kind attention to Dy. CHIEF PROJECT MANAGER/ Engg-I/ DFCCIL-Mumbai” mentioning the tender number.

10. Please attach all the addendum(s)/corrigendum(s)(if any) along with the tender document as per Clause 1.1.4 and then upload with the tender document.
11. **Financial bid (Microsoft Excel file) to be filled, saved and uploaded with digital signature.** Only the downloaded financial bid filed should be uploaded after filing and saving in document library. Do not upload scanned copy such as pdf or jpg file etc of 'Financial Bid' in document library.
12. The bidder must obtain for itself on its own responsibility and its own cost all the information including risks, contingencies & other circumstances in execution of the work. It shall also carefully read and understand all its obligations & liabilities given in tender documents.
13. **Cost of biddings:** The Bidder shall bear all costs associated with the preparation and submission of its Bid, and the Employer shall not be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.
14. Tenderer may carefully note that they are liable to be disqualified at any time during tendering process in case any of the information furnished by them is not found to be true. In addition, the EMD of such tenderer shall be forfeited. The decision of Employer in this respect shall be final and binding.
15. The bidder shall submit only one bid in the capacity of an individual or sole proprietor, partnership firm, company and Joint venture. Violation of this condition is liable to disqualify the tenders in which bidder has participated and EMD of all such tenderers shall stand forfeited.
16. The bidder is expected to examine all instructions, terms, conditions, forms.
17. Specifications and other information in the bidding document. Failure to furnish all information required by the bidding documents or submission of a bid not substantially responsive to the bidding document in every respect will be at the bidder's risk and may result in rejection of his bid.
18. At any time prior to the deadline for submission of bids, Employer may for any reason whether at its own initiative or in response to any request by any prospective bidder amend the bidding documents by issuing Corrigendum, which shall be part of the Tender documents.

19. Employer may at its discretion extend the deadline for submission of the bids at any time before the time of submission of the bids.

**20. Bid submission process:**

The tender documents i.e. Technical Bid and Financial Bid with statutory documents should be submitted through online mode in website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) only. up to **15.00** Hrs on **15.05.2020**. The **“Packet - A (TECHNICAL BID)”** will be opened at **12.00** Hrs on **22.05.2020**. Any modified date and time for submission of tenders shall be uploaded on website [www.dfccil.gov.in](http://www.dfccil.gov.in), [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) and Central Procurement Portal, [eprocure.gov.in](http://eprocure.gov.in). The detail procedure of tender opening will be as per Para 1.3.5.

- Before uploading the Technical Bid and before quoting the rate and uploading the ‘Financial Bid’, bidders are advised to upload scanned copies of the following supporting document in ‘document library’. The list is indicative and not extensive.
1. **EMD Document confirming to 1.3.8 of General Information (Statutory document).**
  2. **Tender Fee Document confirming para 1.3.4.3 (Statutory Document)**
  3. **Supporting Documents for Eligibility Criteria as per Form 2A and 2B as per Chapter II of Part IV. (Statutory Document)**
  4. **Sole proprietorship Firm, Partnership Firm, JV Firm deed/Memorandum and Articles of Association of the firm or company, if applicable as per Para 1.3.6 of General Information (Statutory document).**
  5. **Power of attorney of the person signing the tender document or photocopy duly attested by Notary Public as per para 1.3.6 of General information (Statutory document)**
  6. **Offer letter as per Chapter II of Part IV (Statutory document)**
  7. **GSTN Registration Certificate (Statutory document).**
  8. Any other supporting document as required.

- After uploading above documents, bidder should quote their rates in the downloaded 'Financial Bid' file and save the file. After saving, the bidder can upload the filled file. The name of the downloaded 'Financial Bid' ('Financial bid.xls') file should not be changed.
- The Bidder should submit the original EMD, Tender Document Fees in **CHIEF GENERAL MANAGER/North/Mumbai's Office up to 17.30 hrs. on 21.05.2020. Failure of the same the offer of the bidder is shall be rejected.**
- Tenderer should submit the originals of statutory documents and other documents in CHIEF GENERAL MANAGER/North/Mumbai's Office up to **17.30 hrs. on 21.05.2020.** Documents other than statutory document should be submitted in CHIEF GENERAL MANAGER/North/Mumbai's Office within 7 days from opening. The bid is liable to be rejected in case of failure to submit the documents on time.

## **21. Opening of the tender**

The "Packet-A (TECHNICAL BID)" will be opened online at **12.00 Hrs. on 22.05.2020** at the address mentioned in "Notice Inviting tender" and read out in the presence of such tenderer(s) as is/ are present. The detail procedure of tender opening will be as per para 1.3.5. Tenderers or their authorized representatives who are present shall sign register in evidence of their attendance.

## **Help desk for E- Tendering**

1. For any difficulty in downloading & submission of tender document at website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL), please contact at tenderwizard.com helpdesk no 011-49424365 or mobile no 7738875559/7666563870/7276698860.
2. Bidder manual & system requirement is available on website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) for necessary help.

# **PART-I**

## **Chapter-I**

# **NOTICE INVITING TENDER**

**PART- I**  
**Chapter I**

**DEDICATED FREIGHT CORRIDOR CORPORATION OF INDIA LIMITED**  
**(A GOVERNMENT OF INDIA ENTERPRISE)**

No: MUM/N/EN/ROB/LC – 49

DATE: 09.04.2020

**NOTICE INVITING e-TENDER**  
**National Competitive Bidding**

Dear Sirs,

**Name of Work:- Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway.**

**1.1.1** CHIEF GENERAL MANAGER(North), Dedicated Freight Corridor Corporation of India Limited, 7<sup>th</sup> floor, Central Railway New Administrative Building, D.N. Road, Mumbai, India, invites e-tenders on two packet system on prescribed forms from firms/ Companies/ Joint Ventures having requisite experience and financial capacity for execution of the following work:

| <b>Table 1</b> |   |   |                     |                   |
|----------------|---|---|---------------------|-------------------|
| S. No.         | Name of work  | Tender cost (Rs)*                           | Earnest money (Rs)* | Completion Period |
| 1.             | Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway . | Rs. 10,000/-plus 18% GST<br>(Total 11800/-) | Rs. ₹ 50,00,000/-   | 18 months         |

\* As per DFCCIL works manual

**1.1.2 Eligibility Criteria:**

Eligibility shall be assessed on applicants, fulfilling the technical capability and competence as well as for financial and organizational resources as specified in clause no. 1.3.13 (i) A & B of Preamble and General Instruction to tenders (Part - I, Chapter III).

**1.1.3** The Tender document can be downloaded from DFCCIL's website [www.dfccil.gov.in](http://www.dfccil.gov.in), [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) and Central Procurement Portal, [eprocure.gov.in](http://eprocure.gov.in). **from 11.00 hrs on 12.04.2020 to 15.00 hrs on 15.05.2020**

**1.1.4** DFCCIL may issue addendum(s)/corrigendum(s) to the tender documents. In such case, the addendum(s)/corrigendum(s) shall be issued and placed on website [www.dfccil.gov.in](http://www.dfccil.gov.in), [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) and [central procurement portal.eprocure.gov.in](http://centralprocurementportal.eprocure.gov.in) at least three days in advance of date fixed for opening of tenders. The tenderers who have downloaded the tender documents from website must visit the website and ensure that such addendum(s)/corrigendum(s) (if any) is also downloaded by them.

**1.1.5** The tender documents should be submitted through online mode in website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) only. The offer submitted other than online will not be accepted.

**1.1.5.1** The tender documents shall be in two separate online packets viz **Packet -A containing TECHNICAL BID** and **Packet- B containing FINANCIAL BID**. Detailed credential as per the requirement of eligibility criteria and all tender papers except Bill of Quantities are to be submitted in Technical Bid. Summary of Prices (Form No.3) with % age above or below or at par on the amount of various schedules "A", "B", "C", "D", "E" & "F" duly filled in along with Schedule of Prices (Form - 4) are to be submitted in "Financial Bid". **Packet- B also contains** Microsoft Excel file to be filled as Financial Bid, saved and Uploaded with digital signature. Only the downloaded financial bid form in excel file should be uploaded after filing and saving the file in document library. **Caution: Do not upload scanned copy such as pdf or jpg file etc of 'Financial Bid' in document library.**

**1.1.6** Tender shall be submitted as per "General Instruction to Tenderers" forming as part of the complete tender documents.

The tender documents should be submitted through online mode in website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) only. The offer submitted other than online will not be accepted. Please refer 'Procedure for submission of E-tender' in Para 'Instructions to Bidder' (ITB), General of chapter I of Part I.

To participate in the E-Bid submission, it is mandatory for the bidders to have user ID & password to login [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL), which has to be obtained by submitting an annual registration charges of INR 2000/- +GST and other taxes as applicable to M/s ITI Ltd through e-payment or latest prevailing charges, which may be confirmed. Bidders have to pay the Tender Processing Fee to ITI Ltd through e-payment at the time of submission of bid. Already registered vendors with M/s. ITI Ltd need not pay registration charges.

- 1.1.7** E-Tenders shall be opened online at the address given below at the time and date given in NIT in the presence of the tenderers or their authorized representatives intending to attend the opening.

Address of Office of the CHIEF GENERAL MANAGER/North/Mumbai (for submission & opening of tenders):

**CHIEF GENERAL MANAGER/North/Mumbai, DFCCIL, 7<sup>th</sup> Floor, Central Railway New Administrative Building, Mumbai-400001, Maharashtra.**

- 1.1.8** Tender shall be submitted as per “**Instructions to Bidders (ITB)**” forming a part of the tender document.
- 1.1.9 Any tender submitted through e-tendering without Earnest Money in the form as specified in tender documents shall not be considered and shall be summarily rejected.**
- 1.1.10** DFCCIL reserves the right to cancel the tenders before submission/opening of tenders, postpone the tender submission/opening date and to accept / reject any or all tenders without assigning any reasons thereof. DFCCIL’s assessment of suitability as per eligibility criteria shall be final and binding.
- 1.1.11** Tenderers may note that they are liable to be disqualified at any time during tendering process in case any of the information furnished by them is not found to be true. EMD of such tenderer shall be forfeited. The decision of DFCCIL in this regard shall be final and binding.
- 1.1.12** The validity of offer shall be **90 days** from the date of opening of the tender.
- 1.1.13** Information as required as per various Forms to tender document should be submitted by the tenderers without fail strictly as per formats.



**1.1.14** The tender document shall be submitted in online mode through website [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL).

**PART-I**  
**Chapter-II**  
**GENERAL INFORMATION / DATA**  
**SHEET**



**DEDICATED FREIGHT CORRIDOR CORPORATION OF INDIA LTD Govt. of India (Ministry of railways) Enterprises**  
**7<sup>th</sup> Floor, New Administrative Building, D.N. Road, Mumbai-400001**

**NOTICE FOR INVITING BIDS (Online i.e. E-Tender)**

|  |   |
|--|---|
| Tender No                              | <b>MUM/N/EN/ROB/LC-49, Dated: 09.04.2020</b>  |
| Name of work                           | <b>NAME OF WORK: - Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway.</b> |
| (a) Type of Tender                     | Open Tender (Single stage two packet).  |
| (b) Type of Contract                   | Works Contract.   |
| (c) Tender Value                       | <b>₹ 43,35,08,406/-</b>   |
| (d) Completion Period                  | <b>18 months</b>  |
| (e) Earnest Money                      | <b>₹ 50,00,000/- ( Paid through Demand Draft/ banker's Cheque, FDR payable in favour of " Dedicated freight Corridor corporation of India Limited, Mumbai")</b>   |
| (f) Cost of Tender document            | <b>Rs 10,000/- plus GST (18%) i.e. 11,800/- To be paid by D.D./Banker's Cheque in favour of DFCCIL payable at Mumbai</b>  |
| (g) Tender Processing Fee              | <b>Rs 7,500/- plus GST (18%), plus taxes and duties as applicable (non refundable) through e- payment while uploading of tender</b>   |
| (h) Performance Bank Guarantee         | Performance Guarantee (PG) have to be submitted within 30(thirty) days from the date of issue of Letter Of Acceptance (LOA), amounting to 5% of the contract value in the form as give in clause 16.4 of GCC      |
| (i) Retention Money / Security Deposit | 5% of Contract Value  |
| (j) Officer:                           | <b>Chief General Manager (North), Mumbai Dedicated Freight Corridor Corporation of India Limited/Mumbai, 7<sup>th</sup> Floor, New Administrative Building, D.N. Road, Mumbai-400001</b>                          |
| (k) E-Tendering Web Site               | <b>E-tendering site- <a href="http://www.tenderwizard.com/DFCCIL">www.tenderwizard.com/DFCCIL</a></b><br><br>Help: Please contact Tender wizard helpdesk at 011-49424365  |
| (L)Pre bidding Conference              | <b>On 01.05.2020 at 11.00 AM at office of Chief General Manager (North) Mumbai, 7<sup>th</sup> Floor, New Administrative Building, DN Road, 400001</b>  |

| <b>DATE &amp; TIME SCHEDULE</b>   |                                      |
|---|--------------------------------------|
| Date of Uploading of NIT & Other Documents (Online Publishing date)                           | <b>11.04.2020 at 12.00 Hrs.</b>      |
| Documents download/Sell date (Online)   | <b>From 12.04.2020 at 11.00 Hrs.</b> |
| Bid submission Last date (Online)   | <b>15.05.2020 up to 15.00 Hrs.</b>   |
| Last date of submission of originals of statutory documents i.e. EMD & Tender Document Charge | <b>21.05.2020 up to 17.30 Hrs.</b>   |
| Bid Opening date & Time (online)  | <b>22.05.2020 at 12.00 Hrs.</b>      |

**CHIEF GENERAL MANAGER (North), Mumbai Dedicated Freight Corridor Corporation of India Limited/Mumbai, 7<sup>th</sup> Floor, New Administrative Building, D.N. Road, Mumbai-400001**

**PART I  
CHAPTER III**

**PREAMBLE & GENERAL  
INSTRUCTION TO TENDERERS**

# **PART- I**

## **Chapter- III**

### **PREAMBLE & GENERAL INSTRUCTIONS TO TENDERERS**

#### **1.3.1 Introduction**

##### **(i) General**

Dedicated Freight Corridor Corporation of India Ltd. (DFCCIL), a public sector undertaking has been set up under the Indian Companies Act, 1956 for implementation of Dedicated Freight Corridor Project. Government of India is the sole shareholder of the DFCCIL.

Ministry of Railways (MOR), Government of India has planned to construct Dedicated Freight Corridor (DFC) covering about 3338 route kilometres on Eastern and Western Corridors. The coverage of Eastern Corridor is from Ludhiana to Dankuni and Western Corridor is planned from Jawaharlal Nehru Port, Mumbai to Rewari / Tughlakabad / Dadri near Delhi. There will be a linkage between two corridors at Dadri.

##### **(ii) Dedicated Freight Corridor**

Eastern DFC Route will be approximately 1839 Km long from Dankuni to Ludhiana via Dankuni– Asansole– Dhanbad– Gaya– Sonnagar - Mughalsarai- Allahabad- Kanpur- Tundla- Aligarh- Khurja- Bulandshahr– Meerut– Saharanpur– Ambala- Ludhiana.

Western DFC Route will be approximately 1520 Km long from Dadri to JNPT via Rewari – Iqbalgarh - Vadodara-JNPT.

Proposed alignment of DFC has been generally kept parallel to existing Indian Railway line except provision of detours at some stations where the existing yards/cities are congested.

Level Crossings (LC's) are generally unsafe locations and also a congestion points for road/rail's users. These LC's are operational bottlenecks for Railways / DFCCIL in terms of loss in punctuality and reduction in line capacity. Construction of ROB(s)/ RUB(s) is financially and operationally beneficial apart from the fact that it improves the safety of Rail/ Road users.

Road over bridges (ROB) are being constructed on the level crossings falling on Western Corridor of DFCCIL. These ROB's shall span over the existing railway lines, the proposed DFCC lines and on approaches. The ROB's shall be constructed in Railway and DFCCIL portion with composite girders/ *Bow string girders*/ *Through girders* based on Railway GADs and design, and on approach portion, RE wall, RCC girders/ PSC girders etc. based on State Government GADs and detail Designs, and suitably designed RCC abutments, piers and foundations including staircases and other allied components. Depth of type of foundation shall be decided/ designed based on detailed geotechnical investigation at ROB's sites. Before execution or during execution, if there is a modification/correction in approved GADs of Railways/State Government, the Agency has to execute the work as per modified/corrected GADs, for which Contractor shall not be entitled to any extra payment or claims.

**(iii) Scope of Work**

On behalf of President of India, CHIEF GENERAL MANAGER herein after referred to as 'DFCCIL' is inviting sealed tenders from Firms/Companies/ Joint Ventures having requisite experience and financial capacity for execution of the following work:

**NAME OF WORK: - Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway.**

- a) Railway Portion arrangement as per approved GAD:
- b) For Approach portion of work as per approved GAD of Maharashtra State government.

| SL. No. | Level Crossing No | Chainage of ROB (km) | Approx. Rly. Span configuration (m) | Approx. Approach Span configuration (m) |
|---------|-------------------|----------------------|-------------------------------------|---|
| 1       | 49                | KM 96/4-10           | 2x36 (Composite girders)            | 20*24.0M                                |

**(iv) Scope of work is as per the requirements given in the Bid document but Not limited to:**

- (a) Construction of RCC abutments and piers, for Composite girders RCC/PSC girder as per IRC loading, including pile foundations/ open foundation as per GAD/Design.
- (b) Fabrication of composite plate girders/ Bow string girders /Open

Web girders (skew up to 45<sup>0</sup>) of around 18m, 22m, 24m, 30m, 36m, 48m and 62m etc. clear span including erection with traffic power block as per GAD.

- (c) Construction of Approximate 12m/20m etc wide RCC deck slab on plate girders (composite) RCC/PSC girder and 7.5m/ 15m etc. width on approaches as per approved GADs.
- (d) Providing and fixing in position standard fixed type POT bearing, free sliding type POT cum PTFE bearings/*Elastomeric bearings* as per approved drawing.
- (e) Providing and laying cement concrete wearing coat, drainage spouts, footpath, road markings, etc.
- (f) Providing and fixing RCC crash barrier and RCC railing (As per MORTH design) and electric lighting poles.
- (g) Providing and fixing in position single strip seal elastomeric type expansion joints.
- (h) Construction of Inspection platform, railing, ladders, etc.
- (i) Construction of RCC/Steel staircases, providing and fixing of protection screens.
- (j) Construction of approaches which includes constructing of RE wall, RCC slab, piers, crash barrier, earthwork in bank, providing bituminous road & all works related to constructing approaches complete.
- (k) Other miscellaneous works for commissioning Railway/ DFCCIL portion and approach portion of work.
- (v) **Cost of the work: The estimated cost of the tendered work is approximately ₹ 43,35,08,406/-**
- (vi) The Tenderer shall be governed by General Conditions of Contract (GCC), Preamble and General Instructions to Tenderers (ITT) and Special Conditions of Contract (SCC). Wherever, there is a conflict in any condition between USSOR conditions, GCC and Special Conditions of Contract mentioned in the tender documents, the condition mentioned in Special Conditions of Contract will prevail. However, Engineer's decision in this connection shall be final and binding.

Part I, Chapter-IV and V of the tender document contains General Conditions



of Contract and Special Conditions of Contract specific to this work and shall be applicable in the contract.

**(vii) Location**

Works are to be executed in the jurisdiction of Mumbai Division of Western Railway with approaches of ROB's in State Government land. However, DFCCIL reserves right to change the site of work anywhere in adjacent/adjoining area of the work defined in Para 1.3.1(iii) above in the jurisdiction of CGM//NORTH/MUMBAI/DFCCIL and the contractor shall be bound to execute the work without any extra cost.

**1.3.2 (A) Tender Bid**

The Tender Bid shall be submitted online **through uploading on e-tender web site Address:- [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL)** asunder:-

**Packet - A**

Eligibility/Qualifying element of the tender Bid along with other documents mentioned in para 1.3.2 (b) (i), here in after called "TECHNICALBID "

**Packet -B**

Price elements of the Tender Bid as per para 1.3.2 (b) (ii), herein after called "FINANCIAL BID".

The TECHNICAL BIDs (Packet - A) **received through e-tender with physical deposition of EMD, Tender Fee and other statutory documents** shall be opened on the date of tender opening and the detailed scrutiny of TECHNICAL BID shall be carried out.

The "FINANCIAL BID" (Packet - B) **received through e-tender** shall be opened only of those tenderers who qualify in "Technical Bid".

The Financial Bid (Packet- B) of un-qualified tenderers shall not be process further and not opened. The detailed procedure for tender opening and processing is given in Para 1.3.5.

**1.3.2(B) Form of Tender**

The Tender documents shall be in **two separate packets** viz:-

"Packet- A" containing technical Bid and "Packet- B" containing financial Bid. Detailed credentials as per the requirement of eligibility criteria and all tender papers except Summary of Prices and Schedule of Prices are to be submitted through online e-tender in "TECHNICAL BID" i.e. Packet-A. Summary of Prices and Schedule of Prices with percentage above/below/at par duly filled in are to be submitted in "FINANCIALBID" (Microsoft Excel file) to be filled, saved

and uploaded with digital signature through online e-tender.

Completed tender documents in two packets viz. Packet-A and Packet-B shall be submitted through online e-tender on web site: - [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL).

**Any tender received through online e-tender later than the time and date of submission of tenders i.e. 15.00 hrs on 15.05.2020 shall be rejected and unopened.**

**(i) Documents to be uploaded in support of TECHNICAL BID (Packet- A): -**

| S. No | Description   | Documents         |
|-------|---|-------------------|
| (1)   | Offer letter complete.  | Form No.1         |
| (2)   | Tenderer's credentials in accordance With para 1.3.13 (i) & (ii) of Preamble and General Instructions to Tenderers.   | Form No. 2A,2B&2C |
| (3)   | Earnest money in accordance with Para 1.3.8 and Cost of Tender Document in case of downloaded tenders in accordance with Para 1.3.4.3 of Preamble and General Instructions to Tenderers in an envelope.               |                   |
| (4)   | Written confirmation authorizing the signatory of the tender to commit the tenderer and other documents as per format as applicable, in accordance with para 1.3.6 of Preamble and General Instructions to Tenderers. |                   |

**(ii) Documents to be enclosed with the FINANCIAL BID (Packet B): -**

| S. No | Description  | Documents  |
|-------|--|------------|
| (1)   | Summary of Prices, Schedule of Prices & Total Prices | Form No. 3 |

**1.3.3 Tender Document**

This tender document consists of following five parts:

| PART/CHAPTERS | DESCRIPTION | PAGE NO. |
|---------------|-------------|----------|
|---------------|-------------|----------|

|                       |  |            |
|-----------------------|--|------------|
| <b>PART – I</b>       | Important Instructions to Bidders (Tenderers) ITB before submitting their Tenders (Bids) through online. | <b>3</b>   |
| Chapter I             | Notice Inviting Tender   | <b>9</b>   |
| Chapter II            | General Information / Data sheet   | <b>14</b>  |
| Chapter III           | Preamble and General Instructions to Tenderers   | <b>17</b>  |
| Chapter IV            | General Conditions of Contract   | <b>39</b>  |
|                       | Pre-Contract Integrity Pact  | <b>98</b>  |
| Chapter V             | Special Conditions of Contract   | <b>107</b> |
| <b>PART – II</b>      | Technical Specifications   | <b>122</b> |
| <b>PART – III (A)</b> | Additional Technical Specifications – III (A)  | <b>209</b> |
| <b>PART-III (B)</b>   | Additional Technical Specifications – III (B)  | <b>223</b> |
| <b>PART-III (C)</b>   | Additional Technical Specifications – III (C)  | <b>242</b> |
| <b>PART – IV</b>      |  |            |
| Chapter I             | Milestones and Time Schedule   | <b>437</b> |
| Chapter II            | Tender Forms (including Schedule of Prices)  | <b>440</b> |
| <b>PART – V</b>       | Drawings   | <b>481</b> |

### 1.3.4 Sale and Submission of Tender Document

- 1.3.4.1** The Tender document can be downloaded from DFCCIL's website [www.dfccil.gov.in](http://www.dfccil.gov.in), [www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL) and Central Procurement Portal, [eprocure.gov.in](http://eprocure.gov.in). on payment of tender processing fee of the website. The tender document shall be submitted in online mode through website

[www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL). The Tender Document cost of Rs. 10,000/- plus 18% GST (Total 11800/-) through Demand Draft / Banker's cheque payable in favour of "Dedicated Freight Corridor Corporation of India Limited, Mumbai" The cost of the tender form is not refundable and also not transferable.

**1.3.4.2 Bid Document obtaining process:**

As per para 2.1 of Instructions to Bidders (ITB) of General chapter of Part I.

**1.3.4.3 Clause applicable for tender submitted through e-tender**

Tenderer/s are free to download tender documents at their own cost, for the purpose of perusal. Master copy of the tender document will be available in the office of CHIEF GENERAL MANAGER/North, DFCCIL, 7th floor, Central Railway New Administrative Building, D.N. Road, Mumbai-40001. After award of the work, an agreement will be drawn up. The agreement shall be prepared based on the master copy available in the office of General Manager/ROB/CGM, Dedicated Freight Corridor Corporation of India Limited and not based on the tender documents submitted by the Tenderer. In case of any discrepancy between the tender documents submitted through e-tender and the master copy, later shall prevail and will be binding on the Tenderers. No claim on this account shall be entertained.

**1.3.4.4 Cost of Tender documents downloaded from internet**

Tender documents are available on Dedicated Freight Corridor Corporation of India Limited web site i.e. "[www.tenderwizard.com/DFCCIL](http://www.tenderwizard.com/DFCCIL)". The cost of the tender document as indicated above in para 1.3.4.1 above will have to be deposited by the tenderer in the form of Demand draft/banker's cheque payable in favour of 'Dedicated Freight Corridor Corporation of India Limited' along with the Tender document. Tenderer should submit the Tender Document cost in physical form in CHIEF GENERAL MANAGER/Mumbai's Office on/or before date **21.05.2020** up to **17.30 hrs** duly mentioning the tender reference on the envelope. ***Scanned copy of Tender Document cost, EMD to be submitted with online tender.*** In case tender document cost & original EMD not received by the date **21.05.2020** up to **17.30 hrs**, offer will be summarily rejected. This should be paid separately and not included in the earnest money. In case, tender is not accompanied with the cost of the tender document as detailed above, tender will be summarily rejected.

**1.3.4.5 Bid submission process:**

.As per para 20 of Instructions to Bidders (ITB) of General chapter of Part I.

**1.3.4.6 EMD , Tender Fee and other Statutory documents sealed and super-scribed as**

a foresaid can also be sent by Registered post addressed to the CHIEF GENERAL MANAGER /North, DFCCIL, 7th floor, Central Railway New Administrative Building, D.N. Road, Mumbai-40001, India. EMD, Tender Fee and other statutory documents received after **17.30 hrs on 21.05.2020** shall not be considered. EMD, Tender Fee and other Statutory documents delivered or sent otherwise will be at the risk of the tenderers.

**1.3.4.7 The rates should be quoted in Financial Bid (packet –B) (Microsoft Excel file) to be filled, saved and uploaded with digital signature. Only the downloaded financial bid filled should be uploaded after filling and saving. Don't upload pdf or jpg etc. scanned copy of "financial bid" in document library. The bids submitted without Excel file shall be summarily rejected.**

**1.3.4.8 Signing of All Bid Papers and completing Financial Bid:**

This tender being E-tender, the digital signature obtained from approved Controller of Certificate Authorities (CCA) shall only be considered as authentic. The process of obtaining digital signature has been specified at General of Para-1 of ITB.

**1.3.4.9 Care in Submission of Tenders**—Before submitting a tender, the tenderer will be deemed to have satisfied himself by actual inspection of the site and locality of the works, that all conditions liable to be encountered during the execution of the works are taken into account and that the quoted rates by tenderer in tender forms are adequate and all inclusive in item of Taxes, Duties & Levies etc. in terms of General/Special Conditions of Contract for the completion of works to the entire satisfaction of the Employer.

**1.3.4.10 Pre-bid conference:** There will be pre-bid conference at **11.00 hours on 01.05.2020 at the office of Chief General Manager/North, DFCCIL, 7<sup>th</sup> floor, Central Railway New Administrative Building, D.N. Road, Mumbai-40001.** **Bidders should give their queries in writing at least 3 days prior to Pre-bid conference.** All interested firms / contractors may attend the Pre-bid conference. DFCCIL response to queries as well as addenda to bidding document will be posted on the DFCCIL's website. Non-attendance at the pre-bid conference will not be a cause for disqualification of the bidder.

All communication between the Employer and the tenderer shall be in writing. For the purposes of seeking clarification, the Employer's address is:

Dedicated Freight Corridor Corporation of India Limited

Attention: Dy.CPM/Engg-I / Mumbai

---

Telephone:9004443321, Facsimilenumber:-022-22634184

Electronic mail address: Inrao@dfcc.co.in

**1.3.4.11** Conditional tenders are liable to be rejected. DFCCIL however reserves the right to reject such tenders summarily without assigning any reasons whatsoever. The Railway also reserves the right to reject any special conditions stipulated by the Tenderer as considered unacceptable to the Railway and can call upon the Tenderer to withdraw such conditions. If any deviations from the General conditions/ special conditions/ specifications are proposed by the tenderer, they should be mentioned statement of deviation in Annexure `A' and not elsewhere in the tender documents.

**1.3.4.12** If it is found at any stage of the finalization of the tender or during actual execution of the work that the information furnished in this tender, including clarifications, is incorrect, the tenders are likely to be rejected.

**1.3.4.13** Sales Tax/Commercial Tax/Works Contract Tax:

Taxes prescribed by the Central government/State Government/Local bodies at the rate prescribed by them will be recovered from the bills from time to time.

**1.3.4.14** The list of documents (Check list) to be attached along with the tender documents is as under: -

- Requisite Earnest Money in proper form.
- Tender fee in prescribed form.
- Various Pro-forma attached with tender document as per chapter II of Part IV.
- Offer Letter as per Form No1 of Chapter II of Part IV.
- Documents fulfilling the eligibility criteria as per Form No 2A and 2B as per chapter II of Part IV.
- List of personnel, organization available on hand and proposed to be engaged for the subject work.
- List of plants & machinery available on hand (own) and proposed to be inducted (Own & hired to be given separately) for the subject work.
- List of works completed in the last three financial years and current financial year giving description of work, organization for whom executed, approximate value of contract at the time of award, date of award, date of schedule completion of work, date of actual commencement of work, actual date of completion and completion cost. Supportive documents/certificates from the organizations with whom they had worked should also be enclosed. Certificate from private individuals for whom such works were executed will not be accepted.
- List of works on hand indicating description of work, contract value, date of award, value of work executed & approximate value of balance work yet to be done. Supportive documents/certificates from the organizations

with whom they are working should also be enclosed. Certificate from private individuals for whom such works are being executed will not be accepted.

- Method statement, PERT CHARTS & Construction schedule vis-à-vis deployment resources.
- MOU for JV and Partnership deed as per Forms 9,10,11,12 and 13 of Chapter II of Part IV.
- Power of Attorneys as per Form 12 & 13 of Chapter II of Part IV.
- All above documents duly signed & completed in all and signing each and every page of the document.
- Pan Card, GSTN Registration.

### 1.3.5 Opening of Tender:

- (a) Tender will be opened online at **12.00 hrs. on 22.05.2020**, in CHIEF GENERAL MANAGER(North), Dedicated Freight Corridor Corporation of India Limited, 7th floor, Central Railway New Administrative Building, D.N. Road, Mumbai, India, in the presence of the tenderers or their representatives as may be present at the prescribed date and time.
- (b) The outer sealed covers EMD, Tender Fee, Form 1,2A, 2B and 2C with other statutory documents shall be opened at **12.00 hrs on 22.05.2020**. Thereafter the packet of '**TECHNICAL BID (Packet- A)**' only of the tenderers whose EMD, Tender Fee, stipulated Forms have been received in the office of CHIEF GENERAL MANAGER /North/ Mumbai/ DFCCIL office shall be opened and the contents thereof i.e. qualification details shall be read out. **FINANCIAL BID (Packet-B)** shall be opened subsequently after informing the parties participated.
- (b) After the opening of "TECHNICAL BID" (Packet-A) of all the tenderers, these Bids shall be scrutinized and analyzed. If found necessary by the Employer, the tenderers shall be asked to furnish clarifications and the Employer may also hold discussions with the tenderers after giving due notice. The names of the tenderers whose Bid are considered complete and meet eligibility criteria shall be shortlisted.
- (d) The **FINANCIAL BID (Packet-B)** shall be opened on a subsequent date and time duly notified well in advance. The Financial Bids of only those tenderers shall be opened who are short listed after scrutiny of their Technical Bid. The Financial Bid of the tenders who do not qualify during scrutiny of Technical Bid shall not be opened. The time of opening, date and venue of online financial Bids of Shortlisted tenderer shall be advised to qualified tenderers well in advance to enable them to depute their representative. The earnest money of non-qualifying tenderers will be returned back within a reasonable period of completion of results of Technical Bid.

**1.3.5.1** The Employer (DFCCIL) will notify Bidders in writing who have been rejected on the grounds of their Technical bids being substantially non-responsive to the requirements of the bidding document and their price bids i.e. FINANCIAL BID ( Packet-B) submitted online will not be opened.

**1.3.6 Constitution of the Firm: -**

**1.3.6.1** Tenderer shall clearly specify whether the tender is submitted on his own or on behalf of a partnership firm / Joint Venture (JV) / Company. The tenderer(s) who is / are constituents of the firm / Company, shall enclose self-attested copies of the constitution of their concern, Partnership Deed and Power of attorney along with their tender. Tender documents in such cases shall be signed by such persons as may be legally competent to sign them on behalf of the firm / company as the case may be.

**1.3.6.2** The tenderer shall give full details of the constitution of the Firm / JV / Company and shall also submit following documents (as applicable), in addition to documents mentioned above:

- (a) Sole Proprietorship Firm: The tenderer shall submit the notarized copy of the affidavit.
- (b) Partnership Firm : The tenderer shall submit self-attested copies of (i) registered / notarized Partnership Deed and (ii) Power of Attorney duly authorizing one or more of the partners of the firm or any other person(s), authorized by all the partners to act on behalf of the firm and to submit & sign the tender, sign the agreement, witness measurements, sign measurement books, receive payments, make correspondences, compromise / settle / relinquish any claim (s) preferred by the firm, Sign "No claim Certificate", refer all or any dispute to arbitration and to take similar action in respect of all tenders / contracts or said tender / contract.
- (c) Joint Venture: The tenderer shall submit documents as mentioned in clause 65 of GCC.
- (d) Companies registered under Companies Act-1956: The tenderer shall submit (i) the copies of Memorandum of Association (MOA) and Articles of Association (AOA) of the company; and (ii) Power of attorney duly registered / notarized by the company (backed by the resolution of Board of Directors) in favour of the individual, signing the tender on behalf of company.

**1.3.6.3** If it is mentioned in the tender submission that it is being submitted on behalf of / by a sole Proprietorship Firm / Partnership Firm / Joint



**venture / registered Company etc. but above-mentioned documents (as applicable) are not enclosed along with tender, the tender shall be summarily rejected.**

If it is NOT mentioned in the tender submission that it is being submitted on behalf of / by a Sole Proprietorship Firm / Partnership Firm / Joint Venture / Registered Company etc., then the tender shall be treated as having been submitted by the individual who has signed the tender.

After opening of the tender, any document pertaining to the constitution of the Firm / Joint Venture etc. shall neither be asked nor be entertained / considered by DFCCIL.

**1.3.6.4** A tender from Joint Venture / Partnership Firm etc. shall be considered only where permissible as per the tender conditions.

**1.3.6.5** The DFCCIL will not be bound by any power of attorney granted by the tenderer or by changes in the composition of the Firm made subsequent to the submission of tender. It may, however, recognize such power of attorney and changes after obtaining proper legal advice.

**1.3.7 Validity of Tender: -**

Tenderer shall keep his offer open for a minimum period of 90 days from the date of opening of the tender or as mentioned in the Tender Notice.

**1.3.8 Earnest Money: -**

- (a) The tender must be accompanied by Earnest Money in favour of **'Dedicated Freight Corridor Corporation of India Limited, Mumbai** deposited in any of the forms as mentioned in 1.3.8(c), failing which the tender will not be considered.
- (b) The earnest money shall remain deposited with the DFCCIL for the period of validity of the offer prescribed in this tender i.e. 90 days from the date of opening of tender. If the validity of the offer is extended, the validity of earnest money should also be extended failing which the offer after the expiry of the afore said period may not be considered by the DFCCIL.
- (c) The Earnest money should be in any of the following forms:  
FDR/Banker's cheque / Demand Draft executed by State bank of India or any of the nationalized banks or any Indian Scheduled Bank.
- (d) It shall be understood that the tender documents have been sold/issued to the tenderer and the tenderer is permitted to tender in consideration of stipulation on his part, that after submitting his tender he will not resile from his offer or modify the terms and conditions, thereof in a manner not

acceptable to the Employer. Should the tenderer fail to observe or comply with the said stipulation, the aforesaid amount shall be liable to be forfeited to the DFCCIL.

- (e) The earnest money of the unsuccessful tenderer(s) will, save as here- in-before provided, be returned to the unsuccessful tenderer(s) within a reasonable time but the DFCCIL shall not be responsible for any loss or depreciation that may happen for the due performance of the stipulation to keep the offer open for the period specified in the tender documents or to the earnest money while in their possession nor be liable to pay interest thereon.
- (f) The bidder has to submit the original EMD in physical form shall be in sealed Envelope along with the tender fee and Statutory documents addressed to Dy. CHIEF PROJECT MANAGER/Engg -I/DFCCIL, Mumbai mentioning the tender Number on or before 17.30 hrs on **21.05.2020** .

**NOTE:** No interest shall be paid by DFCCIL on earnest money amount.

#### **1.3.9 Execution of Contract Agreement: -**

The Tenderer whose tender is accepted shall be required to appear in person at the office of **CHIEF GENERAL MANAGER/North, DFCCIL, 7th floor, Central Railway New Administrative Building, D.N. Road, Mumbai-40001** or if a firm or corporation, a duly authorized representative shall so appear and execute the contract agreement within 60 days after notice that the contract has been awarded to him. Failure to do so shall constitute a breach of the agreement affected by the acceptance of the tender in which case the full value of the earnest money accompanying the tender shall stand forfeited without prejudice to any other rights or remedies.

In the event of any tenderer whose tender is accepted refuses to execute the contract agreement as here in before provided, DFCCIL may determine that such tenderer has abandoned the contract and there upon his tender and acceptance thereof shall be treated as cancelled and DFCCIL shall be entitled to forfeit the full amount of the Earnest Money.

#### **1.3.10 Security Deposit on Acceptance of Tender:**

The security deposit/rate of recovery/mode of recovery on acceptance of tender shall be as per the Para 16.(1) to 16.(3) of General Conditions of Contract(GCC).

#### **1.3.11 Tenderer's Address**

The tenderer should state in the tender his postal address legibly and clearly. Any communication sent in time, to the tenderer by post at his said address shall be deemed to have reached the tenderer duly and in time. Important documents should be sent by registered post.

### 1.3.12 Right of DFCCIL to Deal with Tenders

- (a) The DFCCIL reserves the right of not to invite tenders for any of DFCCIL work or works or to invite open or limited tenders and when tenders are called to accept a tender in whole or in part or to reject any tender or all tenders without assigning reasons for any such action.
- (b) The authority for the acceptance of the tender will rest with the DFCCIL. It shall not be obligatory on the said authority to accept the lowest tender or any other tender and no tenderer(s) shall demand any explanation for the cause of rejection of his/their tender nor the DFCCIL undertake to assign reasons for declining to consider or reject any particular tender or tenders.

### 1.3.13 (i) Eligibility Criteria

#### (A): Technical Eligibility Criteria

| Criteria  | Compliance Requirement |  | Documents   |
|---|------------------------|--|---|
| Requirement   | Single Entity          | Joint venture  | Submission Requirements   |
| <p><b>(i)</b> The tenderer / JV firm or Lead Member of JV firm must have satisfactorily completed at least one single work in last three previous financial years and the current financial year upto the date of submission of tender, of construction of any one of the following having minimum value of 35% of the Advertised value of tender: <b>Rs. 15,17,27,942/-</b></p> <p>1 Railway Bridge* having superstructure of RCC or PSC or Steel on at least one span.<br/><b>OR</b></p> <p>2 Viaduct of Railway* having superstructure of RCC or PSC or Steel on at least one span.<br/><b>OR</b></p> <p>3 Bridge* of Metro Railway having superstructure of RCC or PSC or</p> | Must meet requirement  | <p>Existing JV - Must meet requirement.</p> <p>Or</p> <p>Lead Member of proposed JV- Must meet requirement</p> | <p>The tenderer shall submit the completion certificates / certified completion certificates from the client(s) and or Photostat of original certificates of client. All documents either original or photocopy should be attested by Notary.</p> |

|  |  |  |  |
|--|--|--|--|
| <p>Steel on at least one span<br/><b>OR</b></p> <p>4 Viaduct* of Metro Railway having superstructure of RCC or PSC or Steel on at least one span.<br/><b>OR</b></p> <p>5 ROB of Railway Portion having superstructure of RCC or PSC or Steel on at least one span.<br/><b>OR</b></p> <p>6 Approach Portion of ROB having superstructure of RCC or PSC or Steel on at least one span.<br/><b>OR</b></p> <p>7 Flyover on Roads having superstructure of RCC or PSC or Steel on at least one span.</p> <p>8 Foot Over Bridge Over Railway Track</p> <p><b>Note:</b></p> <p>(a) *Road Under Bridge of box type shall not be considered as Railway bridge/ viaduct of railway/bridge of metro/viaduct of metro and shall not be considered as similar nature of work for this tender.</p> <p>(b) For the purpose of technical eligibility criteria, the definition of ROB means "Road Over Bridges" constructed over Railway line(s).</p> <p><b>And</b></p> |  |  |  |
|--|--|--|--|

|   |                       |   |  |
|---|-----------------------|---|--|
| <p><b>(ii)</b> The tenderer / JV firm or any Member of JV firm must have satisfactorily completed in last three previous financial years and the current financial year upto the date of submission of tender, at least one single work having a component of “fabrication and erection”, of Open Web Steel Girder or Plate Steel Girder or Bow string Steel Girder irrespective of cost of work done.</p> <p>This fabrication and erection must be for Railway Bridge or Metro Railway or ROB or Foot Over Bridge over Railway Track.</p> <p><b>Note:</b></p> <p>(a) *Road Under Bridge of box type shall not be considered as Railway bridge/ viaduct of railway/bridge of metro/viaduct of metro and shall not be considered as similar nature of work for this tender.</p> <p>(b) For the purpose of technical eligibility criteria, the definition of ROB means “Road Over Bridges” constructed over Railway line(s).</p> <p>(c) The single work can be a separate work or same as (i) above</p> | Must meet requirement | Existing JV - Must meet requirement.<br><br>Or<br><br>Any Member of proposed JV- Must meet requirement. | The tenderer shall submit the completion certificates / certified completion certificates from the client(s) and or Photostat of original certificates of client. All documents either original or photocopy should be attested by Notary. |
|---|-----------------------|---|--|

**Note:**1 . Value of completed work done by a member in an earlier JV Firm shall be reckoned only to the extent of the concerned member's share in that JV firm for the purpose of satisfying his / her compliance to the above-mentioned technical eligibility criteria in the tender under consideration.

3. In case the tenderer/s is a partnership firm, the work experience shall be in the name of partnership firm only.

**(B): Financial Eligibility Criteria**

| Criteria  | Compliance Requirement |                       | Documents   |
|---|------------------------|-----------------------|---|
| Requirement   | Single Entity          | Joint Venture         | Submission Requirements   |
| The contractual payments received by the tenderer / JV firm or the arithmetic sum of contractual payments received by all the members of the JV firm in the previous three financial year and the current financial year up to the date of submission of tender shall be at least <b>150% of advertised value of tender i.e. Rs.650262609/-</b> . | Must meet Requirement  | Must meet requirement | TDS certificates/ Audited balance sheets and or Photostat of TDS certificates/Audited Balance sheets clearly indicating the contractual amount received. All documents either original or photocopy should be attested by Notary. |

**Note: 1.** Contractual payments received by a Member in an earlier JV firm shall be reckoned only to extent of the concerned member's share in that JV Firm for the purpose of satisfying compliance of the above mentioned financial eligibility criteria in tender for considerations.

**2.** In case the tenderer/s is a partnership firm, the turnover etc. shall be in the name of partnership firm only.

**1.3.13 (ii) Credentials of Tenderer**

The tenderer shall provide satisfactory evidence in support of their technical and financial eligibility, which are acceptable to DFCCIL, as follows:

- (a) For Technical eligibility criteria, the details will be submitted in Form No.2A along with supporting documents.
- (b) For Financial eligibility criteria, the details will be submitted in Form No.2B along with supporting documents.

- (c) The tenderer shall submit the completion certificates/certified completion certificates from the client(s) or Photostat of original certificates of client. All documents either original or photocopy should be attested by Notary. These certificates should indicate the details of works carried out and successful commissioning of similar type of work executed by the tenderer. Completion certificate from Govt. organisation /PSUs/Public Limited Company will be accepted. The certificate from Private individual/Private Company for whom such works are executed shall not be accepted. In case, the work is executed for Public Limited Company, copy of work order, bill of Quantity, TDS certificate payments received and copy of final/last bill paid by client shall be submitted.

The following will be applicable for evaluating the eligibility:

- (i) Similar nature of work physically completed within the qualifying period, i.e. last three financial year and current financial year (even though the work might have commenced before the qualifying period) shall only be considered in evaluating the eligibility.
- (ii) The total value of similar nature of work completed during the qualifying period and not the payment received within qualifying period alone, shall be considered. In case, the final bill of similar nature of work has not been passed and final measurements have not been recorded, the paid amount including statutory deductions is to be considered. If final measurements have been recorded and work has been completed with negative variation, then also the paid amount including statutory deductions is to be considered.

However, if final measurements have been recorded and work has been completed with positive variation but variation has not been sanctioned, original contract agreement value or last sanctioned contract agreement value whichever ever is lower, shall be considered for judging eligibility.

- (iii) As proof of sufficient financial capacity and organizational resources, contractor should have received total payments against satisfactory execution of all completed /on-going works of all types (not confined to only similar works) during the last three financial years and in the current financial year (upto the date of submission of the tender) of a value not less than 150% of advertised tender value.

- (iv) Tenderer shall submit a statement of contractual payments received during last three financial years and current financial year on the prescribed Performa as per Form No. 2B. The details shall be based on the form 16-A issued by the employer i.e. the certificate of deduction of tax at source as per Income Tax Act 1961. The photo copies of Form 16- A shall be closed duly attested by Notary Public with seal and Notarial Stamp there on or a certificate from auditor or audited balance sheet certified by Chartered Accountant clearly indicating the contractual amount received duly attested by Notary Public with seal and Notarial Stamp there on.
- (v) The tenderer shall be considered disqualified/in-eligible if:
  - (a) The Tenderer or any of its partners and/or subcontractors included in the tender has been banned for business with Ministry of Railways/DFCCIL along with any of its attached and subordinate offices through an order issued by Ministry of Railways as per list available on Website ([http:// www. Indian Railways. gov.in / railway board](http://www.IndianRailways.gov.in/railwayboard) ) of Railway Board pertaining to banning of Business, with the banning being valid as on the date of submission the Tender.
  - (b) The Tenderer or any of its partners has suffered bankruptcy / in solvency or it is in the process of winding-up or there is a case of insolvency pending before any Court on the deadline of submission of application.
- (vi) For the purposes of conversion of foreign currency to Indian rupees (INR) Bank Currency(BC) selling exchange rates as published by State Bank of India on the date 28 days prior to date of submission of tender shall be used. For few of the currencies where BC selling rates are not published by SBI or reserve bank of India, the exchange rate may be obtained from website- <http://www.oanda.com/currency/historical-rates> or <http://www.xe.com>.
- (vii) For the purpose of evaluation of all proposals, all values given in INR in eligible qualification criteria and the values provided by the applicants in the proposal in the currencies other than INR shall be converted into one i.e. INR as per exchange rate mentioned in para (vi) above.



#### **1.3.14 Period of Completion**

**The entire work is required to be completed in all respects within 18 months (Eighteen months) from the date of issue of the acceptance letter.** Time is the essence of contract. The contractor shall be required to maintain steady and regular progress to the satisfaction of the Engineer to ensure that the work will be completed in all respects within the stipulated time.

- 1.3.15** If the Tenderer/s deliberately gives any wrong information about credentials / documents in his / their tenders and thereby create(s) circumstances for acceptance of his /their tender, DFCCIL reserves the right to reject such tender at any stage, besides, shall suspend business with such tenderer. The EMD of such tenderers shall also be forfeited.

#### **1.3.16 Quantum of work and materials:**

The indicative schedule of quantities of various items of works is included in Form - 4 of the tender documents.

#### **1.3.17 Employer not bound to accept any tender:**

The employer shall not be bound to accept the lowest or any tender or to assign any reason for non-acceptance or rejection of a tender. The employer reserves the right to accept any tender in respect of the whole or any portion of the work specified in the tender papers or to reduce the work or to accept any tender for less than the tendered quantities without assigning any reason whatsoever.

#### **1.3.18 Schedule of Prices**

The Schedule-I (Railway portion i.e. having composite girders) & II (Approach portion ROB excluding Railway portion) of the tender document lists out the Schedule of Prices for various items. Based on these, the total tender value has also been worked out.

#### **1.3.19 Performance Guarantee: Refer relevant clause of GCC.**

- 1.3.20** The tenderer shall furnish information for making payment through ECS/ NEFT / RTGS (Tender Form No. 8 placed at Part IV of the tender documents).

#### **1.3.21 Negotiation:**

Should DFCCIL decide to negotiate with a view to bring down the rates, the

tenderer called for negotiations should furnish the following form of declaration before commencement of negotiations:

"I..... do declare that in the event of failure of contemplated negotiations relating to Tender No..... dated .....my original tender shall remain open for acceptance on its original terms and conditions,".

#### **1.3.22 Site Inspection:**

Tenderers are requested to inspect the site and carry out careful examination to satisfy them as to the nature of work involved and facilities available at the site. They should note carefully all the existing structures and those under construction through other agencies. They should also study the suitability of utilizing the different equipment and the machinery that they intend to use for the execution of the work. The tenderers should also select suitable sites for the purpose of locating their store yard, laboratory, staff quarters etc., and satisfy themselves with regard to the feasibility of transporting the girders, etc. from the yard to the final site of placement etc.

#### **1.3.23 No form C &D shall be issued to the contractor for this work.**

.

\*\*\*\*\*

**PART - I**  
**CHAPTER - IV**  
**GENERAL CONDITIONS OF CONTRACT**

**PART - I**  
**CHAPTER IV**

**GENERAL CONDITIONS OF CONTRACT**

**DEFINITIONS AND INTERPRETATION**

**1. (1) Definition:-** In these General conditions of Contract, the following terms shall have the meaning assigned hereunder except where the context otherwise requires:-

- (a) “Railway” shall mean the President of the Republic of India or the Administrative Officers of the Railway/DFCCIL or of the Successor Railway / DFCCIL authorized to deal with any matters which these presents are concerned on his behalf.
- (b) “General Manager of Railway ” shall mean the officer -in-charge of the General Superintendence and Control of the Railway and shall mean and include their successors, of the successor Railway;
- (c) “Chief Engineer” shall mean the officer -in-charge of the Engineering Department of Railway and shall also include Chief Engineer (Construction), Chief Signal and Telecommunication Engineer, Chief Signal and Telecommunication Engineer(Construction), Chief Electrical Engineer, Chief Electrical Engineer(Construction) and shall also include GGM/GM/CGM of DFCCIL.
- (d) “Divisional Railway Manager” shall mean the Officer in-charge of a Division of the Railway and shall also mean any officer nominated by Managing Director / DFCCIL and shall mean and include their successors of the successor Railway.
- (e) “Engineer” and Employer’s Engineer shall mean the CHIEF GENERAL MANAGER of DFCCIL / PMC appointed by DFCCIL.
- (f) “Engineer’s Representative” shall mean the Assistant Engineer, Assistant Signal and Telecommunication Engineer and Assistant Electrical Engineer, APM / PM / Dy. CPM / Add. CPM of DFCCIL in direct charge of the work and shall include any Sr. Sec. / Sec / Jr. Engineer / Executive / Sr. Executive, APM/PM / Dy CPM of DFCCIL of Civil Engineering / Signal & Telecommunication Engineering / Electrical Engineering Department appointed by the Railway / DFCCIL and shall mean and include the Engineer’s Representative of the

successor Railway / DFCCIL.

- (g) “Contractor” shall mean the person / Firm / Company / JV whether incorporated or not who enters into the contract with the DFCCIL and shall include their executors, administrators, and successors and permitted assigns.
- (h) “Contract” shall mean and include the Agreement of Work Order, the accepted schedule of rates of the Schedule or Rates of Railway / DFCCIL modified by the tender percentage for items of work quantified, or not quantified, General Conditions of Contract, Special Conditions of Contracts, if any, Drawings, Specifications, Additional / Special Specifications, if any and tender forms, if any, and all other documents included as part of contract .
- (i) “Works” shall mean the works to be executed in accordance with the contract.
- (j) “Specifications” shall mean the Specifications for materials and works referred / mentioned in tender documents.
- (k) “Schedule of rates of Railway” shall mean the schedule of rates issued under the authority of the Chief Engineer from time to time and shall also includes Rates specified in tender document. Schedule of rates of State Govt.” shall mean the schedule of rates issued under the authority of the Chief Engineer/State Govt. Gujarat from time to time and shall also includes Rates specified in tender document
- (l) “Drawing” shall mean the maps, drawings, plans and tracings or prints there of annexed to the contract and shall include any modifications of such drawings and further drawings as may be issued by the Engineer from time to time.
- (m) “Constructional Plan” shall mean all appliances or things of whatsoever nature required for the execution, completion or maintenance of the works or temporary works (as hereinafter defined) but does not include materials or other things intended to form or forming part of the permanent work.
- (n) “Temporary Works” shall mean all temporary works of every kind required for the execution completion and/or maintenance of the works.
- (o) “Site” shall mean the lands and other places on, under, in or through which the works are to be carried out and any other lands or places provided by the

Railway for the purpose of the contract.

- (p) "Period of Maintenance" shall mean the defect liability period from the date of completion of the works as certified by the Engineer.

**1.(2) Singular and Plural:-** Words importing the singular number shall also include the plural and vice versa where the context requires.

**1.(3) Headings & marginal headings:-**The headings and marginal headings in these general conditions are solely for the purpose of facilitating reference and shall not be deemed to be part thereof or be taken into consideration in the interpretation or construction thereof or the contract.

## **GENERAL OBLIGATION**

**2. (1) Execution Co-relation and intent of contract Documents :-**The contract documents shall be signed in triplicate by the DFCCIL and the Contractor. The contract documents are complementary, and what is called for by any one shall be as binding as if called for by all, the intention of the documents is to include all labour and materials, equipment and transportation necessary for the proper execution of work. Materials or work not covered by or properly inferable from any heading or class of the specifications shall not be supplied by the DFCCIL to the contractors unless distinctly specified in the contract documents. Materials or works described in words which so applied have a well-known technical or trade meaning shall be held to refer to such recognized standards.

**2.(2)** If a work is transferred from the jurisdiction of one Railway to another Railway or to a Project Authority/ DFCCIL or vice versa while contract is in subsistence, the contract shall be binding on the Contractor and the Successor Railway/Project in the same manner & take effect all respects as if the Contractor and the Successor Railway/Project were parties there to from the inception and the corresponding officer or the Competent Authority in the Successor Railway/Project will exercise the same powers and enjoy the same authority as conferred to the Predecessor Railway/Project under the original contract/agreement entered into.

**2.(3)** If for administrative or other reasons the contract is transferred to the Successor Railway/Successor Project Authority of DFCCIL the contract shall not withstanding any things contained herein contrary there to, be binding on the Contractor and the Successor Railway /Project Authority/ DFCCIL in the same manner and take effect in all respect as if the Contractor and the Successor

Railway/ successor Project Authority of DFCCIL had been parties thereto from the date of this contract. The contract shall be Administered/Managed by GGM/GM/CGM/nominated by DFCCIL.

- 3.(1) Law governing the contract:-**The contract shall be governed by the law for the time being in force in the Republic of India.
- 3.(2) Compliance to regulations and bye-laws:-**The contractor shall conform to the provision of any statute relating to the works and regulations and by-laws of any location authority and of any water and lighting companies or undertakings, with whose system the work is proposed to be connected and shall before making any variation from the drawings or the specifications that may be necessitated by so confirming give to the Engineer notice specifying the variation proposed to be made and the reasons for making the variation and shall not carry out such variation until he has received instructions from the Engineer in respect thereof. The contractor shall be bound to give all notices required by statute, regulations or bye-laws as aforesaid and to pay all fees and taxes payable to any authority in respect thereof.
- 4. Communications to be in writing:-** All notices, communications, reference and complaints made by the DFCCIL or the Engineer or the Engineer's representative or the contractor inters concerning the work shall be in writing and no notice, communication, reference or complaint not in writing shall be recognized.
- 5. Service of Notices on Contractors:-**The contractor shall furnish to the Engineer the name designation and address of his authorized agent and all complaints, notices, communications and references shall be deemed to have been duly given to the contractor if delivered to the contractor or his authorized agent or left at or posted to the address so given and shall be deemed to have been so given in the case of posting on day on which they would have reached such address in the ordinary course of post or on the day on which they were so delivered or left. In the case of contract by partners, any change in the constitution of the firm shall be forthwith notified by the contractor to the Engineer.
- 6. Occupation and use of land: -** No land belonging to or in the possession of the Railway / DFCCIL/State govt. shall be occupied by the Contractor without the permission of the Railway / DFCCIL. The

Contractor shall not use, or allow to be used, the site for any purposes other than that of executing the works. Whenever non-Railway bodies / persons are permitted to use Railway/State Govt. premises with competent authority's approval, conservancy charges as applicable from time to time may be levied.

7. **Assignment or subletting of contract:-** The contractor shall not assign or sublet the contract or any part thereof or allow any person to become interested therein in any manner whatsoever without the special permission in writing of the DFCCIL. Any breach of this condition shall entitle the DFCCIL to rescind the contract under clause 62 of these conditions and also render the contractor liable for payment to the DFCCIL in respect of any loss or damage arising or ensuing from such cancellation. Provided always that execution of the details of the work by petty contractor under the direct and personal supervision of the Contractor or his agent shall not be deemed to be sub-letting under this clause. The permitted subletting of work by the contractor shall not establish any contractual relationship between the sub-contractor and the DFCCIL and shall not relieve the contractor of any responsibility under the contract.
8. **Assistance by the DFCCIL for the Stores to be obtained by the Contractor:-** Owing to difficulty in obtaining certain materials (including Tools & Plant) in the market, the DFCCIL may have agreed without any liability therefore to endeavour to obtain or assist the contractor in obtaining the required quantities of such materials as may be specified in the tender. In the event of delay or failure in obtaining the required quantities of the aforesaid material the contractor shall not be deemed absolved of his own responsibility and shall keep in touch with day to day positions regarding their availability and accordingly adjust progress of works including employment of labour and the DFCCIL shall not in any way be liable for the supply of materials or for the non-supply thereof for any reasons whatsoever nor for any loss or damage arising in consequence of such delay or no supply.
9. **Deleted**
10. **Carriage of materials:-** No forwarding orders shall be issued by the DFCCIL for the conveyance of contractor's materials, tools and plant by Rail which may be required for use in the works and the contractor shall pay full freight charges at public tariff rates therefore.



11. Deleted
12. **Representation on Works:-** The contractor shall, when he is not personally present on the site of the works place and keep a responsible agent at the works during working hours who shall on receiving reasonable notice, present himself to the Engineer and orders given by the Engineer or the engineer's representative to the agent shall be deemed to have the same force as if they had been given to the Contractor. Before absenting himself, the contractor shall furnish the name and address of his agent for the purpose of this clause and failure on the part of the Contractor to comply with this provision at any time will entitle the DFCCIL to rescind the contract under clause 62 of these conditions.
13. **Relics and Treasures:-** All gold, silver, oil and other minerals of any description and all precious stones, coins, treasures relics antiquities and other similar things which shall be found in or upon the site shall be the property of the DFCCIL and the Contractor shall duly preserve the same to the satisfaction of the DFCCIL and shall from time to time deliver the same to such person or persons as the DFCCIL may appoint to receive the same.
14. **Excavated material:-**The contractor shall not sell or otherwise dispose of or remove except for the purpose of this contract, the sand, stones, clay, ballast, earth, rock or other substances or materials which may be obtained from any excavation made for the purpose of the works or any building or produced upon the site at the time of delivery of the possession thereof but all the substances, materials, buildings and produce shall be the property of the DFCCIL provided that the contractor may, with the permission of the Engineer, use the same for the purpose of the works either free of cost or pay the cost of the same at such rates as may be determined by the Engineer.
15. **Indemnity by Contractors:-** The contractor shall indemnify and save harmless the Railway/DFCCIL from and against all actions, suit proceedings losses, costs, damages, charges, claims and demands of every nature and description brought or recovered against the Railways /DFCCIL by reason of any act or omission of the contractor, his agents or employees, in the execution of the works or in his guarding of the same. All sums payable by way of compensation under any of these conditions shall be considered as reasonable compensation to be applied to the actual loss or damage sustained, and whether or not any damage shall have been sustained.

- 16.(1) Security Deposit:-** The earnest money deposited by the contractor with this tender will be retained by the Railways / DFCCIL as part of security for the due and faithful fulfilment of the contract by the contractor. The balance to make up the security deposit, the rates for which are given below, may be deposited by the contractor in cash or may be recovered by percentage deduction from the contractor's "on account" bills. Provided also that in case of defaulting contractor the DFCCIL may retain any amount due for payment to the contractor on the pending "on account bills" so that the amounts so retained may not exceed 10% of the total value of the contract.
- 16.(2) Recovery of Security Deposit:-** Unless otherwise specified in the special conditions, if any, the Security Deposit / rate of recovery / mode of recovery shall be as under:-
- (a) Security Deposit for each work should be 5% of the contract value.
  - (b) The rate of recovery should be at the rate of 10% of the bill amount till the full security deposit is recovered.
  - (c) Security Deposits will be recovered only from the running bills of the contract and no other mode of collecting SD such as SD in the form of instruments like BG (except Note (ii) below); FD etc. shall be accepted towards Security Deposit. Security deposit shall be returned to the contractor after the expiry of the Defect Liability Period in all the cases other than Note (i) mentioned below and after passing the final bill based on No Claim Certificate with the approval of the Competent Authority. The Competent Authority shall normally be the authority who is competent to sign the contract. If this competent authority is of the rank lower than JA grade / CGM, DFCCIL, then JA grade officer / CGM, DFCCIL (Concerned with the work) should issue the certificate. The certificate, inter alia, should mention that the work has been completed in all respects and that all the contractual obligations have been fulfilled by the contractor and that there is no due from the contractor to Railways / DFCCIL against the contract concerned. Before releasing the SD, an unconditional and unequivocal no claim certificate from the contractor concerned should be obtained.

**Note:**

- (i) After the work is physically completed, security deposit recovered from the running bills of a contractor can be returned to him if he so desires, in lieu of FDR / irrevocable Bank Guarantee for equivalent amount to be submitted by him.
- (ii) In case of contracts of value Rs.50 crore and above, irrevocable Bank Guarantee can also be accepted as a mode of obtaining security deposit.

- 16.(3)** No interest will be payable upon the Earnest Money and Security Deposit or amounts payable to the contractor under the contract, but Government Securities deposited in terms of Sub-clause (1) of this clause will be payable with interest accrued thereon.

**16.(4) Performance Guarantee (P.G.)**

The procedure for obtaining Performance Guarantee is outlined below:

- (a) The successful bidder shall have to submit a Performance Guarantee (PG) within 30 (thirty) days from the date of issue of Letter of Acceptance (LOA). Extension of time for submission of PG beyond 30 (thirty) days and upto 60 days from the date of issue of LOA may be given by the Authority who is competent to sign the contract agreement. However, a penal interest of 15% per annum shall be charged for the delay beyond 30 (thirty) days, i.e. from 31<sup>st</sup> day after the date of issue of LOA. In case the contractor fails to submit the requisite PG even after 60 days from the date of issue of LOA, the contract shall be terminated duly forfeiting EMD and other dues, if any payable against that contract. The failed contractor shall be debarred from participating in re-tender for that work.
- (b) The successful bidder shall submit the performance Guarantee in any of the following forms amounting to 5% of the contract value:-
- (i) a deposit of Cash
  - (ii) irrevocable Bank Guarantee
  - (iii) Government Securities including State Loan Bonds at 5 percent below the market value
  - (iv) Deposit receipts, pay orders, Demand Drafts and Guarantee Bonds. These forms of Performance Guarantee could be either of the State Bank of India or of any of the Nationalized Banks;
  - (v) Guarantee Bonds executed or Deposits Receipts tendered by all Scheduled Banks;
  - (vi) A Deposit in the Post Office Saving Bank;
  - (vii) A deposit in the National Savings Certificates.
  - (viii) Twelve years National Defence Certificates;
  - (ix) Ten years Defence Deposits;
  - (x) National Defence Bonds; and
  - (xi) Unit Trust Certificates at 5 per cent below market value or at the face value whichever is less.

**Note:** The instruments as listed above will also be acceptable for Guarantees in case of Mobilization advance.

- (c) The performance Guarantee shall be submitted by the successful bidder after the letter of acceptance has been issued, but before signing of the contract agreement. The agreement should normally be signed within 30 (thirty) days after the issue of LOA and the Performance Guarantee shall also be submitted within this time limit. This P. G. shall be initially valid up to the stipulated date of completion plus 60 days beyond that. In case, the time limit for completion of work gets extended, the contractor shall get the validity of Performance Guarantee extended to cover such extended time for completion of work plus 60 days.
- (d) The value of PG to be submitted by the contractor will not change for variation upto 25 % (either increase or decrease). In case during the course of execution, value of the contract increases by more than 25 % of the original contract value, an additional performance guarantee amounting to 5 % (five percent) for the excess value over the original contract value shall be deposited by the contractor.
- (e) The performance Guarantee (PG) shall be released after the physical completion of the work based on the 'completion certificate' issued by the competent authority stating that the contractor has completed the work in all respects satisfactorily. The security deposit shall, however, be released only after the expiry of the defect liability period and after passing the final bill based on 'No Claim Certificate' from the contractor.
- (f) Whenever the contract is rescinded, the security deposit shall be forfeited and the Performance Guarantee shall be encashed. The balance work shall be got done independently without risk and cost of the failed contractor, the failed contractor shall be debarred from participating in the tender for executing the balance work. If the failed contractor is a JV or a partnership firm, then every member / partner of such a firm shall be debarred from participating in the tender for the balance work in his / her individual capacity or as a partner of any other JV / partnership firm.
- (g) The Engineer shall not make a claim under the Performance Guarantee except for amounts to which the President of India / DFCCIL is entitled under the contract (no withstanding and/or without prejudice to any other provisions in the contract agreement) in the event of:

- (i) Failure by the contractor to extend the validity of the Performance Guarantee as described herein above, in which event the Engineer may claim the full amount of the Performance Guarantee.
- (ii) Failure by the contractor to pay President of India / DFCCIL any amount due, either as agreed by the contractor or determined under any of the Clauses/conditions of the agreement, within 60 days of the service of the notice to the effect by Engineer.
- (iii) The contract being determined or rescinded under provision of the GCC the Performance Guarantee shall be forfeited in full and shall be absolutely at the disposal of the President of India.

**17. Force Majeure Clause:-** If at any time, during the continuance of this contract, the Performance in whole or in part by either party of any obligation under this contract shall be prevented or delayed by reason of any war, hostility, acts of public enemy, civil commotion, sabotage, serious loss or damage by fire, explosions, epidemics, strikes, lockouts or act of God (hereinafter, referred to events) provided, notice of the happening of any such event is given by either party to the other within 30 days from the date of occurrence thereof, neither party shall by reason of such event, be entitled to terminate this contract nor shall either party have any claim for damages against the other in respect of such non- performance of delay in performance, and works under the contract shall be resumed as soon as practicable after such event has come to an end or ceased to exist, and the decision of the Engineer as to whether the works have been so resumed or not shall be final and conclusive, PROVIDED FURTHER that if the performance in whole or in part of any obligation under this contract is prevented or delayed by reason of any such event for a period exceeding 120 days, either party may at its option terminate the contract by giving notice to the other party.

**17-A Extension of time in Contracts:-** Subject to any requirement in the contract as to completion of any portion or portions of the works before completion of the whole, the contractor shall fully and finally complete the whole of the works comprised in the contract (with such modifications as may be directed under conditions of this contract) by the date entered in the contract or extended date in terms of the following clauses:-

- (i) **Extension due to modification:-** If any modifications have been ordered which in the opinion of the Engineer have materially increased the magnitude of the work, then such extension of the contracted date of completion may be granted as shall appear to the Engineer to be reasonable in the circumstances, provided moreover that the Contractor shall be responsible for requesting such extension of the date as may be considered necessary as soon as the cause thereof shall arise and in any case not less than one month before the expiry of the date fixed for completion of the works.
  
- (ii) **Extension for delay not due to DFCCIL or Contractor:-** If in the opinion of the Engineer the progress of work has any time been delayed by any act or neglect of DFCCIL's employees or by other contractor employed by the DFCCIL under sub-clause (4) of clause 20 of these conditions or in executing the work not forming part of the contract but on which contractor's performance necessarily depends or by reasons of proceeding taken or threatened by or dispute with adjoining or to neighbouring owners or public authority arising otherwise through the Contractor's own default etc. or by the delay authorized by the Engineer pending arbitration or in consequences of the contractor not having received in due time necessary instructions from the DFCCIL for which he shall have specially applied in writing to the Engineer or his authorized representative then upon happening of any such event causing delay, the contractor shall immediately give notice thereof in writing to the Engineer within 15 days of such happening but shall nevertheless make constantly his best endeavours to bring down or make good the delay and shall do all that may be reasonably required of him to the satisfaction of the Engineer to proceed with the works. The contractor may also indicate the period for which the work is likely to be delayed and shall be bound to ask for necessary extension of time. The Engineer on receipt of such request from the contractor shall consider the same and shall grant such extension of time as in his opinion is reasonable having regard to the nature and period of delay and the type and quantum of work affected thereby.

No other compensation shall be payable for works so carried forward to the extended period of time, the same rates, terms and conditions of contract being applicable as if such extended period of time was originally provided in the original contract itself.

- (iii) **Extension for delay due to DFCCIL:-** In the event of any failure or delay by the DFCCIL to hand over the Contractor possession of the lands necessary for the execution of the works or to give the necessary notice to commence the

works or to provide the necessary drawings or instructions or any other delay caused by the DFCCIL due to any other cause whatsoever, then such failure or delay shall in no way affect or vitiate the contract or alter the character thereof or entitle the contractor to damages or compensation therefore, but in any such case, the DFCCIL may grant such extension or extensions of the completion date as may be considered reasonable.

**17-B Extension of time for delay due to contractor:-** The time for the execution of the work or part of the works specified in the contract documents shall be deemed to be the essence of the contract and the works must be completed not later than the date(s) as specified in the contract. If the contractor fails to complete the works within the time as specified in the contract for the reasons other than the reasons specified in clause 17 and 17-A, the DFCCIL may, if satisfied that the works can be completed by the contractor within reasonable short time thereafter, allow the contractor for further extension of (Performa at Form No. 14) time as the Engineer may decide. On such extension the DFCCIL will be entitled without prejudice to any other right and remedy available on that behalf, to recover from the contractor as agreed damages and not by way of penalty a sum equivalent to  $\frac{1}{2}$  of 1% of the contract value of the works for each week or part of the week.

For the purpose of this clause, the contract value of the works shall be taken as value of work as per contract agreement including any supplementary work order/contract agreement issued. Provided also, that the total amount of liquidated damages under this condition, shall not exceed the under noted percentage value or of the total value of the item or groups of items of work for which a separate distinct completion period is specified in the contract.

- (i) For contract value up to Rs. 2 lakhs - 10% of the total value of the contract
- (ii) For contracts valued above Rs. 2 lakhs- 10% of the first Rs.2 lakhs and 5% of the balance

Further competent authority while granting extension to the currency of contract under clause 17.(B) of GCC may also consider levy of token penalty as deemed fit based on the merit of the case. Provided further, that if the DFCCIL is not satisfied that the works can be completed by the Contractor and in the event of failure on the part of the contractor to complete the work within further extension of time allowed as aforesaid, the DFCCIL shall be entitled without prejudice to any other right or remedy available in that behalf, to appropriate the contractor's security deposit and rescind the contract under clause 62 of these conditions, whether or not actual damage is caused by such default.

- 18.(1) Illegal Gratification:-** Any bribe, commission, gift or advantage given, promised or offered by or on behalf to the contractor or his partner, agent or servant or, anyone on his behalf, to any officer or employee of the DFCCIL, or to any person on his behalf in relation to obtaining or execution of this or any other contract with the DFCCIL shall, in addition to any criminal liability which he may incur, subject contractor to the rescission of the contract and all other contracts with the DFCCIL and to the payment of any loss or damage resulting from such decision and the DFCCIL shall be entitled to deduct the amounts so payable from any moneys due to the Contractor(s) under this contract or any other contracts with the DFCCIL.
- 18.(2)** The contractor shall not lend or borrow from or have or enter into any monetary dealings and transactions either directly or indirectly with any employee of the DFCCIL and if he shall do so, the DFCCIL shall be entitled forthwith to rescind the contract and all other contracts with the DFCCIL. Any question or dispute as to the commission or any such offence or compensation payable to the DFCCIL under this clause shall be settled by the General Manager/ROB /CGM of the DFCCIL, in such a manner as he shall consider fit and sufficient and his decision shall be final and conclusive. In the event of rescission of the contract under this clause, the contractor will not be paid any compensation whatsoever except payments for the work done up to the date of rescission.

### **EXECUTION OF WORKS**

- 19.(1) Contractor's understanding:-** It is understood and agreed that the contractor has, by careful examination, satisfied himself as to the nature and location of the work, the conformation of the ground, the character, quality and quantity of the materials to be encountered, the character of equipment and facilities needed preliminary to and during the progress of the works, the general and local conditions, the labour conditions prevailing therein and all other matters which can in any way affect the works under the contract.
- 19.(2) Commencement of works:-**The contractor shall commence the works within 15 days after the receipt by him of an order in writing to this effect from the Engineer and shall proceed with the same with due expedition and without delay.



- 19.(3) Accepted Programme of work:-** The contractor who has been awarded the work shall as soon as possible but not later than 30 days after the date of receipt of the acceptance letter in respect of contracts with initial completion period of two years or less or not later than 90 days for other contracts have to submit the detailed programme of work indicating the time schedule of various items of works in the form of Bar Chart/PERT/CPM. He shall also submit details of organization (in terms of labour and supervisors) plant and machinery, that he intends to utilize (from time to time) for execution of the work within stipulated date of completion. The programme of work amended as necessary by discussions with the Engineer, shall be treated as the agreed programme of the work for the purpose of this contract and the contractor shall endeavour to fulfill this programme of work. The progress of work will be watched accordingly and the liquidated damages will be with reference to the overall completion date. Nothing stated herein shall preclude the contractor in achieving earlier completion of item or whole of the works than indicated in the programme.
- 19.(4) Setting out of works:-** The contractor shall be responsible for the correct setting out of all works in relation to original points, lines and levels of reference at his cost. The contractor shall execute the work true to alignment, grade, levels and dimensions as shown in the drawing and as directed by the Engineer's representative and shall check these at frequent intervals. The contractor shall provide all facilities like labour and instruments and shall co-operate with the Engineer's representative to check all alignment, grades, levels and dimensions. If, at any time, during the progress of the works any error shall appear or arise in any part of the work, the contractor, on being required so to do by the Engineer's representative shall, at his own cost rectify such errors, to the satisfaction of the Engineer's representative. Such checking shall not absolve the contractor of his own responsibility of maintaining accuracy in the work. The contractor shall carefully protect and preserve all bench marks, sight rails, pegs and other things used in setting out the work.
- 20.(1) Compliance to Engineer's instructions:-** The Engineer shall direct the order in which the several parts of the works shall be executed and the contractor shall execute without delay all orders given by the Engineer from time to time but the contractor shall not be relieved thereby from responsibility for the due performance of the works in all respects.
- 20.(2) Alterations to be authorized:-** No alterations in or additions to or omissions or abandonment of any part of the works shall be deemed authorized, except

under instructions from the Engineer, and the contractor shall be responsible to obtain such instructions in each and every case in writing from the Engineer.

- 20.(3) Extra works:-** Should works over and above those included in the contract require to be executed at the site, the contractor shall have no right to be entrusted with the execution of such works which may be carried out by another contractor or contractors or by other means at the option of the DFCCIL.
- 20.(4) Separate contracts in connection with works:-** The DFCCIL shall have the right to let other contracts in connection with the works. The contractor shall afford other contractors reasonable opportunity for the storage of their materials and the execution of their works and shall properly connect and coordinate his work with theirs. If any part of the contractors work depends for proper execution or result upon the work of another contractor(s), the contractor shall inspect and promptly report to the Engineer any defects in such works that render it unsuitable for such proper execution and results. The contractor's failure so-to inspect and report shall constitute an acceptance of the other contractor's work as fit and proper for the reception of his work, except as to defects which may develop in the other contractor's work after the execution of his work.
- 21. Instruction of Engineer's Representative:-** Any instructions or approval given by the Engineer's representative to contractor in connection with the works shall bind the contractor as though it had been given by the Engineer provided always as follows:
- (a) Failure of the Engineer's representative to disapprove any work or materials shall not prejudice, the power of the Engineer thereafter to disapprove such work or material and to order the removal or breaking up thereof.
  - (b) If the Contractor shall be dissatisfied by reason of any decision of the Engineer's representative, he shall be entitled to refer the matter to the Engineer who shall there upon confirm or vary such decision.
- 22.(1) Adherence to specifications and drawings:-** The whole of the works shall be executed in perfect conformity with the specifications and drawings of the contract. If contractor performs any works in a manner contrary to the specifications or drawings or any of them and without such reference to the Engineer he shall bear all the costs arising or ensuing therefore and shall be responsible for all loss to the DFCCIL.

- 22.(2) Drawings and specifications of the works:-** The contractor shall keep one copy of drawings and specifications at the site, in good order, and such contract documents as may be necessary available to the Engineer or the Engineer's representative.
- 22.(3) Ownership of drawings and specifications:-** All drawings and specifications and copies thereof furnished by the DFCCIL to the Contractor are deemed to be the property of the DFCCIL. They shall not be used on other works and with the exception of the signed contract set, shall be returned by the contractor to the DFCCIL on completion of the work or termination of the contract.
- 22.(4) Compliance with Contractor's request for details:-** The Engineer shall furnish with reasonable promptness, after receipt by him of the contractor's request for the same, additional instructions by means of drawings or otherwise, necessary for the proper execution of the works or any part thereof. All such drawing and instructions shall be consistent with the contract Documents and reasonably inferable there from.
- 22.(5) Meaning and intent of specification and drawings:-** If any ambiguity arises as to the meaning and intent of any portion of the specifications and drawings or as to execution or quality of any work or material, or as to the measurements of the works the decision of the Engineer thereon shall be final subject to the appeal (within 7 days of such decision being intimated to the contractor) to the Chief Engineer/ General Manager/ROB,/CGM who shall have the power to correct any errors, omissions, or discrepancies in aforementioned items and whose decision in the matter in dispute or doubt shall be final and conclusive.
- 23 Working during night:-** The contractor shall not carry out any work between sun-set and sun-rise without the previous permission of the Engineer.
- 24. Damage to Railway / DFCCIL property or private life and property:-**The contractor shall be responsible for all risk to the work and for trespass and shall make good at his own expense all loss or damage whether to the works themselves or to any other property of the Railway or the lives, persons or property of others from whatsoever cause in connection with the works until they are taken over by the Railway / DFCCIL and this although all reasonable and

proper precautions may have been taken by the contractor, and in case the Railway / DFCCIL shall be called upon to make good any costs, loss or damages, or to pay an compensation, including that payable under the provisions of the Workmen's Compensation Act or any statutory amendments thereof to any person or persons sustaining damages as aforesaid by reason of any act, or any negligence or omissions on the part of the contractor the amount of any costs or charges including costs and charges in connection with legal proceedings, which the Railway / DFCCIL may incur in reference thereto, shall be charged to the contractor. The Railway / DFCCIL shall have the power and right to pay or to defend or compromise any claim of threatened legal proceedings or in anticipation of legal proceedings being instituted consequent on the action or default of the contractor, to take such steps as may be considered necessary or desirable to ward off or mitigate the effect of such proceedings, charging to contractor, as aforesaid any sum or sums of money which may be paid and any expenses whether for reinstatement or otherwise which may be incurred and the propriety of any such payment, defence or compromise, and the incurring of any such expenses shall not be called in question by the contractor.

**25. Sheds, stores houses and Yards:-**The contractor shall at his own expense provide himself with sheds, stores houses and yards in such situations and in such numbers as in the opinion of the Engineer is requisite for carrying on the works and the contractor shall keep at each such sheds, stores houses and yard a sufficient quantity of materials and plant in stock as not to delay the carrying out of the works with due expedition and the Engineer and the Engineer's representative shall have free access to the said sheds, store houses and yards at any time for the purpose of inspecting the stock of materials or plant so kept in hand, and any materials or plan which the Engineer may object to shall not be brought upon or used in the works, but shall be forthwith removed from the sheds, store houses or yards by the contractor. The contractor shall at his own expenses provide and maintain suitable mortar mills, soaking vats or any other equipment's necessary for the execution of the works.

**26. Provision of efficient and competent Staff at work sites by the Contractor:-**

**26.1** The contractor shall place and keep on the works at all times efficient and competent staff to give the necessary directions to his workmen and to see that they execute their work in sound and proper manner and shall employ only such supervisors, workmen and labourers in or about the

execution of any of these works as are careful and skilled in the various trades.

**26.2** The contractor shall at once remove from the works any agents, permitted sub-contractor, supervisor, workman or labourer who shall be objected to by the Engineer and if and whenever required by the Engineer, he shall submit a correct return showing the names of all staff and workmen employed by him.

**26.3** In the event of the Engineer being of the opinion that the contractor is not employing on the works a sufficient number of staff and workmen as is necessary for the proper completion of the works within the time prescribed, the contractor shall forthwith on receiving intimation to this effect deploy the additional number of staff and labour specified by the Engineer within seven days of being so required and failure on the part of the contractor to comply with such instructions will entitle the DFCCIL to rescind the contract under clause 62 of these conditions.

**26A. Deployment of Qualified Engineers at Work Sites by the Contractor :-**

**26A.1** The contractor shall also employ Qualified Graduate Engineer or Qualified Diploma Holder Engineer, based on value of contract, as may be prescribed by the Ministry of Railways through separate instructions from time to time.

**26A.2** In case the contractor fails to employ the Engineer, as aforesaid in Para 26A.1, he shall be liable to pay penalty at the rates, as may be prescribed by the Ministry of Railways through separate instructions from time to time for the default period for the provisions, as contained in Para 26A.1.

**26A.3 Deleted**

**27.(1) Workmanship and testing:-** The whole of the works and / or supply of materials specified and provided in the contract or that may be necessary to be done in order to form and complete any part thereof shall be executed in the best and most substantial workman like manner with materials of the best and most approved quality of their respective kinds, agreeable to the particulars contained in or implied by the specifications and as referred to in and represented by the drawings or in such other additional particulars, instructions and drawings may be found requisite to be given during the carrying on of the works and to the entire satisfaction of the Engineer according to the instructions and directions which the contractors may from time to time receive from the Engineer. The materials may be subjected to tests by means of such machines, instruments

and appliances as the Engineer may direct and wholly at the expense of the contractor.

**27.(2) Removal of improper work and materials:-** The Engineer or the Engineer's Representative shall be entitled to order from time to time:

- (a) The removal from the site within the time specified in the order of any materials which in his opinion are not in accordance with the specifications or drawings.
- (b) the substitution of proper and suitable materials, and
- (c) the removal and proper re-execution, notwithstanding any previous tests thereof or on account payments therefore, of any work which in respect of materials or workmanship; is not in his opinion in accordance with the specifications and in case of default on the part of the contractor in carrying out such order the DFCCIL shall be entitled to rescind the contract under clause 62 of these conditions.

**28. Facilities for inspection:-** The contractor shall afford the Engineer and the Engineer's Representative every facility for entering in and upon every portion of the work at all hours for the purpose of inspection or otherwise and shall provide all labour, materials, planks, ladders, pumps, appliances and things of every kind required for the purpose and the Engineer and the Engineer's Representative shall at all times have free access to every part of the works and to all places at which materials for the works are stored or being prepared.

**29. Examination of work before covering up:-** The contractor shall give 7 days' notice to the Engineer or the Engineer's representative whenever any work or materials are intended to be covered up in the earth, in bodies or walls or otherwise to be placed beyond the reach of measurements in order that the work may be inspected or that correct dimensions may be taken before being so covered, placed beyond the reach of measurement in default whereof, the same shall at the option of the Engineer or the Engineer's representative be uncovered and measured at the contractor's expense or no allowance shall be made for such work or materials.

**30. Temporary Works:-** All temporary works necessary for the proper execution of the works shall be provided and maintained by the contractor and subject to the consent of the Engineer shall be removed by him at his expenses when they are

no longer required and in such manner as the Engineer shall direct. In the event of failure on the part of the contractor to remove the temporary works, the Engineer will cause them to be removed and cost as increased by supervision and other incidental charges shall be recovered from the contractor. If temporary huts are provided by the contractor on the Railway / DFCCIL land for labour engaged by him for the execution of works, the contractor shall arrange for handing over vacant possession of the said land after the work is completed; if the contractor's labour refuse to vacate, and have to be rejected by the Railway / DFCCIL necessary expenses incurred by the Railway / DFCCIL in connection therewith shall be borne by the contractor.

**31.(1) Contractor to supply water for works:-** Unless otherwise provided in the contract, the contractor shall be responsible for the arrangements to obtain supply of water necessary for the works.

**31.(2) Deleted**

**31.(3) Deleted**

**31.(4)(a) Contractor to arrange supply of Electric power for works:-** Unless otherwise provided in the contract, the contractor shall be responsible for arrangements to obtain supply of electric power for the works.

**31.(4)(b) Deleted**

**32. Property in materials and plant:-** The materials and plant brought by the Contractor upon the site or on the land occupied by the Contractor in connection with the works and intended to be used for the execution thereof shall immediately, they are brought upon the site of the said land, be deemed to be the property of the Railway / DFCCIL. Such of them as during the progress of the works are rejected by the Engineer under Clause 25 of these conditions or are declared by him not to be needed for the execution of the works or such as on the grant of the certificate of completion remain unused shall immediately on such rejection, declaration or grant cease to be deemed the property of the Railway / DFCCIL and the Contractor may then (but not before) remove them from the site or the said land. This clause shall not in any way diminish the liability of the Contractor nor shall the Railway / DFCCIL be in any way answerable for any loss or damage which may happen to or in respect of any such materials or plant either by the same being lost, stolen, injured or destroyed by fire, tempest or otherwise.

- 33.(1) Tools, Plant and Materials Supplied by DFCCIL:-** The Contractor shall take all reasonable care of all tools, plant and materials or other property whether or a like description or not belonging to the DFCCIL and committed to his charge for the purpose of the works and shall be responsible for all damage or loss caused by him, his agents, permitted subcontractor, or his workmen or others while they are in his charge. The Contractors shall sign accountable receipts for tools, plants and materials made over to him by the engineer and on completion of the works shall hand over the unused balance of the same to the Engineer in good order and repair, fair wear and tear excepted, and shall be responsible for any failure to account for the same or any damage done thereto.
- 33.(2) Hire of DFCCIL / Railway's Plant:-** The DFCCIL may hire to the Contractor such plant as concrete mixers, compressors and portable engines for use during execution of the works on such terms as may be specified in the special conditions or in a separate agreement for Hire of Plant.
- 34.(1) Precaution during progress of works:-** During the execution of works, unless otherwise specified, the Contractor shall at his own cost provide the materials for and execute all shoring, timbering and strutting works as is necessary for the stability and safety of all structures, excavations and works and shall ensure that no damage, injury or loss is caused or likely to be caused to any person or property.
- 34.(2) Roads and Water courses:-** Existing roads or water courses shall not be blocked, cut through, altered, diverted or obstructed in any way by the Contractor, except with the permission of the Engineer. All compensations claimed for any unauthorized closure, cutting through, alterations, diversion or obstruction to such roads or water courses by the Contractor or his agent or his staff shall be recoverable from the Contractor by deduction from any sums which may become due to him in terms of contract, or otherwise according to law.
- 34.(3) Provision of access to premises:-** During progress of work in any street or thoroughfare, the Contractor shall make adequate provision for the passage of traffic, for securing safe access to all premises approached from such street or thoroughfare and for any drainage, water supply or means of lighting which may be interrupted by reasons of the execution of the works and shall react and maintain at his own cost barriers, lights and other safeguards as prescribed by the Engineer, for the regulation of the traffic, and provide watchmen necessary to prevent accidents. The works shall in such cases be



executed night and day if so ordered by the Engineer and with such vigour so that the traffic way be impeded for as short a time as possible.

**34.(4) Safety of Public:-** The Contractor shall be responsible to take all precautions to ensure the safety of the public whether on public or DFCCIL/Railway property and shall post such look out men as may in the opinion of the Engineer be required to comply with regulations pertaining to the work.

**35. Deleted.**

**36.(1) Suspension of works:-** The Contractor shall on the order of the Engineer, suspend the progress of the works or any part thereof for such time or times and in such manner as the Engineer may consider necessary and shall during such suspension properly protect and secure the work so far as is necessary in the opinion of the Engineer. If such suspension is:-

- (a) Provided for in the contract, or
- (b) Necessary for the proper execution of the works or by the reason of weather conditions or by some default on the part of the Contractor, and/or
- (c) Necessary for the safety of the works or any part thereof.

**36.(2)** The Contractor shall not be entitled to the extra costs, if any, incurred by him during the period of suspension of the works, but in the event of any suspension ordered by the Engineer for reasons other than aforementioned and when each such period of suspensions exceeds 14 days, the contractor shall be entitled to such extension of time for completion of the work as the Engineers may consider proper having regard to the period or periods of such suspensions and to such compensations as the Engineer may consider reasonable in respect of salaries or wages paid by the Contractor to his employees during the periods of such suspension.

**36.(3) Suspension lasting more than 3 months:-** If the progress of the works or any part thereof is suspended on the order of the Engineer for more than three months at a time, the Contractor may serve a written notice on the Engineer requiring permission within 15 days from the receipt thereof to proceed with the works or that part thereof in regard to which progress is suspended and if such permission is not granted within that time the Contractor by further written notice so served may, but is not bound to, elect to treat the suspension where it affects part only of the works as an omission of such part or where it affects the

whole of the works, as an abandonment of the contract by the DFCCIL.

**37. Rates for items of works:-** The rates, entered in the accepted Schedule of Rates of the Contract are intended to provide for works duly and properly completed in accordance with the general and special (if any) conditions of the contract and the specifications and drawings together with such enlargements, extensions, diminutions, reductions, alterations or additions as may be ordered in terms of Clause 42 of these conditions and without prejudice to the generality thereof and shall be deemed to include and cover superintendence and labour, supply, including full freight, of materials, stores, patterns, profiles, moulds, fittings, centring, scaffolding, shoring props, timber, machinery, barracks, tackle, roads, pegs, posts, tools and all apparatus and plant required on the works, except such tools, plant or materials as may be specified in the contract to be supplied to the Contractor by the DFCCIL, the erection, maintenance and removal of all temporary works and, buildings, all watching, lighting, bailing, pumping and draining, all prevention of or compensation for trespass, all barriers and arrangements for the safety of the public or of employees during the execution of works, all sanitary and medical arrangements for labour camps as may be prescribed by the DFCCIL, the setting of all work and of the construction, repair and upkeep of all centre lines, bench marks and level pegs thereon, site clearance, all fees duties, royalties, rent and compensation to owners for surface damage or taxes and impositions payable to local authorities in respect of land, structures and all material supplied for the work or other duties or expenses for which the Contractor may become liable or may be put to under any provision of law for the purpose of or in connection with the execution of the contract, and all such other incidental charges or contingencies as may have been specially provided for in the specifications.

**38. Deleted**

**39.(1) Rates for extra items of works:-** Any type of work carried out by the Contractor on the instructions of the Engineer which is not included in the accepted schedules of rates shall be executed at the rates set forth in the "Schedule of Rates of Railway" modified by the tender percentage and such items are not contained in the latter, at the rate agreed upon between the Engineer and the Contractor before the execution of such items of work and the Contractors shall be bound to notify the Engineer at least seven days before the necessity arises for the execution of such items of works that the accepted schedule of rates does not include rate or rates for the extra work involved. The rates

payable for such items shall be decided at the meeting to be held between the Engineer and Contractor, in as short a period as possible after the need for the special item has come to the notice. In case the Contractor fails to attend the meeting after being notified to do so or in the event of no settlement being arrived at, the DFCCIL shall be entitled to execute the extra works by other means and the Contractor shall have no claim for loss or damage that may result from such procedure.

- 39.(2)** Provided that if the Contractor commences work or incurs any expenditure in regard thereto before the rates as determined and agreed upon as lastly hereunto fore-mentioned, then and in such a case the Contractor shall only be entitled to be paid in respect of the work carried out or expenditure incurred by him prior to the date of determination of rates as aforesaid according to the rates as shall be fixed by the Engineer. However if the Contractor is not satisfied with the decision of the Engineer in this respect he may appeal to the CGM/General Manager/ROB within 30 days of getting the decision of the Engineer, supported by analysis of the rates claimed. The CGM's/ General Manager's decision after hearing both the parties in the matter would be final and binding on the Contractor and the DFCCIL.
- 40.(1) Handing over of works:-** The Contractor shall be bound to hand over the works executed under the contract to the DFCCIL complete in all respects to the satisfaction of the Engineer. The Engineer shall determine the date on which the work is considered to have been completed, in support of which his certificate shall be regarded as sufficient evidence for all purposes. The Engineer shall determine from time to time, the date on which any particular section of the work shall have been completed, and the contractor shall be bound to observe any such determination of the Engineer.
- 40.(2) Clearance of site on completion:-** On completion of works, the Contractor shall clear away and remove from the site all constructional plant, surplus materials, rubbish and temporary works of every kind and leave the whole of the site and works clean and in a workman like condition to the satisfaction of the Engineer. No final payment in settlement of the accounts for the works shall be paid, held to be due or shall be made to the, Contractor till, in addition to any other condition necessary for final payment, site clearance shall have been affected by him, and such clearance may be made by the Engineer at the expense of the Contractor in the event of his failure to comply with this provision within 7 days after receiving notice to that effect. Should it become necessary for the Engineer to have the site cleared at the expenses of

the Contractor, the DFCCIL shall not be held liable for any loss or damage to such of the Contractor's property as may be on the site and due to such removal there from which removal may be effected by means of public sales of such materials and property or in such a way as deemed fit and convenient to the Engineer.

## **VARIATIONS IN EXTENT OF CONTRACT**

- 41. Modification to contract to be in writing:** - In the event of any of the provisions of the contract requiring to be modified after the contract documents have been signed, the modifications shall be made in writing and signed by the DFCCIL and the Contractor and no work shall proceed under such modifications until this has been done. Any verbal or written arrangement abandoning, modifying, extending, reducing or supplementing the contract or any of the terms thereof shall be deemed conditional and shall not be binding on the DFCCIL unless and until the same is incorporated in a formal instrument and signed by the DFCCIL and the Contractor, and till then the DFCCIL shall have the right to repudiate such arrangements.
- 42.(1) Powers of modification to contract:-** The Engineer on behalf of the DFCCIL shall be entitled by order in writing to enlarge or extend, diminish or reduce the works or make any alterations in their design, character position, site, quantities, dimensions or in the method of their execution or in the combination and use of materials for the execution thereof or to order any additional work to be done or any works not to be done and the contractor will not be entitled, to any compensation for any increase/reduction in the quantities of work but will be paid only for the actual amount of work done and for approved materials supplied against a specific order.
- 42.(2)** (i) Unless otherwise specified in the contract, the accepted variation in quantity of each individual item of the contract would be up to 25% of the quantity originally contracted, except in case of foundation work. The contractor shall be bound to carry out the work at the agreed rates and shall not be entitled to any claim or any compensation whatsoever up to the limit of 25% variation in quantity of individual item of works.
- (ii) In case of earthwork, the variation limit of 25% shall apply to the gross quantity of earth work and variation in the quantities of individual classifications of soil shall not be subject to this limit.

- (ii) In case of foundation work, no variation limit shall apply and the work shall be carried out by the contractor on agreed rates irrespective of any variation.

**42.(3) Valuation of variations:-** The enlargements, extensions, diminution, reduction, alterations or additions referred to in sub-clause (2) of this clause shall in no degree affect the validity of the contract but shall be performed by the Contractor as provided therein and be subject to the same conditions, stipulations and obligations as if they had been originally and expressly included and provided for in the specifications and drawings and the amounts to be paid therefore shall be calculated in accordance with the accepted schedule of rates. Any extra items / quantities of work falling outside the purview of the provisions of sub-clause (2) above shall be paid for at the rates determined under clause-39 of these conditions.

**42.(4) Variations In Quantities During Execution Of Works Contracts:-** The procedure detailed below shall be adopted for dealing with variations in quantities during execution of works contracts:

1. Individual NS items in contracts shall be operated with variation of plus or minus 25% and payment would be made as per the agreed rate.
2. In case an increase in quantity of an individual item by more than 25% of the agreed quantity is considered unavoidable, the same shall be got executed by floating a fresh tender. If floating a fresh tender for operating that item is considered not practicable, quantity of that item may be operated in excess of 125% of the agreed quantity subject to the following conditions:
  - (a) Operation of an item by more than 125% of the agreed quantity needs the approval of DFCCIL;
    - (i) Quantities operated in excess of 125% but up to 140% of the agreed quantity of the concerned item, shall be paid at 98% of the rate awarded for that item in that particular tender;
    - (ii) Quantities operated in excess of 140% but up to 150% of the agreed quantity of the concerned item shall be paid at 96% of the rate awarded for that item in that particular tender;
    - (iii) Variation in quantities of individual items beyond 150% will be prohibited and would be permitted only in exceptional unavoidable

circumstances with the concurrence of associate finance and shall be paid at 96% of the rate awarded for that item in that particular tender.

- (b) The variation in quantities as per the above formula will apply only to the Individual items of the contract and not on the overall contract value.
  - (c) **Execution of quantities beyond 150% of the overall agreemental value should not be permitted and, if found necessary, should be only through fresh tenders or by negotiating with existing contractor, with approval of DFCCIL .**
- 3. In cases where decrease is involved during execution of contract:
  - (a) The contract signing authority can decrease the items upto 25% of individual item.
  - (b) For decrease beyond 25% for individual items or 25% of contract agreement value, the approval of competent authority, after obtaining 'No Claim Certificate' from the contractor and with finance concurrence, giving detailed reasons for each such decrease in the quantities.
  - (c) It should be certified that the work proposed to be reduced will not be required in the same work.
- 4. The limit for varying quantities for minor value items shall be 100% (as against 25% prescribed for other items). A minor value item for this purpose is defined as an item whose original agreement value is less than 1 % of the total original agreement value.
- 5. **No such quantity variation limit shall apply for foundation items.**
- 6. As far as SOR items are concerned, the limit of 25% would apply to the value of SOR schedule as a whole and not on individual SOR items. However, in case of NS items, the limit of 25% would apply on the individual items irrespective of the manner of quoting the rate (single percentage rate or individual item rate).
- 7. - Deleted -

8. - Deleted -

9. - Deleted -

10. The aspect of vitiation of tender with respect to variation in quantities should be checked and avoided. In case of vitiation of the tender (both for increase as well as decrease of value of contract agreement), sanction of the competent authority as per schedule of power of DFCCIL as per single tender should be obtained.

**Note:** Variation to be approved should be limited so as not to completely change the scope, character and purpose of the original contract.

### **CLAIMS**

**43.(1) Monthly Statement of Claims:-** The Contractor shall prepare and furnish to the Engineer once in every month an account giving full and detailed particulars of all claims for any additional expenses to which the Contractor may consider himself entitled to and of all extra or additional works ordered by the Engineer which he has executed during the preceding month and no claim for payment for and such work will be considered which has not been included in such particulars.

**43.(2) Signing of “No Claim” Certificate:-** The Contractor shall not be entitled to make any claim whatsoever against the DFCCIL under or by virtue of or arising out of this contract, nor shall the DFCCIL entertain or consider any such claim, if made by the Contractor, after he shall have signed a “No Claim” Certificate in favour of the DFCCIL in such form as shall be required by the DFCCIL after the works are finally measured up. The contractor shall be debarred from disputing the correctness of the items covered by “No Claim” Certificate or demanding a clearance to arbitration in respect thereof.

### **MEASUREMENTS, CERTIFICATES AND PAYMENTS**

**44. Quantities in schedule annexed to Contract:-** The quantities set out in the accepted schedule of rates with items of works quantified are the estimated quantities of the works and they shall not be taken as the actual and correct quantities of the work to be executed by the Contractor in fulfilment of his obligations under the contract.

**45. Measurement of works:-** The Contractor shall be paid for the works at the rates in the accepted schedule of rates and for extra works at rates determined under Clause 39 of these conditions on the measurements taken by the Engineer or the Engineer's representative in accordance with the rules prescribed for the purpose by the DFCCIL. The quantities for items the unit of which in the accepted schedule of rates is 100 or 1000 shall be calculated to the nearest whole number, any; fraction below half being dropped and half and above being taken as one; for items the unit of which in the accepted schedule of rates is single, the quantities shall be calculated to two places of decimals. Such measurements will be taken of the work in progress from time to time and at such intervals as in the opinion of the Engineer shall be proper having regard to the progress of works. The date and time on which "on account" or final measurements are to be made shall be communicated to the Contractor who shall be present at the site and shall sign the results of the measurements (which shall also be signed by the Engineer or the Engineer's representative) recorded in the official measurements book as an acknowledgement of his acceptance of the accuracy of the measures. Failing the Contractor's attendance the work may be measured up in his absence and such measurements shall, notwithstanding such absence, be binding upon the Contractor whether or not he shall have signed the measurement books provided always that any objection made by him to measurement shall be duly investigated and considered in the manner set out below:-

(a) It shall be open to the Contractor to take specific objection to any recorded measurements or Classification on any ground within seven days of the date of such measurements. Any re-measurement taken by the engineer or the Engineer's representative in the presence of the Contractor or in his absence after due notice has been given to him in consequence of objection made by the Contractor shall be final and binding on the Contractor and no claim whatsoever shall thereafter be entertained regarding the accuracy and classification of the measurements.

(b) If an objection raised by the Contractor is found by the Engineer to be incorrect the Contractor shall be liable to pay the actual expenses incurred in measurements.

**46.(1) "On-Account" Payments:-** The Contractor shall be entitled to be paid from time to time by way of "One-Account" payment only for such works as in the opinion of the Engineer he has executed in terms of the contract.



All payments due on the Engineer's or the Engineer's representative's certificates of measurements shall be subject to any deductions which may be made under these presents and shall further be subject to, unless otherwise required by Clause 16 of these conditions, a retention of ten percent by way of security deposits, until the amount of security deposit by way of retained earnest money and such retentions shall amount to 10% of the total value of the contract provided always that the Engineer may by any certificate make any correction or modification in any previous certificate which shall have been issued by him and that the Engineer may withhold any certificate if the works or any part thereof are not being carried out to his satisfaction.

**46.(2) Rounding off amounts:** - The total amount due on each certificate shall be rounded off to the nearest rupee i.e. sum less than 50 paise shall be omitted and sums of 50 paise and more upto Re. 1/- will be reckoned as Re. 1/-

**46.(3) On Account Payments not prejudicial to final settlement:** - "On-Account" payments made to the 'Contractor shall be without prejudice to the final making up of the accounts (except where measurements are specifically noted in the Measurement Book as "Final Measurements" and as such have been signed by the Contractor) and shall in no respect be considered or used as evidence of any facts stated in or to be inferred from such accounts nor of any particular quantity of work having been executed nor of the manner of its execution being satisfactory.

**46.(4) Manner of payment:** - Unless otherwise specified payments to the Contractor will be made by cheque but no cheque will be issued for an amount less than Rs. 100/-

#### **46A PRICE VARIATION CLAUSE:**

**46A.1** Applicability: Price variation clause shall be applicable for this contract and irrespective of the contract completion period. Variation in quantities shall not be taken into account for applicability of PVC in the contract.

Materials supplied free of cost by DFCCIL to the contractors shall fall outside the purview of price variation clause. If, in any case, accepted offer include some specific payment to be made to consultant or some materials supplied by DFCCIL free or at fixed rate, such payment shall be excluded from the gross value of the work for the purpose of payment /recovery of price variation.

- 46A.2** Base month: The base month for the 'Price Variation Clause' shall be taken as month of opening of tender including extensions, if any, unless otherwise stated elsewhere. The quarter of applicability of PVC shall commence from the month following the month of opening of tender. The price variation shall be based on the average price Index of the quarter under consideration.
- 46A.3** Validity : Rates accepted by DFCCIL shall hold good till completion of work and no additional claim shall be admissible on account of fluctuations in market rates increase in taxes / any other levies / tolls etc. except that payment recovery for overall market situation shall be made as per Price variation clause given hereunder.
- 46A.4** Adjustment for variation in prices of material, labour, fuel, explosives detonators, steel, concreting, ferrous, nonferrous, insulator, zinc and cement shall be determined in the manner prescribed hereunder.
- 46A.5** Components of various items in a contract on which variation in prices be admissible shall be material, labour, fuel, explosives detonators, steel, cement and lime, concreting, ferrous, nonferrous, insulator, zinc, erection, etc. However, for fixed component, no price variation shall be admissible.
- 46A.6** The percentages of labour, material, fuel, component etc. in various types of Engineering Works shall be as under:

| Component  | % age | Component                 | % age |
|--|-------|---------------------------|-------|
| <b>(A) Earthwork contracts</b>                   | N.A   |                           |       |
| Labour component                                 | -     | Other material components | -     |
| Fuel component                                   | -     | Fixed component *         | -     |
| <b>(B) Ballast and Quarry products Contracts</b> | N.A   |                           |       |
| Labour component                                 | -     | Other material components | -     |
| Fuel component                                   | -     | Fixed component*          | -     |
| <b>(C) Tunneling Contracts</b>                   | N.A   |                           |       |
| Labour component                                 |       | Detonator Component       | -     |
| Fuel component                                   | -     | Other material components | -     |
| Explosive Component                              | -     | Fixed component*          | -     |
| <b>(D) Other work Contracts**</b>                |       |                           |       |
| Labour component                                 | 30%   | Fuel component            | 15%   |
| Material component                               | 40%   | Fixed component*          | 15%   |

\* It shall not be considered for any price variation

**\*\* Category of PVC applicable for all Schedule (I & II) items other than supply of cement and steel items.**

**For Steel and Cement items the PVC applicable are as per given below formula:**

**46A.7** Formulae: The amount of variation in prices (increase / decrease) in the several components (labour, material etc.) shall be worked out by the following formulae:

$$(i) \quad L = \frac{W \times (L_Q - L_B)}{L_B} \times \frac{L_C}{100}$$

$$(ii) \quad M = \frac{W \times (M_Q - M_B)}{M_B} \times \frac{M_C}{100}$$

$$(iii) \quad F = \frac{W \times (F_Q - F_B)}{F_B} \times \frac{F_C}{100}$$

$$(iv) \quad S = \frac{SW \times (S_Q - S_B)}{S_B}$$

$$(v) \quad C = \frac{C_V \times (C_Q - C_B)}{C_B}$$

- Applicable if Cement supply is paid under separate item (In this tender cement is not paid under separate item).

L      Amount of price variation in Labour.

M      Amount of price variation in Materials.

F      Amount of price variation in Fuel.

S      Amount of price variation in Steel.

C      Amount of price variation in Cement.

W      Gross value of the work done by the contractor as per on account bill(s), excluding cost of materials supplied by DFCCIL at fixed price, minus the price values of cement and steel. This will also exclude specific payment, if any, to be made to the consultants engaged by contractors (such payment

shall be indicated in the contractor's offer)

- L<sub>B</sub> Consumer price index number for industrial workers- All India- published in RBI bulletin for the base period.
- L<sub>Q</sub> Consumer Price Index Number for industrial workers -All India- Published in RBI bulletin for the average Price Index of the three months of the quarter under consideration.
- M<sub>B</sub> Index Number of wholesale prices – By groups and sub groups-All commodities-As published in the RBI Bulletin for the base period
- M<sub>Q</sub> Index Number of wholesale prices – By Groups and sub Groups-All commodities as published in the RBI Bulletin for the average Price Index of the three months of the quarter under consideration.
- F<sub>B</sub> Index Number of wholesale prices – By Groups and sub Groups for fuel, power, light and lubricants as published in the RBI Bulletin for the base period
- F<sub>Q</sub> Index Number of wholesale prices – By Groups and sub Groups for fuel and power as published in the RBI Bulletin for the average Price Index of the three months of the quarter under consideration.
- S Amount of Price Variation in Reinforcement Steel
- S<sub>W</sub> Gross value of the Reinforcement Steel supplied by the contractor as per the ‘on account’ bill for the Month under consideration.
- S<sub>Q</sub> The index Number of commodities ‘MS Bright Bars of group item (d) Mild Steel-Long Products under (N) MANUFACTURE OF BASIC METAL’ of Wholesale Price Index published by Office of Economic Adviser, Govt. of India, Ministry of Commerce & Industry Department of Industrial Policy & Promotion (DIPP) in the month on the day 28 days prior to the last day of the period to which a particular RA Bill is related. (Ref: CO letter No. HQ/EN/ED/WDFC/PVC Steel-ROB/2019 dated 12-03-2019)
- S<sub>B</sub> The index Number of commodities ‘MS Bright Bars of group item (d) Mild Steel-Long Products under (N) MANUFACTURE OF BASIC METAL’ of Wholesale Price Index published by Office of Economic Adviser, Govt. of India, Ministry of

Commerce & Industry Department of Industrial Policy & Promotion (DIPP) in the month on the day 28 days prior to the closing date of submission of Bids. (Ref: CO letter No. HQ/EN/ED/WDFC/PVC Steel-ROB/2019 dated 12-03-2019)

C<sub>V</sub> Value of cement supplied by contractor as per on account bill in the quarter under consideration.

C<sub>B</sub> Index Number of wholesale prices of sub Group (of cement & lime) as published in the RBI Bulletin for the base period.

C<sub>Q</sub> Index Number of wholesale prices of sub Group (of cement & lime) as published in the RBI Bulletin for the average price index of three months of quarter under consideration.

L<sub>C</sub> % of labour component

M<sub>C</sub> % of Material component

F<sub>C</sub> % of Fuel component

**46A.8** The demands for escalation of cost shall be allowed on the basis of provisional indices made available by Reserve Bank of India. Any adjustment needed to be done based on the finally published indices shall be made as and when they become available.

#### **46A.9 Special Note**

- (1) It is clearly indicated that price variation implies both increase as well decrease in input prices and therefore price variation during the currency of the contract may result in extra payment or recovery as the case may be.
- (2) The Index Number for the base period will be the Index Number as obtained for the month of opening of the tender and the quarter will commence from the month following the month of opening of tender. If the rates quoted in negotiated tenders are accepted, the base month for PVC will be month in which Negotiations are held.
- (3) General Conditions of Contract shall be applicable in context of Price variation. However, decision of Engineer shall be final & finding, in case of any conflict.

#### **46A.10 Price Variation During Extended Period of Contract**

The price adjustment as worked out above, i.e. either increase or decrease shall be applicable up to the stipulated date of completion of work including the extended period of completion where such extension has been granted under Clause 17-A of the General Conditions of Contract. However, where extension of time has been granted due to contractor's failure under Clause 17-B of the General Conditions of Contract, price adjustment shall be done as follows:

- (a) In case the indices increase above the indices applicable to the last month of original completion period or the extended period under Clause 17-A, the price adjustment for the period of extension granted under Clause 17-B shall be limited to the amount payable as per the Indices applicable to the last month of the original completion period or the extended period under Clause 17-A of the General Conditions of Contract; as the case may be.
- (b) In case the indices fall below the indices applicable to the last month of original/extended period of completion under Clause 17-A, as the case may be; then the lower indices shall be adopted for the price adjustment for the period of extension under Clause 17-B of the General Conditions of Contract.

**47.0 Maintenance of works:-** The Contractor shall at all times during the progress and continuance of the works and also for the period of maintenance specified in the Tender Form after the date of passing of the certificate of completion by the Engineer or any other earlier date subsequent to the completion of the works that may be fixed by the Engineer be responsible for and effectively maintain and uphold in good substantial, sound and perfect condition all and every part of the works and shall make good from time to time and at all times as often as the Engineer shall require, any damage or defect that may during the above period arise in or be discovered or be in any way connected with the works, provided that such damage or defect is not directly caused by errors in the contract documents, act of providence or insurrection or civil riot, and the contractor shall be liable for and shall pay and make good to the DFCCIL or other persons legally entitled thereto whenever required by the Engineer so to do, all losses, damages, costs and expenses they or any of them may incur or be put or be liable to by reasons or in consequence of the operations of the Contractor or of his failure in any respect.

**48.(1) Certificate of completion of works:-** As soon as in the opinion of the Engineer, the works has been completed and has satisfactorily passed any final test or tests that may be prescribed, the Engineer shall issue a certificate of completion duly indicating the date of completion in respect, of the work and the

period of maintenance of the work shall commence from the date of completion mentioned in such certificate. The Engineer may also issue such a certificate indicating date of completion with respect to any part of the work (before the completion the whole of work), which has been both completed to the satisfaction of the Engineer and occupied or used by the DFCCIL. When any such certificate is given in respect of part of a work, such part shall be considered as completed and the period of maintenance of such part shall commence from the date of completion mentioned in the completion certificate issued for that part of the work.

**48.(2) Contractor not absolved by completion Certificate:-** The Certificate of completion in respect of the works referred to in sub-clause (1) of this clause shall not absolve the Contractor from his liability to make good any defects imperfections, shrinkages or faults which may appear during the period of maintenance specified in the tender arising in the opinion of the Engineer from materials or workmanship not in accordance with the drawings or specifications or instruction of the Engineer, which defects, imperfections, shrinkages or faults shall upon the direction in writing of the Engineer be amended and made good by the Contractor at his own cost: and in case of default on the part of Contractor the Engineer may employ labour and materials or appoint another Contractor to amend and make good such defects, imperfections, shrinkages and faults and all expenses consequent thereon and incidental thereto shall be borne by the Contractor and shall be recoverable from any moneys due to him under the contract.

**49.0 Approval only by maintenance Certificate:-** No certificate other than maintenance certificate referred to in Clause 50 of the conditions shall be deemed to constitute approval of any work or other matter in respect of which it is issued or shall be taken as an admission of the due performance of the contract or any part thereof or of the accuracy of any claim or demand made by the Contractor or of additional varied work having been ordered by the Engineer nor shall any other certificate conclude or prejudice any of the powers of the Engineer.

**50.(1) Maintenance Certificate:-** The Contract shall not be considered as completed until a Maintenance Certificate shall have been signed by the Engineer stating that the works have been completed and maintained to his satisfaction. The Maintenance Certificate shall be given by the Engineer upon the expiration of the period of maintenance or as soon thereafter as any works ordered during such period pursuant to sub clause (2) Clause 48 of these conditions shall have been

completed to the satisfaction of the Engineer and full effect shall be given to this Clause notwithstanding the taking possession of or using the works or any part thereof by the DFCCIL.

**50.(2) Cessation of DFCCIL Liability:** - The DFCCIL shall not be liable to the Contractor for any matter arising out of or in connection with the contract of the execution of the works unless the contractor shall have made a claim in writing in respect thereof before the issue of the Maintenance Certificate under this clause.

**50.(3) Unfulfilled Obligations:-** Notwithstanding the issue of the Maintenance certificate the Contractor and (subject to sub-clause 2 of this clause) the DFCCIL shall remain liable for the fulfilment of any obligation incurred under the provision of the contract prior to the issue of the maintenance Certificate which remains unperformed at the time such certificate is issued and for the purposes of determining the nature and extent of any such obligations the contract shall be deemed to remain in force between the parties thereto.

**51.(1) Final Payment:-** On the Engineer's certificate of completion in respect of the works, adjustment shall be made and the balance of account based on the Engineer or the Engineer's representative's certified measurements of the total quantity of work executed by the contractor upto the date of completion and on the accepted schedule or rates and for extra works on rates determined under Clause 39 of these conditions shall be paid to the Contractor subject always to any deduction which may be made under these presents and further subject to the Contractor having delivered to the Engineer either a full account in detail of all claims he may have on the DFCCIL in respect of the works or having delivered "No Claim Certificate" and the Engineer having after the receipt of such account given a certificate in writing that such claims are correct, that the whole of the works to be done under the provisions of the Contracts have been completed, that they have been inspected by him since their completion and found to be in good and substantial order, that all properties, works and things, removed, disturbed or injured in consequence of the works have been properly replaced and made good and all expenses and demands incurred by or made upon the DFCCIL for or in the respect of damage or loss by from or in consequence of the works, have been satisfied agreeably and in conformity with the contract.

**51.(2) Post Payment Audit:-** It is an agreed term of contract that the DFCCIL reserves to itself the right to carry out a post-payment audit and or technical examination of the works and the final bill including all supporting vouchers, abstracts etc.



and to make a claim on the contractor for the refund any excess amount paid to him if as a result of such examination any over-payment to him is discovered to have made in respect of any works done or alleged to have been done by him under the contract.

**51A. Production of vouchers etc. by the Contractor:-**

- (i) For a contract of more than one crore of rupees, the contractor shall, whenever required, produce or cause to be produced for examination by the Engineer any quotation, invoice, cost or other account, book of accounts, voucher, receipt, letter, memorandum, paper of writing or any copy of or extract from any such document and also furnish information and returns verified in such manner as may be required in any way relating to the execution of this contract or relevant for verifying or ascertaining cost of execution of this contract (the decision of the engineer on the question of relevancy of any documents, information or return being final and binding in the parties).The contractor shall similarly produce vouchers; etc., if required to prove to the Engineer, that materials supplied by him, are in accordance with the specifications laid down in the contract.
- (ii) If any portion of the work in a contract of value more than one crore of rupees be carried out by a sub-contractor or any subsidiary or allied firm or company (as per Clause 7 of the General Conditions of Contract),the Engineer shall have power to secure the books of such sub-contract or any subsidiary or allied firm or company, through the contractor, and such books shall be open to his inspection.
- (iii) The obligations imposed by sub clause (i) & (ii) above is without prejudice to the obligations of the contractor under any statute rules or orders binding on the contractor.

**52.0 Withholding and lien in respect of sums claimed:-** Whenever any claim or claims for payment of a sum of money arises out of or under the contract against the contractor, the DFCCIL shall be entitled to withhold and also have a lien to retain such sum or sums in whole or in part from the security, if any, deposited by the contractor and for the purpose aforesaid, the DFCCIL shall be entitled to withhold the said cash security deposit or the security if any, furnished as the case may be and also have a lien over the same pending finalization or adjudication of any such claim. In the event of the security being insufficient to cover the claimed amount or amounts or if no security has been

taken from the contractor, the DFCCIL shall be entitled to withhold and have a lien to the extent of the such claimed amount or amounts referred to supra, from any sum or sums found payable or which at any time thereafter may become payable to the contractor under the same contract or any other contract with this or any other DFCCIL or any Department of the Central Government pending finalization or adjudication of any such claim.

It is an agreed term of the contract that the sum of money or moneys so withheld or retained under the lien referred to above, by the DFCCIL will be kept withheld or retained as such by the DFCCIL till the claim arising out of or under the contract is determined by the arbitrator (if the contract governed by the arbitration clause) or by the competent court as the case may be and that the contractor will have no claim for interest or damages whatsoever on any account in respect of such withholding or retention under the lien referred to supra and duly notified as such to the contractor. For the purpose of this clause, where the contractor is a partnership firm or a limited company, the DFCCIL shall be entitled to with hold and also have a lien to retain towards such claimed amount or amounts in whole or in part from any sum found payable to any partner/limited company, as the case may be whether in his individual capacity or otherwise.

**52A. Lien in respect of claims in Other Contracts:-**

- (i) Any sum of money due and payable to the contractor (including the security deposit returnable to him) under the contract may be withheld or retained by way of lien by the DFCCIL, against any claim of this or any other DFCCIL or any other Department of the Central Government in respect of a payment of a sum of money arising out of or under any other contract made by the contractor with this or any other Department of the Central Government.
- (ii) However, recovery of claims of DFCCIL in regard to terminated contracts may be made from the Final Bills, Security Deposits and Performance Guarantees of other contract or contracts, executed by the contractor. The Performance Guarantees submitted by the Contractor against other contracts, if required, may be withheld and encashed. In addition, 10% of each subsequent 'on-account bill' may be withheld, if required, for recovery of DFCCIL's dues against the terminated contract.
- (iii) It is an agreed term of the contract that the sum of money so withheld or retained under this clause by the DFCCIL will be kept withheld or retained as such by the DFCCIL till the claim arising out of or under any other contract is

either mutually settled or determined by arbitration, if the other contract is governed by arbitration clause or by the competent court as the case may be and contractor shall have no claim for interest or damages whatsoever on this account or on any other ground in respect of any sum of money withheld or retained under this clause and duly notified as such to the contractor.

- 53.0 Signature on Receipts for Amounts:-** Every receipt for money which may become payable or for any security which may become transferable to the Contractors under these presents, shall, if signed in the partnership name by anyone of the partners of a Contractor's firm be a good and sufficient discharge to the DFCCIL in respect of the moneys or security purported to be acknowledged thereby and in the event of death of any of the Contractor, partners during the pendency of the contract it is hereby expressly agreed that every receipt by anyone of the surviving Contractor partners shall if so signed as aforesaid be good a sufficient discharge as aforesaid provided that nothing in this clause contained shall be deemed to prejudice or effect any claim which the DFCCIL may hereafter have against the legal representative of any contractor partner so dying for or in respect to any breach of any of the conditions of the contract, provided also that nothing in this clause contained shall be deemed to prejudice or effect the respective rights or obligations of the Contractor partners and of the legal representatives of any deceased Contractor partners interest.

## **LABOUR**

- 54.0 Wages to Labour:-** The Contractor shall be responsible to ensure compliance with the provision of the Minimum Wages Act, 1948 (hereinafter referred to as the "said Act" and the Rules made there under in respect of any employees directly or through petty contractors or subcontractors employed by him on road construction or in building operations or in stone breaking or stone crushing for the purpose of carrying out this contract.

If, in compliance with the terms of the contract, the Contractor supplied any labour to be used wholly or partly under the direct orders and control of the DFCCIL whether in connection with any work being executed by the Contractor or otherwise for the purpose of the DFCCIL such labour shall, for the purpose of this clause, still be deemed to be persons employed by the Contractor.

If any moneys shall, as a result of any claim or application made under the said

Act be directed to be paid by the DFCCIL, such money shall be deemed to be moneys paid by it as aforesaid within seven days after the same shall have been demanded, the DFCCIL shall be entitled to recover the same from any moneys due or accruing to the Contractor under this or any other Contract with the DFCCIL.

- 54A. Apprentices Act:-** The Contractor shall be responsible to ensure compliance with the provisions of the Apprentices Act, 1961 and the Rules and Orders issued there under from time to time in respect of apprentices directly or through petty contractors or sub-contractors employed by him for the purpose of carrying out the Contract.

If the contractor directly or through petty contractors or sub-contractors fails to do so, his failure will be a breach of the contract and the DFCCIL may, in its discretion, rescind the contract. The contractor shall also be liable for any pecuniary liability arising on account of any violation of the provisions of the Act.

**Note:** The contractors are required to engage apprentices when the works undertaken by them last for a period of one year or more and / the cost of works is rupees one lakh or more.

- 55.0 Provisions of payments of Wages Act: -** The Contractor shall comply with the provisions of the Payment of Wages Act, 1936 and the rules made there under in respect of all employees directly or through petty contractors or sub-contractors employed by him in the works. If In compliance with the terms of the contract, the Contractor directly or through petty contractors or sub-contractors shall supply any labour to be used wholly or partly under the direct orders and control of the Engineer whether in connection with the works to be executed hereunder or otherwise for the purpose of the Engineer such labour shall never the less be deemed to comprise persons employed by the contractor and any moneys which may be ordered to be paid by the Engineer shall be deemed to be moneys payable by the Engineer on behalf of the Contractor and the Engineer may on failure of the contractor to repay such money to the DFCCIL deduct the same from moneys due to contractor in the terms of contract. The DFCCIL shall be entitled to deduct from any moneys due to the contractor (whether under this contract or any other contract) all moneys paid or payable by the DFCCIL by the way of compensation of aforesaid or for costs of expenses in connection with any claim thereto and the decision of the Engineer upon any question arising out of the effect or force of this clause shall be final and binding upon the Contractor.

**55A. Provisions of Contract labour (Regulation and Abolition) Act, 1970:**

- 55A.(1)** The contractor shall comply with the provision of the contract labour (Regulation and Abolition) Act, 1970 and the Contract labour (Regulation and Abolition) Central Rules 1971 as modified from time to time, wherever applicable and shall also indemnify the DFCCIL from and against any claims under the aforesaid Act and the Rules.
- 55A.(2)** The Contractor shall obtain a valid licence under the aforesaid Act as modified from time to time before the commencement of the work and continue to have a valid licence until the completion of the work. Any failure to fulfil the requirement shall attract the penal provision of the Contract arising out of the resultant non-execution of the work.
- 55A.(3)** The Contractor shall pay to the labour employed by him directly or through subcontractors the wages as per provision of the aforesaid Act and the Rules wherever applicable. The Contractor shall notwithstanding the provisions of the contract to the contrary, cause to be paid the wages to labour indirectly engaged on the works including any engaged by subcontractors in connection with the said work, as if the labour had been immediately employed by him.
- 55A.(4)** In respect of all labour directly or indirectly employed in the work for performance of the contractor's part of, the contract, the Contractor shall comply with or cause to be complied with the provisions of the aforesaid Act and Rules wherever applicable.
- 55A.(5)** In every case in which, by virtue of the provisions of the aforesaid Act or the Rules, the DFCCIL is obliged to pay any amount of wages to a workman employed by the Contractor or his sub-contractor in execution of the work or to incur any expenditure on account of the Contingent, liability of the DFCCIL due to the contractor's failure to fulfil his statutory obligations under the aforesaid Act or the rules the DFCCIL will recover from the Contractor, the amount of wages so paid or the amount of expenditure so incurred, and without prejudice to the rights of the DFCCIL under the section 20, sub-section (2) and section 2, sub-section (4) of the aforesaid Act, the DFCCIL shall be at liberty to recover such amount or part thereof by deducting it from the security deposit and/ or from any sum due by the DFCCIL to the contractor whether under the contract or otherwise. The DFCCIL shall not be bound to contest any claim made against it under sub-section (1) of section 20 and sub-section (4) of section 21 of the

aforesaid Act except on the written request of the contractor and upon his giving to the DFCCIL full security for all costs for which the DFCCIL might become liable in contesting such claim. The decision of the DFCCIL regarding the amount actually recoverable from the contractor as stated above shall be final and binding on the Contractor.

**55B. Provisions of Employees Provident Fund and Miscellaneous Provisions Act, 1952:**

The Contractor shall comply with the provisions of Para 30 & 36-B of the Employees Provident Fund Scheme, 1952; Para 3 & 4 of Employees' Pension Scheme, 1995; and Para 7 & 8 of Employees Deposit Linked Insurance Scheme, 1976; as modified from time to time through enactment of "Employees Provident Fund & Miscellaneous Provisions Act, 1952", wherever applicable and shall also indemnify the DFCCIL from and against any claims under the aforesaid Act and the Rules.

**55C. Provisions of "The Building and Other Construction Workers (Regulation of Employment and Conditions of Service) Act, 1996" and "The Building and Other Construction Workers' Welfare Cess Act, 1996" :**

The tenderers, for carrying out any construction work, must get themselves registered with the Registering Officer under Section-7 of the Building and Other Construction Workers Act, 1996 and rules made thereto by the concerned State Govt. and submit certificate of Registration, issued from the Registering Officer of the concerned State Govt. (Labour Dept.). As per this Act, the tenderer shall be levied a cess @1% of cost of construction work, which would be deducted from each bill. Cost of material, when supplied under a separate schedule item, shall be outside the purview of cess.

**56.0 Reporting of Accidents of Labour:-** The Contractor shall be responsible for the safety of all employees directly or through petty contractors or sub-contractor employed by him on the works and shall report serious accidents to any of them however and wherever occurring on the works to the Engineer or the Engineers Representative and shall made every arrangements to render all possible assistance.

**57.0 Provision of Workmen's Compensation Act:-** In every case in which by virtue of the provisions of section 12 sub-section (1) of the Workmen's Compensation Act 1923, DFCCIL is obliged to pay compensation to a workman directly or through petty contractor or subcontractor employed by the Contractor in executing the work, DFCCIL will recover from the Contractor the amount of the

compensation so paid, and, without prejudice to the rights of DFCCIL under Section 12 Sub-section (2) of the said Act, DFCCIL shall be at liberty to recover such amount or any part thereof by deducting it from the security deposit or from any sum due by DFCCIL to the Contractor whether under these conditions or otherwise, DFCCIL shall not be bound to contest any claim made against it under Section 12 Sub-section (1) of the said Act except on the written request of the Contractor and upon his giving to DFCCIL full security for all costs for which DFCCIL might become liable in consequence of contesting such claim.

- 57A. Provision of Mines Act:-** The contractor shall observe and perform all the provisions of the Mines Act, 1952 or any statutory modifications or re-enactment thereof for the time being in force and any rules and regulations made there under in respect of all the persons directly or through the petty contractors or sub-contractors employed by him under this contract and shall indemnify the DFCCIL from and against any claims under the Mines Act, or the rules and regulations framed there under, by or on behalf of any persons employed by him or otherwise.
- 58.0 DFCCIL not to provide quarters for Contractors:-** No quarters shall normally be provided by the DFCCIL for the accommodation of the contractor or any of his staff employed on the work.
- 59.(1) Labour Camps:-** The contractor shall at his own expense make adequate arrangements for the housing, supply of drinking water and provision of latrines and urinals for his staff and workmen, directly or through the petty contractors or sub-contractors and for temporary crèche (Bal-mandir) where 50 or more women are employed at a time. Suitable sites on DFCCIL land, if available, may be allotted to the contractor for the erection of labour camps, either free of charge or on such terms and conditions that may be prescribed by the DFCCIL. All camp sites shall be maintained in clean and sanitary conditions by the contractor at his own cost.
- 59.(2) Compliance to rules for employment of labour:-** The contractor(s) shall conform to all laws, by-laws rules and regulations for the time being in force pertaining to the employment of local or imported labour and shall take all necessary precautions to ensure and preserve the health and safety of all staff employed directly or through petty contractors or sub-contractors on the works.

- 59.(3) Preservation of peace:-** The contractor shall take requisite precautions and use his best endeavours to prevent any riotous or unlawful behaviour by or amongst his workmen and other employed directly or through the petty contractors or sub-contractors on the works and for the preservation of peace and protection of the inhabitants and security of property in the neighbourhood of the works. In the event of the DFCCIL requiring the maintenance of a special Police Force at or in the vicinity of the site during the tenure of works, the expenses thereof shall be borne by the contractor and if paid by the DFCCIL shall be recoverable from the contractor.
- 59.(4) Sanitary arrangements:-** The contractor shall obey all sanitary rules and carry out all sanitary measures that may from time to time be prescribed by the Railway Medical Authority and permit inspection of all sanitary arrangements at all times by the Engineer, the Engineer's Representative of the Medical staff of the DFCCIL. Should the contractor fail to make the adequate sanitary arrangements, these will be provided by the DFCCIL and the cost therefore recovered from the contractor.
- 59.(5) Outbreak of infectious disease:-** The contractor shall remove from his camp such labour and their families as refuse protective inoculation and vaccination when called upon to do so by the Engineer or the Engineer's representative on the advice of the DFCCIL. Should cholera, plague or other infectious disease break out, the contractor shall burn the huts, beddings, clothes and other belongings of or used by the infected parties and promptly erect new huts on health sites as required by the engineer, failing which within the time specified in the Engineer's requisition, the work may be done by the DFCCIL and the cost therefore recovered from the contractor.
- 59.(6) Deleted**
- 59.(7) Medical facilities at site: -** The Contractor shall provide medical facilities at the site as may be prescribed by the Engineer on the advice of the DFCCIL in relation to the strength of the Contractor's resident staff and workmen.
- 59.(8) Use of intoxicants: -** The sale of ardent spirits or other intoxicating beverages upon the work or in any of the buildings, encampments or tenements owned, occupied by or within the control of the contractor or any of his employees shall be forbidden and the Contractor shall exercise his influence and authority to the utmost extent to secure strict compliance with this condition.



- 59.(9) Non-employment of female labour:** - The Contactor shall see that the employment of female labour on / in Cantonment areas, particularly in the neighbourhood of soldier's barracks, should be avoided as far as possible.
- 59.(10) Restrictions On The Employment Of Retired Engineers Of Railway/DFCCIL Services Within one Year Of Their Retirement :** The Contractor shall not, if he is a retired Government Engineer of Gazetted rank, himself engage in or employ or associate a retired Government Engineer of Gazetted rank, who has not completed one year from the date of retirement, in connection with this contract in any manner whatsoever without obtaining prior permission of the President and if the Contractor is found to have contravened this provision it will constitute a breach of contract and administration will be entitled to terminate the contract and forfeit Earnest Money Deposits (EMD), Performance Guarantee (PG) and Security Deposits (SD) of that contract.
- 60.(1) Non-employment of labours below the age of 15:-** the Contractor shall not employ children below the age of 15 as labourers directly or through petty contractors or subcontractors for the execution of work.
- 60.(2) Medical Certificate of fitness for labour:** - It is agreed that the contractor shall not employ a person above 15 and below 19 years of age for the purpose of execution of work under the contract unless a medical certificate of fitness in the prescribed form (Proforma at Form No.15) granted to him by a certifying surgeon certifying that he is fit to work as an adult is obtained and kept in the custody of the contractor or a person nominated by him in this behalf and the person carries with him, while at work; a token giving a reference to such certificate. It is further agreed that the responsibility for having the adolescent examined medically at the time of appointment or periodically till he attains the age of 19 years shall devolve entirely on the contractor and all the expenses to be incurred on this account shall be borne by him and no fee shall be charged from the adolescent or his parent for such medical examination.
- 60.(3) Period of validity of medical fitness certificate:-** A certificate of fitness granted or renewed for the above said purposes shall be valid only for a period of one year at a time. The certifying surgeon shall revoke a certificate granted or renewed if in his opinion the holder of it is, no longer fit for work in the capacity stated therein. Where a certifying surgeon refuses to grant or renew a certificate or revoke a certificate, he shall, if so required by the person concerned, state his reasons in writing for doing so.

- 60.(4) Medical re-examination of labourer:-** Where any official appointed in this behalf by the Ministry of labour is of the opinion that any person employed in connection with the execution of any work under this contract in the age group 15 to 19 years is without a certificate of fitness or is having a certificate of fitness but no longer fit to work in the capacity stated in the certificate, he may serve on the Contractor, or on the person nominated by him in the regard, a notice requiring that such persons shall be examined by a certifying surgeon and such person shall not if the concerned official so directs, be employed or permitted to do any work under this contract unless he has been medically examined and certified that he has been granted a certificate of fitness or a fresh certificate of fitness, as the case may be.

**EXPLANATIONS:-**

- (1) Only qualified medical practitioners can be appointed as “Certifying Surgeons” and the term “Qualified Medical Practitioners” means a person holding a qualification granted by an authority specified in the Schedule to the Indian Medical Degrees Act, 1916 (VII to 1916) or in the Schedule to the Indian Medical Council Act, 1933 (XXVII) of 1933.
- (2) The Certifying surgeon may be a medical officer in the service of State or Municipal Corporation.

**DETERMINATION OF CONTRACT**

- 61.(1) Right of DFCCIL of determine the contract:-** The DFCCIL shall be entitled to determine and terminate the contract at any time should, in the DFCCIL’s opinion, the cessation of work becomes necessary owing to paucity of funds or from any other cause whatever, in which case the value of approved materials at site and of work done to date by the Contractor will be paid for in full at the rate specified in the contract. Notice in writing from the DFCCIL of such determination and the reasons therefore shall be conclusive evidence thereof.
- 61.(2) Payment on determination of contract:-** Should the contract be determined under sub clause (1) of this clause and the Contractor claims payment for expenditure incurred by him in the expectation of completing the whole of the work, the DFCCIL shall admit and consider such claims as are deemed reasonable and are supported by vouchers to the satisfaction of the

Engineer. The DFCCIL's decision on the necessity and propriety of such expenditure shall be final and conclusive.

**61.(3)** The contractor shall have no claim to any payment of compensation or otherwise, howsoever on account of any profit or advantage which he might have derived from the execution of the work in full but which he did not derive in consequence of determination of contract.

**62.(1) Determination of contract owing to default of contractor:-** If the Contractor should:-

- (i) Becomes bankrupt or insolvent, or
- (ii) Make an arrangement with of assignment in favour of his creditors, or agree to carry out the contract under a Committee of Inspection of his creditors, or
- (iii) Being a Company or Corporation, go into liquidation (other than a voluntary liquidation for the purposes of amalgamation or reconstruction), or
- (iv) Have an execution levied on his goods or property on the works, or
- (v) assign the contract or any part thereof otherwise than as provided in Clause 7 of these conditions, or
- (vi) Abandon the contract, or
- (vii) Persistently disregard the instructions of the Engineer, or contravene any provision of the contract, or
- (viii) Fail to adhere to the agreed programme of work by a margin of 10% of the stipulated period, or
- (ix) Fail to remove materials from the site or to pull down and replace work after receiving from the Engineer notice to the effect that the said materials or works have been condemned or rejected under clause 25 and 27 of these conditions, or
- (x) Fail to take steps to employ competent or additional staff and labour as required under clause 26 of the conditions
- (xi) Fail to afford the Engineer or Engineer's representative proper facilities

for inspecting the work or any part thereof as required under clause 28 of the conditions, or

(xii) promise offer or give any bribe, commission, gift or advantage either himself or through his partner, agent or servant to any officer or employee of the DFCCIL or to any person on his or on their behalf in relation to the execution of this or any other contract with this DFCCIL.

(xiii)(A) At any time after the tender relating to the contract, has been signed and submitted by the Contractor, being a partnership firm admit as one of its partners or employee under it or being an incorporated company elect or nominate or allow to act as one of its directors or employee under it in any capacity whatsoever any retired engineer of the gazetted rank or any other retired gazetted officer working before his retirement, whether in the executive or administrative capacity, or whether holding any pensionable post or not, in the DFCCIL for the time being owned and administered by the President of India before the expiry of one year from the date of retirement from the said service of such Engineer or Officer unless such Engineer or Officer has obtained permission from the President of India or any officer duly authorized by him in this behalf to become a partner or a director or to take employment under the contract as the case may be, or

**(xiii) (B) Fail to give at the time of submitting the said tender :-**

- (a) The correct information as to the date of retirement of such retired engineer or retired officer from the said service, or as to whether any such retired engineer or retired officer was under employment of the Contractor at the time of submitting the said tender, or
- (b) The correct information as to such engineers or officers obtaining permission to take employment under the contractor, or
- (c) Being a partnership firm, the correct information as to, whether any of its partners was such a retired engineer or a retired officer, or
- (d) Being in incorporated company, correct information as to whether any of its directors was such as retired engineer or a retired officer, or
- (e) Being such a retired engineer or retired officer suppress and not disclose at the time of submitting the said tender the fact of his being such a retired engineer or a retired officer or make at the time of submitting the said tender a wrong statement in relation to his obtaining permission to take the contract or if the contractor be a partnership firm or an incorporated company to be a partner or director of such firm or company as the case

may be or to seek employment under the contractor.

Then and in any of the said clause, the Engineer on behalf of the DFCCIL may serve the Contractor with a notice (Pro-forma at Form No.16) in writing to that effect and if the contractor does not within seven days after the delivery to him of such notice proceed to make good his default in so far as the same is capable of being made good and carry on the work or comply with such directions as aforesaid of the entire satisfaction of the Engineer, the DFCCIL shall be entitled after giving 48 hours notice (Pro-forma at Form No. 17) in writing under the hand of the Engineer to rescind the contract as a whole or in part or parts (as may be specified in such notice) and after expiry of 48 hours notice, a final termination notice (Proforma at Form No. 18) should be issued and adopt the following courses:

To measure up or the whole or part of the work from which the contractor has been removed and get it completed by another contractor, the manner and method in which such work is completed shall be in the entire discretion of the Engineer whose decision shall be final.

**62.(2) Right of DFCCIL after, rescission of contract owing to default of contractor:**

In the event of any or several of the courses, referred to in sub-clause (1) of the clause, being adopted.

- (a) the contractor shall have no claim to compensation for any loss sustained by him by reason of his having purchased or procured any materials or entered into any commitments or made any advances on account of or with a view to the execution of the works or the performance of the contract and contractor shall not be entitled to recover or be paid any sum for any work thereto for actually performed under the contract unless and until the Engineer shall have certified the performance of such work and the value payable in respect thereof and the contractor shall only be entitled to be paid the value so certified.
- (b) The Engineer or the Engineer's representative shall be entitled to take possession of any materials, tools, implements, machinery and buildings on the works or on the property on which these are being or ought to have been executed, and to retain and employ the same in the further execution of the works or any part thereof until the completion of the works without the contractor being entitled to any compensation for the use and employment thereof or for wear and tear or destruction thereof.

- (c) The Engineer shall as soon as may be practicable after removal of the contractor fix and determine ex-parte or by or after reference to the parties or after such investigation or enquiries as he may consider fit to make or institute and shall certify what amount(if any) had at the time of rescission of the contract been reasonably earned by or would reasonably accrue to the contractor in respect of the work then actually done by him under the contract and what was the value of any unused, or partially used materials, any constructional plan and any temporary works upon the site. The legitimate amount due to the contractor after making necessary deductions and certified by the Engineer should be released expeditiously.

#### **STATEMENT OF DISPUTES - INDIAN RAILWAY ARBITRATION RULES**

**63.0 Matters finally determined by the DFCCIL –** All disputes and differences of any kind whatsoever arising out of or in connection with the contract, whether during the progress of the work or after its completion and whether before or after the determination of the contract, shall be referred by the contractor to the Director /General Manager/CGM, DFCCIL and the Director/General Manager/CGM, DFCCIL shall within 120 days after receipt of the contractor's representation make and notify decisions on all matters referred to by the contractor in writing provided that matter for which provision has been made in clauses 8, 18, 22.(5), 39, 43.(2), 45.(a), 55, 55A.(5), 57, 57A, 61.(1), 61.(2) and 62.(1) to (xiii)(B) of General Conditions of contract or in any special clause of the conditions of the contract shall be deemed as 'excepted matters' (matters not arbitrable) and decisions of the DFCCIL authority, thereon shall be final and binding on the contractor; provided further that 'excepted matters' shall stand specifically excluded from the purview of the arbitration clause.

#### **64. (1) Demand for Arbitration :-**

**64. (1) (i)** In the event of any dispute or difference between the parties hereto as to the construction or operation of this contract, or the respective rights and liabilities of the parties on any matter in question, dispute or difference on any account or as to the withholding by the DFCCIL of any certificate to which the contractor may claim to be entitled to, or if the DFCCIL fails to make a decision within 120 days, then and in any such case, but except in any of the 'excepted matters' referred to in clause 63 of these conditions, the contractor, after 120 days but within 180 days of his presenting his final claim on disputed matters shall demand in writing that the dispute or difference be referred to arbitration.

- 64.(1) (ii)** The demand for arbitration shall specify the matters which are in question, or subject of the dispute or difference as also the amount of claim item wise. Only such dispute or difference, in respect of which the demand has been made, together with counter claims or set off, given by the DFCCIL, shall be referred to arbitration and other matters shall not be included in the reference.
- 64.(1) (iii) (a)** The arbitration proceedings shall be assumed to have commenced from the day, a written and valid demand for arbitration is received by the DFCCIL.
- (b) The claimant shall submit his claim stating the facts supporting the claims along with all the relevant documents and the relief or remedy sought against each claim within a period of 30 days from the date of appointment of the Arbitral Tribunal.
- (c) The DFCCIL shall submit its defence statement and counter claim(s), if any, within a period of 60 days of receipt of copy of claims from Tribunal thereafter, unless otherwise extension has been granted by Tribunal.
- (d) The place of arbitration would be New Delhi/Mumbai. The decision of DFCCIL shall be final and binding.
- 64.(1) (iv)** No new claim shall be added during proceedings by either party. However, a party may amend or supplement the original claim or defence thereof during the course of arbitration proceedings subject to acceptance by Tribunal having due regard to the delay in making it.
- 64.(1) (v)** – If the contractor(s) does/do not prefer his/their specific and final claims in writing, within a period of 90 days of receiving the intimation from the DFCCIL that the final bill is ready for payment, he/they will be deemed to have waived his/their claim(s) and the DFCCIL shall be discharged and released of all liabilities under the contract in respect of these claims.
- 64.(2) Obligation During Pendency of Arbitration:–** Work under the contract shall, unless otherwise directed by the Engineer, continue during the arbitration proceedings, and no payment due or payable by the DFCCIL shall be withheld on account of such proceedings, provided, however, it shall be open for Arbitral Tribunal to consider and decide whether or not such work should continue during arbitration proceedings.

**64.(3) Appointment of arbitrator**

**64.(3)(a)(i)** In cases where the total value of all claims in question added together does not exceed Rs.25,00,000 (Rupees twenty five lakhs only), the Arbitral tribunal shall consist of a sole arbitrator nominated by the MD/DFCCIL. The sole arbitrator shall be appointed within 60 days from the day when a written and valid demand for arbitrator is received by MD/DFCCIL .

**64.(3)(a)(ii)** In cases not covered by the clause 64(3)(a)(i), the Arbitral Tribunal shall consist of a Panel of three officials, as the arbitrators. For this purpose, the DFCCIL will send a panel of more than 3 names of DFCCIL officers which may also include the name(s) of Officer(s) empanelled to work as Arbitrator to the contractor within 60 days from the day when a written and valid demand for arbitration is received by the MD/DFCCIL. Contractor will be asked to suggest to MD/DFCCIL at least 2 names out of the panel for appointment as contractor's nominee within 30 days from the date of dispatch of the request by DFCCIL. The MD/DFCCIL shall appoint at least one out of them as the contractor's nominee and will, also simultaneously appoint the balance number of arbitrators either from the panel or from outside the panel, duly indicating the 'presiding arbitrator' from amongst the 3 arbitrators so appointed. MD/DFCCIL shall complete this exercise of appointing the Arbitral Tribunal within 30 days from the receipt of the names of contractor's nominees. While nominating the arbitrators it will be necessary to ensure that one of them is from the Accounts department. An officer of selection grade of accounts department shall be considered of equal status to the officers in SA grade of other department of DFCCIL for the purpose of appointment of arbitrator.

**64.(3)(a)(iii)** If one or more of the arbitrators appointed as above refuses to act as arbitrator, withdraws from his office as arbitrator, or vacates his/their office/offices or is/are unable or unwilling to perform his functions as arbitrator for any reason whatsoever or dies or in the opinion of the MD/DFCCIL fails to act without undue delay, the MD/DFCCIL shall appoint new arbitrator/arbitrators to act in his/their place in the same manner in which the earlier arbitrator/arbitrators had been appointed. Such re-constituted tribunal may, at its discretion, proceed with the reference from the stage at which it was left by the previous arbitrator(s).

**64.(3) (a) (iv)** The arbitral Tribunal shall have power to call for such evidence by way of affidavits or otherwise as the arbitral Tribunal shall think proper, and it shall be the duty of the parties hereto to do or cause to be done all such things as may



be necessary to enable the arbitral Tribunal to make the award without any delay. The arbitral Tribunal should record day-to-day proceedings. The proceedings shall normally be conducted on the basis of documents and written statements.

- 64.(3)(a)(v)** While appointing arbitrator(s) under sub-clause (i), (ii) & (iii) above, due care shall be taken that he/they is/are not the one/those who had an opportunity to deal with the matters to which the contract relates or who in the course of his/their duties as DFCCIL servant(s) expressed views on all or any of the matters under dispute or differences. The proceedings of the arbitral Tribunal or the award made by such Tribunal will, however, not be invalid merely for the reason that one or more arbitrator had, in the course of his service, opportunity to deal with the matters to which the contract relates or who in the course of his/their duties expressed views on all or any of the matters under dispute.
- 64.(3)(b)(i)** The arbitral award shall state item wise, the sum and reasons upon which it is based. The analysis and reasons shall be detailed enough so that the award could be inferred there from.
- 64.(3)(b)(ii)** A party may apply for corrections of any computational errors, any typographical or clerical errors or any other error of similar nature occurring in the award of a tribunal and interpretation of a specific point of award to tribunal within 60 days of receipt of the award.
- 64.(3)(b)(iii)** A party may apply to tribunal within 60 days of receipt of award to make an additional award as to claims presented in the arbitral proceedings but omitted from the arbitral award.
- 64.(4)** In case of the Tribunal, comprising of three Members, any ruling on award shall be made by a majority of Members of Tribunal. In the absence of such a majority, the views of the Presiding Arbitrator shall prevail.
- 64.(5)** Where the arbitral award is for the payment of money, no interest shall be payable on whole or any part of the money for any period till the date on which the award is made.
- 64.(6)** The cost of arbitration shall be borne by the respective parties. The cost shall inter-alia include fee of the arbitrator(s), as per the rates fixed by the DFCCIL from time to time and the fee shall be borne equally by both the parties.

- 64(7)** Subject to the provisions of the aforesaid Arbitration and Conciliation Act 1996 and the rules there under and any statutory modifications thereof shall apply to the arbitration proceedings under this clause.

### **JOINT VENTURE (JV) FIRMS IN WORKS TENDERS**

- 65.0 Participation Of Joint Venture (JV) Firms In Works Tender:** This Clause shall be applicable for works tenders of value as approved and communicated by Railway Board /DFCCIL from time to time.
- 65.1** Separate identity / name shall be given to the Joint Venture Firm.
- 65.2** Number of members in a JV Firm shall not be more than three.
- 65.3** A member of JV Firm shall not be permitted to participate either in individual capacity or as a member of another JV Firm in the same tender.
- 65.4** The tender form shall be purchased and submitted only in the name of the JV Firm and not in the name of any constituent member.
- 65.5** Normally earnest money deposit (EMD) shall be submitted only in the name of Employer “Dedicated Freight Corridor Corporation of India Limited” A/C JV Firm and not in the name of constituent member. However, in exceptional cases EMD in the name of Employer “Dedicated Freight Corridor Corporation of India Limited” A/C JV Firm and not in the name of Lead Member can be accepted subject to written confirmation from JV members to the effect, that EMD submitted by the Lead Member may be deemed as EMD submitted by JV Firm.
- 65.6** One of the members of the JV Firm shall be its Lead Member who shall have a majority (at least 51%) share of interest in the JV Firm and also, must have satisfactorily completed in the last three previous financial years and the current financial year upto the date of opening of the tender, one similar single work for a minimum value of 35% of advertised tender value and as defined in technical eligibility criteria. The other members shall have a share of not less than 20% each in case of JV Firms with upto three members. In case of JV Firm with foreign member(s), the Lead Member has to be an Indian Firm with a minimum share of 51%.
- 65.7** A copy of Memorandum of Understanding (MoU) executed by the JV members shall be submitted by the JV Firm along with the tender. The complete details of

the members of the JV Firm, their share and responsibility in the JV Firm etc. particularly with reference to financial, technical and other obligations shall be furnished in the MOU. (The MOU format for this purpose is enclosed along with the tender, Form No. 9).

- 65.8** Once the tender is submitted, the MoU shall not be modified / altered / terminated during the validity of the tender. In case the tenderer fails to observe/comply with this stipulation, the full Earnest Money Deposit (EMD) shall be liable to be forfeited.
- 65.9** Approval for change of constitution of JV Firm shall be at the sole discretion of the Employer (DFCCIL). The constitution of the JV Firm shall not be allowed to be modified after submission of the tender bid by the JV Firm, except when modification becomes inevitable due to succession laws etc. and in any case the minimum eligibility criteria should not get vitiated. However, the Lead Member shall continue to be the Lead Member of the JV Firm. Failure to observe this requirement would render the offer invalid.
- 65.10** Similarly, after the contract is awarded, the constitution of JV Firm shall not be allowed to be altered during the currency of contract except when modification become inevitable due to succession laws etc. and in any case the minimum eligibility criteria should not get vitiated. Failure to observe this stipulation shall be deemed to be breach of contract with all consequential penal action as per contract conditions.
- 65.11** On award of contract to a JV Firm, a single Performance Guarantee shall be submitted by the JV Firm as per tender conditions. All the Guarantees like Performance Guarantee, Bank Guarantee for Mobilization Advance, Machinery Advance etc. shall be accepted only in the name of the JV Firm and no splitting of guarantees amongst the members of the JV Firm shall be permitted.
- 65.12** On issue of LOA (Letter Of Acceptance), an agreement among the members of the JV Firm (to whom the work has been awarded) shall be executed and got registered before the Registrar of the Companies under Companies Act or before the Registrar/Sub-Registrar under the Registration Act, 1908. This JV Agreement shall be submitted by the JV Firm to the DFCCIL before signing the contract agreement for the work. In case the tenderer fails to observe/comply with this stipulation, the full Earnest Money Deposit (EMD) shall be forfeited and other penal actions due shall be taken against partners of the JV and the JV. This Joint Venture Agreement shall have, inter-alia, following Clauses :

- 65.12.1** Joint and Several Liability - Members of the JV Firm to which the contract is awarded, shall be jointly and severally liable to the Employer (DFCCIL) for execution of the project in accordance with General and Special Conditions of Contract. The JV members shall also be liable jointly and severally for the loss, damages caused to the Railways / DFCCIL during the course of execution of the contract or due to non-execution of the contract or part thereof.
- 65.12.2** Duration of the Joint Venture Agreement - It shall be valid during the entire currency of the contract including the period of extension, if any and the defect liability period after the work is completed.
- 65.12.3** Governing Laws - The Joint Venture Agreement shall in all respect be governed by and interpreted in accordance with Indian Laws.
- 65.13** Authorized Member - Joint Venture members shall authorize one of the members on behalf of the Joint Venture Firm to deal with the tender, sign the agreement or enter into contract in respect of the said tender, to receive payment, to witness joint measurement of work done, to sign measurement books and similar such action in respect of the said Tender/contract. All notices/correspondences with respect to the contract would be sent only to this authorized member of the JV Firm.
- 65.14** No member of the Joint Venture Firm shall have the right to assign or transfer the interest right or liability in the contract without the written consent of the other members and that of the employer (DFCCIL) in respect of the said tender/contract.
- 65.15** Documents to be enclosed by the JV Firm along with the tender:
- 65.15.1** In case one or more of the members of the JV Firm is/are partnership firm(s), following documents shall be submitted:
- (a) Notary certified copy of the Partnership Deed,
  - (b) Consent of all the partners to enter into the Joint Venture Agreement on a stamp paper of appropriate value (in original).
  - (c) Power of Attorney (duly registered as per prevailing law) in favour of one of the partners of the partnership firm to sign the JV Agreement on behalf of the partnership firm and create liability against the firm.

**65.15.2** In case one or more members is/are Proprietary Firm or HUF, the following documents shall be enclosed:

Affidavit on Stamp Paper of appropriate value declaring that his/her Concern is a Proprietary Concern and he/she is sole proprietor of the Concern OR he/she is in position of "KARTA" of Hindu Undivided Family (HUF) and he/she has the authority, power and consent given by other partners to act on behalf of HUF.

**65.15.3** In case one or more members is/are limited companies, the following documents shall be submitted:

- (a) Notary certified copy of resolutions of the Directors of the Company, permitting the company to enter into a JV agreement, authorizing MD or one of the Directors or Managers of the Company to sign JV Agreement, such other documents required to be signed on behalf of the Company and enter into liability against the company and/or do any other act on behalf of the company.
- (b) Copy of Memorandum and Articles of Association of the Company.
- (c) Power of Attorney (duly registered as per prevailing law) by the Company authorizing the person to do/act mentioned in the para (a) above.

**65.15.4 Deleted**

**65.16 Credentials & Qualifying Criteria :** Technical and financial eligibility of the JV Firm shall be adjudged based on satisfactory fulfillment of the following criteria :

**65.16.1 Technical Eligibility Criteria :** As defined in Preamble and General Instructions to tenderers.

**65.16.2 Financial Eligibility Criteria :** As defined in Preamble and General Instructions to tenderers.

# **PRE CONTRACT INTEGRITY PACT CHAPTER IV (B)**

**PART-I**  
**CHAPTER IV (B)**

**Annexure – I**

**PRE CONTRACT INTEGRITY PACT**

**1.4.1 General**

This pre-bid pre-contract Agreement (hereinafter called the Integrity Pact) is made on \_\_\_\_\_ day of the month of \_\_\_\_\_ 2020, between, on one hand, the DFCCIL acting through Shri \_\_\_\_\_ Designation of the officer, (hereinafter called the CLIENT, which expression shall mean and include, unless the context otherwise requires, his successors in office and assigns) of the First Part and M/s \_\_\_\_\_ represented by Shri \_\_\_\_\_, Chief Executive Officer (hereinafter called the “BIDDER/SELLER” which expression shall mean and include, unless the context otherwise requires, his successors and permitted assigns) of the Second part.

WHEREAS the CLIENT proposes to procure (Name of the Stores/Equipment/Item, Name of the Consultancy Service, Name of works Contract, Name of Services) and the [A] is willing to offer/has offered for stores or works.

WHEREAS the [A] is a private company/public company/Government undertaking/partnership/ registered export agency, constituted in accordance with the relevant law in the matter and the CLIENT is a PSU performing its functions on behalf of the President of India.

NOW, THEREFOR,

To avoid all forms of corruption by following a system that is fair, transparent and free from any influence/prejudiced dealings prior to, during and subsequent to the currency of the contract to be entered into with a view to:-

Enabling the CLIENT to obtain the desired said (Name of the Stores/Equipment/Items, Name of the Consultancy Service, Name of Works Contract, Name of Services) at a

competitive price in conformity with the defined specifications by avoiding the high cost and the distortionary impact of corruption on public procurement, and

Enabling BIDDERS to abstain from bribing or including in any corrupt practice in order to secure [B] by providing assurance to them that their competitors will also abstain from bribing and other corrupt practices and the CLIENT will commit to prevent corruption, in any form, by its officials by following transparent procedures.

The parties hereto hereby agree to enter into Integrity Pact and agree as follows:

### **Commitments of the CLIENT**

- 1.1 The CLIENT undertakes that no official of the CLIENT, connected directly or indirectly with the [B], will demand, take a promise for or accept, directly or through intermediaries, any bribe, consideration, gift, reward, favour or any material or immaterial benefits or any other advantage from the [A] either for themselves or for any person, organization or third party related to the [B], in exchange for the advantage in the bidding process, bid evaluation, contracting or implementation process related to the [B].
  - 1.2 The CLIENT will, during the pre-contract stage, treat all BIDDERS alike, and will provide to all BIDDERS the same information and will not provide any such information to any particular BIDDER which could afford an advantage to that particular[A] in comparison to other BIDDERS.
  - 1.3 All the officials of the CLIENT will report to the appropriate Government office any attempted or completed breaches of the above commitments as well as any substantial suspicion of such a breach.
2. In case any such preceding misconduct on the part of such official (s) is reported by the [A] to the CLIENT with full and verifiable facts and the same is prima facie found to be correct by the CLIENT, necessary disciplinary proceedings, or any other action as deemed fit, including criminal proceedings may be initiated by the CLIENT and such a person shall be debarred from further dealings related to the [B] process. IN such a case while an enquiry is being conducted by the CLIENT the proceedings under the [B] would not be stalled.

### **Commitments of BIDDERS**



3. The [A] commits itself to take all measures necessary to prevent corrupt practices, unfair means and illegal activities during any stage of its bid or during any pre-contract or post-contract stage in order to secure the [B] contract or in furtherance to secure it and in particular commit itself to the following:-
- 3.1 The [A] will not offer, directly or through intermediaries any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any official of the CLIENT, conducted directly or indirectly with the bidding process, or to any person, organisation or third party related to the [B] in exchange for any advantage in the bidding, evaluation, contracting and implementation of the [B].
- 3.2 The [A] further undertakes that it has not given, offered or promised to give, directly or indirectly any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any official of the CLIENT or otherwise in procuring the Contract or forbearing to do or having done any act in relation to the obtaining or execution of the [B] or any other [B] with the Government for showing or forbearing to show favour or disfavour to any person in relation to the [B] or any other [B] with the Government.
- 3.3 [A] shall disclose the name and address of agents and representatives and Indian [A] shall disclose their foreign principals or associates.
- 3.4 [A] shall disclose the payments to be made by them to agents/brokers or any other intermediary, in connection with this bid/document.
- 3.5 The [A] further confirms and declares to the CLIENT that the [A] is the original manufacturer/integrator/authorized government sponsored export entity of the defence stores and has not engaged any individual or firm or company whether Indian or foreign to intercede, facilitate or in any way to recommend to the CLIENT or any of its functionaries, whether officially or unofficially to the award of the [B] to the [A] nor has any amount been paid, promised or intended to be paid to any such individual, firm or company in respect of any such intercession, facilitation or recommendation.
- 3.6 The [A] either while presenting the bid or pre-contract negotiations or before signing the [B] shall disclose any payments he has made, is committed to or intends to make to officials of the CLIENT or their family members, agents, brokers or any other intermediaries in connection with the [B] and the details of services agreed upon for such payments.
- 3.7 The [A] will not collude with other parties interested in the [b] to impair the transparency, fairness and progress of the bidding process, bid evaluation, contracting and implementation of the [B].

- 3.8 The [A] will not accept any advantage in exchange for any corrupt practice, unfair means and illegal activities.
- 3.9 The [A] shall not use improperly, for purposes of competition or personal gain, or pass on to others, any information provided by the CLIENT as part of the business relationship, regarding plans, technical proposals and business details, including information contained in any electronic data carrier. The [A] also undertakes to exercise due and adequate care lest any such information is divulged.
- 3.10 The [A] commits to refrain from giving any complaint directly or through any other manner without supporting it with full and verifiable facts.
- 3.11 The [A] shall not instigate or cause to instigate any third person to commit any of the actions mentioned above.
- 3.12 If the [A] or any employee of the [A] or any person acting on behalf of the [A], either directly or indirectly, is a relative of any of the officers of the CLIENT, or alternatively, if any relative of an officer of the CLIENT has financial interest/stake in the BIDDERS firm, the same shall be disclosed by the [A] at the time of filling of tender.

The term 'relative' for this purpose would be as defined in section 6 of the Companies Act 1956.

- 3.13 The [A] shall not lend to or borrow any money from or enter into any monetary dealings or transactions, directly or indirectly, with any employee of the CLIENT.

#### 4. **Previous Transaction:**

- 4.1 The [A] declares that no previous transgression occurred in the last three years immediately before signing of this Integrity Pact, with any other company in any country in respect of any corrupt practices envisaged hereunder or with any Public Sector Enterprise in India or any Government Department in India that could justify BIDDERS exclusion from the tender process.
- 4.2 The [A] agrees that if it makes incorrect statement on this subject, [A] can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason.

#### 5. **Earnest Money (Security Deposit)**

- 5.1 While submitting commercial bid, the [A] shall deposit an amount \_\_\_\_\_ (to be specified in RFP) as Earnest Money/Security Deposit, with the CLIENT through any of the following instruments:
- (i) Bank Draft or a Pay Order in favour of \_\_\_\_\_
  - (ii) A confirmed guarantee by an Indian Nationalized Bank, promising payment of the guaranteed sum of the CLIENT on demand within three working days without any demur whatsoever and without seeking any reasons whatsoever. The demand for payment by the CLIENT shall be treated as conclusive proof or payment.
  - (iii) Any other mode or through any other instrument (to be specified in the RFP)
- 5.2 The Earnest Money/Security Deposit shall be valid up to a period of five years or the complete conclusion of the contractual obligations to the complete satisfaction of both the BIDDER and the CLIENT, including warranty period, whichever is later.
- 5.3 In case of the successful [A] a clause would also be incorporated in the Article pertaining to Performance Guarantee in the [B] that the provisions of Sanction for Violation shall be applicable for forfeiture of Performance Bond in case of a decision by the CLIENT to forfeit the same without assigning any reason for imposing sanction for violation of this pact.
- 5.4 No interest shall be payable by the CLIENT to the [A] on Earnest Money/Security Deposit for the period of its currency.

6. **Sanctions for Violations:**

- 6.1 Any breach of the aforesaid provisions by the [A] or any one employed by it or acting on its behalf (whether with or without the knowledge of the [A]) shall entitle the CLIENT to take all or any one or the following actions, wherever required.
- (i) To immediately call off the pre-contract negotiations without assigning any reason or giving any compensation to the [A]. However, the proceedings with the BIDDER(s) would continue.
  - (ii) The Earnest Money Deposit (in pre-contract stage) and /or Security Deposit/performance Bond (after the [B] is signed) shall stand forfeited fully and the CLIENT shall not be required to assign any reason therefore.
  - (iii) To immediately cancel the [B], if already signed, without giving any compensation to the [A].
  - (iv) To recover all sums already paid by the CLIENT, and in case of an Indian [A] with interest thereon at 2% higher than the prevailing Prime

Lending Rate of State Bank of India, while in case of a [A] from the country other than LIBOR. If any outstanding payment is due to the [A] from the CLIENT in connection with any other [B], such outstanding payment could also be utilized to recover the aforesaid sum and interest.

- (v) To encash the advance bank guarantee and performance bond/warranty bond, if furnished by the [A], in order to recover the payments, already made by the CLIENT, along with interest.
  - (vi) To cancel all or any other Contracts with the [A]. The [A] shall be liable to pay compensation for any loss or damage to the CLIENT resulting from such cancellation/ rescission and the CLIENT shall be entitled to deduct the amount so payable from the money(s) due to the [A].
  - (vii) To debar the [A] from participating in future bidding processes of the Government of India for a minimum period of five years, which may be further extended at the discretion of the CLIENT.
  - (viii) To recover all sums paid in violation of this Pact by [A] to any middleman or agent or broker with a view to securing [B] the contract.
  - (ix) In cases where irrevocable Letters of Credit have been received in respect of any [B] signed by the CLIENT with the [A], the same shall not be opened.
  - (x) Forfeiture of Performance Bond in case of a decision by the CLIENT to forfeit the same without assigning any reason for imposing sanction for violation of this pact.
- 6.2 The CLIENT will entitled to take all or any of the actions mentioned at para 6.1(i) to (x) of this Pact also on the Commission by the [A] or any one employed by it or acting on its behalf (whether with or without the knowledge of the [A], of an offence as defined in chapter IX of the Indian Penal Code, 1860 or Prevention of Corruption Act, 1988 or any other stature enacted for prevention of corruption.
- 6.3 The decision of the CLIENT to the effect that a breach of the provisions of this Pact has been committed by the [A] shall be final and conclusive on the [A]. However, the [A] can approach the independent Monitor(s) appointed for the purposes of this Pact.

## 7. **Fall Clause**

- 7.1 The [A] undertakes that it has not supplied /is not supplying similar product/system or sub systems at a price lower than that offered in the

present bid in respect of any other Ministry/Department of the Government of the India or PSU and if it is found at any stage that similar product/ systems or sub systems was supplied by the [A] to any other Ministry/ Department of the Government India or a PSU at a lower price, then that very price, with due allowance for elapsed time, will be applicable to the present case and the difference in the cost would be refunded by the [A] to the CLIENT, if the [B] has already been concluded.

## 8. **Independent Monitors**

- 8.1 The CLIENT has appointed Independent Monitors (hereinafter referred to as Monitors) for this Pact in consultant with the Central Vigilance Commission (Names and Addresses of the Monitors to be given).
- 8.2 The task of the Monitors shall be to review independently and objectively, whether and to what extent the parties comply with the obligations under this pact.
- 8.3 The monitors shall not be subject to instructions by the representatives of the parties and perform their functions neutrally and independently.
- 8.4 Both the parties accept that the Monitors have the right to access all the documents relating to the project/ procurement, including minutes of meetings.
- 8.5 As soon as the Monitor notices, or has reason to believe, a violation of this Pact, he will so inform the Authority designed by the CLIENT.
- 8.6 The BIDDER(s) accepts that the Monitors has the right to access without restriction to all project documentation of the CLIENT including that provided by the BIDDER. The [A] will also grant the Monitor, upon his request and demonstration of a valid interest, unrestricted and unconditional access to his project documentation. The same is applicable to Subcontractors. The Monitor shall be under contractual obligation to that treat the information and documents of the [A] with confidentiality.
- 8.7 The CLIENT will provide to the Monitor sufficient information about all meetings among the parties related to the Project provided such meetings could have an impact on the contractual relations between the parties. The parties will offer to the Monitor the option to participate in such meetings.
- 8.8 The Monitor will submit a written report to the MD/DFCCIL within 8 to 10 weeks from the date of reference or intimation to him by the CLIENT/BIDDER and, should the occasion arise, submit proposals for correcting problematic situations.

9. **Facilitation of Investigation**

In case of any allegation of violation of any provisions of this Pact of payment of commission, the CLIENT or its agencies shall be entitled to examine all the documents including the Books of Accounts of the [A] and the [A] shall provide necessary information and documents in English and shall extend all possible help for the purpose of such examination.

10. **Law and Place of Jurisdiction**

This Pact is subject to Indian Law. The place of performance and jurisdiction is the seat of the CLIENT.

11. **Other Legal Actions**

The action stipulated in this Integrity Pact is without prejudice to any other legal action that may follow in accordance with the provisions of the extant law in force relating to any civil or criminal proceedings.

12. Validity

12.1 The validity of this Integrity Pact shall be from date of its signing and extend upto 5 years or the complete execution of the [B] to the satisfaction of both the CLIENT and the [A], including warranty period, whichever is later. In case [A] is unsuccessful, this Integrity Pact shall expire after six months from the date of the signing of the [B].

12.2 Should one or several provisions of this pact turn out to be invalid; the remainder of this Pact shall remain valid. In this case, the parties will strive to come to an agreement to their original intentions.

13. The parties hereby sign this Integrity Pact at \_\_\_\_\_ on

**CLEINT**  
**Name of the Officer**  
**Designation**  
**Deptt. /Ministry/ PSU**

**BIDDER**  
**CHIEF EXECUTIVE OFFICER**

**Witness**

1. \_\_\_\_\_

2. \_\_\_\_\_

**Witness**

1. \_\_\_\_\_

2. \_\_\_\_\_

# **SPECIAL CONDITIONS OF CONTRACT (CHAPTER V)**

## **PART - I**

### **CHAPTER V**

#### **SPECIAL CONDITIONS OF CONTRACT**

- 1.5.1** This Tender shall be governed by Preamble and General instructions to tenderers, General condition of Contract, Special conditions of contract, Technical Specifications, Additional Technical specifications (if any), Drawings, Forms, Annexures, etc.
- 1.5.2** If there are varying or conflicting provisions in the documents forming part of the contract, Engineer shall be deciding authority with regard to the intentions of the provision and decision of Engineer will be final and binding on the contractor.
- 1.5.3** **Scheme of work:-** Within a period of 30 days beginning from the date of issue of Letter of Acceptance of Tender, the Contractor shall submit the detailed time schedule for execution of work and various documents enumerated in tender papers to the employer.
- 1.5.4** **Quality Assurance Plan for Substructure and foundation**
- All materials used in the work shall be of the best quality as per codes. Quality Assurance Plan shall include for materials used and for workmanship of work. The contractor shall submit Quality Assurance Plan for the substructure and foundation. The contractor shall also ensure that the Employer's prescribed Quality Assurance Standards are rigidly followed in for the construction of substructure and foundation. These are to be approved from the client / DFCCIL
- 1.5.5** **Quality Assurance Plan for Superstructure including bearings**
- (a) All materials used in the work shall be of the best quality as per codes / Specifications for fabrication and erection of steel girder bridges (B1-2001) amended till date. Quality Assurance Plan shall include for materials used and for workmanship of work. Quality Assurance Plan shall also be prepared for erection of girder and casting of deck slab. The contractor shall submit Quality Assurance Plan for the superstructure and bearing. The contractor shall also ensure that the Employer's prescribed Quality Assurance Standards are rigidly followed for the construction of superstructure including bearing. Since, the superstructure is



Composite girder. Quality Assurance Plan shall be in line with Quality Assurance plans prepared by RDSO for Open Web Girder and POT & POT-PTFE bearings. These plans are to be approved from the DFCCIL.

- (b) The contractor shall ensure quality at all necessary points, whether at manufacturer's works, or in his depot or at work site as well as during erection through Quality Assurance Plan.
- (c) The Contractor shall adopt a suitable Quality Assurance Programme according to approved instructions, drawings, specifications, etc.
- (d) The erection scheme of composite girder shall be approved by DFCCIL before start of erection of girder.
- (e) Fabrication of composite girder will be inspected by DFCCIL's Engineer in Charge / RDSO / PMC's representative.

**1.5.6 Expenses of Employer' Representative** – All the expenses of Engineer's representative shall be borne by the Employer whether the inspected material is finally utilised in work or not.

**1.5.7** The decision of the Engineer shall be final in respect of acceptability or otherwise of any material, fittings, component or equipment required for the work.

**1.5.8** This programme of the Contractor shall generally cover the followings: -

**1.5.8.1** The organization to manage and implement the Quality Assurance programme.

**1.5.8.2** The documentation control system:

- (i) Basic control system.
- (ii) Adopted at manufacturer's work
- (iii) Adopted at the Contractor Depot and work site.

**1.5.8.3.** Procedure adopted for:

- (i) Source Inspection.
- (ii) Incoming raw material inspection.
- (iii) Verification of material purchased.

- (iv) Fabrication Controls.
- (v) Site erection controls.

**1.5.8.4** Inspection and Test Procedure for:

- (i) Manufacture and quality control procedure.
- (ii) Field activity.

**1.5.8.5** System of handling and storage.

**1.5.8.6** System of quality audit.

**1.5.8.7** System of maintenance of records.

**1.5.8.8** For the purpose of obtaining 'On Account Payment', the Contractor shall submit along with the invoice, the documents indicated in the prescribed quality Assurance standards which should inter alia cover the following as may be applicable in each case.

- (i) Material test reports on raw materials used.
- (ii) Material type and routine test report on components specification.
- (iii) Inspection Plan with reports of the inspection Plan check points.
- (iv) Routine test report.
- (v) Factory test results as required under the specification.
- (vi) Quality audit report including test check report of Employer's representative if any.

**1.5.9 Traffic Blocks / Power Blocks / Shut Down:**

- (a)** The contractor shall obtain Power / Traffic / Shut down in the name of authorized representative of DFCCIL. Engineer/Engineer's representative will facilitate to make arrangements to obtain power blocks / shutdown (hereinafter referred to as blocks) for works to be carried out along or adjacent to the track work. Works such as foundations of abutments/piers shall generally be done without blocks. However if block is required due to safety considerations, the construction shall be done under block. The requirement of shut down, power blocks etc. shall be assessed by the contractor and will be submitted to the Engineer/Engineer's representative. All the erection of girders etc. shall be done under minimum power block/shut down. Contractor will arrange minimum two gangs of labours i.e. expert of TR line fitters, Semi skilled fitters, labours etc. with

supervisors and sufficient tools and tackles required as per site conditions. Work will be done day & night with war foot level with the approval of the Engineer/Engineer's representative. Block will be provided for each ROB individually.

- (b) Blocks will be granted during day & night hours continuous. The Contractor shall confirm that he will equip himself to carry out all construction during night blocks efficiently by suitable special lighting equipment without any extra cost.
- (c) Block period shall be counted from the time the TR-line is placed at the Contractor's disposal at the work-spot till it is cleared by the Contractor.
- (d) Blocks will be subject to normal operating conditions and rules of the Railway. All formalities of exchanging private number etc. with the traffic control/traction power controller will be carried out by the Engineer staff and for this purpose the Engineer will depute a representative for each ROB, who will be responsible for imposing power blocks/shut down and also removing the same after men, material and equipment have been cleared by the Contractor from running tracks and the same declared safe for traffic by Engineer/Engineer's representative in case of works involving safety of running tracks.
- (e) The works required to be done under traffic block shall be carried out only in the presence of DFCCIL officials. The Railway supervisor shall certify safe conditions for passage of trains before resumption of traffic. The works to be done under traffic block shall be carried out under the provision of banner flag and protection of engineering flagman.
- (f) Any charges which may be levied by IR on account of "Possessions" shall be payable by the contractor but shall be reimbursed by the Employer. However penalties, if any, levied by Indian Railways caused due to any careless working or otherwise of violation of the Terms and Conditions of the track block, shall be payable by the contractor.

#### **1.5.10 Work By Other Agencies**

- (a) Any other works undertaken at the same time by the Engineer direct or through some other agency at the same time or section where the contractor is carrying out his work will not entitle the contractor to prefer any

claim regarding any delays or hindrances he may have to face on this account but the Employer shall grant a reasonable extension of time to the contractor. The contractor shall comply with any instruction which may be given to him by the Employer in order to permit simultaneous execution of his own works and those undertaken by other contractors or the DFCCIL without being entitled on this account on any extra charge.

- (b) The contractor shall not be entitled to any extra payment due to hindrance resulting from normal Railway operations, such as delay on account of adequate number of and duration of blocks not being granted, operational delay in movement of work trains extension of time to the contractor.

#### **1.5.11 Infringement of patents:**

- (a) The Contractor is forbidden to use any patents or registered drawings, process or pattern in fulfilling his contract without the previous consent in writing of the owner of such patent, drawing, pattern or trade mark, except where these are specified by the Employer himself. Royalties where payable for the use of such patented processes, registered drawings of patterns shall be borne exclusively by the Contractor. The contractor shall advise the Employer of any proprietary right that may exist on such processed drawings or patterns which he may use of his own accord.
- (b) In the case of patent taken out by the Contractor of the drawings or patterns registered by him, or of those patents, drawings, or patents for which he holds a licence, the signing of the Contract automatically gives the Employer the right to repair by himself the purchased articles covered by the patent or by any person or body chosen by him and to obtain from any sources he desires the component parts required by him in carrying out the repair work. In the event of infringement of any patent rights due to above action of the Employer, he shall be entitled to claim damages from the contractor on the grounds of any loss of any nature which he may suffer e.g. in the case of attachment because of counterfeiting.
- (a) **Indemnification by contractor:-** In the event of any claim or demand being made or action being brought against the Employer for infringement of later patent in respect of any equipment, machine, plant, work or thing used or supplied by the Contractor under this contract or in respect of any methods of using or working by the Employer of such equipment machine, plant work

or thing, the contractor shall indemnify the employer and keep him indemnified and harmless against all claims, costs, charges and expenses arising from or incurred by reason of such claim provided that the Employer shall notify the contractor immediately any claim is made and that the contractor shall be at liberty, if he so desires with the assistance of the Employer if required but at the Contractor's expense, to conduct all negotiations for the settlement of the same or any litigation that may arise there from and provided that no such equipment, machine, plant work or thing, shall be used by the Employer for any purpose or in any manner other than that for which they have been supplied by the Contractor and specified under this contract.

#### **1.5.12 Insurance:-**

Before commencing of works, it shall be obligatory for the contractor to obtain, at his own cost, insurance cover in the joint name of the contractor and employer from reputed companies under the following requirements:

- (a)** Liability for death of or injury to any person/ employer's staff / animals or things or loss of or damage to any property / things / the work of other contractor (other than the work) arising out of the performance of the Contract.
- (b)** Construction Plant, Machinery and equipment brought to site by the Contractor.
- (c)** Any other insurance cover as may be required by the law of the land.

The contractor shall provide evidence to the employer / Engineer before commencement of work at site that the insurances required under the contract have been effected and shall within 60 days of the commencement date, provide the insurance policies to the Employer/Engineer, the contractor shall, whenever, called upon, produce to the engineer or his representative the evidence of payment of premiums paid by him to ensure that the policies indeed continue to be in force.

The Contractor shall also obtain any additional insurance cover as per the requirements of the Contract.

The Employer/Engineer shall not be liable for or in respect of any damages or compensation payable to any workman or other person in the employment of the Contractor or his sub-contractor or petty contractor / other contractor working there. The Contractor shall indemnify and keep indemnified the employer / Engineer against all such damages and compensation for which the contractor is liable.

The Policies of the contractor shall remain in force throughout the period of execution of the works and till the expiry of the defect liability period except for any specific insurance covers necessary for shorter period.

If the Contractor fails to effect or keep in force or provide adequate cover as acceptable to the engineer in the insurance policies mentioned above, then in such cases, the engineer may effect and keep in force any such insurance or further insurance on behalf of the Contractor. The recovery shall be made at the rate of 1.5 times the premium/premiums paid by the engineer in this regard from the payment due to the Contractor or from the contractor's Performance security. However, the Contractor shall not be absolved from his responsibility and /or liability in this regard.

#### **1.5.13 Accident:-**

- (a)** The contractor shall, in respect of all staff engaged by him or by his sub-contractor, indemnify and keep the employer at all times indemnified and protected against all claims made and liabilities incurred under Workman's Compensation Act, the Factories Act and the Payment of Wages Act, and rules made there under from time to time or under any other labour and Industrial Legislation made from time to time.
- (b)** The contractor shall indemnify and keep the employer indemnified and harmless against all actions, suits, claim demands, costs, charges or expenses arising in connection with any death or injury sustained by any person or persons sustained due to the acts or omission of the contractor, his sub-contractors, his agents or his staff during the executions of this contract irrespective of whether such liability arises under the Workman's Compensation Act, or Fatal Accident Act or any other statute in force for the time being.
- (c)** The contractor's liability to meet third party claims of the type outlined above will be applicable only in cases where accidents have been caused by workmanship, material, execution or negligence on the part of the

contractor and further the liability of the contractor will be limited to Rs.5 lakh for any one accident.

- (d) The contractor shall be responsible for all repairs and rectification of damages to completed works or works under execution due to DFCCIL accidents, thefts, pilferage or any other cause, without delay to minimize or to avoid traffic detentions, in a section until the installation are provisionally handed over to the employer.

#### **1.5.14 Safety Measures:-**

- (a) The contractor shall take all precautionary measures in order to ensure the protection of his own personnel moving about or working on the railway premises, but shall then conform to the rules and regulations of the Railway if and when, in the course of the work there is likely to be any danger to persons in the employment of the contractor due to running traffic while working in the Railway siding and premises, the contractor shall provide flagman or look out men for protection of such persons. The employer shall remain indemnified by the contractor in the event of any accident occurring in the normal course of work, arising out of the failure of contractor or his men to exercise reasonable precaution at all places of work.
- (b) Blasting of rocks for foundation work shall be done only after due notice is given to the employer and time/s and date /s for blasting operations agreed to by the employer. Blasting, if required to be done in the vicinity of the track, shall not be undertaken until the Employer's flagmen on duty take necessary step to protect trains and the track is adequately protected by the contractor against damage by blasted rock. The contractor shall follow detailed instructions which will be issued to him regarding blasting operations in the vicinity of tracks.
- (c) The contractor shall abide by all Railway regulations in force for the time being and ensure that the same are followed by his representatives, Agents or sub-contractors or workmen. He shall give due notice to his employees and workers about provision of this para.
- (d) The works must be carried out most carefully without any infringement of the Indian Railway Act or the General and Subsidiary Rules in force on

the Railway, in such a way that they do not hinder Railway operation or affect the proper functioning of or damage any DFCCIL equipment, structure or rolling stock except as agreed to by the employer, provided that all damage and disfiguration caused by the contractor at his own cost failing which cost of such repairs shall be recovered from the contractor.

- (b) If safety of track or track drainage etc. is affected as a consequence of works undertaken by the contractor, the contractor shall take immediate steps to restore normal conditions. In case of delay, the employer shall, after giving due notice to the contractor in writing, take necessary steps and recover the costs from the contractor.

#### **1.5.15 Guarantee / Defect Liability Period:-**

- (a) The Contractor shall guarantee that all the works executed under this contract shall be free from all defects and faults in material, workmanship and manufacture and shall be of acceptable standards for the contracted work and in full conformity with the technical specifications, drawings and other contract stipulations, **for a period of 6 months from the date of taking over by the Employer**
- (b) During the period of guarantee the Contractor shall keep available an experienced engineer / man power to attend to any defective works / installations resulting from defective erection and/or defect in the installation supplied by the Contractor. This engineer shall not attend to rectification of defects which arise out of normal wear and tear and come within the purview of routine maintenance work. The contractor shall bear the cost of modifications, additions or substitutions that may be considered necessary due to faulty materials or workmanship for the satisfactory working of the equipment. The final decision shall rest with the Engineer his successor(s)/Nominee.
- (c) During the period of Guarantee the Contractor shall be liable for the replacement at site of any parts which may be found defective in the executed work whether such parts / structural elements of his own manufacture or those of his sub-contractor / supplier whether arising from faulty materials, workmanship or negligence in any manner on the part of the Contractor provided always that such defective parts as are not repairable at site are promptly returned to the Contractor if so required by him at his (Contractor's) own expenses. In case of parts of



executed work detected during guarantee period, contractor should replace all such items irrespective of the fact whether all such items have failed or not. The Contractor shall bear the cost of repairs carried out on his behalf by the Employer at site. In such a case, the contractor shall be informed in advance of the works proposed to be carried out by the Employer.

- (d) If it becomes necessary for the Contractor to replace or renew any defective portion of the structural elements until the expiration of six month from the date of such replacement or renewal or until the end of the above mentioned period whichever is later.

Such extension shall not apply in case of defects of a minor nature, the decision of the General Manager/ROB, /CGM or his successor/nominee being final in the matter. If any defect be not remedied within a reasonable time during the aforesaid period the Employer may proceed to do work at the Contractor's risk and expense, but without prejudice to any other rights and remedies which the Employer may have against the Contractor in respect of such defects or faults.

- (e) The repaired or renewal parts structure shall be delivered / supplied and erected / executed on site free of charge to the employer.
- (f) Any materials, fittings, components or equipment's / structure supplied under items for supplying / providing and fixing in schedule shall also be covered by the provisions of this paragraph. The liability of the Contractor under the guarantee will be limited to re-supply of components / structure installation and fittings.

#### **1.5.16 Final Acceptance:-**

- (a) The final acceptance of the entire work executed shall take effect from the date of expiry of the period of guarantee / Defect Liability period as defined in paragraph 1.5.15 above of the expiry of the last of the respective periods of guarantee of various ROB's, provided in any case that the Contractor has complied fully with his obligations under clause 1.5.15 in respect of each ROB, provided also that the attention has been paid by way of maintenance by the Employer.
- (b) If on the other hand the contractor has not so complied with his

obligation under Para 1.5.15 above in respect of any work, the Employer may either extend the period of guarantee in respect of that work until the necessary works are carried out by the Contractor or carry out those works or get them carried out suo moto on behalf of the Contractor at the Contractor's expenses. After expiry of the period of guarantee for each work, a certificate of final acceptance for the section shall be issued by the Employer and the last of such certificate will be called the last and final acceptance certificate. The contract shall not be considered as completed until the issue of final acceptance certificate by the Employer.

- (c) The Employer shall not be liable to the Contractor for any matter arising out of or in connection with the contract or execution of the work unless the Contractor shall have made a claim in writing in respect thereof before the issue of final acceptance certificate under this clause.

Notwithstanding the issue of final acceptance certificate the Contractor and the Employer (subject to sub-clause as above) shall remain liable for fulfilment of any obligation incurred under the provision of the contract prior to the issue of final acceptance certificate which remains unperformed at the time such certificate is issued and for determining the nature and extent of such obligation the contract shall be deemed to remain in force between the parties hereto.

#### **1.5.17 Payment:-**

Payment will be governed by the terms specified in Part-I, Chapter IV and in accordance with accepted schedule of prices, read with relevant para of the other parts and Chapters of the Tender Papers. The employer retains the right to withhold money due to the contractor arising out of this contract for any default of the contractor .

- (i) The Contractor shall, whenever required, produce or cause to be produced for examination by the Employer any quotation / invoice, cost of other account, book of account, voucher, receipt letter, memorandum paper or writing or any copy of or extract from any such document and also furnish information and returns verified in such manner as may be required in anyway relating to the execution of this contract or relevant for verifying or ascertaining the cost of the execution of this Contract (the decision of the employer on the question of relevancy of any documents, information or

return being final and binding on the parties). The Contractor shall similarly produce vouchers etc., if required, to prove to the Employer that materials supplied by him are in accordance with the specifications laid down in the contract.

- (ii) If any portion of the work be carried out by a sub-contractor or any subsidiary or allied firm or company the Employer shall have power to secure the books of such sub-contractor or any subsidiary or allied firm or company, through the Contractor, and such books shall be open to his inspection. The Contractor should seek prior permission from the employer for subletting whole and/or part of the work to any sub-contractor.
- (iii) The obligations imposed by sub-clause (i) and (ii) above are without prejudice to the obligation of the Contractor under any statute, rules or order binding to the Contractor or other conditions of the contract.
- (iv) It is an agreed term of the contract that the employer reserves the right to carry out post-payment Audit and/or technical examination of the works and the final bill, including all supporting vouchers, abstracts etc. and to make a claim on the Contractor for the refund of any excess amount paid to him if as a result of such examination any over payment to him is discovered to have been made in respect of any work done or alleged to have been done by him under the contract.

**1.5.18** All payments in respect of the contract during the currency of the contract shall be made through Electronic Clearing System (ECS) / National Electronic Funds Transfer (NEFT/RTGS). The successful tenderer on award of contract must submit ECS/NEFT/RTGS Mandate Form complete in all respects as detailed at Form No. 8 of the tender document. However, if the facility of ECS/NEFT/RTGS is not available at a particular location, the payments shall be made by cheque.

**1.5.19 Performance Guarantee:-**

- (i) The Bank Guarantee for performance Guarantee shall remain valid until a date 60 days (or as specified in the Contract) after expiry of Defects Liability Period.
- (ii) The Bank Guarantee for performance Guarantee shall be submitted invariably in the format given in the bidding document.

- (iii) The performance Guarantee shall be released 21 days after issue of performance certificate.

**1.5.20 Mobilization Advance:-** (Applicable for Advertised tender of value more than Rs. 25.00 crore)

- (a) The Tenderer/Contractor may be granted a recoverable interest bearing mobilization advance upto 10% of the contract value provided mobilization advance is admissible as per the tender conditions and he specifically applies for it while tendering. If the tenderer fails to apply specifically for Mobilization Advance while giving his offer at the tendering stage in case where grant of Mobilization Advance is permissible, no subsequent requests from him for grant of this advance will be entertained. The rate of interest is 4.5% per annum above the Base Rate of State Bank of India, as effective on the date of approval of payment of Mobilization Advance by the competent authority.
- (b) The advance will be granted in two instalments viz., 5% of the contract value on signing of the contract agreement and the balance 5% on Mobilization of site establishment, setting up offices, bringing in equipment and actual commencing of work. Each instalment will be released on submission of a security in a form acceptable to the DFCCIL (similar to Performance Guarantee notified in Clause 16.(4) (b) of General conditions of contract for the amount of the at least 110% of the value of the sanctioned advance amount covering instalment together with interest charges calculated upto the end of the contract period. The tenderer who seeks Mobilization Advance should be specific about the course of action proposed to be followed in producing the security to the satisfaction of the Railway. Each security should be at least not less than one lakh rupees. These securities shall be returned as and when the value of the advance plus interest is recovered from the running bill.
- (c) The recovery of the advance and interest thereon will be made through the every on account bills, pro-rata, commencing from the time the value of the work executed under the contract reaches 15% of the contract value and completed when the value of the work executed under the contract reaches 85% of the contract value or assessed value whichever is less.

- (d)** The Mobilization Advance granted shall be returned back to the DFCCIL in case the work is not completed in the original contract completion period.
- (e)** The Bank Guarantee shall be from a Nationalized Bank in India or State Bank of India, in a form acceptable to DFCCIL. (Tender Form No. 19 placed at Part IV of the tender documents).

Note: The instruments as listed under Performance Guarantee vide Clause 16.(4) (b) of General conditions of contract will also be acceptable for Guarantee in case of Mobilisation Advance.

**1.5.21 Arbitration: - Refer to clause 63 of GCC.**

## **PART II**

# **TECHNICAL SPECIFICATION**

## **PART - II**

### **TECHNICAL SPECIFICATIONS**

For technical specifications, refer Indian Railways Unified Standard Specifications (Works and Materials), 2011 amended upto date/ Gujarat State SOR/Codes/Manual / NH SOR /Codes/Manual as shall be relevant. and the specification for fabrication and erection of steel girder bridges and Locomotive Turn Table (Fabrication Specification), Serial No B1 - 2001 amended up to date. The decision of DFCCIL is final and binding to the contractor.

Indian Railways Unified Standard Specifications (Works and materials), Volume I & II are available for sale at the offices of General Managers and DRMs at all Zonal Railways & Production Units.

#### **2.1 GENERAL GUIDELINES REGARDING SPECIFICATIONS AND SPECIAL CONDITIONS FOR SUPPLY OF CEMENT FOR CONSTRUCTION WORKS**

##### **2.1.1 SUPPLY OF CEMENT:**

- 2.1.1.1** Supply of cement to various specifications as required for various items under different schedules will be paid under the items in Schedule.
- 2.1.1.2** The cement required for various items of work under Schedule shall be supplied by the Contractor at the site of work in accordance with the requirements and specifications.
- 2.1.1.3** For supply and use of cement in various works, relevant Indian Railways Unified Standard Specifications (Works and Materials), Volume I & II - 2010, IRS codes and IS Specifications will be applicable. Wherever, relevant specifications are not available, decision of the Engineer shall be final and binding on the contractor.

##### **SPECIFICATIONS FOR CEMENT:**

**2.1.2.1** The cement used shall conform to any of the following standards.

- (i) 33 Grade Ordinary Portland Cement conforming to IS: 269
- (ii) 43 Grade Ordinary Portland Cement conforming to IS: 8112
- (iii) 53 Grade Ordinary Portland Cement conforming to IS: 12269
- (iv) Rapid Hardening Ordinary Cement conforming to IS: 8041
- (v) High Strength Portland Cement conforming to IRS: T: 40

(vi) Hydrophobic Portland cement conforming to IS: 8043

(vii) Low heat Portland cement conforming to IS: 12600

(viii) Sulphate Resistance Cement conforming to IS: 12330

### **2.1.3 SOURCE AND PACKAGING:**

**2.1.3.1** Cement to be used on the works shall be procured from the main / reputed cement plants or from their authorized dealers. Decision of DFCCIL regarding reputed firms shall be final and binding on the contractor.

**2.1.3.2** Cement shall be packed in jute sacking bags conforming to IS: 2580-1982, double hessian bituminised (CRI type) or woven HDPE conforming to IS: 11652-1986, woven polypropylene conforming to IS: 11653-1986, Jute synthetic union conforming to IS: 12174-1987, or any other approved composite bags, bearing the following information in legible markings:

Manufacturer's name or Registered Trade Mark of manufacturer, if any.

Grade of cement

Type of cement

Weight of each bag in Kg.

Date of manufacture,

IS Code No. to which the cement conforms.

**2.1.3.3** All cement bags shall have company stitches intact and if any sign of tampering with company stitches is noticed, the same will be rejected without any test and no compensation shall be payable in this regard.

### **2.1.4 TEST CERTIFICATE REGARDING QUALITY OF CEMENT:**

**2.1.4.1** Necessary test certificates will have to be produced by the contractor regarding the quality of the cement conforming to the specification in addition to the manufacturer's certificates.

**2.1.4.2** DFCCIL reserves the right to take samples during the course of the work and get the cement tested in reputed laboratories to ascertain the conformity to the specification. Cost of such testing shall be borne by the contractor without any extra payment.



**2.1.4.3** Tests on cement shall be done as per relevant IS Codes. These tests are as follows:

- (i) Compressive strength
- (ii) Initial and final setting time
- (ii) Consistency
- (iv) Soundness.
- (v) Fineness

**2.1.4.4** The Contractor shall arrange to carryout above tests for every 100 Tonnes of cement and for every change in lot/batch and the same shall be submitted to the DFCCIL and take approval of the DFCCIL before using in work. No extra payment will be made for conducting such tests.

**2.1.4.5** Any temporary structure required for storage of cement, has to be provided by the tenderer at his cost and shall be removed after completion of work. The DFCCIL will only provide suitable land wherever land is available and is free for use. On completion of the work or as directed by the Engineer, the shed if put up by the Contractor, should be removed by the contractor and site cleared at his cost.

## **2.1.5 CONSUMPTION OF CEMENT:**

**2.1.5.1** The cement consumption for other than design mix concrete, shall be as per Western Railway Unified Standard Schedule of Rates (Works and Materials), Engineering Department and for approved design mix concrete, the quantity of cement will be decided based on the approved design mix keeping in mind Minimum and Maximum cement content specified for various grades. Excess cement used will not be paid for and the decision of the Engineer in this connection shall be final and binding on the Contractor.

## **2.1.6 PAYMENT FOR CEMENT:-**

Cement supplied for the work and measured under the Schedule will be paid if specified separately only after its use in various works under the Schedules of the contract as per conditions and no advance payment for supply will be admissible.

## **2.1.7 GENERAL:-**

**2.1.7.1** No wastage of any of the materials supplied and used in the work by the contractor including cement is payable by DFCCIL, contractor shall make his own arrangements for storing cement for use in work.

- 2.1.7.2** Contractor should take proper precautionary measures to store the cement in good condition against rains, etc. Storage of cement at the work site shall be at the contractor's expense and risk. Any damage occurring to cement due to faulty storage in contractor's shed or on account of negligence on his part shall be the liability of the contractor.
- 2.1.7.3** 53 Grade/43 Grade/33 Grade of cement should be stacked separately in countable manner.
- 2.1.7.4** Admixture as per IS: 9103 of approved manufacturer by the Engineer shall be permitted to be used in concrete wherever required. However, no extra payment for the admixtures used shall be payable unless otherwise specified in the Schedule.
- 2.1.7.5** Cement for temporary and enabling works shall be arranged by the contractor at his own cost and no extra payment will be paid on this account.
- 2.1.7.6** Empty Cement bags on release from the work is the property of the Contractor and shall be disposed off by the Contractor himself.

## **2.2 GENERAL GUIDELINES REGARDING SPECIFICATIONS AND SPECIAL CONDITIONS FOR CONCRETE WORKS**

### **2.2.1 Specifications:-**

**2.2.1.1** Concrete for PCC, RCC (Including piling and RCC deck slab) shall be as per relevant Indian Railway Unified Standard Specifications (Works & Materials) Volume I & II, Engineering Department, 2010 and IS Specifications. Some important guide lines are listed below. Along with these, all other relevant IRS, IRC and IS specifications with their up to date versions shall also govern. These govern all concrete works in bridges, etc., as applicable.

(i) IRS Concrete Bridge Code.

(ii) IS 456 :Code of Practice for Plain and Reinforced Concrete.

(iii) Relevant Indian Railway Unified Standard Specifications (Works & Materials) Volume I & II, Engineering Department, 2010

(iv) Relevant IRS/IRC/MORTH/IS Specifications/Codes.

(v) Relevant PSC Codes & Specification.

**2.2.1.2** Specifications for cement, steel, binding wire, used in concrete construction shall be as per IRS/IRC/MORTH/IS specifications. Any other

specifications/rules/guidelines issued from time to time by Railway Board/RDSO shall also govern the works.

- 2.2.1.3** In all matters of execution, including testing of various components, where the above codes/specifications/guidelines are not clear or explicit or at variance, the directions given by the Engineer shall be final and binding on the contractor.

**2.2.2 Cement:-**

- 2.2.2.1** The cement used in concrete construction shall be 53 Grade Ordinary Portland cement as per the design and as specified in the relevant schedules. Specifications for cement are covered under the supply schedule.

**2.2.3 Reinforcement:-**

- 2.2.3.1** All Reinforcement Steel (TMT Bars of Grade Fe 500) shall be procured as per specification mentioned in IS : 1786. Independent tests shall be conducted, wherever required, to ensure that the materials procured conform to the Specifications.

These steel shall be procured only from those firms, which are Established, Reliable, Indigenous & Primary Producers of Steel, having Integrated Steel Plants (ISP), using iron ore as the basic raw material and having in – house iron rolling facilities, followed by production of liquid steel and crude steel, as per Ministry of Steel's guidelines.

- 2.2.3.2** Bars shall be cut, bent and placed correctly and accurately to the size and shape as shown in the detailed drawing. Preferably bars of full length shall be used. The reinforcement shall be tied with annealed steel binding wire. Overlapping of bars, where necessary, shall be done as directed by Engineer. Rates quoted include the cost of annealed steel binding wire of appropriate specifications. Rate also include necessary cutting and straightening is also included.

- 2.2.3.3** Welding of reinforcement will not be generally permitted except in special circumstances under the written approval of the Engineer.

- 2.2.3.4** A register shall be maintained by the Contractor with full details of reinforcement provided for accountable and payment of steel reinforcement. The contractor should sign a similar such register maintained by DFCCIL before undertaking concreting works, as a token of acceptance of the details of reinforcement steel provided in works, failing which the details as recorded by DFCCIL shall be binding on the contractor for the purpose of payment and no dispute will be entertained by DFCCIL on this account.

**2.2.3.5** Contractor shall remove from site any steel materials rejected by the Engineer within a reasonable time as specified by him.

**2.2.3.6** Protective Coatings:- In order to offer adequate resistance against corrosion, reinforcement bars may be provided with suitable protective coatings depending upon the environmental conditions. In aggressive environments (severe, and extreme) application of cement slurry coating after removal of rust and other loose material from the surface of the reinforcement bar will generally be sufficient.

**2.2.3.7** The steel consumption shall be as per the drawings issued by the DFCCIL. Quantity of steel reinforcement consumption shall be as per reinforcement actually utilized in the work based on approved bar bending schedule. Nothing extra will be paid for wastage or for cut rods, if any, which will be property of the contractor. The weight of the steel will be calculated from the nominal weight given in the producer's hand / IRUSS (W & M), 2010-Volume-I books.

#### **2.2.4 Coarse & Fine Aggregates:-**

**2.2.4.1** Aggregates shall comply with the requirements of IS: 383 and shall be subjected to the tests in accordance with IS: 2386. Coarse aggregates shall be from crushed stone from approved quarries. Sand shall be from good river sources of approved quarries only.

**2.2.4.2** The size of the coarse aggregates shall be as per relevant IRS / IS specifications.

**2.2.4.3** The size of the fine aggregates shall be as per relevant IRS / IS specifications.

**2.2.4.4** Coarse aggregate shall be crushed and roughly cubical in shape. Fine aggregate shall be naturally produced. Creek/ Marine sand shall not be used in permanent works.

**2.2.4.5** The grading of the sand shall conform to relevant IS specification. The sand shall be screened on a 4.75 mm size screen to eliminate over size particles. The sand, if required, shall be washed in screw type mechanical washers in potable water to remove excess silt, clay and chlorides wherever required. The screening and washing of sand shall be completed at least one day before using it in concrete. The washed sand shall be stored on a sloping platform and in such a manner as to avoid contamination.

#### **2.2.5 Water:**

**2.2.5.1** Water used for washing of aggregates and for mixing and curing concrete shall be clean, potable and free from injurious amounts of oils, acids, alkalis, salts, sugar,

organic materials or other substances that may be deleterious to concrete or steel and shall conform to clause 5.4 of IS : 456.

**2.2.5.2** In case of doubt regarding development of strength, the suitability of water for making concrete shall be ascertained by the compressive strength as per IS : 4031 (Part VI) and initial setting time tests IS : 4031 (Part V).

**2.2.5.3** Water found satisfactory for mixing is also suitable for curing concrete. However, water used for curing should not produce any objectionable stain or unsightly deposit on the concrete surface. The presence of tannic acid or iron compounds is objectionable.

#### **2.2.6 Admixtures:-**

**2.2.6.1** In bridges, use of admixtures is governed by clause 4.4 of IRS Concrete Bridge Code.

**2.2.6.2** The admixtures, when permitted, shall conform to IS: 9103. Calcium chloride or admixtures containing calcium chloride shall not be used in structural concrete containing reinforcement, pre-stressing tendon or other embedded metal. The admixture containing Cl & SO<sub>3</sub> ions shall not be used. Admixtures containing nitrates shall also not be used. Admixtures based on thiocyanate may promote corrosion and therefore shall be prohibited.

**2.2.6.3** Concrete admixtures shall be obtained only from established manufactures with proven track record or as per approved list wherever available.

**2.2.6.4** The contractor shall provide the following information concerning each admixture after obtaining the same from the manufacturer before the same is put to use:

- (a) The chemical names of the main ingredients in the admixtures.
- (b) The chloride iron content, if any, expressed as a percentage by mass of the total admixture.
- (c) Values of dry material content, ash content and relative density of the liquid admixture which can be used for Uniformity Tests.
- (d) Whether or not the admixture leads to the entrainment of air when used as per the manufacturer's recommended dosage, and if so to what extent.
- (e) Where two or more admixtures are proposed to be used in any one mix, confirmation as to their compatibility.

- (f) There would be no increase in risk of corrosion of the reinforcement or other embodiments as a result of using the admixture.
- (g) Retardation achieved in initial setting time.
- (h) Normal dosage and detrimental effects, if any, of under dosage and over dosage.
- (i) Recommended dosages and expected results, including proof for the same wherever required. Independent test results shall be produced by the contractor on demand/as specified.

## **2.2.7 Storage of materials:-**

**2.2.7.1** Storage of materials shall be as per IS: 4082. All materials may be stored at proper places so as to prevent their deterioration or intrusion by foreign matter and to ensure their satisfactory quality and fitness for the work. The storage space must also permit easy inspection, removal and restoring of the materials. All such materials even though stored in approved godowns / places, must be subjected to acceptance test prior to their immediate use.

**2.2.7.2** Aggregate shall be stored at site on a hard and dry level patch of ground. If such a surface is not available, a platform of planks or of corrugated iron sheets, or a floor of dry bricks, or a thin layer of lean concrete shall be made so as to prevent the admixture of clay, dust, vegetable and other foreign matter.

Stacks of fine and coarse aggregate shall be kept in separate stack piles, sufficiently removed from each other to prevent the materials at the edge of the piles getting intermixed. On a large job it is desirable to construct dividing walls to give each type of aggregate its own compartment. Fine aggregate shall be stacked in place where loss due to the effect of wind is minimum.

Unless specified otherwise or necessitated by site conditions, stacking of aggregate should be carried out in regular sizes.

**2.2.7.3** Cement shall be transported, handled and stored at the site in such a manner as to avoid deterioration or contamination. Cement shall be stored above ground level in perfectly dry and water-tight sheds and shall be stacked not more than eight bags high. Wherever bulk storage containers are used their capacity should be sufficient to cater to the requirement at site and should be cleaned at least once every 3 months. Cement older than 3 months from the date of manufacture shall not be used. Each consignment shall be stored separately so that it may be readily identified and inspected and cement shall be used in the sequence in which it is delivered at site. Any consignment or part of a consignment of cement which had deteriorated in any way, during storage, shall not be used in the works and shall be removed from the site by the Contractor without charge to DFCCIL. For more

details regarding stacking and storage of cement, refer clause 17.10.1, 17.10.2 and 26.1.2.7 of Indian Railway Unified Standard Specifications (Works & Materials), Volume II, - 2010.

**2.2.7.4** The reinforcement bars, when delivered on the job, shall be stored above the surface of the ground level by at least by 150mm and shall ordinarily be stored in such a way as to avoid distortion and to prevent deterioration and corrosion. Every bar shall be inspected before assembling on the works and any defective, brittle, excessively rusted or burnt bars shall be removed. Cracked ends of bars shall be cut out.

#### **2.2.8 Testing of cement & others:-**

Cement and other items shall be tested as per specifications. However, the contractor shall also arrange for additional tests at his own cost as required by the Engineer as and when required. The decision of the Engineer shall be final in this regard.

#### **Concreting:**

**2.2.9.1** The contractor shall make his own arrangements for supply of water and electricity for all his works at his own cost. He shall arrange potable quality water for use in all concrete works and samples of water shall be got tested from approved laboratory/approved by the Engineer before being used in concreting. Apart from water, fine & coarse aggregates and all other materials shall be tested from time to time by the contractor at his cost to ensure proper quality works.

**2.2.9.2** Maximum / minimum size of aggregates, standards of quality of materials, minimum cover for concrete, use of admixtures / chemicals, treatment to reinforcement / finished surfaces, etc., shall be as per relevant Codes, IS / IRS specifications and conditions of contract as specified.

**2.2.9.3** All exposed concrete surfaces shall be finished smooth by the contractor at his own cost. Shuttering materials for RCC in superstructure shall be strictly of steel only to permit vigorous vibration and to ensure no deviation of finished dimensions by more than +5/-0 mm and wooden shutters are not permitted. For other works also, proper quality of shuttering materials which will permit vibrating and will not require additional finishing shall only be used. If there is any variation in the surface, alignment or lines in the products beyond permissible rejection limits indicated in these conditions, the DFCCIL reserves the right to reject the same and the contractor shall not have any claim in this regard and cost of DFCCIL materials involved will be recovered from the contractor including penalties, if any imposed.



**2.2.10 Weigh batching, vibrating, curing & testing:**

**2.2.10.1** All concrete shall be machine batched, machine mixed and machine vibrated, by using appropriate vibrators. Weigh batching plant, mixers, vibrators, etc., of appropriate capacity, as specified/directed by the Engineer, shall be arranged by the contractor at his cost. In this case, Weigh batching plants shall have computerized control for weighing, loading, mixing and delivery.

**2.2.10.2** Batching plants, transit mixers, concrete pumps, etc., shall be installed by the contractor necessarily at site. In case of failure of any of the above, standby arrangements for ensuing continuous concreting has to be provided by the contractor at his cost. For piling works concreting shall be done continuously as per the volumes designed without break and accordingly standby arrangements shall be ensured by the contractor.

**2.2.10.3** Curing & vibrating shall be arranged by the contractor at all locations/heights at his own cost and no extra payment on this account will be admissible. Curing of concrete shall be done as per relevant IS Codes / Specifications. If curing is not done by the contractor properly, DFCCIL may get it done through any other means at the Contractor's cost without any notice to him and recover from his bills the same including penalty if any at the discretion of the Engineer. The concrete shall be kept wet constantly by ponding or covered with a layer of sacking canvas etc.

**2.2.10.4** Test cubes shall be cast at regular intervals and tested to ascertain the strength of concrete. The contractor shall establish a cube testing facility along with operator at the site or nearby area to facilitate prompt testing of concrete. Test cube moulds as required as per IS Codes shall be made available by the contractor at his cost.

**2.2.11 Design Mix Concrete:**

(a)**General:** Design Mix is mandatory for grades higher than M20. For concrete of compressive strength greater than M55, specialized literature should be consulted. Admixtures may be used while designing. Only design mix shall be used for all items of concrete. Prior to the start of construction, the contractor shall submit details of each trial mix of each grade of concrete to the Engineer for approval. When the proportions of the mix are approved, the contractor shall not vary any of the design parameters or the source of the materials without the approval of the Engineer. Wherever there is a significant change in materials used, fresh trial mix shall be arranged by the contractor as required by the Engineer. The concrete shall be designed keeping in view the minimum cement content and maximum cement content. Minimum cement content depends upon the environmental exposure conditions but maximum Cement Content shall be limited to 500kg/m.<sup>3</sup>

(b)**Mix Design and Proportioning:** Recommended guidelines for Concrete Mix Design are given in IS: 10262 which may be referred to for details. As mentioned therein in



order that not more than the specified proportion of test results is likely to fall below the characteristic strength, the concrete mix has to be designed for a somewhat higher target average compressive strength. In terms of clause 9.2.2 of IS : 456, the Target Mean Strength of Concrete mix should be equal to the characteristic strength plus 1.65 times the Standard Deviation. Mix proportion shall be designed to ensure that the workability of fresh concrete is suitable for conditions of handling and placing, so that after compaction it surrounds all reinforcement and completely fill the form work. When concrete is hardened, it shall have the stipulated strength, durability and impermeability.

Determination of the proportions of by weight of cement, aggregate and water shall be based on design mix.

As a trial the manufacturer of concrete may prepare a preliminary mix according to provisions of SP:23-1982. (Special Publications 23-1982 of Bureau of Indian Standards) Mix design shall be tried and the mix proportions checked on the basis of tests conducted at a recognized laboratory approved by the Engineer. All concrete proportions for various grades of concrete shall be designed separately and mix proportions established keeping in view the workability for various structural elements, methods of placing and compacting.

(c)**Standard deviation:** Standard deviation calculations of test results based on tests conducted on the same mix design for particular grade designation shall be done in accordance with Clause 9.2.4 of IS 456. Table 8 of IS 456 gives the standard deviation that can be assumed for design of mix in the first instance. The final standard deviation figures may be determined based on test results for the particular grade of concrete when available.

| <b>Max size of Aggregate, Target Mean Strength</b> |                            |  |  |
|--|----------------------------|--|--|
| Grade of Concrete                                  | Max size of Aggregate (mm) | Characteristic Strength ( $f_{ck}$ ) at 28 days ( $N/mm^2$ ) | Target Mean Strength ( $f_{ck}$ ) 28 days ( $N/mm^2$ ) |
| M20  | 20                         | 20   | 26.60  |
| M25  | 20                         | 25   | 31.60  |
| M30  | 20                         | 30   | 38.25  |
| M35  | 20                         | 35   | 43.25  |
| M40  | 20                         | 40   | 48.25  |

|     |    |    |       |
|-----|----|----|-------|
| M45 | 20 | 45 | 53.25 |
|-----|----|----|-------|

(d) **Approval of Design Mix:** The contractor shall submit details of each trial mix of each grade of concrete designed for various workability conditions to the Engineer for his comments and approval. Concrete of any particular design mix and grade shall be produced / manufactured for works only on obtaining written approval of the Engineer.

**2.2.12 Requirements of Consistency:-** The mix shall have the consistency which will allow proper placement and consolidation in the required position. Every attempt shall be made to obtain uniform consistency. The optimum consistency for various types of structures shall be as indicated in table below or as directed by the Engineer.

| Slump Required for workability |  |            |
|--------------------------------|--|------------|
|                                | Type   | Slump (mm) |
| 1                              | (a) Structures with exposed inclined surface requiring low slump concrete to allow proper compaction   | 25         |
|                                | (b) Plain Cement Concrete  | 25         |
| 2                              | RCC structures with widely spaced reinforcements; e.g. solid columns, piers, abutments, footings, well steining  | 40-50      |
| 3                              | RCC structures with fair degree of congestion of reinforcement; e.g. pier and abutment caps, box culverts well curb, well cap, walls with thickness greater than 300mm | 50-75      |
| 4                              | RCC and PSC structures with highly congested reinforcements e.g. deck slab girders, box girders, walls with thickness less than 300mm                                  | 75-125     |
| 5                              | Underwater concreting through tremie e.g. bottom plug, cast-in-situ piling   | 100-200    |

The minimum slump of concrete in case of bored cast in situ pile shall be 150 to 200 mm.

**2.2.13 Durability:-** The durability of concrete depends on its resistance to deterioration & environment in which it is placed. The resistance of concrete to weathering, chemical attack, abrasion, frost and fire depends largely upon its quality and constituent materials. Susceptibility to corrosion of the steel is governed by the cover provided and the permeability of concrete. The cube crushing strength alone is not a reliable guide to the quality and durability of concrete; it must also have adequate cement content and a low water-cement ratio. The general environment to which the concrete will be exposed during its working life is classified into three levels of severity that is moderate, severe, and extreme as described below:

| Environment | Exposure condition  |
|-------------|---|
| MODERATE    | Concrete surface protected against weather or aggressive conditions. Concrete surface sheltered from severe rain or freezing whilst wet. Concrete exposed to condensation. Concrete structure continuously under water. Concrete in contact with non aggressive soil /ground water.     |
| SEVERE      | Concrete surface exposed to severe rain, alternate wetting & drying or occasional freezing or severe condensation. Concrete exposed to aggressive subsoil / ground water or coastal environment.  |
| EXTREME     | Concrete surface exposed to sea water spray, corrosive fumes or severe freezing conditions whilst wet. Concrete structure surfaces exposed to abrasive action, surfaces of members in tidal zone. All other exposure conditions which are adverse to exposure conditions covered above. |

Maximum water-cement ratio, grade of concrete and cementitious material content for various environment conditions for achieving durability are indicated below for guidance:

#### **2.2.13.1 Maximum Water Cement Ratio:-**

The limits for maximum water cement ratio for design mix shall be based on environmental conditions as defined in durability clause. The limits for maximum water cement ratio for different environmental conditions shall be as given in Table below:

| Environment | Maximum Water-Cement Ratio |                                 |                                   |
|-------------|----------------------------|---------------------------------|-----------------------------------|
|             | Plain Concrete<br>(PCC)    | Reinforced<br>Concrete<br>(RCC) | Pre stressed<br>Concrete<br>(PSC) |
| Moderate    | 0.50                       | 0.45                            | 0.40                              |
| Severe      | 0.45                       | 0.40                            | 0.40                              |
| Extreme     | 0.40                       | 0.35                            | 0.35                              |

**2.2.13.2 Grade of Concrete:-**From durability consideration, depending upon the environment to which the structure is likely to be exposed during its service life, minimum grade of concrete shall be as given in table below:

#### Minimum Grade of Concrete

For Bridges in Pre stressed Concrete and important Bridges.

| Structural member | Moderate exposure | Severe Exposure | Extreme exposure |
|-------------------|-------------------|-----------------|------------------|
| PCC member        | M-25              | M-30            | M-35             |
| RCC member        | M-30              | M-35            | M-40             |
| PSC member        | M-35              | M-40            | M-45             |

For Bridges other than mentioned above and sub-structure

| Structural member | Moderate exposure | Severe Exposure | Extreme exposure |
|-------------------|-------------------|-----------------|------------------|
| PCC Member        | M-15              | M-20            | M-25             |
| RCC member        | M-20              | M-25            | M-30             |

**2.2.13.3 Cementitious Material Content:-**Maximum Cementitious Material Content shall be limited to 500kg/m<sup>3</sup>. Depending upon the environment to which the structure is likely to be exposed during its service life, minimum Cementitious Material Content in concrete shall be as given in table below:

| Minimum Cementitious Material Content |   |         |                     |         |
|---------------------------------------|---|---------|---------------------|---------|
| Environment                           | Minimum Cementitious Material Content in Kg/cum |         |                     |         |
|                                       | Plain Concrete                                  |         | Reinforced Concrete |         |
|                                       | (PCC)   |         | (RCC)               |         |
|                                       | Grade   | Content | Grade               | Content |
| Moderate                              | M25   | 240     | M30                 | 300     |
| Severe                                | M30   | 250     | M35                 | 350     |
| Extreme                               | M35   | 300     | M40                 | 400     |

**2.2.13.4** Clear cover is the least distance from outer most surface of steel or binding wire or its end to the face of concrete. It is also an dimension used in design and indicated on the drawings. From durability consideration, minimum clear cover shall be as under.

| Minimum Covers    |                     |                    |                      |
|-------------------|---------------------|--------------------|----------------------|
| Type of structure | Extreme Environment | Severe Environment | Moderate Environment |
| Slab              | 50                  | 35                 | 25                   |
| Beam/Girder       | 60                  | 50                 | 35                   |
| Column            | 75                  | 75                 | 50                   |
| Piles             | 75                  | 75                 | 50                   |

**2.2.14 Permeability of concrete:** Permeability requirements are as specified in IRS Concrete Bridge Code. Permeability test shall be mandatory for all RCC bridges under severe and extreme environment. Under moderate environment, permeability test shall be mandatory for all major bridges and for other bridges and structures.

**2.2.15 Mixing of concrete:**

2.2.15.1 Concrete shall be mixed either in a mini mobile batching plant or in a batching and mixing plant as per the specifications. Hand mixing shall not be permitted. The mixer or the plant shall be at an approved location considering the properties of the mixes and the transportation arrangements available with the Contractor. The mixer or the plant shall be approved by the Engineer.

2.2.15.2 Mixing shall be continued till materials are uniformly distributed and a uniform colour of the entire mass is obtained, and each individual particle of the coarse aggregate shows complete coating of mortar containing its proportionate amount of cement.

2.2.15.3 Mixers which have been out of use for more than 30 minutes shall be thoroughly cleaned before putting in a new batch. The first batch of concrete from the mixer shall contain only two thirds of the normal quantity of coarse aggregate. Mixing plant shall be thoroughly cleaned before changing from one type of mix to another.

**2.2.16 Transporting, Placing and Compaction of Concrete:**

2.2.16.1 The method of transporting and placing concrete shall be approved by the Engineer. Concrete shall be transported and placed as near as practicable to its final position, so that no contamination, segregation or loss of its constituent materials takes place. Concrete shall not be freely dropped into place from a height exceeding 1.5 metres.

2.2.16.2 When concrete is conveyed by chute, the plant shall be of such size and design as to ensure practically continuous flow. Slope of the chute shall be so adjusted that the concrete flows without the use of excessive quantity of water and without any segregation of its ingredients. The delivery end of the chute shall be as close as possible to the point of deposit. The chute shall be thoroughly flushed with water before and after each working period and the water used for this purpose shall be discharged outside the formwork.

2.2.16.3 All formwork and reinforcement contained in it shall be cleaned and made free from standing water, dust, immediately before placing of concrete.

2.2.16.4 No concrete shall be placed in any part of the structure until approval of the Engineer has been obtained.

2.2.16.5 If concreting is not started within 24 hours of the approval being given, it shall have to be obtained again from the Engineer. Concreting then shall proceed continuously over the area between the construction joints. Fresh concrete shall not be placed against concrete which has been in position for more than 30 minutes unless a proper construction joint is formed.

2.2.16.6 Except where otherwise agreed to by the Engineer, concrete shall be deposited in horizontal layers to a compacted depth of not more than 450 mm when internal vibrators are used and not exceeding 300 mm in all other cases.

2.2.17 Concrete when deposited shall have a temperature of not less than 5° C and not more than 40°C. It shall be compacted in its final position within 30 minutes of its discharge from the mixer, unless carried in properly designed agitators, operating continuously. It may be necessary to add retarding admixtures to concrete if trials shows that the period indicated above are unacceptable. In all such matters, engineer's decision shall be final.

2.2.18 Concrete shall be thoroughly compacted by vibration or other means approved by Engineer, during placing and worked around the reinforcement, embedded fixtures and into corners of the formwork to produce a dense homogenous void-free mass having the required surface finish. When vibrators are used, vibration shall be done continuously during the placing of each batch of concrete until the expulsion of air has practically ceased and in a manner that does not promote segregation. Over vibration shall be avoided to minimize the risk of forming a weak surface layer. When external vibrators are used, the design of formwork and disposition of vibrator shall be such as to ensure efficient compaction and to avoid surface blemishes. Vibrators shall not be applied through reinforcement and where vibrators of immersion type are used, contact with reinforcement and all inserts like ducts etc., shall be avoided. The internal vibrators shall be inserted in an orderly manner and the distance between insertions should be about one and half times the radius of the area visibly affected by vibration. Additional vibrators in serviceable condition shall be kept at site so that they can be used in the event of breakdowns.

2.2.19 Mechanical vibrators used shall be of appropriate specifications, type and capacity and as directed by the Engineer.

#### **2.2.20 Equipment and machinery for concreting:**

2.2.20.1 For concrete works, the following equipment's in numbers indicated are considered necessary for efficient and speedier concreting at each site. However, the actual numbers may be arranged as required by the Engineer, taking into account the site conditions.

| <b>Indicative List of Equipment and Machinery</b> |  |              |
|---|--|--------------|
| 1.  | Concrete Batching plant (10 to 20 cum/hr capacity)             | 1 No.        |
| 2.  | Transit Mixers (4 to 7 cum capacity)                           | 2 Nos.       |
| 3.  | Concrete Vibrators (2 HP capacity)                             | 4 Nos.       |
| 4.  | Vibrators of Needles (60mm & 40mm)                             | 4 Nos.       |
| 5.  | Screed vibrator (for ROBs)                                     | 2 Nos.       |
| 6.  | Form vibrator (500 watts capacity)                             | 2 Nos.       |
| 7.  | Generator (35 KV capacity)                                     | 1 No.        |
| 8.  | Welding set (3 to 5 KV capacity)                               | 1 No.        |
| 9.  | Reinforcement Steel Cutting Machine                            | 2 No.        |
| 10.   | Reinforcement Steel Bending Machine                            | 2 No.        |
| 11.   | Concrete Pumps (10 to 20 HP capacity with 40m pipe length)     | 1 No.        |
| 12.   | Hydra 12.0 T capacity crane                                    | 1 No.        |
| 13.   | Concrete Funnel Bucket   | 1 No.        |
| 14.   | Air compressor (100 to 150 cum capacity)                       | 1 No.        |
| 15.   | Concrete Dumpers   | 2 Nos.       |
| 16.   | Any other including power lifts etc., as required to suit site | Adequate No. |

2.2.20.2 All the machinery are required to be arranged by the contractor at his own cost and the agreement rates for concreting include the same. No extra payment is admissible for any machinery arranged by the contractor.



## **2.2.21 TRANSPORTATION OF CONCRETE & PUMPING OF CONCRETE**

### **2.2.21.1 General**

Fresh concrete can be transported to the placement area by a variety of methods. Common among them are:

- Mixer trucks
- Stationary truck bodies with or without agitators.
- Buckets hauled by trucks.
- Conveyor belts.
- Hose or pipe line by pumping.

Each type of transportation has specific advantages and limitations depending on the condition of use, mix, accessibility and location of placing.

### **2.2.21.2 Transportation by Mixer Trucks**

**2.2.21.2.1** These are essentially revolving drums mounted on truck chassis. Truck mixers used in the job shall be labelled permanently to indicate the manufacturer's specifications for mixing like:-

- Capacity of drum.
- Total number of drum revolutions for complete mixing.
- Mixing speed
- Maximum time limit before completion of discharge and after cement has entered the drum.
- Reduction in time period of discharge due to warm weather or other variables.

All above information shall only form guidelines for the manufacturer/producer of concrete.

**2.2.21.2.2** Fulfilment of the stipulated number of revolutions or elapsed time shall not be the acceptable criterion. As long as the mixing water limit is not exceeded and the concrete has satisfactory plastic physical properties and is of satisfactory consistency and

homogeneity for satisfactory placement and consolidation and is without initial set, the concrete shall be acceptable.

**2.2.21.2.3** When the concrete is totally mixed in transporting trucks volume of concrete being transported shall not exceed 63% of the rated capacity of the drum. In case the concrete is totally mixed in the central batching plant, the transporting truck may be loaded up to 80% of the rated capacity of the drum. In this case the drum shall be rotated at charging speed during loading and reduced to agitating speed after loading is complete.

**2.2.21.2.4** When transporting concrete by truck mixers, delivery time shall be restricted to 90 minutes or initial setting time whichever is less from the time cement has entered the mixer to completion of discharge.

### **2.2.21.3      Transporting by Agitating / Non-agitating Trucks.**

**2.2.21.3.1** Transporting ready mix concrete by this method shall consist of truck chassis mounted with open top bodies. The metal body shall be smooth and streamlined for easy discharge. Discharge may be from the rear when the body is mechanically tilted. Body of the truck shall have a provision of discharge gate. Mechanical vibrators shall be installed at the discharge gate for control of discharge flow.

**2.2.21.3.2** Agitators, if mounted, also aid in the discharging of concrete from the truck in addition to keeping the concrete alive.

**2.2.21.3.3** Water shall not be added to concrete in transport through this system.

**2.2.21.3.4** Bodies of trucks shall be provided with protective covers during period of inclement weather.

**2.2.21.3.5** Delivery period, when adopting this system of transporting concrete shall be restricted to 30 minutes from the moment all ingredients including cement and water enter in mixer to completion of discharge.

### **2.2.21.4      Transporting by Buckets**

This method of transportation is very common for transportation of centrally mixed concrete. Buckets of suitable capacities may be filled with concrete which is totally mixed in central plant and hauled to the job site. Buckets then may be conveyed to the actual point of placement either with the help of crane/hoist or they may be carted..

As in the case of open truck transportation, extra water shall not be added to concrete transported in buckets. Concrete shall be protected from inclement weather by necessary covering arrangements. Also, maximum delivery period for this system of transportation

from the time cement is introduced into the mixer to completion of discharge shall not exceed 30 minutes.

#### **2.2.21.5 Cleaning**

Before loading concrete in either truck mixer, open bodied trucks or buckets, the containers shall be thoroughly cleaned, washed and dried, so that there is no water or moisture in the container which may affect the designed water content of the concrete.

#### **2.2.21.6 Other Methods of Transportation**

Transportation of concrete either by belt conveyors or by pumping is envisaged in some works.

If, the producer/manufacturer/purchaser/contractor of ready mix concrete desires to use such methods of transportation, they may do so provided their scheme and complete specifications are submitted to the Engineer for his record and approval.

#### **2.2.21.7 Objective**

Method of transportation used shall ensure:-

Efficient delivery of concrete

No significant alterations of properties with regard to water cement ratio, slump, air content and homogeneity.

All variables in transportation, considering type and accessibility of placement locations, distance, time interval etc., shall be carefully studied before arriving at the method used.

#### **2.2.21.8 Pump able Concrete (Extracted from Para 8.9 of Concrete Bridge Code, 1997)**

General- Pumpable concrete is the concrete which is conveyed by pressure through either rigid pipe or flexible hose and discharged directly into the desired area. It is especially used where space for construction equipment is very limited.

Pumping Rate and Range – Depending on the equipment, pumping rate should be 10 to 70 cum. per hour. Effective pumping range is upto 300m horizontally and 90m vertically.

(i) Proportioning Pumpable Concrete

Basic Consideration - More emphasis on quality control is essential to the proportioning and use of a dependable pump mix. Concrete mixes for pumping must be plastic. Particular attention must be given to the mortar and to the amounts and sizes of coarse aggregates.

The maximum size of angular coarse aggregate is limited to one-third of smallest inside diameter of the hose or pipe. Provisions should be made for elimination of oversized particles in the concrete by finish screening or by careful selection of aggregates.

#### (ii) Pumping Concrete

a) Proper planning of concrete supply, pump locations, line layout, placing sequences and the entire pumping operation will result in saving of cost and time. The pump should be placed as near the placing area as practicable and the entire surrounding area must have adequate bearing strength. Lines from the pump to the placing area should be laid out with a minimum of bends. The pipe line shall be rigidly supported.

b) While pumping downward 15m or more, it is desirable to provide an air release valve at the middle of the top bend to prevent vacuum or air build up. When pumping upward, it is desirable to have a valve near the pump to prevent reverse flow.

#### **2.2.22 Construction Joints :-**

2.2.22.1 Construction joints shall be avoided as far as possible and in no case the locations of such joints shall be changed or increased from those shown on the drawings, except with express approval of the Engineer. The joints shall be provided in a direction perpendicular to the member axis. Sequencing of concrete placement should be organized in such a way that cold joints are totally eliminated. The sequence of concreting shall be submitted for approval of Engineer prior to concreting of the structural element. Concreting shall be carried out continuously up to the construction joints, the position and arrangement of which shall be predetermined by the designer.

2.2.22.2 Construction joints should be positioned to minimize the effect of the discontinuity on the durability, structural integrity and appearance of the structure. Joints should be located away from regions of maximum stress caused by loading particularly where shear and bond stresses are high.

2.2.22.3 Laitance, both on the horizontal and vertical surfaces of the concrete, should be removed before fresh concrete is cast. The surface should be roughened to promote good adhesion. Various methods for removal can be used but they should not dislodge the coarse aggregate particles. Concrete may be brushed with a stiff brush soon after casting while the concrete is still fresh and while it has only slightly stiffened. If the concrete has partially hardened, it may be treated by wire brushing or with a high pressure water jet, followed by drying with an air jet, immediately before the new concrete is placed. Fully

hardened concrete should be treated with mechanical hand tools or grit blasting, taking care not to split or crack aggregate particles.

2.2.22.4 Where there is likely to be a delay before placing the next concrete lift, protruding reinforcement should be protected. Before the next lift is placed, rust loose mortar, or other contamination should be removed from the bars and where conditions are particularly aggressive and there has been a substantial delay between lifts, the concrete should be cut back to expose the bars for a length of about 50 mm to ensure that contaminated concrete is removed.

2.2.22.5 In all cases, when construction joints are made, it should be ensured that the joint surface is not contaminated with release agents, dust, or curing membrane and that the reinforcement is fixed firmly in position at the correct cover.

2.2.22.6 When the formwork is fixed for the next lift, it should be inspected to ensure that no leakage can occur from the fresh concrete. It is a good practice to fix a 6 mm thick sponge which seals the gap completely. The practice of first placing a layer of mortar or grout is not recommended. The old surface should be soaked with water without leaving puddles, immediately before starting concreting; then the new concrete should be thoroughly compacted against it. When fresh concrete is cast against existing mature concrete or masonry the older surfaces should be thoroughly cleaned and soaked to prevent the absorption of water from the new concrete. Standing water should be removed shortly before the new concrete is placed and the new concrete should be thoroughly vibrated in the region of the joint.

**2.2.23 Finishing of concrete:** The finished surface of concrete after removal of formwork shall be such that no touching up is required. All fins/holes caused by form joints, supports, rods etc., shall be ground/filled up effectively using appropriate machinery shutters, formwork etc., used in construction shall be as specified in the conditions and the labour used shall be skilled to suit the quality requirements of the work. Any surface, finished poorly in the opinion of the Engineer shall require repair/remedial measures at the cost of the contractor and the Engineer's decision in this regard shall be final. Any structure, which has deficiencies in finishing including product parameters beyond the rejection limits, as specified in these conditions, are liable to be rejected and the decision of the Engineer shall be final in this regard.

**2.2.24 Coatings for concrete:** Normally finished concrete structures do not require any surface protective coatings in non-aggressive environment (moderate) for all structures. For aggressive environment (severe and extreme conditions), Epoxy phenolic IPN coating or CECRI Integrated four coat system can be used in superstructure of bridges and coal tar epoxy coating for sub structure of bridges (in affected part only).

**2.2.25 Shuttering, Formwork & False work:-**

2.2.25.1 Shuttering, Formwork & False work shall be designed to meet the requirements of the permanent structure, taking into account the actual conditions of materials, environment and site conditions. Careful attention shall be paid to the detailing of connections and functions. All the materials used for shuttering, formwork & falsework shall conform to the specified quality consistent with the intended purpose and actual site condition as applicable. All shuttering, form work, false work, etc., shall be got approved by the Engineer before it is put into use.

2.2.25.2 Forms shall not be struck until the concrete has reached strength at least twice the stress to which the concrete may be subjected at the time of removal of formwork or as approved by the Engineer. In normal circumstances and where Ordinary Portland Cement is used, forms may generally be removed after the expiry of the following periods:-

| <b>Stripping Time</b>  |  |
|--|--|
| a) Walls, columns and vertical faces of all structural members | 24 to 48 hours as may be decided by the Engineer |
| b) Slabs ( props left under)                                   | 3 days   |
| c) Beam soffits (props left under)                             | 7 days   |
| d) Removal of props under slabs                                |  |
| 1) Spanning up to 4.5 m  | 7 days   |
| 2) Spanning over 4.5 m   | 14 days  |
| e) Removal of props under beams                                |  |
| 1) Spanning up to 6 m  | 14 days  |
| 2) Spanning over 6 m   | 21 days  |

Where the shape of the element is such that the formwork has re-entrant angles, the formwork shall be removed as soon as possible after the concrete has set, to avoid shrinkage crack occurring due to the restraint imposed.

## **2.2.26 Defective Concrete and Measurement of concrete:**

2.2.26.1 Should any concrete be found honeycombed or in any way defective which may be, at the discretion of the Engineer suspected to affect the performance of the

structure, shall be rejected outright. Contractor shall have no claim in this regard and the decision of the Engineer shall be final. The member, structurally independent, in which the concrete is found to be defective, shall be replaced by the contractor at his cost fully. The damages arising on account of such defective concreting shall also be recoverable from the dues of the contractor, including penalties if any. DFCCIL reserves the right to get the member replaced by any means at the cost of the contractor at any cost if the contractor delays reproduction.

2.2.26.2 However, some surface defects, not affecting the structural properties shall, on the instruction of the Engineer, be repaired as per the approved procedures. The complete cost of such repairs shall be borne by the contractor and no compensation shall be payable. Records of such repairs done shall be maintained by the contractor.

| <b>Tolerances for Finished Concrete Bridge Structure</b> |   |  |
|--|---|--|
| S No   | Description of defects in any part or full member or the structure at the decision of the Engineer. | Permissible limits (unless otherwise specified in designs/drawings)                        |
| 1  | Shift from alignment  | 1) $\pm 25$ mm in member.  |
| 2  | Deviation from plumb in piers or variation from specified batter.                                   | 1 in 250 subjected to a maximum value of 0.5 times the least lateral dimension of pier.    |
| 3  | Deviation from plumb in abutments or variation from specified batter.                               | 1 in 125   |
| 4  | Cross sectional dimensions of piers, abutments and girders  | +20mm/-5mm   |
| 5  | Thickness of deck slab of bridges   | + 6 mm / - 3 mm  |
| 6  | Size and location of openings   | $\pm 12$ mm  |
| 7  | Plan dimensions of footings (formed excavation)   | + 50 mm / - 25 mm  |
| 8  | Plan dimensions of footings (unformed excavation)   | + 75 mm / - 00 mm  |
| 9  | Thickness of footings   | - 5%, + No limit   |
| 10   | Footing eccentricity  | 0.02 times the width of the footing in the direction of deviation, but not more than 50 mm |
| 11   | Reduced level of top of footing / pier / bed block  | $\pm 5$ mm   |
| 12   | Centre to centre distance of pier and abutments at pier top   | $\pm 30$ mm  |
| 13   | Centre to centre distance of bearings along span  | $\pm 5$ mm   |
| 14   | Centre to centre distance of pier bearings across span  | $\pm 5$ mm   |

2.2.26.3 The tolerances for finished concrete bridge structures shall be governed by IRS Concrete Bridge Code and shall be followed; deviations beyond the permissible limits shown are liable to be rejected. These tolerances apply to other structures also appropriately.



## **2.2.27 Sampling and Strength Testing of Concrete:**

**2.2.27.1 General:** Samples from fresh concrete shall be taken as per IS: 1199 (method of sampling and analysis of concrete). Concrete for making 3 test cubes shall be taken from a batch of concrete at point of delivery into construction according to procedure laid down in IS: 1199 and 150 mm cubes shall be made, cured and tested at the age of 28 days for compressive strength in accordance with IS:516. The 28 days test strength result for each cube shall form an item of sample.

Concrete shall conform to the surface finish and tolerance as prescribed in Unified specifications. Random sampling and lot by lot of acceptance / inspection shall be made for the 28 days cube strength of concrete.

Concrete under acceptance shall be notionally divided into lots for the purpose of sampling, before commencement of work. The delimitation of lots shall be determined by the following:

- (i) No individual lot shall be more than 30 cum in volume.
- (ii) At least one cube forming an item of the sample representing the lot shall be taken from concrete of the same grade and mix proportions cast on any day.
- (iii) Different grades of mixes of concrete shall be divided into separate lots.
- (iv) Concrete of a lot shall be used in the same identifiable component of the bridge.

## **2.2.27.2 Sampling .**

### **2.2.27.2.1 Frequency of Sampling**

**Sampling procedure:** A random sampling procedure shall be adopted to ensure that each concrete batches forming the lot under acceptance / inspection shall have a reasonable chance of being tested that is, sampling should be spread over the entire period of concreting and cover all mixing units.

**Frequency:** The minimum frequency of sampling of concrete of each grade shall be in accordance with table below. At least one sample shall be taken from each shift of work.

| Minimum Frequency of Sample                     |  |
|---|--|
| Quantity of concrete in work, (M <sup>3</sup> ) | No. of samples   |
| 1-5   | 1  |
| 6-15  | 2  |
| 16-30   | 3  |
| 31-50   | 4  |
| 51 and above                                    | 4 plus one additional sample for each additional 50 M <sup>3</sup> or part thereof |

**2.2.27.2.2 Test Specimen:** Three test specimens shall be made from each sample for testing at 28 days. Additional samples may be required for various purposes such as to determine the strength of concrete at 7 days or at the time of striking the formwork, or to determine the duration of curing, or to check the testing error. Additional samples may also be required for testing samples cured by accelerated methods as described in IS: 9013. The specimen shall be tested as described in IS: 516.

**2.2.28 Test Results of Sample:** The test results of the sample shall be the average of the strength of 3 specimens. The individual variation should not be more than  $\pm 15$  percent of average. If more, test results of the sample are invalid.

**2.2.29 Acceptance Criteria of Concrete:** Acceptance criteria shall be acceptance of concrete as per Clause No 16 of Annexure 4.2 of Indian Railway Unified Standard Specifications (Works & Materials), Volume I, 2010. Also refer criteria of concrete vide clause no 20.3.11.5 of Indian Railway Unified specifications. The 28 days compressive strength shall be the criterion for acceptance or rejection of the concrete.

The followings shall also be strictly followed.

- (i) Whenever a mix is redesigned due to a change in the quality of aggregate or cement or for any other reason, it shall be considered a new mix and initially subject to the acceptability criteria above.
- (ii) If the concrete produced at site does not satisfy the above strength requirements, the Engineer shall reserve the right to require the contractor to improve the methods of batching, the quality of the ingredients and redesign the mix with increased cement content, if necessary. The Contractor shall not

be entitled to claim any extra cost for the extra cement used for the modifications stipulated by the Engineer for fulfilling the strength requirement specified.

- (iii) It is the complete responsibility of the contractor to redesign the concrete mixes by approved standard methods and to produce the reinforced concrete conforming to the specification and the strength requirements approved by the Engineer. It is expected that the Contractor will have competent staff to carry out this work.

### **2.2.30 setting of field laboratory by the Contractor:**

- 2.2.30.1 For all works, the Contractor shall set up a field laboratory of his own for testing of cement/water/concrete at work site, which should be open for use and inspection by the DFCCIL officials at any time and carryout the tests with his own equipment's, gauges, machinery, consumables and operators, at his own cost. The laboratory shall be equipped with necessary equipment to carry out various tests such as property tests, sieve analysis, setting time of cement, compression tests on cubes, slump test, workability test etc., on aggregate, cement, water and concrete required for ensuring the required quality. For steel however, test reports of reputed institutes/laboratories are acceptable.
- 2.2.30.2 The cost of setting up the laboratory, equipping the same, maintaining conducting all tests on materials and cubes shall be borne by the contractor, within his quoted rates for works and no extra payment is eligible for the same.
- 2.2.30.3 All gauges, machines, equipment's and other measuring and testing equipment's of the laboratory shall be got checked / calibrated regularly and the necessary certificates furnished to the Engineer by the Contractor.
- 2.2.30.4 All the equipment, machinery etc., shall be kept in good working condition. Contractor shall also maintain the required qualified / experienced staff at the laboratory.
- 2.2.30.5 The following is the minimum laboratory facilities at the site which are to be provided and operated by the contractor at his cost.
  - (i) Testing of fine and coarse aggregates as per IS:383 and IS:2386.
  - (ii) Testing of cement concrete as per IS: 8142 and IS:516.
  - (iii) Testing of water as per IS: 456 and IS: 3025.

(iv) Certain non-routine testing such as (a) Testing of admixtures, (b) Chemical testing of fine and coarse aggregates (c) Permeability of concrete (permeability test on concrete shall be got done when the mix design is approved / changed of the reputed laboratories as approved by Engineer). The frequency and need for these tests shall be decided by the Engineer, based on stipulations contained in conditions of contract or on the basis of accepted Engineering practice (e.g. whenever source of admixture is changed, tests stipulated in the codes will have to be carried out afresh, etc).

**2.2.30.6** As frequently as the Engineer may require, testing shall be carried out in the field for:

- (a) Moisture content and absorption and density of sand and aggregate.
- (b) Silt content of sand.
- (c) Grading of sand and aggregates.
- (d) Slump test of concrete.
- (e) Concrete cube test.
- (f) Permeability test for concrete
- (g) Density of Plasticizer.
- (h) PH Value of water

**2.2.31** **Ladders for inspections:** Steel ladders are to be provided at the abutments and all pier locations on both sides of girder bridges to enable inspecting officials to get down from the track level to the top of the piers / abutments.

**2.2.32** **Expansion joints:** Expansion joints – strip seal elastomeric type expansion joint shall be for 80mm expansion gap in RCC deck slab as per drawings.

**2.2.33** **Seating of foundations:**

As far as possible, open foundations should be located on the firm ground having stable strata. The strata shall be well compacted before levelling course and foundations are laid on the levelling.

In case foundations resting on rock, no foundation shall be laid on sloping rock. The rock shall be made level for the width of the foundation before levelling course is laid. Before seating on the rock, capacity of the rock shall

be assessed properly and safe bearing capacity assessed in the designs is to be confirmed.

The seating of the rock shall be achieved by cutting into the rock at least by 0.50m depth to ensure removal of all weak layers and for obtaining adequate anchorage in case of open foundations. After level surface is made on the rock, a rich mix layer of 150mm thick shall be laid to even the bedding surface.

If the rock is encountered while piling, pile shall be anchored into rock to the depth as per codal provision.

**2.2.34 Drainage outlets:** 50mm galvanized GI pipes in case of deck slab in bridges will serve as drainage spouts.

## **2.3 GENERAL GUIDELINES AND SPECIFICATIONS FOR BORED CAST-IN-SITU RCC PILE FOUNDATIONS:**

2.3.1 The piles shall be bored cast-in-situ. The scope of the work included in relevant schedules is for the provision and testing of bored cast-in-situ RCC pile foundations with the pile cap. Items for piling in soil has been provided in schedule. If any boulder in the form of obstruction comes in the boring, no extra payment for piling in boulders shall be made. Bore log provided by the DFCCIL for construction are only indicative in this regard and it is the contractors' responsibility to make correct assessment of ground conditions before starting the piling operation Rate of piling is divided into four items (a) item of empty boring (b) payment of concrete in M: 35 from pile item (c) Payment of reinforcement in MT from pile item.(d) Payment of liner in MT. Rate of Item of piling includes cost of all materials, Cement and labour involved in all operations. The Payment of empty boring, concrete M35, reinforcement and liner paid separately in respective items.

### **2.3.2 CONCRETING IN BORED CAST-IN-SITU PILES**

- (i) Bored Cast-in-situ concrete piles shall be installed by making a bore into the ground by removal of material. Cast-in-situ concrete piles may be cast in metal liners which may remain permanently in place. The metal casing shall be of sufficient thickness and strength to hold its original form and show no harmful distortion after it and adjacent casings have been driven and the driving core, if any, has been withdrawn.
- (ii) Concreting and reinforcement work will be done in accordance with relevant clauses in Chapters 3 and 4 of Indian Railway Unified Standard Specifications

(Works & Materials) Volume - I, 2010 supplemented by these specifications. The decision of DFCCIL is final and binding on the contractor.

- (iii) Any liner or bore-hole which is improperly located or shows partial collapse that would affect the load carrying capacity of the pile, shall be rejected or repaired as directed by the Engineer at the cost of the Contractor.
- (v) Bored cast-in-situ piles in soils which are stable may often be installed with only a small casing length at the top. A minimum of 2.0m length of top of bore shall invariably be provided with casing to prevent any loose soil falling into the bore. In cases in which the side soil lower down can fall into the hole, it is necessary to stabilise the side of the bore hole with drilling mud, or a suitable steel casing. The casing may be left in position permanently specially in cases where the aggressive action of the ground water is to be avoided, or in the cases of piles built in water or in cases where significant length of piles could be exposed due to scour.
- (vi) For bored cast-in-situ piles, casing / liner shall be driven open ended with a pile driving hammer capable of achieving penetration of the liner to the length as approved by the Engineer. Materials inside the casing shall be removed progressively by air lift, grab or percussion equipment or other approved means. Unless otherwise approved by the Engineer, the diameter of the bore-holes shall be not more than the inside diameter of the liner.
- (vii) Where bored cast-in-situ piles are used in soils liable to flow, the bottom of the casing shall be kept enough in advance of the boring tool to prevent the entry of soil into the casing, thus preventing the formation of cavities and settlements in the adjoining ground. The water level in the casing should generally be maintained at the natural ground water level for the same reasons. The joints of the casing shall be made as tight as possible to minimise inflow of water or leakage of slurry during concreting. Where mud flow conditions exist, the casing of cast-in-situ piles shall not be allowed to be withdrawn. Prior to the lowering of the reinforcement cage into the pile shaft, the shaft shall be cleaned of all loose materials. Cover to reinforcing steel shall be maintained by suitable spacers, tied in advance to the reinforcement.
- (viii) Wherever practicable, concrete should be placed in a clean dry hole. Where concrete is placed in dry condition and there is casing present, the top 3m of the pile shall be compacted using internal vibrators.
- (ix) Before concreting under water, the bottom of the hole shall be cleaned of drilling mud and all soft or loose material very carefully. In case a hole is

bored with use of drilling mud, concreting should not be taken up when the specific gravity of bottom slurry is more than 1.2. The drilling mud should be maintained at 1.5m above the ground water level.

- (x) Where the casing is withdrawn from cohesive soils for the formation of cast-in-situ pile, the concreting should be done with necessary precautions to minimise the softening of the soil by excess water. Care shall be taken during concreting to prevent as far as possible the segregation of the ingredients. The displacement or distortion of reinforcement during concreting and also while extracting the tube shall be avoided.
  - (xi) The concrete shall be properly graded, shall be self-compacting and shall not get mixed with soil, excess water, or other extraneous matter. Special care shall be taken in silty, clays and other soils with the tendency to squeeze into the newly deposited concrete and cause necking. Sufficient head of green concrete shall be maintained to prevent inflow of soil or water into the concrete.
  - (xii) The placing of concrete shall be a continuous process from the toe level to the top of the pile. To prevent segregation, a tube or tremie pipe as appropriate shall be used to place concrete in all piles.
  - (xiii) To ensure compaction by hydraulic static heads, rate of placing concrete in the pile shaft shall not be less than 6m (length of pile) per hour. Under water concreting should be done with tremie.
  - (xiv) The maximum water cement ratio shall be 0.50 for cast in situ piles.
  - (xv) The cement content shall not be less than 400 kg/cum of concrete.
  - (xvi) The minimum slump of concrete for bored cast-in-situ piles shall 150mm to 200mm, but the slump should not exceed 200mm in any case.
  - (xvii) **Concreting under water:-**General requirements and precautions for concreting under water shall be as given in concreting chapter 3 of IR Unified Standard Specifications (Work & Materials), Volume - I, 2010 supplemented by following instructions: The decision of DFCCIL is final and binding on the contractor.
- (a) The concreting of a pile must be completed in one continuous operation. Also, for bored holes, the finishing of the bore, cleaning of the bore, lowering of reinforcement cage and concreting of pile for full height must be accomplished in one continuous operation without any stoppage.

- (b) The concrete should be coherent, rich in cement with high slump and restricted water cement ratio.
- (c) The tremie pipe will have to be large enough with due regard to the size of aggregate. For 20mm aggregate the tremie pipe should be of diameter not less than 150mm and for larger aggregate, larger diameter tremie pipes may be necessary.
- (d) The first charge of concrete should be placed with a sliding plug pushed down the tube ahead of it to prevent mixing of water and concrete.
- (e) The tremie pipe should always penetrate well into the concrete with an adequate margin of safety against accidental withdrawal if the pipe is surged to discharge the concrete.
- (f) The pile should be concreted wholly by tremie and the method of deposition should not be changed part way up the pile to prevent the laitance from being entrapped within the pile.
- (g) All tremie tubes should be scrupulously cleaned after use.
- (h) In special circumstances, the Engineer may permit use of any other proved method of concrete placement designed for under water concrete. In such cases, a detailed method statement should be prepared and got approved by the Engineer.
- (xviii) The diameter of the finished pile shall not be less than that specified and a continuous record shall be kept by the Engineer as to the volume of concrete placed in relation to the pile length cast.

2.3.3 The schedule of quantities in this contract is based on bored cast-in-situ pile of required capacity and for approximate anticipated depth as indicated in the drawings. Depth of piles is likely to vary and contractor shall have no claim whatsoever irrespective of the depth of piles provided at any and all locations. Installation of piles shall be carried out as per layout drawings, installation criteria and the instructions of the Engineer. The method of installing the piles, including details of the equipment shall be submitted by the contractor and got approved by the Engineer before start of work.

2.3.4 Piling work shall conform to specifications IS : 2911 Parts 1 & 4 unless otherwise specified.



- 2.3.5 Workmanship of bored cast-in-situ piles includes the provisions for control of piling installation, use of drilling mud, cleaning of borehole, tremie concreting, defective pile, recording of data shall be as per Clause 8 of IS: 2911(Part 1/Section 2).
- 2.3.6 The specifications for safe load, test load, total displacement, net displacement etc., shall also conform to provisions as per IS: 2911 (Part 4).
- 2.3.7 The contractor shall set out piles with precision survey duly erecting permanent bench marks and other references. He shall be responsible for correct maintenance of position and plumb thereafter and these shall be checked periodically. The control of alignment and inclination of piles shall be as per IS :2911(Part 1/Section 2). Tolerances as specified in the above code or as specified shall govern.
- 2.3.8 Level marks shall be put accurately on each pile immediately after it is installed. If any pile shows subsequently a tendency to heave up due to installation of other piles later or due to any other reason, corrective course of action shall be suggested and taken by the contractor after approval by the Engineer at the cost of contractor.
- 2.3.9 Durability provisions such as clear cover to reinforcements, minimum and maximum cement content, maximum water-cement ratio and permeability of concrete shall be adhered to as mentioned earlier and below. The exposed area of pile above the ground level. In case of harmful chemical constituents found in subsoil and in water such as chlorides and sulphides, special provisions as per relevant codes of practice shall be followed for protection against reinforcement corrosion and disintegration of concrete and for such protection against corrosion and bio-fouling, the pile concrete/liner below cut-off level shall be painted with appropriate material, if ordered by Engineer for which payment will be made separately as specified in relevant schedules.
- 2.3.10 Sulphate resistant cement may be used on need based consideration after conducting the soil investigation and water investigation. It shall not be used under such conditions where concrete is exposed to risk of excessive chlorides and sulphate attack both. Requirements of concrete exposed to sulphate attack shall be as per Table 4 of IS :456. Where chloride is encountered along with sulphate in soil or ground water, Ordinary Portland Cement with C3A contents from 5 to 8 % shall be desirable to be used in concrete instead of sulphate resisting cement. For pH around 4, steel and concrete both have to be specially quoted. If sulphate resistant cement is used which has faster setting properties, curing shall start within five hours of concreting.
- 2.3.11 Method of boring, namely, Bailer and Chisel, Rotary, Direct Mud Circulation (DMC), Reverse Mud Circulation (RMC), Percussion, etc., shall be chosen as appropriate to strata and site conditions. The agreement rates for piling are inclusive of any type of

boring/any type of supporting arrangements adopted by the contractor and no extra payments are admissible for any type of scheme adopted by the contractor.

2.3.12 Borehole stability shall be maintained with casing and/or mud circulation..

2.3.13 Use of drilling mud (Bentonite) in stabilizing the sides of bore holes is mandatory in soils of inadequate capacity. The decision on the need of use of Bentonite will be taken by the Engineer which is final. The bentonite slurry shall be maintained at 1.5m above the ground water level during boring operations and till the pile is concreted. The bentonite slurry shall be under constant circulation till start of concreting and shall meet the requirements stipulated in the subsequent clauses. Agreemental rates for piling includes the cost of Bentonite and related operations and the contractor cannot claim any extra cost on this account.

2.3.14 Providing MS Liners: This item is for supply and fixing contractor's permanent MS liners for the pile from the top of working platform upto the required depth as may be decided by the Engineer. The contractor shall fabricate the MS liners from his own MS sheets to suit the diameter of the pile as directed. Required length of MS liners will be made up by welding each unit outside by the contractor with his own equipment and plants. It shall be clearly noted that the MS sheets required for manufacture of the liners shall not be supplied by the DFCCIL. The welding shall be of proper quality so as to withstand the hammering forces. The payable depth shall however, be measured only from the cut off level though the liner might have been provided right from the level of working platform on practical considerations, since the length above the cut off level has to be necessarily removed by gas cutting for facilitating peeling of the top portion of the pile and for interlacing its reinforcement bars into the capping slab. Therefore, the rate quoted shall cater for the element of cutting and removing the surplus length of MS liners. There is, however, no objection for the surplus pieces, if usable, are united and are re-welded to the required length for reuse on some of the other piles. No claim shall be entertained if the cut pieces cannot be reused by the contractor.

2.3.15 The contractor shall take all necessary precautions while piling close to existing structures/other foundations/track so as to minimize vibrations and ground movement. Bores shall be encased as directed by the Engineer and boring shall commence only after precautionary measures are taken. While working near the existing track, infringements and other safety aspects shall be specially considered and taken care of.

2.3.16 The contractor shall indemnify the DFCCIL Administration against any claim or obligations arising out of any damage to structure or out of any injury to any person/persons due to piling working done by him.

- 2.3.17 The contractor shall mobilize and maintain requisite resources for piling including concreting. Additional resources, as a standby shall also be available in advance of work, to take care of any eventualities. Admixtures as approved by Engineer, shall be kept in readiness before concreting to meet any exigencies. After boring and/or cage lowering to avoid borehole instability and settlement of bentonite, boreholes shall not be left un-concreted for long.
- 2.3.18 The spoils arising out of boring shall be disposed off as directed by Engineer within the agreed rates. In case of piling close to Railway track or near the existing road, contractor shall make adequate arrangements for disposing the muck away properly. Contractor shall also make adequate drainage arrangement for mud slurry so that the same does not affect the tracks or roads or adjoining properties.
- 2.3.19 The bored spoils may be dumped in a low lying area as directed by Engineer so that work site is restored back to normal condition after completion of work.
- 2.3.20 When the bore has reached its final depth, it shall be free from any foreign matter before placing the reinforcement cage and concreting for the pile is started. Reinforcement for the pile shall be carefully placed in position and concreting then started. The cover block used also shall satisfy strength and permeability criteria.
- 2.3.21 If hard rock is encountered, socketing in hard rock shall also be provided as per codal provision.
- 2.3.22 In case of sloping bedrock profile, the requisite depth of socketing shall be ensured as minimum all round piling and the payment will be made for the least depth of socketing only and no claims of differential depth of socketing are admissible.
- 2.3.23 The bottom level of pile cap will be decided by Engineer, depending upon capacity and ground level.
- 2.3.24 Care shall be taken for free flow of concrete through splices and congested reinforcement zones with proper detailing and monitoring.
- 2.3.25 The quantity of concrete required for a particular pile shall be calculated as per depth of the pile and nominal diameter of the pile. This quantity shall be checked with the actual quantity of concrete used, which is to be recorded and signed jointly by the contractor and representative of the DFCCIL. Theoretical quantity of concrete, calculated as per depth and nominal diameter of the pile shall form the basis of calculating the cement quantity as per approved design mix, for payment to the contractor,

- 2.3.26 For the finishing of pile heads, the clearances of reinforcements in the pile cap and the keying of the pile head into the pile cap shall be as given in IS : 2911.
- 2.3.27 The contractor shall maintain bore log register and bored samples for each pile boring and concreting. The details shall contain various operations in pile boring with time, type of soil met with depth of penetration with levels, liner welding and lowering details, obstruction to boring, if any, machine down time, rock touch level and final socketed level. The flushing out details before cage lowering and before concreting shall also be recorded. The concreting details such as mix proportions, sounding at various depths vis-à-vis cement / concrete consumption, unusual observations while concreting, interruption to concreting, if any and overflow concrete shall be recorded. The swelling and/or squeezing of borehole in uncased portion shall be specially monitored with recording of sounding depth, quantity concreted actually and quantity theoretically estimated corresponding to that sounding depth.
- 2.3.28 The payable depth of piles shall be taken up to the clear distance from the cut-off level (bottom of pile cap) to the average bottom of the bore. The depth so measured shall be rounded off to the nearest first decimal of a metre (0.05 metre or more to be reckoned as 0.10 metre whereas below 0.05 metre to be reckoned as 0.00 metre) for the purpose of making payment.
- 2.3.29 In group of two or more piles, piles of same diameter and same load carrying capacity shall be installed. The distance between centre to centre of such piles shall be governed by IS :2911. In case the contractor offers to install the piles closer than this spacing, he shall state the reduction in the working load of the pile which will be subject to the approval of Engineer. The additional piles required on this account shall be provided by the contractor without any extra cost to the DFCCIL. Also cost of cement and steel reinforcement used on this score will have to be borne by the contractor. New MS liners shall also be to contractors account.
- 2.3.30 If any pile during boring has deviated from the design position or from the verticality or if the safe allowable load of the pile is not obtainable as per the design, all these facts shall be reported promptly to the Engineer during the execution of the work with suggestion from the contractor regarding adequate corrective measures. The Engineer shall consider the suggestions of the contractor and shall give necessary directions for the corrective measure which shall be done by the contractor at his own cost and risk. However, if certain piles are rejected by the Engineer on account of improper location / verticality / alignment / capacity, the Engineer may allow the rejected piles to be left in their places and additional piles may be installed to take up the safe working load of the rejected piles with satisfaction of Engineer without any extra cost to the DFCCIL. If any such changes involve additional expenditure due to

increase in size of pile cap, etc., the same shall also be borne by the contractor including the extra cost involved in the usage of the extra quantity of cement and steel used in such changes.

2.3.31 No payment will be made for rejected piles and also for the cement, steel and the MS liners provided for the rejected piles.

2.3.32 **Pile load Test:** IS : 2911 (Part 4) prescribes various guidelines and procedures for load tests on piles. Pile load test shall be conducted as per IS : 2911 (Part 4) and as directed by the Engineer. Vertical load tests (compression) and lateral load tests shall be adopted for testing of piles. There shall be two categories of tests on piles for each type of loading (vertical and lateral), namely, initial tests and routine tests. Initial tests should be carried out on test piles which are not to be incorporated in the work. Routine tests shall be carried out as a check on working piles.

Initial load test is carried out to determine the ultimate load capacity and arrival at the safe load by application of factor of safety whereas routine test is conducted to determine the safe load of pile, checking the safety load and extent of safety. In other words, routine test is conducted to check whether the pile is capable of taking the working load assigned to it.

Non-destructive testing i.e. Integrity testing of pile using Low Strain / Sonic Integrity Test / Sonic Echo test method in accordance with IS : 14893 shall be carried out for integrity testing of concrete in the installed pile.

The vertical load test and lateral load test shall be carried out as per clause 6 and 7 of IS : 2911 (Part 4).

Safe load on a pile is derived by applying a factor of safety on ultimate load capacity of pile as determined by a load test whereas working load is the load assigned to pile according to design. The safe loads on single pile and on group of piles for the initial test and routine test shall be in accordance clause 6.1.5 and 6.1.6 of IS : 2911 (Part 4). Test load shall be 2.5 times the safe capacity load for Initial Load. For routine test, test load shall be at least 1.5 times the working load for maximum settlement not exceeding 12mm in case of single pile whereas test load shall be equal to the working load for maximum settlement not exceeding 25mm in case of group piles.

The test shall be carried out at cut off level wherever practicable, otherwise suitable allowance shall be made in the interpretation of the test results / test load if the test is not carried out at cut-off level.

The contractor shall submit all data along with load vs settlement, time vs settlement, interpretation of the pile load test, etc., in a report along with characteristics of the pile as per IS 2911 and as directed by the Engineer.

For any other type of test such as pull out tests, etc. if considered necessary, the contractor shall make arrangements in consultation with the Engineer and payments for the same will be eligible as decided mutually in advance.

Payment for initial vertical load test, routine vertical load test and lateral load test will be made against a separate item provided in the schedule.

**2.3.33** The contractor is required to carry out load test in pile or group of piles as per provisions contained in IS : 2911 (Part 4) of and shall provide all the designing, testing, loading, supporting, instrumenting, recording & reporting arrangements at the agreement rates. The design, instrumentation etc., shall be approved by the CGM/North, DFCCIL.

**2.3.34** The payment for the test of the pile or group of piles shall be made to the contractor only when the test is found to be satisfactory. For tests which are found to be unsatisfactory or which are not completed due to any reasons whatsoever, no payment shall be made to the contractor.

**2.3.35** The agreemental rates for tests include instrumentation, reporting, arranging of necessary kentledge, R.S. Joists, sand bags, etc, required for loading the platform for successful testing of the pile or group of piles and removing the same from the site of work after the test is completed and clearing the site to the satisfaction of the Engineer and no extra payment shall be made on this account.

**2.3.36** In case of defective piles, DFCCIL reserves the right to order, at the cost of contractor, non-destructive test for integrity and / or capacity assessment or additional static load tests as confirmatory tests at the cost of the contractor. The test shall be considered satisfactory only if the criteria laid in specifications are satisfied and the behaviour of the pile or pile group during the period of test does not disclose any defects as specified in relevant codes and as directed by the Engineer.

**2.3.37** Each pile shall be identified with a reference member. Level marks shall be accurately painted on each pile immediately after its installation. The contractor shall record all the information during installation of piles as directed by the Engineer. Pile records in triplicate shall be submitted by the contractor.

**2.3.38** Approval of the termination depth of the pile by the Engineer shall, in no way, absolve the contractor on the integrity of the pile.



**2.3.39 Control of Position and Alignment:** Piles shall be installed as accurately vertical (for vertical piles) as possible. The permissible limits for deviation with respect to position and alignment shall conform to IS: 2911 (Part 1/Section 2).

2.3.40 Working level shall be above the cut-off-level. After the initial boring of about 1m, temporary guide casing of suitable length shall be lowered in the pile bore for vertical pile. The diameter of guide casing shall be such as to give the necessary finished diameter of the concrete pile. The centre line of guide casing shall be checked before continuing further boring. Guide casing shall be minimum of 1.0m length. Additional length of casing may be used depending on the condition of the strata, ground water level etc. The temporary guide casing (if provided) shall be withdrawn cautiously, after concreting is done upto the required level. While withdrawing the casing, concrete shall not be disturbed.

2.3.41 Permanent MS Liners shall be provided for piles upto point of refusal or as directed by the Engineer. The bottom end of the MS Liner shall be stiffened by welding additional plates to withstand the impact during driving.

2.3.42 In case hard rock is encountered, chiseling is essentially required for softening of the rock, the same may be adopted only on approval of the Engineer, at no extra cost to the DFCCIL. Advancement of pile bore shall be done by drilling only, in case of use of rotary hydraulic drilling rig.

2.3.43 Specifications for Bentonite shall be as follows: Liquid limit of bentonite when tested in accordance with IS: 2720 (Part V) shall be 400 percent or more. Bentonite solution should be made by mixing it with fresh water using pump for circulation. The density of the freshly prepared bentonite suspension shall be between 1.03 and 1.10 gm / ml depending upon the pile dimensions and type of soil in which the pile is to be installed. However, the density of bentonite suspension after mixing with deleterious materials in the pile bore may be upto 1.25 gm / ml. The marsh viscosity when tested by a marsh cone shall be between 30 to 60stoke. The pH value of the bentonite suspension shall be between 9 and 11.5.

2.3.44 Cleaning of borehole:- After completion of borehole upto the required depth, the borehole shall be cleaned as per clause 8.3 of IS : 2911 (Part 1/Section 2).

2.3.45 A protocol shall be maintained regarding the strata at the founding level, SPT value, percent core recovery, Unconfined Compressive Strength (UCS) from the nearest borehole, socketing horizon, flushing of pile bore, time interval between end of boring and start of concreting, bentonite density before start of concreting.

2.3.46 Top of Concrete in Pile and Cut off-level (COL):- Cut-off-Level of piles shall be as indicated in drawings released for construction. The top of concrete in pile as cast

shall be above the cut-off-level by 1.0 metre (maximum) to remove all laitance and weak concrete and to ensure good concrete at cut-off-level, for proper embedment into the pile cap. The area surrounding the piles shall be excavated up to the bottom of the pile caps. After seven days of concreting of pile, the exposed part of concrete above the COL shall be removed / chipped off and made rough at COL. The projected reinforcement above COL shall be properly cleaned and bent to the required shape and level to be anchored into the pile cap. The pile top shall be embedded into the pile cap by 150 mm or clear cover to reinforcement, whichever is higher. All loose material on the top of pile head after chipping to the desired level shall be removed and disposed off as directed by the Engineer.

2.3.47 Reinforcement: The longitudinal reinforcement shall project 50 times its diameter above cut-off-level unless otherwise indicated. Proper cover to reinforcement and central placement of the reinforcement cage in the pile bore shall be ensured by use of suitable concrete spacers or rollers, cast specifically for the purpose. Placement of reinforcement cage to its full length shall be ensured before concreting. Minimum clear cover to the reinforcement shall be 75 mm, unless otherwise mentioned.

2.3.48 Building Up of Piles: If any pile, already cast as per construction drawing, requires any extra casting due to any change in cut-off-level, then the pile shall be built up by using at least one grade higher concrete than specified for piles, ensuring proper continuity with the existing concrete and to the satisfaction of the Engineer. Necessary reinforcement, as per design requirement and suitable shuttering shall be provided, before casting the concrete. Surrounding soil shall also be built up to the required level by proper compaction, to ensure lateral capacity of the pile.

2.3.49 Breaking Off: If any pile already cast requires breaking, due to subsequent change of Pile's cut-off-level, then the same shall be carried out, not before seven days of casting without affecting the quality of existing pile, such as loosening, cracking etc., and to the satisfaction of the Engineer. If any pile is cracked, the same shall be replaced by the contractor at his own cost.

2.3.50 Bore Hole testing: Bore hole shall be made as per IS:1892.

### **2.3.51 IMPORTANT CONSIDERATIONS, INSPECTION / PRECAUTIONS**

- (i) While concreting uncased piles, voids in concrete shall be avoided and sufficient head of concrete shall be maintained to prevent inflow of soil or water into the concrete. It is also necessary to take precautions during concreting to minimise the softening of the soil by excess water. Uncased cast-in-situ piles shall not be permitted where mudflow conditions exist.



- (ii) The drilling mud such as bentonite suspension shall be maintained at a level sufficiently above the surrounding ground water level to ensure the stability of the strata which is being penetrated all through the boring operation and until the pile has been concreted.
- (iii) Where bentonite suspension is used to maintain the stability of the bore-hole, it is essential that the properties of the material be carefully controlled at stages of mixing, circulating through the bore-hole and immediately before concrete is placed. It is advisable to limit:
  - (a) The density of bentonite suspension to 1.05 g/cc and maintain it.
  - (b) The marsh cone viscosity between 30 and 40.
  - (c) The pH value between 9.5 and 11.50
  - (d) The silt content less than 1 per cent
  - (e) The liquid limit of bentonite not less than 400 per cent

These aspects shall act as controlling factors for preventing contamination of bentonite slurry by clay and silt.

- (iv) The bores shall be washed by bentonite flushing to ensure clean bottom at two stages viz. (a) after completion of boring and (b) prior to concreting after placing of reinforcement cage. Flushing of bentonite shall be done continuously with fresh bentonite slurry till the consistency of inflowing and outflowing slurry is similar.
- (v) Tremie of 150mm to 200mm diameter shall be used for concreting. The tremie should have uniform and smooth cross-section inside, and shall be withdrawn slowly ensuring adequate height of concrete outside the tremie pipe at all stages of withdrawal. Other precautions to be taken while tremie concreting are:
  - (a) The sides of the bore-hole have to be stable throughout
  - (b) The tremie shall be water tight throughout its length and have a hopper attached at its head by a water tight connection.
  - (c) The tremie pipe shall be large enough in relation to the size of aggregates. For 20mm aggregate the tremie pipe shall be of diameter not less than 150mm and for larger size aggregate tremie pipe of larger diameter is required.
  - (d) The tremie pipe shall always be kept full of concrete and shall penetrate well into the concrete in the bore-hole with adequate margin of safety against accidental withdrawal if the pipe is surged to discharge the concrete.

- (e) For very long or large diameter piles, use of retarding plasticiser in concrete is desirable.

### **2.3.52 Pile Data:**

The contractor shall submit data in the following proforma for each pile indicating all technical details along with date and time of various operations in adequate permanent forms/copies for record.

#### **Performa:-**

- (i) Reference No. Location (Co-ordinates) \_\_ area.
- (ii) Sequence of installation of piles in group
- (iii) Pile diameter & type
- (iv) Working level (Platform level)
- (v) Cut off level (COL)
- (vi) Actual length below COL
- (vii) Pile termination level
  - (a) Start of socket (Level)
  - (b) Termination of pile (Level):
- (viii) Top of finished concrete level
- (ix) Date and time of start and completion of boring.
- (x) Depth of ground water table in the vicinity.
- (xi) Type of soil/ rock at pile tip
- (xii) Method of boring operation
- (xiii) Details of drilling mud (Bentonite) as used:
  - (a) Freshly supplied mud:
    - Liquid limit
    - Sand content
    - Density

Marsh viscosity

Swelling index,

PH value

(b) Contaminated mud:

Density

Sand content

(xiv) (a) Standard Penetration Test (SPT) Penetration for 100 blows at Socketing Level for reference pile:

(b) Unconfined Compression Strength (UCS) Value in rock (from the nearest bore hole): Core recovery (from the nearest bore hole):

(c) Rate of drilling in mm / hr:

(1) At start of socketing horizon

(2) At termination level

(xv) Date and time of start and completion of concreting.

(xvi) Method of placing concrete

(xvii) Concrete quantity

Actual:

Theoretical:

(xviii) Ref. number of test cubes

(xix) Grade and slump of concrete

(xx) Results of test cubes

(xxi) Reinforcement details:

Main reinforcement Stirrups: Type

No. \_\_\_\_\_ No. \_\_\_\_\_

Dia \_\_\_\_\_ Dia \_\_\_\_\_

Depth \_\_\_\_\_ Spacing \_\_\_\_\_

- (xxii) Any other information regarding obstructions, delay and other interruption to the Sequence of work.
- (xxiii) Pile bore log details (in brief).

**2.3.53** Such structure or parts of the structure which fail or pass the specified tests, shall be removed from the site by the tenderer/contractor at his cost and the contractors shall redo the work. Payments made on account of the rejected structure/part structure work shall be recovered from the contractor and the work will be redone by him at the same rates.

## **2.4 GENERAL GUIDLINES AND SPECIFICATIONS FOR SUPPLY OF REINFORCEMENT AND STRUCTURAL STEEL**

### **2.4.1 SUPPLY OF STEEL FOR VARIOUS WORKS:**

Supply of steel to various specifications as required under various schedules in the contract is governed by the Technical specifications and Special Conditions specified hereunder.

All steel shall be supplied by the Contractor at the site of work and stacked, stored, protected and maintained by him at his cost till they are put into use. Any temporary structure required for storage of steel etc., has to be provided by the Contractor at his cost and should be removed after completion of the work. The DFCCIL will only provide suitable land for construction of the above temporary shed free of cost wherever available.

For supply and use of steel in various works, relevant IRS Codes Specifications, IS Specifications and Railways / MORTH specifications will be applicable or relevant. The decision of DFCCIL shall be final and binding on the contractor.

.

### **2.4.2 SPECIFICATIONS FOR STEEL:**

2.4.2.1 The steel supplied by the contractor must satisfy any of the following material specifications as required for the work along with other concerned specifications.

- (i) The reinforcement steel shall be Thermo mechanical Treated bars of grade Fe 500 conforming / satisfying to IS 1786 (Upto date).
- (ii) The structural steel shall be conforming to IS 2062 (Upto date) as specified. It shall have Sub quality 'B0' & Grade E250 (Fe 410 W) as mentioned in the tender schedule and the requirements of IRS B1-2001 shall be fulfilled for all

components for all spans. 12 mm thick & above plates are fully killed and fully normalized / controlled cooled as mentioned in the tender schedule. 'B0' sub quality indicate the requirement of impact test at zero-degree temperature and should conform to Charpy Impact Test at zero-degree temperature in accordance with relevant I.S. Code.

- (iii) Relevant other IS and IRS Specifications with regard to properties, testing and use of the above steel items also shall govern.

**2.4.2.2** The contractor shall produce the manufacturers test certificate for each lot of supply satisfying the requirements of relevant IS specifications and at the specific frequency as laid down.

**2.4.2.3** The Contractor shall arrange to carryout additional tests on physical properties of steel for every 40 metric tonne (t) of steel and for every change in lot / batch for reinforcement steel and structural steel at his cost. No extra payment will be made for conducting such tests and the agreemental rate is inclusive of above testing charges.

### **2.4.3 PROCUREMENT OF STEEL:**

**2.4.3.1** All Reinforcement steel (TMT bars) and Structural Steel shall be procured as per specification mentioned in BIS's documents – IS:1786 and IS:2062. Independent tests shall be conducted, wherever required, to ensure that the materials procured conform to the Specifications.

These steel shall be procured only from those firms, which are Established, Reliable, Indigenous & Primary Producers of Steel, having Integrated Steel Plants (ISP), using iron ore as the basic raw material and having in-house iron rolling facilities, followed by production of liquid steel and crude steel, as per Ministry of Steel's (Government of India) guidelines.

However, only certain isolated sections of structural steel, not being rolled by ISPs, can be procured from the authorized re-rollers of ISPs or authorized licensee of BIS having traceability system and who use billets produced by ISPs with the approval of Engineer.

**2.4.3.2** The contractor shall have to submit the cash memo and challans along with the lot / batch of steel purchased in token of proof of purchase of steel from reputed dealers. Steel shall be approved by Engineer only after production of necessary certificates before use in works.

#### **2.4.4 REINFORCEMENT AND STRUCTURAL STEEL:**

- 2.4.4.1 Payment for supply of all types of steel shall be made for the quantity required / used as per the drawings issued from time to time. No payment will be admissible for quantity supplied in excess of the required quantity as per drawings. However, contractor will be permitted to take the excess quantity back by his own means, but no claim for payment for transportation so involved will be admissible. No payment will be made for more supply of steel at the site / excess used in Construction. No payment will be made for steel used in temporary or enabling works unless explicitly provided for in the Schedules. Steel for enabling/temporary works shall be arranged by the Contractor at his own cost.

#### **2.4.5 STAGE PAYMENTS FOR STRUCTURAL STEEL:**

- 2.4.5.1 No Advance Payment shall be made. However, stage payment for manufacturer of steel girders shall be made as per Bills of Quantities by the DFCCIL for steel physically brought to site by the contractor.

- 2.4.5.2 Stage payment for steel will be released subject to the following conditions:

The steel shall be delivered at site and properly stored under covered sheds in measurable stacks and separately maintained for various sizes, sections and dates of supply.

The quantities of steel shall be brought to the site only in such instalments that would facilitate smooth progress of work and consumed in reasonable time. The payment will be restricted to a maximum of 30% of the schedule quantity at any point of time.

Proper accountable in the Steel Register is to be maintained in the prescribed format at the site for the receipt and use of the steel.

Ownership of such steel shall be deemed to vest with the DFCCIL.

Before releasing the stage payment, the contractor shall insure the steel at his own cost in favour of DFCCIL against theft, misuse, damages, fire etc.

The price variation claim for steel will continue to be governed as per extant PV clause and with reference to delivery at site.

The Stage payment will be made, only when the Engineer or his authorized representative certifies that the said quantity of steel is received at site and entered in the register and that in his opinion the steel is actually required in accordance with the contract.

No Stage payment is permitted for steel required for temporary and enabling works.

**2.4.5.3** (i) 60% payment shall be released after fabrication and receiving fabricated component at ROB site.

(ii) 20% payment shall be released after assembling the fabricated components as per drawing at ROB site.

(iii) 20% payment shall be released after erection and completion of item.

**2.4.5.4** Any Stage payment found to be made against the materials brought to the site in excess over the actual materials consumed in work shall be recovered from the contractor dues.

**2.4.6 OTHERS:**

2.4.6.1 Reinforcement steel and structural steel, shall be stored in such a way so as to avoid distortion and to prevent deterioration by corrosion. All steel used should be free from loose Mill scale, loose rust, paints and oil covering / coating etc.

2.4.6.2 Steel material, for which stage payment has been availed by the Contractor, shall be property of DFCCIL and will be issued to contractor by Engineer whenever required for the work. Contractor will be solely responsible for guarding against theft / misuse of the consignment due to any cause what so ever. The stage payment will be made, only when the Engineer certifies that in his opinion that the materials are actually required in accordance with the contract. It is the responsibility of the agency to ensure that steel as per the requirement is brought to site as per approved drawings / requirements.

2.4.6.3 The contractor shall be bound to store the materials at site of work earmarked for the purpose by the Engineer and shall not remove from the site nor use for any other purposes than exclusively for execution of the work for which the materials are intended for. Safe guarding of the materials is the responsibility of the contractor even if the material is deemed to be owned by the DFCCIL and insurance etc., have been arranged by the contractor.

2.4.6.4 Contractor shall remove from site any steel materials rejected by the Engineer within reasonable time as specified by him.

2.4.6.5 Before the test pieces are selected, the Contractor shall furnish copies of the mill records of the reinforcement steel giving number of coils in each cast with sizes and identity marks to enable identification of the material with the bill produced.

## 2.5 GENERAL GUIDELINES AND SPECIFICATIONS FOR FABRICATION & ERECTION OF COMPOSITE GIRDER AND SPECIAL CONDITIONS

### 2.5.1 GENERAL:

This chapter covers the supply of material, fabrication, assembly and erection of Composite Girder/ BOW string/RCC Girders and bearings.

The composite girder shall be fabricated / erected as per approved GAD/ Design and launching scheme provided.

For detailed technical specifications for fabrication and erection of girders, refer special condition and specification for "Schedule-F", added to superseded by Additional Specifications if any, appended to or as modified from time to time and Indian Railway Specification for Fabrication and Erection of Steel Girder Bridges and Locomotive Turn-Tables (Serial No B1-2001) shall be followed.

**Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway is to be constructed. The superstructure of these ROB's in Railway portion is composite girder.**

Composite girder is a combination of plate girders and deck slab. These girders involve the use of shear connector also. The Width of bridge is as per approved GAD and approved design.

The RCC deck slab has been designed with design Mix Concrete with grade of Concrete M35. The environmental exposure condition of this area where these ROB's are being constructed is moderate. As per moderate condition, minimum grade of concrete required as per Addendum and Corrigendum slip no 12 of Concrete Bridge Code - 1997 is M30. Minimum grade of concrete requirement is for durability of the structure. Hence, M35 satisfies the codal provisions of Concrete Bridge Code.

| SL. No. | Level Crossing No | Chainage of ROB (km) | Appx configuration Bridge proper (m) | Span for | Appx configuration approaches (m) | Span for |
|---------|-------------------|----------------------|--------------------------------------|----------|-----------------------------------|----------|
| 1       | 49                | 96/4-6               | 2x36<br>(Composite girders)          |          | 23*24.0m                          |          |



The bearings used in these girders are Elastomeric / POT cum PTFE Bearing as per approved GADs & design. The contractor has to purchase the bearings from the approved manufacturers of Railways/RDSO/State Government as may be applicable or relevant, as per approved drawing. The decision of DFCCIL shall be final and binding to the contractor.

Bearing design shall be done by bearing manufacture are as per load/forces on bearing given in the drawing and design/ drawing of bearing shall be got approved from Consultant. The cost of design of bearing shall be borne by the contractor. The decision of the DFCCIL shall be final and binding two the contractor.

Pin and Metallic Guide bearing have also been shown in the drawings of superstructure of RDSO composite girders. But these are used in Seismic Zone IV and V. For this work, these bearings are not applicable.

The 18m, 22m, 24m, 30m, 36m, 48m and 62m etc as per GADs span Composite plate girder/ Bow string girder/ Open Web Girders are to be fabricated as per Indian Railway Specification for Fabrication and Erection of Steel Girder.

Bridges and Locomotive Turn-Tables (Serial No B1-2001).

High Strength Friction Grip Bolts (HSFGB) shall be used as per drawings of RDSO Notes for use of HSFGB are given in drawing no. RDSO/B-11760/R.

For skew ROBs, please refer drawing no. RDSO/B-11759/R.

Protection screen is to be provided as per RDSO Drawing No RDSO/ETI/0068 in each ROB.

The protective coating is to be given to the composite girder by metalizing with sprayed aluminium as recommended in RDSO drawings.

The Contractor will be required to develop jigs & Masters for each components of composite Girder and same will be approved by DFCCIL authorized inspecting officials. Masters templates should be stored & handled carefully and should be used only for checking the correctness of the jigs from time to time.

After successful inspection of the fabricated components, appropriate surface treatment i.e. metalizing shall be rendered & components transported to bridge sites.

Contractor will be responsible for making material dumping and girder erection yard as per the requirement for which no extra payment will be made by the DFCCIL to the Contractor

### **2.5.2 Site Inspection**

Tenderers are requested to inspect the site and carry out careful examination to satisfy them as to the nature of work involved and facilities available at the site. They should note carefully all the existing structures and those under construction through other agencies. They should also study the suitability of utilizing the different equipment's and the machinery that they intend to use for the execution of the work. The tenderers should also select suitable sites for the purpose of locating their store yard, laboratory, staff quarters etc., and satisfy themselves with regard to the feasibility of transporting the plate girders from the yard to the final site of placement etc.

### **2.5.3 Brief Design Data**

The composite girders has been designed as per relevant IRS / IRC / RDSO codes & other guidelines.

### **2.5.4 Codes and Specifications:**

The materials as well as execution of works shall be confirming to the following specifications and codes of practice (Latest Revision of the Specification /Codes & upto date correction slips to be referred).

#### **2.5.4.1 Indian Railway Standard Codes and Specifications:**

- (i) IR Specification for Fabrication of steel girder bridge & Locomotives turn tables (fabrication specification) – SERIAL NO. B1-2001 issued by RDSO, Reprint -2008 incorporating A & C slip upto 4 (upto date).
- (ii) IRS : Welded Bridge Code (1989)
- (iii) IRS : Steel Bridge Code (2003 )
- (iv) IRS: M-28 Specifications for electrodes.
- (v) IRS: M-39 Specification for wire flux for SAW.

#### **2.5.4.2 Indian Standard Specification:**

- (i) IS: 2062-2011 Specification for structural steel.
- (ii) IS: 813-1986 Scheme of symbols for welding.
- (iii) IS: 800-2007.
- (iv) IS: 9595-1996 Manual for metal arc welding.

- (v) IS: 818-1968 Code of Practice for safety and Health requirements in electric and gas welding operations.
- (vi) IS: 5666-1970 Etch (Pre-treatment) Primer
- (vii) IS: 104-1979 Specification for Ready mixed paint, brushing, zinc chrome, Priming
- (viii) IS : 2339-1963 : Aluminium paint
- (ix) IS: 2004-1991 Carbon steel forgings for general engineering purposes.
- (x) IS: 1852-1985 Rolling and cutting tolerances for hot-rolled steel products.
- (xi) IS: 1148-2009 Rivet bars for structural purposes.
- (xii) IS: 4353-1995 Recommendations of Sub-merged Arc welding of mild steel and low alloy steel.
- (xiii) IS: 3935-1966 (shear connector)

### **2.5.5 Materials**

**2.5.5.1** Steel (Plates and Rolled sections) should conform to IS: 2062-2011. It shall have Sub quality 'B0' & Grade E250 (Fe 410 W) as mentioned in the tender schedule and the requirements of IRS B1-2001 shall be fulfilled for all components for all spans. 12 mm thick & above plates are fully killed and fully normalized / controlled cooled as mentioned in the tender schedule. 'B0' sub quality indicate the requirement of impact test at zero-degree temperature and should conform to Charpy Impact Test at zero-degree temperature in accordance with relevant I.S. Code.

Material supplied by the manufacturers shall be ultrasonically tested as per codal provisions at the manufacturer's premises before dispatch. The contractor on receipt of supply in his factory premises/fabrication workshop may have to carryout random USFD testing as per standards laid down in various codes and verify them with the list received from manufacturers, if instructed by the inspection agency/ Site Engineer. Only tested steel shall be used for fabrication. The steel shall comply in all respects with the requirements of approved drawings and relevant codes and specifications and it may be noted that quality of steel used for fabrication shall be the essence of the contract & shall be rigidly followed.

**2.5.5.2** Structural Steel shall be procured as per specification mentioned in BIS's documents – IS : 2062-2011. Independent tests shall be conducted, wherever required, to ensure that the materials procured conform to the Specifications.

These steel shall be procured only from those firms, which are Established, Reliable, Indigenous & Primary Producers of Steel, having Integrated Steel Plants (ISP), using iron

ore as the basic raw material and having in – house iron rolling facilities, followed by production of liquid steel and crude steel, as per Ministry of Steel's (Government of India) guidelines.

However, only certain isolated sections of structural steel, not being rolled by ISPs, can be procured from the authorized re-rollers of ISPs or authorized licensee of BIS having traceability system and who use billets produced by ISPs with the approval of Engineer.

### **2.5.6 Test Certificates& Testing**

All materials for the work shall pass Mechanical test, Charpy test, Chemical Analysis, etc. prescribed by the relevant IS specifications or such other equivalent specifications.

For all materials including HSFG bolts, the contractor shall furnish copies of test certificates from the manufacturers including proof sheets, mill test certificates, etc. showing that the materials have been tested in accordance with the requirements of various specifications and codal provisions.

If any further testing of materials is required by Engineer in respect of these and other items, it shall be arranged for by the contractor at a reputed laboratory/National test house as approved by Engineer. For this, nothing extra shall be payable and accepted rates in the schedule of items shall be deemed to include this.

Even satisfactory outcome of such tests or analysis shall in no way limit, dilute or interfere with the absolute right of the Engineer to reject the whole or part of such materials supplied, which in the judgement of the inspecting authority does not comply with the conditions of the contract. The decision of the Engineer in this regard shall be final, binding and conclusive for all purposes.

The Engineer shall be empowered, at his/her discretion to make or have made under the supervision, any of the tests specified in the specifications mentioned herein in addition to such other tests as he/she may consider necessary, at any time upto the completion of the contract and to such an extent as he/she may think necessary to determine the quality of all materials used therein. In doing so, he/she shall be at liberty under any reasonable procedure, he/she may think fit to select, identify, have cut-off and take possession of test pieces from the material either before, during or after its being worked up into the finished product.

The Engineer shall also be empowered to call for a duly authenticated series of mechanical tests to be obtained from the maker for this materials used in the work and to accept the same in lieu of other tests to the extent he/she deems fit. The Contractor shall supply the material required for the test pieces and shall also prepare the test pieces necessary.

The test shall be carried out by the Contractor, for which Contractor shall provide all facilities including supply of labour and plant. Engineer may at his/her discretion direct the Contractor to despatch such tests pieces as he/she may require to the National Test House or elsewhere as he/she may think fit for such testing purposes.

The Engineer may at his/her discretion, check test results obtained at Contractor's work by independent tests at National Test House.

The Engineer shall at all times be empowered to examine and check the working of the Contractor's plant before and after using it. Should the Contractor's plant be found, in the Engineer's opinion, unreliable, he/she is empowered to cancel any tests already carried out in this contract and have these tests carried out at any National Test House or elsewhere, as he/she may think fit.

### **2.5.7 Packing**

All projecting plates or bars shall be kept in shape by timber or angle bars spiked or bolted to them and the ends of chord lengths, end posts etc at their shipping joints shall be protected and stiffened so as to prevent damage or distortion in transit as the Engineer may direct.

All threaded ends and machined surfaces are to be efficiently protected against damage in transit. The parts shall be transported in convenient lengths.

All straight bars and plates except small pieces are to be transported in convenient bundles temporarily riveted or bolted together or bound with wrought iron or suitable wire as the Engineer may direct. All bolts, nuts, washers, plates under 300mm square and small articles generally are to be packed separately for each span in cases each weighing when full not more than 350 kg or in strong petroleum casks, or barrels as approved by Engineer. If not entirely filled by the contents the space left shall be closely packed with wood shaving or other suitable material. HSFG & other temporary Bolts of different sizes shall be separately packed in bags, each bag having a label indicating its contents. A list of contents shall be placed on top of each case or cask.

### **2.5.8 Stacking Materials:**

The materials, on receipt at site, shall be carefully unloaded, examined for defects, checked, sorted and stacked securely on a level bed out of danger from flood and out of contact with water or ground moisture. All materials shall be available for inspection by the Engineer.

The materials shall be verified with the marking shown on the marking plan of part list, which shall be supplied by the manufacturers or the Engineer.

Any materials found damaged during transit or while unloading should be stacked separately and damaged portions shall be indicated by paint with distinctive colour. All such materials shall be dealt with under the orders of the Engineer without delay. If any component after receipt at site, has in the opinion of the Engineer or Purchaser, been damaged in transit, such component shall be replaced or repaired to the satisfaction of the Engineer or Purchaser free of cost.

All such damaged material shall be dealt with as per the orders of the Engineer. Badly damaged portions may require replacement. Slightly distorted parts may be straightened by gradual pressure without heat or annealing. Badly distorted or broken parts must be dealt with as the case demands and as directed by the Engineer.

Where the work has been passed in the manufacturer's works as strictly interchangeable, all members bearing the same marks can be stacked together without reference to any particular span.

The tenderer shall unload the material promptly on delivery; otherwise the tenderer shall be responsible for demurrage charges.

On receipt of rolled steel at workshop or fabrication yard, they shall be carefully unloaded and stacked properly to avoid bending, twisting, corrosion etc.

**2.5.9 Manufacturing** – The whole work shall be representative of the highest class of workmanship. The greatest accuracy shall be observed in the design, manufacture and erection of every part of the work to ensure that all parts will fit accurately together on erection and similar parts shall be strictly interchangeable as explained interchangeability paragraph. The contractor shall state which of the following alternative methods of manufacture, he intends to adopt.

(i) The whole of work to be erected complete and pieces marked to place.

(ii) All spans to be made strictly interchangeable as specified below.

**2.5.10 Interchangeability :**

(i) Every span is to be temporarily erected complete in Contractor's works. and all parts as marked to their place, unless the whole of the work is made completely interchangeable by the use of steel jigs and hard steel bushes controlled by master gauges, in which case the first span must be completely erected to test the accuracy of the templates. Further spans or part span assemblies built from parts selected at random by the Engineer shall be erected from time to time to check the accuracy of the work as the Engineer may require.

(ii) If the work is considered interchangeable by the Engineer a simplified scheme of marking will be permitted, i.e. all pieces which are identical shall bear one distinguishing

mark irrespective of the span to which they belong. Should the interchangeability not to the satisfaction of the Engineer, the whole of the spans must be erected complete and all parts marked to their place without additional charge. The tenderers must state in their tenders whether they intend to adopt complete interchangeability or not.

(iii) Under special arrangement with the Engineer, it shall be permissible for approved portions of the work to be despatched before complete erection of the first span, provided the Contractor satisfies the Engineer that such portions of the work are strictly interchangeable and will assemble correctly and accurately in the complete structure.

**2.5.11** The tenderer may fabricate the steel work at his workshop or at the site of the work as is convenient to him. If the fabrication is done in his own workshop, the transportation of the fabricated materials may be done by Road or Rail transport at his own cost. The tenderer must inspect the approach roads right from the workshop and should ensure that it would be possible for him to transport the materials by Road.

**2.5.12** If the tenderer proposes to fabricate the steel at site, land / site would be given to the tenderer to make temporary workshop free of cost, if available, but on completion of work, the site would be restored to normal condition.

**2.5.13** HSFG bolts shall be provided as per RDSO drawing.

**2.5.14** The responsibility of custody of the materials, in Tenderer's workshop or site will remain with tenderer till the completion of work and then handed over to the DFCCIL.

**2.5.15** All welding consumables (electrodes, wire, flux etc.) shall be procured only from the manufacturers approved by RDSO subject to final approval by Engineer.

**2.5.16 Removal of Unused Materials etc:**

The contractor shall take steps as desired by the Engineer to ensure that rejected work is not resubmitted for inspection.

On the completion of the work, the tenderer shall remove all his unused and surplus materials, plant, staging and refuse, or other materials produced by his operations and shall leave the site in a clean and tidy condition.

**2.5.17 Fabrication**

**2.5.17.1 General**

The fabrication of the girders and its accessories shall be carried out by the contractor in his factory premises or in a well-established fabrication workshop to be set up by the contractor at bridge site or any other location as approved by the Engineer. The workshop staff shall have requisite experience, proven skill and experience in the technique of fabricating large



components. Accuracy of fabrication shall be realized through controlled high precision jigs, fixtures and templates, which shall be inspected and passed by Engineer specifically approved in prior by GM/ROB, CGM/DFCCIL. The fabrication shall be preceded by Quality Assurance plans to be submitted by the contractor and every activity shall be documented in detail. The Quality Assurance Plans shall clearly indicate how individual processes such as cutting of raw steel, making, drilling, assembly bolting, welding, painting, handling etc. shall be monitored for quality. The quality parameters for monitoring shall be identified. These identified quality parameters shall also be specified in these quality plans. The contractor shall get these quality plans approved from Engineer before start of fabrication work. The Engineer shall be empowered to check the manufacturing process from time to time to ensure that the work is executed as per approved quality plans. The quality records shall be submitted to Engineer for record, after completion of fabrication work.

The works of fabrication in contractor's fabrication shop will at all times be open for inspection by Engineer / agency as nominated by Engineer. Before dispatch of fabricated steel work from the shops, the same will be inspected in the contractor's fabrication workshop by Engineer who will thereafter issue inspection certificate.

Any defect noticed during inspection in the execution of work shall be rectified or replaced by the contractor at his own cost. The decision of Engineer or any other agency nominated for inspection as to be rectified or replaced, shall be final and conclusive.

#### **2.5.17.2 Fabrication Drawings**

The contractor shall prepare detailed shop drawings including drawing office dispatch lists (DODL's) on the basis of design drawings supplied by Engineer in such size and in such details as may be specified by Engineer. The shop drawings shall be submitted to Engineer in triplicate. No work of fabrication will be started without such approval being obtained. Contractor has to arrange the proof checking of the working fabrication drawings from the nominated Institution / Consultant. The cost will be borne by the contractor. Nomination of the Institution/Consultant for proof checking works will be decided by concerned GM/ROB, CGM/DFCCIL. Engineer will make all efforts to approve the drawings submitted by the contractor within reasonable time but no claim from contractor for any delay on this account shall be entertained by Engineer.

For Engineer's use and record, the contractor shall supply free of charge, four sets of prints on string paper and one set of neatly executed tracings of all approved detailed drawings and fabrication drawings, soon after communication of approval for use at site.

#### **2.5.17.3 Maintenance of records by Fabricators**



The records of fabrication shall be maintained in the registers such as Jigs register, HSFG bolt checking register, Material offering and inspection register, RDSO inspection notes and compliance register, Welding procedure data register, Radiographic inspection register and Statement of material test certificates, etc. The formats are given in Appendix I of IRS B1 – 2001.

#### **2.5.17.4 Tolerance in Fabrication**

Basically, composite girders are plate girders. Fabrication tolerance for plate girders shall be as stipulated in Appendix II of IRS–B1– 2001.

All members of the girder and joints are to be either welded or bolted as shown in the approved structural drawings. No welding except where approved by the Engineer is to be carried out at site. All welding and bolting are to be carried out as per relevant IRS Specifications.

#### **2.5.18 Steel Tape**

The Contractor shall maintain a master steel tape of approved make for which he/she has obtained a certificate of accuracy from any National Test House or Government recognised institutions competent to do so.

#### **2.5.19 Flattening and Straightening**

**2.5.19.1** All steel materials, plates, bars and structural shall have straight edges, flat surfaces and be free from twist. If necessary, they shall be cold straightened or flattened by pressure before being worked or assembled unless they are required to be of curvilinear form. Pressure applied for straightening or flattening shall be such as it would not injure the material and adjacent surfaces or edges shall be in close contact or at uniform distance throughout.

**2.5.19.2** Flattening and straightening under hot condition shall not be carried out unless authorized and approved by the Engineer

#### **2.5.20 Planning and Shearing**

**2.5.20.1** Except where otherwise indicated, cutting of all plates and sections shall be affected by shearing or sawing. All edges shall be clean, reasonably square and true. Wherever possible the edges shall be cut in a shearing machine, which will take the whole length of the plate in one cut.

**2.5.20.2** Should the inspection find it necessary, the cut edges shall be ground afterwards.

**2.5.20.3** Planning or machining of the edges or surface shall be carried out when so specified in the contract drawings or where specifically ordered by the Engineer. Where

machining is specified, the plates or all sections shall be cut in the first instance to such a size so as to permit not less than 3mm of metal being removed from each sheared edge or end, in the case of plates or sections of 12mm or less in thickness and not less than 6mm of metal being removed in the case of plates and sections exceeding 12mm in thickness.

**2.5.20.4** The butting ends of all booms and struts where spliced shall be faced in an end milling machine after members have been completely fabricated. In the case of compression members the face shall be machined so that the faces are at right angle to the axis of the members and the joint when made, will be in close contact throughout. At the discretion of the Engineer, a tolerance of 0.4mm may be permitted at isolated places on the butting line.

### **2.5.21 Flame Cutting**

**2.5.21.1** Flame cutting by mechanically controlled torch/torches shall be accepted both in the case of mild steel and high tensile steelwork. Provided the edge as given by the torch is reasonably clean and straight, plates may be cut to shape and beams and other sections cut to length with a gas cutting torch, preferably oxyacetylene gas should be used.

**2.5.21.2** All flame cut edges shall be ground to obtain reasonably clean square and true edges. Draglines produced by flame cut should be removed.

**2.5.21.3** Unless machining has been specifically provided for, special care is to be taken to ensure that ends of all plates and members are reasonably in close contact and the faces are at right angles to the axis of the members and joints, when made, are also reasonably in close contact.

**2.5.21.4** Use of multi-head flame cutting machine having multiple oxy acetylene torches is desirable for higher productivity and reducing the distortion due to cutting operation. Plasma-arc cutting method can also be employed. This process offers less heat input causing less distortion.

### **2.5.22 Method of fabrication**

Considering the length and height of span, jigs and fixtures shall be used to guide and support drilling of holes and fixtures during entire fabrication work.

Jigs after manufacture shall be checked and approved by Engineer or any other Inspecting agency as nominated by GM/ROB,/CGM, DFCCIL. Only approved and stamped jigs shall be used for fabrication.

#### **2.5.22.1 Tack Assembly**

Tack assembly is the next step in fabrication which assembles the components to get the form of component or girder. This activity is to be done carefully so that the final

components/ girders are fabricated to correct geometric shape and the size is within the tolerance specified.

For tack assembly, the components shall be kept on a firm hard bed and shall be held in position using suitable fixtures so that once the measurements are taken to set a component at proper location, these shall not move till the final tack assembly is done. The entire work shall be done in area where arrangements for manipulating the member such turning over, shifting etc can be conveniently done using EOT or other type of cranes and suitable covered shelter for sufficient protection against the weather is available.

Quality of tack Welds: as per clause 24 of Welded Bridge Code,

(i) Tack welds shall be not less than the throat thickness or leg length of the root run to be used in the joint

(ii) Length of the tack weld shall not be less than four times the thickness of the thicker part or 50mm whichever is the smaller.

(iii) Where tack weld is incorporated in a welded joint, the shape, size and quality shall be suitable for incorporation in the finished weld and it shall be free from all cracks and other welding defects. Tack welds, which have poor quality and can crack, shall be cut out, ground and re-welded.

(iv) Tack welds shall not be made at extreme ends of joints.

(v) Tack welds are equally important in the overall quality and performance of the girder and these shall also be made by qualified welders.

(vi) After the tack assembly is complete, the girder./ component shall be checked for dimensional accuracy as per clause 13 of IRS B1. Drilling Jig and tacked members shall be clamped to a fixture to avoid shifting of jig during handling and drilling.

Tack welding may be permitted only at ends or locations, which will eventually be cut and removed. No active part of the component shall be tack welded as this would initiate crack formation in service.

### 2.5.23 Template

The contractor shall supply and provide templates at his own cost. **No separate payment shall be made for this and accepted rates shall be deemed to include this aspect.** The templates throughout the work shall be of steel of similar category. The templates shall be used for marking of cutting materials and as well as for profile machining for girders. Templates shall be used for marking of drilling holes in steel structure. In case where actual

materials from a bridge have been used as templates for drilling similar pieces the Engineer will decide whether these are fit to be used as part of finished structure.

#### **2.5.24 Template Shop**

Fully covered template shop consisting of uninterrupted steel or concrete floor as approved having true and correct level covering adequate area shall be provided by the contractor.

#### **2.5.25 Drilling and Sub punching**

All holes shall be drilled but the Contractor may, if he/she so prefers sub-punch them to a diameter 6mm less than that of finished holes, e.g. a punched hole which is to be drilled out to 25mm in diameter shall not exceed 19mm in diameter at the die end. When the bolt holes are to be sub-punched, they shall be marked with a centre punch and made with a nipple punch or preferably, shall be punched in a machine in which the position of the hole is automatically regulated. The punching shall be so accurate that when the work has been put together before drilling, a gauge 1.5mm less in diameter than the size of the punched holes can be passed easily through all the holes.

Holes for turned bolts, should be 1mm under drilled in shop and should be reamed at site to suit the diameter of turned bolt.

The steel bushes shall be case hardened by an approved process and checked for diameter after the heat-treatment. The bores of bushes shall initially have a tolerance of -0mm, 0.1mm. The tolerance shall be checked from time to time and when the bores exceed a tolerance of, -0mm, +0.4mm, the bushes shall be rejected. For this purpose, go and no-go gauges are to be used. Tolerances for checking jigs from master plates shall be +0mm-0.13mm.

The work shall be taken apart after drilling and all burrs left by the drill and the sharp edges of all the bolt holes completely removed.

Drifting to enlarge unfaired holes is prohibited. The holes required to be enlarged shall be reamed provided the Engineer permits such reaming after satisfying himself about the extent of inaccuracy and the effect of reaming on the soundness of the structure. The Engineer reserves the right to reject all steel work if the holes are not properly matched.

On completion of drilling of holes in each component and before shifting the jig, it shall be ensured that all holes are drilled to their correct diameter to reconfirm quality of work.

#### **2.5.26 Temporary Bolts, Nuts & Washers:**

Refer Cl.28.1 to Cl.28.8 of IR Fabrication specification Serial No. IRS-B1-2001 issued by RDSO.

#### **2.5.27 Alterations in the Work:**

The Contractor shall not in any case or in any circumstances have authority to make any alterations in, modifications of, substitution for, addition to, or omission of work or any method or system of construction, unless an alteration order in writing directing such alteration, modification, substitution, addition, omission or change shall have been given by the DFCCIL prior to the commencement of the work or part of work nor shall the Contractor be entitled to any payment for or in respect of any such alteration, modification, substitution, addition, omission or change may have been actually made and executed and no course of conduct shall be taken to be a waiver of the obligation and conditions hereby imposed.

All altered, modified, substituted, additional and changed work, labour and materials and all omitted work shall be valued by the Purchaser on the basis of the rates specified in the schedule.

#### **2.5.28 Welding**

Welded construction work shall be carried out generally in accordance with the provisions of Indian Railway Standard Welded Bridge Code and subject to further specifications given in the following paragraphs.

All welds should be done by submerged-arc welding process either fully automatic or semi-automatic. Carbon di oxide welding or manual metal-arc welding may be done only for welds of very short runs or of minor importance or where access of the locations of weld do not permit automatic or semi-automatic welding.

Except for special types of edge preparation, such as single and double 'U' single and double 'J' the fusion edges of all the plates which are to be joined by welding may be prepared by using mechanically controlled automatic flame cutting equipment and then ground to a smooth finish. Special edge preparation should be made by machining or gouging.

Site welding should not be undertaken except in special circumstances with the approval of the Chief Bridge Engineer/CGM/DFCCIL/Agency/Officers nominated by CGM-DFCCIL. Site welding should be confined to connections having low stresses, secondary members, bracings etc. Manual metal arc welding may be done taking adequate precautions as per IS:9595 and under strict supervision.

#### **2.5.29 Welding Procedure**

The welding procedure shall be such as to avoid distortion and minimize residual shrinkage stresses. Properly designed jigs should be used for assembly. The welding techniques and sequences, quality, size of electrodes, voltage and current required shall be as prescribed by manufacturers of the material and welding equipment. The contractor should submit full details of welding procedure in proforma given at Appendix-V of IRS B1-2001.

### **2.5.30 Sequence of welding and welding pass**

For fabrication of welded composite girders, channel shear connectors shall be welded on top flange plate prior to assembly of I-section. This facilitates correction of any distortion of flange plate developed during the welding of channel shear connectors.

In making a typical I-section four fillet welds are to be made. The welding sequence to be followed is indicated by number 1 to 4 as shown in the Fig. 3 of IR Fabrication Specification Serial No. IRS-B1-2001 issued by RDSO.

Whenever a square butt weld in a 10 or 12mm thick plate is required to be made, the sequence to be adopted is shown in Fig. 3 of IR Fabrication Specification Serial No. IRS-B1-2001 issued by RDSO.

### **2.5.31 Procedure Trials for welding and cutting**

Where required by the Engineer, welding and flame cutting trials as per following shall be carried out and completed before fabrication on representative samples of materials to be used in the work, as follows.

- (i) The samples of material shall be selected and marked by the ENGINEER when the materials for the work are inspected at the mills.
- (ii) The trials of flame cutting shall be carried out in material representative of all thicknesses to be used in the work.
- (iii) The welding & flame cutting trials shall be commensurate to the satisfaction of Engineer and the procedures to be adopted in the fabrication of work which shall include:
  - (a) Welding procedure in accordance with IRS Welded Bridge Code supplemented by IS 813 and IS 1980.
  - (b) Heat control techniques required to ensure that the flame cut surface of steel are suitable for inclusion in welds.
- (iv) The trials shall include specimen weld details from the actual construction which shall be welded in a manner simulating the most unfavourable instances of fit-up and preparation. After welding the specimens shall be held as long as possible at room

temperature but in any case not less than 72 hours, and then shall be sectioned and examined for cracking. Six representative samples of each weld joint similar to joint used in fabrication of all components shall be prepared by qualified and certified welding operators.

- (v) Procedure trials: Testing shall be to relevant IS code or if approved to BS 709. The following groups of tests shall be carried out with the type of welds.

**Butt welds:** Transverse tensile test, transverse & longitudinal bend test with the root of weld in tension and compression respectively, charpy V-notch impact test.

**Fillet welds:** Fillet weld fracture test.

**Track welds:** Inspection for cracking.

**All welds:** Macro examination.

Additional tests may also be carried out as per requirement and instruction of Engineer, the cost of which shall be borne by the contractor.

Shop welded joints will be radio graphically examined for 100 %.

Following tests are normally performed on welds.

**(a) Non Destructive Tests (NDT):**

- Visual inspection/profile gauge for dimensional check of size and throat thickness of weld.
- Etching test for penetration of joint.
- Magnetic particle or Ultra Sonic Pulse Velocity (USPV)
- Gamma Radiography & x-ray (only for butt welds)
- Dye penetration of all welds joints.

**(b) Destructive Test :**

- Tensile test
- Bend test
- Impact test
- Load test.

Once samples representing the weld joint used in fabrication of all components are tested and test results are found satisfactory, then approval shall be taken from the Engineer for

the welding of built up components by approved welding operators. Welding Procedure Qualification Records (WPQR'S) shall include joint details, welding consumables (i.e. electrode/wire & flux combination), weld parameters (i.e. welding current, wire feed speed), welding position, welding equipment carriage speed (for SAW process), arc Length, arc voltage etc.

### **2.5.32 Preparation of Faces**

Preparation of joint face: Except for special types of edge preparation such as single or double 'U' & 'J' joints, the fusion edges of all plates which are to be joined by welding shall be prepared by using mechanically controlled automatic flame cutting equipment with the cutting allowance.

It shall be ensured by Non-destructive tests that the fusion face and adjacent surface are free from cracks, notches or other irregularities that are likely to cause defects during service or interfere with deposition of the weld.

Fusion faces and the surrounding surface up to 50 mm shall be free from mill scale, moisture, oil, paint dirt or any other substance which may affect the quality of the weld, and same shall be removed by grinding or flame cleaning/grit blasting.

Details of joint, fusion faces, root face and gap shall be as per details given in fabrication drawing or as stipulated in IS:9595.

### **2.5.33 Welding Operation**

Parts to be welded shall be assembled such that the joints to be welded are accessible and visible to the operator. Assembly jig and fixture shall be used for accuracy.

Manipulators should preferably be used to execute the sequence of welding without disturbance, in the most suitable position. Fixture shall maintain the alignment with minimum restraint in order to reduce the possibility of locked up stresses.

Run in and run out plate shall be provided for fabrication of built up members or truss to ensure that weld will start on run in plate and weld will stop on run out plate and thus avoid crater defects on the components.

The size and length of weld shall not be less than those specified in the drawing nor shall they be in excess of the requirement without prior approval of the Inspecting Officer. The location of weld shall not be changed without prior approval of the Engineer.

During design and detailing of component lengths, care is to be taken to avoid butt weld in built up members of truss. Therefore, it is essential to use only nearest size and length or rolled sections that have been procured to scheduled sizes and lengths by proper planning. No butt weld shall be carried out without approval of Engineer.



Fabrication of components subject to dynamic loading in the structure need careful inspection during fabrication by qualified, experienced and certified Engineer from contractor's side and final approval by Inspecting Officer. This inspection shall be carried out as stipulated in Indian Railway Welded Bridge Code before, during and after welding.

#### **2.5.34 Precautions during welding**

The Contractor shall submit list of weld joints of different combined thickness for approval of welding procedure for all members.

The welding of built up component shall be carried out only by approved welding operators and in accordance with Welding Procedure Qualification Records. WPQR's shall be prepared in advance and approved by the Engineer. Proper welding sequence shall be followed to avoid distortion and minimize residual shrinkage stress, and surface defects, within acceptable tolerance limits.

To ensure sound and defect free welding of built up members, record of welding adopted as per approved qualifying procedure shall be maintained in Performa prescribed in guidelines for welded fabrication issued by TPIA (Third Party Inspecting Agency) specifically approved in prior by GM/ROB/ CGM, DFCCIL.

Any change during welding for fabrication of built up member, such as welding sequence, welding process, positioning, wire and flux combination joint details, increase or decrease in combined thickness of joint by 5 mm etc. shall be carried out only after representative samples test and procedure qualification, is accepted. **In no case deviation from WPQR's without approval of Engineer shall be adopted.**

#### **2.5.35 Additional Precautions during Welding**

Following precautions shall further be observed during fabrication.

(i) All equipments shall be provided with calibrated gauges to observe limits of variation for parameters prescribed in WPQR'S for welding current, arc voltage, speed of travel of equipment etc.

Covered shed for environmental control (particularly against dust, moisture and water) shall be provided to avoid entrapment of hydrogen which is likely to cause crack initiation in weld or under bed of weld (i.e. Heat Affected Zone HAZ). Also baking of flux use for submerged arc welding in oven for an hour at 200 degree C shall be carried out to ensure that no moisture is contained in flux during welding.

All tack weld shall be carried out by qualified and approved welder only. As tack weld will become part of the final weld, it shall be free from all cracks and other welding defects.

If multiple runs are used for fabrication of built up member, inter run cleaning shall be carried out and subsequent weld bed made only after approval of inspecting officer or his authorized representative. This is to check free defects in the weld. Also visible defects such as cracks, cavities, if any, shall be removed by grinding. It shall be ensure during welding that craters are avoided.

Stray arcing of components, which cause local hard spots or cracking of parent metal, shall be avoided.

Flux of approved quality will be permitted for use.

The Auto melt grade wire spools of wires for Submerged Arc Welding and Carbon Dioxide (CO<sub>2</sub>) consumables of only the approved quality will be permitted.

Pre Heat Treatment will be given to the consumables to remove the moisture if any.

No violation of welding procedure will be permitted on any account.

#### **2.5.36 Technical Organisation/tools, equipments and plants**

(A) Contractor should have qualified and trained manpower suitable to do the work in terms of technical specifications and contract conditions.

(B) Contractor should have suitable and adequate plants, machinery and equipments required to execute the work like:

(i) Cutting machine

(ii) Radial drilling machine.

(iii) Edge milling machine, end milling machines.

(iv) Plate/structural steel straightening machine.

(v) Pneumatic grinding machine, drilling machines, chipping machines and wrenches etc.

(vi) Sand blasting equipment and metalizing equipments.

(vii) Welding machines.

(a) SAW

(b) MIG/MAG

- (viii) Welding transformers<sup>3+</sup>
- (ix) Cranes of adequate capacity.
- (x) Suitable Jigs and fixtures.
- (xi) To test the raw material and girders to conform to relevant specification, testing facilities, for the following should be available either in house or through outsourcing.
  - (a) Elcometer for measurement of thickness of paints.
  - (b) Steel measuring taps duly calibrated.
  - (c) Ultrasonic flow detection testing facilities for checking internal flaws.
- (xii) Suitable Welding manipulator.
- (xiii) Macro etching/DP or MP testing facilities.
- (xiv) Tongue tester for measuring current and voltage.
- (xv) Gauges for checking weld size throat thickness and edge preparation etc..

All equipment's must meet the requirements of corresponding IS, IRS or other international specifications.

(C) **Manpower:** Adequate No. of trained qualified welders shall be available with the contractor. The welder must be trained in accordance with the provision of IS: 817. They must be trained either from recognized welding institutes or by in house training, where proper training facilities exist. The welder must be tested as per requirements of IS: 7310 and proper records maintained.

List of equipment's mentioned above is only indicated and not exhaustive. The firm shall be required to deploy all other machineries, tools & plants etc. required for successful completion of the work of fabrication, assembly and launching of the girders.

### **2.5.37 General: Bolting & Welding**

Qualified trained, and experienced supervision is essential at all times during fabrication, and for maintenance of records.

After welding of welded components, they shall be finished finally by grinding or matching with the help of a profile template. All the butting ends of components shall be faced in milling machine after members haven completely fabricated. In the case of compression members, the face shall be machined so that the faces are of proper angle as shown in drawing and the joint when made will be in close contact throughout within a gap tolerance

of less than 0.15 mm. The Engineer may permit a tolerance of (-) 0.4 mm at isolated points in butting line.

### **2.5.38 PAINTING**

Specification for metalizing and painting will be done as per Clause no 39.2.1 of Indian Railway Specification for Fabrication and Erection of Steel Girder Bridges and Locomotive Turn-Tables (Serial No B1-2001).

#### **2.5.38.1 Surface Preparation**

This is the most important factor in ensuring good performance of the steel girder. The surface should be clean, dry and free from contaminants and it should be rough enough to ensure adhesion of the paint film. However, it should not be so rough that the film cannot cover the surface peaks.

The cleaning of the surface shall be done initially with the use of emery paper, wire brushes, scrapers etc. for spot cleaning to remove rust, scale etc. Subsequently, sand blasting of the surface shall be done to remove rust, mill scale along with some of the base metal. This will be achieved by high velocity impact of abrasive material against the surface in accordance with the provisions of IS: 6586, which will also create a base for good adhesion. The abrasive material once used for cleaning heavily contaminated surface should not be reused even though re-screened. Washed salt free angular silica sand of mesh size 12 to 30 with a minimum of 40% retained on a 20 mesh screen shall be used for blasting. The material specifications and other requirements shall be as provided in Indian Railways Bridge Manual, 1998.

All site bolts, nuts and washers shall be thoroughly cleaned and dipped in boiled linseed oil. All machined surfaces are to be well coated with a mixture of white lead conforming to IS: 34 and Mutton tallow conforming to IS: 887 as per specifications before despatch to site. Nothing extra shall be payable to contractor on this account.

All the components in the floor and deck system in open web girders and all members in plate & composite girders shall be metalized as IRS specifications.

#### **2.5.38.2 Metal Spraying**

The metal spraying shall be carried out as soon as possible after surface preparation but in any case within such period that the surface is still completely clean, dry and without visible oxidation. If deterioration in the surface to be coated is observed by comparison with a freshly prepared metal surface of similar quality which has undergone the same preparation, the preparation treatment should be repeated on the surface to be coated

The wire method shall be used for the purpose of metallizing the diameter of the wire being 3mm or 5mm. Specified thickness of coating shall be applied in multiple layers and in no case less than 2 passes of the metal spraying unit shall be made over every part of the surface. At least one layer of the coating must be applied within 4 hours of blasting and the surface must be completely coated to the specified thickness within 8 hours of blasting.

#### **2.5.38.2.1 Purity of Aluminium**

The chemical composition of aluminium to be sprayed shall be 99.5% aluminium conforming to IS: 2590.

#### **2.5.38.2.2 Appearance of the Coating**

The surface of the sprayed coating shall be of uniform texture and free from lumps, coarse areas and loosely adherent particles.

#### **2.5.38.2.3 Thickness of the Coating**

The nominal thickness of the coating shall be 150  $\mu$ (microns). The minimum local thickness, determined in accordance with procedure given in clause 2.5.38.3 below, shall be not less than 110  $\mu$ (microns).

### **2.5.38.3 Shop Painting**

Any oil, grease or other contamination should be removed by thorough washing with a suitable thinner until no visible traces exist and the surfaces should be allowed to dry thoroughly before application of paint. The coatings may be applied by brush or spray. If sprayed, pressure type spray guns must be used. One coat of wash primer to IS:5666 shall be applied first. After 4 to 6 hours of the application of the wash primer, one coat of Zinc chrome primer to IS:104 with the additional proviso that zinc chrome to be used in the manufacture of primer shall conform to type 2 of IS:51 shall be applied. After hard drying of zinc chrome primer, one coat of Aluminium paint to IS:2339 (brushing or spraying as required) shall be applied.

### **2.5.38.4 Site Painting**

After the steel work is erected at site a second cover coat of Aluminium paint to IS: 2339 (brushing or spraying as required) shall be applied after touching up the primer and the cover coat given in the shop if damaged in transit

### **2.5.38.5 Method for the Determination of Local Thickness**

#### **2.5.38.5.1 Equipment**

Any magnetic or electro-magnetic thickness meter that will measure local thickness of a known standard with an accuracy of  $\pm 10$  percent.

#### **2.5.38.5.2 Calibration of Instrument**

Calibrate and check the meter on one of the following standards (as appropriate):

- (i) (Applicable to magnetic and electro-magnetic meters other than the pull-off type) A soft brass shim, free from burrs, in contact with the grit-blasted surface of the base metal prior to its being sprayed. The thickness of the shim shall be measured by micro meter and shall be approximately the same as the thickness of the coating.
- (ii) A sprayed metal coating of uniform known thickness approximately the same as the thickness of the sprayed coating to be tested, applied to a base of similar composition and thickness to the article being sprayed, grit-blasted in accordance with Clause 2.5.38.1.

#### **2.5.38.5.3 Procedure**

For each measurement of local thickness, make an appropriate number of determinations, according to the type of instrument used.

With instrument measuring the average thickness over an area of not less than 0.645 sq cm, the local thickness shall be the result of the one reading.

With instruments having one or more pointed or rounded probes, the local thickness shall be the mean of three readings within a circle of 0.645 cm<sup>2</sup> area.

With meters having two such probes, each reading shall be the average of two determinations with the probes reversed position.

#### **2.5.38.6 Method Of Test For Adhesion**

Using a straight edge and hardened steel scribe which has been ground to a sharp 30 degree point, scribe two parallel lines at a distance apart equal to approximately 10 times the average coating thickness. In scribing the two lines, apply enough pressure on each occasion to cut through the coating to the base metal in a single stroke.

#### **2.5.38.7 Inspection**

#### **2.5.38.7.1 Determination of Local Thickness**

The minimum local thickness shall be determined by the method described above.

#### **2.5.38.7.2 Adhesion**

The sprayed metal coating shall be subjected to an adhesion test using the method described above. If any part of the coating between the lines breaks away from the base metal, it shall be deemed to have failed the test. Articles, which have been rejected shall have the defective sections blasted clean of all sprayed metal prior to re-spraying. Where the rejection has been solely due to too thin a coating, sprayed metal of the same quality may be added provided that the surface has been kept dry and is free from visible contamination.

#### **2.5.39 Paints: Source & Quality**

Paint and other accessories including those for metallizing work will be supplied by the contractor. Paints manufactured by the following firms (or more) may be used subject to their being in the approved list of RDSO and final approval by the Engineer.

M/s. Jenson Nicholson. Paints

M/s. British / Barger paints.

M/s. Shalimar Paints

M/s. I.C.I. paints

M/s. Nerolac. Paints

The contractor shall furnish to the Engineer, the date of manufacture of paint as certified by the manufacturers with the necessary container marking and test certificate for paint conforming to relevant IS code. In addition to this, he shall also submit the necessary vouchers in respect of paint purchased by him.

The Engineer reserves the right to get the paint tested at contractor's expenses as considered necessary by the Engineer. If the test results do not conform to relevant IS specifications fully, then the lot of paint shall be rejected and got removed from the contractor(s) storage. If the paint has already been applied it shall be removed.

In addition to above, the following tests are required to be carried out in the field.

-Weight per litre

- Consistency test

- Scratch test.
- Flexibility and adhesive test.

The Engineer reserves the right to reject the lot of paint even on the basis of field results.

#### **2.5.40 Painting - General Instructions**

Painting shall not be commenced till the surface preparation has been approved by the Engineer or his representative.

Sealed containers of paint of approved brand shall be used. The paint drums must be rolled, turned upside down and shaken before opening. The paint must be stirred well before use. Over stirring which results in invisible air bubbles etc, shall be avoided.

Where brush painting is accepted, the paint must be applied by means of flat brushes not more than 75 mm in width having soft flexible bristles conforming to IS: 384.

Round and oval brushes of approved quality conforming IS: 487 may also be used as per the instructions of the Engineer or his representative or inspecting officer.

All new brushes should be soaked in raw linseed oil conforming to IS: 77 for at least 24 hours before use.

The date of painting shall be marked with paint on the member.

#### **2.5.41 Care during Painting**

Paint should be mixed in small quantities sufficient to be consumed within one hour in the case of red lead paint.

The applied coat of paint shall be uniform, and free from brush marks, sack marks, blemishes, scratching, non-uniform thickness, holes, log marks, fuel staining, cracking, scaling, and other defects.

Paint shall be applied only on dry and clean surface free from moisture or dust (including scrapping dust).

Paint should be used within the prescribed life from the date of manufacture.

**2.5.41.1** Each coat of paint shall be left dry till it sufficiently hardens before the subsequent coat is applied. Each coat of paint shall be inspected by the Engineer and certified as satisfactory before applying subsequent coat.



## **2.5.42 ASSEMBLEY & ERECTION**

### **2.5.42.1 General**

The contractor shall provide at his own cost all tools, machinery, equipment and erection material, including all temporary works and shall assemble all components in every respect as stipulated in the contract and in accordance with approved drawings and specifications.

Before starting the work the contractor shall seek the Engineer's approval as to the method he proposes to follow and the type and suitability of equipment he proposes to use for assembly of girder components and launching of girder. The approval of the Engineer shall however not in any way relieve the contractor of the responsibility for the adequacy and safety of methods and/or equipment's he proposes to use for carrying our work in full accordance with drawings and specifications.

All temporary work shall be properly designed and substantially constructed for the loads, which it will be called upon to support. Adequate allowance and provision of a lateral forces and wind loads shall be made according to local conditions and ensure that support shall not settle during erection.

When chains are used for lashing care must be taken to protect the edges of members from twisting and distortion, damage to paint and similar effects.

Temporary bracing shall be provided to take care of stresses caused by erection equipment or other incidental loads during erection.

The method use for lifting and slinging flexible members shall be brought to the notice of the Engineer and shall be subject to his approval.

The contractor shall observe sufficient accuracy in the assembly of every part of the work to ensure that all parts fit accurately together.

### **2.5.42.2 Procedure for Assembly in Workshop & Site**

The contractor is required to undertake test assembly of the girders in his fabrication workshop to prove accuracy of templates and Jigs. This assembly can be done in horizontal position. In case the fabrication workshop is set up by the contractor at bridge site itself the test assembly may be done at assembly platform and after testing of accuracy of jigs, fixtures & templates and the same assembly can be launched after bolting.

The test assembly shall be certified by Inspecting agency of the Engineer.

Launching of girders: once sufficient number of girders are assembled and the sub structure has been certified to be ready, launching of girders shall be taken up. The scheme for launching shall be submitted by contractor and approved beforehand by RITES LTD / Railway / or Agency approved by DFCCIL and any statutory clearances such as CRS sanction must be obtained. The decision of DFCCIL shall be final and binding on the contractor.

#### **2.5.43 Care during Assembly at Workshop**

##### **2.5.43.1 Drilling & Drifting of Holes**

Drilling of joints shall be avoided as far as possible and when necessary should be done with great care and under expert supervision. Hammers not exceeding 1kg (2 lb) in weight may be used with turned barrel drifts and a number of holes drifted simultaneously, the effect of drifting shall be checked by observation of adjacent unfilled hole.

Any apparent error in shop work which prevents the assembling and fitting of the mating parts by the proper use of drifts shall be investigated immediately.

As all work is rigidly inspected at the fabrication shop before dispatch, these difficulties should not arise and the cause could possibly be due to the use of incorrect components. It is usually important that parts be correctly handed. Should errors still persist, the matter shall be immediately reported to the Engineer who will decide what action is to be taken.

##### **2.5.43.2 Inspection, Testing & Marking**

All components shall be offered for inspection prior to painting. All approved components shall be stamped defect free, painted as per specifications prior to dispatch to bridge site.

On final finishing of each component, it shall be marked distinctly with paint with shipping mark for guidance, during assembly of component.

##### **2.5.43.3 Stud shear connectors shall be subjected to the following tests:**

The appearance test and test to check the fixing of shear studs shall be as per approved/RDSO drawings.

#### **2.5.44 Transports from Workshop & Stacking at Site**

All items fabricated in the workshop shall be marked and packaged with accompanying package list. The items after fabrication shall be transported by contractor to site by Rail/Road in a manner as to cause no damage to the components. Contractor shall be

liable for all losses and damages in transit for the materials consigned by him till materials are erected and work completed and taken over by the Engineer. Insurance against loss or damage in transit, if any, shall be the responsibility of the contractor.

After identification & correct marking, all components of each girder shall be dismantled & similar components shall be grouped together & labelled; bolts and plates of each size shall be packed separately, after approval by the Engineer.

The packages shall be of such size by length & weight that they are safely transportable by Rail/Road. The components shall be provided with necessary packing to avoid damage to painting & members in transit.

Dimensions for transport shall be as per standard schedules.

### **2.5.45 Assembly at site**

#### **2.5.45.1 Holes**

After drilling holes in temporary tack assembled components, the components shall be taken apart after match marking and all burrs left by drill and sharp edges of all holes shall be removed by spot grinding to ensure full contact when assembled.

Assembly fixture shall be used to build components for turned bolt connection. These connections will help realize correct position of member and matching of coaxial holes in opposite members besides true alignment and level.

After assembly, all blank holes shall be checked with plug gauge of diameter 0.8mm less than hole diameter, to check fair matching of holes before riveting / bolting.

#### **2.5.45.2 Drifts**

Drifts as per IRS specifications may be used for drawing light members into position, but their use on heavy members should be restricted to securing them in their correct position. In no case shall drifting be allowed to such an extent that holes are distorted. Drifting to enlarge unfaired holes is prohibited.

#### **2.5.45.3 Making of joints**

**Cleaning of permanent contact surfaces:-** Surfaces which will have permanent contact shall be removed of paints and mill scale down to bare metal, clean and dried and immediately a coating of zinc chrome red oxide priming to IS:2074 shall be applied. Care shall be taken to see that all burrs are removed and no surface defects exist before the parts are assembled.

**2.5.45.3.1 Reaming**

No reaming shall be undertaken without the written authority of Engineer or his authorized representative except for under drilled holes meant for turned bolts. The contractor shall supply special bolts to fill reamed hole, where reaming is approved. Record of all such variations shall be kept. However, these provisions should not apply for under drilled holes meant for turned bolts. Copies of all correspondence pertaining to the recourse of reaming and the use of oversize bolts shall be sent by the contractor for information to Engineer.

**2.5.45.3.2 Service Bolts & Drifts**

Joints shall normally be made by filling not less than 50% of the holes with service bolts and barrel drifts in the ratio of four to one. The service bolts are to be fully tightened up as soon as the joint is assembled.

**2.5.45.3.3** In cases where the joints have to withstand stresses arising from special methods of erection, provision is to be made to take the whole stress that will or may occur. Cylindrical drifts and turned bolts shall be used to withstand such stresses and no reliance is to be placed on service bolts for this purpose. Up to a maximum of 40 percent of the holes of each member of the joint are to be filled with drifts and balance of strength required is to be attained with turned bolts. The position and number of the drifts and bolts will be decided by Engineer.

**2.5.45.4 Painting of Joints**

All surfaces, which are in permanent contact, shall be thoroughly cleaned down to the bare metal, to remove mill scale, grease etc. They shall be painted immediately before assembly with one coat of suitable primer and raw linseed oil freshly ground and the surface prepared for painting as per painting specification at Clause 2.5.38.

**2.5.46 Assembly and Launching**

The launching of girders shall be done as per approved drawings. For this purpose, the contractor shall submit in triplicate, detailed launching schemes of all the girders including design calculations, safety procedures and method statement with such plans, sketches and other details as may be necessary to determine the suitability and adequacy of the schemes proposed. The scheme will be checked by RITES Ltd/DFCCIL/Railway/or Agency nominated by the DFCCIL. The Payment for the launching scheme of girders shall be born by contractor. The agency shall provide/arrange all works and full support to obtain CRS sanction. Contractor will be responsible to co-ordinate with Divisional Railway/WR HQ officials to get CRS sanction. The methods adopted shall not, under any circumstances, cause the stresses in various members of girder spans to exceed permissible and safe

limits at any stage of launching. One copy duly approved by the Engineer shall be returned to the contractor.

For the Engineer's use and record, the contractor shall supply free of charge, four sets of prints of approved detailed drawings of assembly and launching schemes on strong paper with back of linen for use at site and one set of neatly executed tracings.

The launching system & procedure shown on enclosed drawings are purely indicative of the method proposed for launching for which the permanent members of the girders are designed. The contractor shall provide full structural details of the temporary members and their connections to the girder, along with necessary design calculations not only justifying member's sizes but also for the entire launching system adopted. Contractor will be responsible for getting approval of launching scheme submitted by him from the Engineer.

In order to ensure perfect fit of the temporary components, holes may be carefully drilled for the connecting members in between the girders in situ and T & F High tension grip bolts used.

The launching system shall be test tried if directed by the Engineer and no separate payment for this shall be made.

Nothing extra will be paid to the contractor for adopting any scheme for launching. All temporary members shall be removed after launching and may be taken back by the contractor. Erection gussets provided for connecting the members may be cut and edges ground as required by the Engineer.

#### **2.5.47 Field Bolts, Nuts and Service Accessories**

**2.5.47.1** The work is to include supply of all units, bolts, nuts, washers etc. required to complete erection at site with an allowance for wastage etc. 12.5% of the net number of field bolts and washers required subject to a minimum number of five in each item.

**2.5.47.2** The Contractor shall be responsible for supplying site rivets/bolts of approved length. The length of such bolts shall be verified by snapping a few bolts of each length in the presence of the Engineer.

**2.5.47.3** Black hexagonal bolts (Service bolts) with nuts and ordinary platter's washers and drifts for use in the erection of the work shall also be supplied at 60% (45% bolts and 15% drifts) of the number of field bolts per span in each size (this includes wastage).

#### **2.5.48 Temporary Strengthening**

The launching arrangement may include fabrication of launching nose or restraining girders, sway restraining devices such as sway ropes, restraining cables etc. the supply and fixing of members for temporary strengthening of girder members to take care of erection

stresses and strains and other relevant components for satisfactory and successful completion of the defined scope of work. Erection stresses must be kept within safe and permissible limits at every stage of erection.

**The contractor has to make arrangements at his own cost for the steel for temporary arrangements including sway restraining devices for launching and temporary strengthening of girder, as may be required for the launching operations. The rate quoted should take into account these factors as nothing extra shall be paid.**

#### **2.5.49 Inspection and Rectification**

During erection of girders, the contractor shall provide all facilities and permit the Engineer to inspect the field assembly, site bolting and erection of spans.

After inspection by the Engineer, the contractor shall identify cause of any defect, imperfection and/or fault noticed during such inspection and initiate corrective action as per the direction of the Engineer. All defects, imperfections or faults for which the contractor is liable under the contract, shall be made good by the contractor to Engineer's satisfaction and the cost of identifying and rectifying such defects, imperfection or faults shall be borne by the contractor.

**A neat casting bearing the name of the contractor, the place and date of manufacture, the contact number and the standard of loading to be specified by the Engineer shall be bolted conspicuously on all girders. The drawing of the name plate shall be approved by the Engineer.**

#### **2.5.50 Erection & Equipment:**

2.5.50.1 The Contractor shall provide at his/her own cost all tools, machinery, equipment and erection material necessary for the expeditious execution of the work and shall erect the structural steel and iron work, in every respect as covered by the contract and in accordance with the drawings and specifications.

2.5.50.2 If any labour, material, plant staging haulage and storage facilities are to be provided by the Engineer, details of such items and the conditions under which these are to be supplied shall be clearly specified in the contract agreements. In the absence of any such provisions in the agreement, the Contractor shall make his/her own arrangement for such items.

2.5.50.3 Before starting the work, the Contractor shall advise the Engineer fully as to the method he/she proposes to follow and the amount and character of equipment he/she proposes to use, which shall be subjected to the approval of the Engineer. The approval of the Engineer shall not be considered as relieving the Contractor of the responsibility for the

safety of his/her method or equipment or from carrying the work in full accordance with the drawings and specifications.

2.5.50.4 All temporary work shall be properly designed and substantially constructed for the loads, which it will be called upon to support. Adequate allowance and provision of a lateral forces and wind loads shall be made according to local conditions and ensure that support shall not settle during erection.

2.5.50.5 Careful and periodical inspection of plants shall be made by the Contractor to ensure that all tackle, ropes, chains and other important lifting gear and machinery are in good order and fit for service and well upto the capacity for which they are required.

2.5.50.6 When chains are used for lashing, care must be taken to protect the edges of members to avoid the marking and distortion otherwise caused.

2.5.50.7 Span erected upon staging shall be supported upon suitable blocks, which shall ensure that the girders shall be at the correct elevation and alignment when completed. If other methods of erection be adopted where staging in situ is not employed, special means shall be used to ensure this.

2.5.50.8 The method used for lifting and slinging flexible members shall be brought to the notice of the Engineer and shall be subject to his/her approval.

2.5.50.9 Temporary bracing shall be provided to take care of stresses from erection equipment or other loads carried during erection.

## **2.5.51 ADDITIONAL SPECIAL CONDITIONS:**

### **2.5.51.1 Land:**

DFCCIL will at its discretion, and, if available, arrange land free for use for contractor's office at sites, field workshop, stores, assembly and erection yard. Land required by the contractor for labour or staff colony or other purpose will have to be arranged by him at his own cost.

### **2.5.52.2 Further Drawing and Instructions:**

GM/ROB/CGM, DFCCIL shall have full power to make and issue further drawings or instructions or direction from time to time as may appear necessary and proper to the contractor for efficient construction, completion and maintenance of the works . The contractor shall be bound by the same as fully as be if they had been mentioned or referred to in the contract, and the contractor shall not be entitled to any extra payment in respect of any work or materials shown or directed to be done supplied by such further drawings or



instructions required for completion of unless the GM/ROB,/CGM, DFCCIL have given an extra order for the same in writing.

The tenderer's rate should provide for cutting M. S. Plates for making out M. S. Flats from plates, in case M. S. Flats are not available, No extra payment for such cutting and grinding that may be necessary for converting M. S. Plates to Flats will be admissible.

If the works are required to be done in Railway Yards and Tracks are to be crossed, the tenderer shall inspect the site and make himself thoroughly acquainted with site condition and quote rate considering these aspects.

The work shall have to be done in such a manner that the normal working of the Railway within the railway yard does not get disturbed. No material/temporary structures should be kept adjacent to the running track which may infringe rail traffic. The contractor shall take necessary precaution to prevent/cause damage to the Railway property & staff during the execution of the work.

#### **2.5.52.3 Commencement of the Erection Work at site:**

The contractor shall commence the erection work when and as soon as, but not until, he receives instructions from Engineer to do so. On such order being given, possession of site/authority shall be given to the contractor of such portion or portions of the site as the Engineer may determine.

#### **2.5.52.4 Contractor to Study Drawing & Specification etc. and His Liability:**

The contractor shall be responsible for close scrutiny of the approved drawings supplied by the DFCCIL, For any discrepancies, error or omission in the drawings or other particulars indicated therein, the contractor shall approach the DFCCIL immediately for rectification of indicated therein, the contractor shall approach the DFCCIL immediately for rectification of such discrepancies, errors and omission. If any dimension/figure/features etc. on approved drawings or plans differ from those drawings or plans issued to the contractors at the time of calling the tender, the dimensions as figured upon the approved drawings or plans shall be taken as correct.

#### **2.5.52.5 Contractor to Submit His Time Table:**

The contractor shall submit a monthly progress of work done during the month by the 4<sup>th</sup> day of the following month. He will also give the programme of coming month by 25<sup>th</sup> of each month. The programme will be subject to alteration at the discretion of the DFCCIL officials.

#### **2.5.52.6 Any Doubtful Points to be referred to the GM/ROB, CGM, DFCCIL:**



Should there be any doubt or obscurity as to anything to be done or not to be done by the contractor or as to these instructions or as to any matter or thing, the contractor must set forth such doubt or obscurity in writing and submit the same to GM/ROB,/CGM, DFCCIL. Only such reply as the said GM/ROB,/CGM, DFCCIL may be in writing given shall be taken as the authoritative interpretation of the point in doubt or obscurity.

**2.5.52.7 Contractor's Liability:**

Any fitting, accessory or apparatus which may not have been mentioned in this specification or the drawings, but which are usual or necessary in the execution of such work, are to be provided by the Contractor without extra payment. The whole work must be completed in all details, whether mentioned in this specification or not, with the exception of such work as has been specified in the schedule of items to be separately provided for in the Contract.

Notwithstanding the specifications and conditions stated in the contract, the contractor shall keep the Engineer/ Employer authority fully indemnified and free from all liabilities and risks consequential to any lapse on his part in respect of material quality, standard of workmanship, accuracy of fabrication and the like. He shall provide all labour and material required for execution of the work as per all standards and specifications.

**2.5.52.8** DFCCIL desires that successful contractor should establish (at his own cost) the fabrication workshop near the site only for close monitoring of all the quality aspects of this contract work. Contractor's request for establishing workshop/using workshop proposed/located away from the bridge site shall require prior approval.

**2.5.52.9** Contractor shall establish fully equipped laboratory for all the tests required on materials/processes/products as per provisions of the contract, Specifications and the direction/approval of the Engineer. Costs of these are deemed to be included in the quoted rates. Prior approval of the engineer shall be obtained for non-installation of such testing equipments which can not be installed in normal course due to any reason. However, engineer's decision (for installation and non-installation) in this regard shall be final binding and conclusive.

**2.5.52.10 Site Facilities by the Contractor:**

Contractor shall provide office / site facilities at the bridge site / other locations for ensuring smooth and efficient communication and work execution. Cost of these facilities deemed to be included in the quoted rates and nothing extra shall be paid for this item.

Contractor shall supply round the clock electricity in site offices of DFCCIL located at the bridge during the entire contract work. Contractor shall also maintain the electric fittings/wirings/plants of both the offices in the good condition.

To provide proper communication the contractor shall (at his own cost) establish inter office communication system between DFCCIL office, fabrication workshops and contractor's offices at site. Adequate number of intercom / telephone/ mobile sets or are similar suitable equipments as decided/approved by Engineer fully communicable shall be established in each of the above fabrication shops & at site of bridge work. The entire expenditure incidental to running and maintenance of above shall be borne by the contractor within quoted rates.

Contractor shall (at his own cost) depute / nominate safety officers(s) for supervising safety aspects of all works/process including enabling arrangements for execution and inspection of the work. Safety systems/arrangements should be made for each activity of fabrication/erection and its inspection and same should be certified by nominated safety officer. Special care/arrangements are required to be made for supervising the erection/launching process of such high girders and concreting in road deck: arrangements should facilitate satisfactory and fearless inspection of each activity of launching / erection.

#### **2.5.52.11 Declaration of designed fabrication/assembly yard as a part of site:**

DFCCIL may issue necessary declaration on specific request of the contractor subject in the condition that the workshop area are earmarked exclusively for fabrication of girder components for this bridge with separate entry/exit arrangements. This is with further stipulation that such an arrangement should be acceptable to excise department by way of a no objection certificate. Necessary follow up with Excise Department will be solely the contractor's responsibility. In the event of excise department not agreeing to such an arrangement, the contractor shall not have any claims whatsoever, and shall pay excise tax and other extant taxes as per extant rules within quoted rates and nothing extra would be payable to them on this account.

### **2.5.53 METHOD OF MEASUREMENT FOR PAYMENT**

#### **2.5.53.1 Measurement**

For the purpose of payment, quoted rates apply to the weights of structural steel work calculated from final working drawings based on theoretical weights given in the producer's hand books / IRUSS (W &M),2010-Volume-I and using minimum square overall dimensions, no deductions being made for skew cuts, holes or notches. Each gusset shall be measured as equivalent to the dimension of the smallest enclosing rectangle. The rates items quoted by the tenderer shall include all wastage. **The wastage of steel in the form of skew cuts etc shall be the property of the contractor.**

Payment shall be made on the weight to be calculated in the accordance with the nominal weight of the sections as specified on the drawings. No deduction for holes and no addition for rivets/botls/welds etc shall be made.

The drawing office dispatch lists (D.O.D.Ls) when prepared according to procedure shall be submitted by the contractor to the Engineer for approval.

The payment for steel work as per item in the schedule of items shall be released in stages of accepted item rates for quantities executed, as mentioned in the tender schedule. The payment after receipt of material in fabrication shop shall be made on the basis of measurements contained in the supplier's vouchers, if required, these measurements shall be further verified by the representative of Engineer in charge by measuring dimensions/sizes of the sections and multiplying the same by standard weight. Sampling for actual weight of the sections shall also be done by him as per procedure and frequency prescribed by Engineer.

The payment for complete metallizing / painting of all components of girders including all accessories, painting of contact surface etc including all labour and material, tools and plants, machinery required for all operations of work is included in the accepted rates of item in the schedule. Nothing extra shall be paid.

In the event of a dispute arising as to a portion of steel work, weighment shall be made in the presence of the engineer.

No separate payment shall be made for the field bolts, nuts and service accessories for temporary works.

The cost of temporary erection and testing at the Contractor's workshop, marking, packing and delivery at the site of work is to be included in the price quoted on the tender.

Rate include fabrication of all the types of battens, bracings, ties, stiffeners, packing, diaphragms, shop bolts / welding, T&F bolts, drifts, shop welds, templates, jigs, fixtures, back up supports, accessories, transporting various components from fabrication shop to site including loading, unloading, lift and taxes complete including assembly of girders .

Rate of girder item includes assembling of temporary support for side slewing, raising of girders to the bed block level, providing sliding arrangements and slewing the girder in position and lowering of girder on bearings.

Grouting of holes with epoxy based compounds in the bed block for fixing of HD bolts/anchor pins of bed plates as directed by Engineer are included in the bearing rates.

Rate of girder item includes the Assembling, bolting with contractor's own material, erection, launching, lowering, aligning and placing at exact position as per approved scheme of steel plate girder for required span in proper level and alignment, grip bolts and with all necessary works like making holes.

The rate of girder item will inclusive of supplying /erection and dismantling of staging, scaffolding and other temporary arrangement required for assembling, erection, launching and lowering of the girder.

The rate shall be also inclusive of cold straightening of deformed bent girder parts before the assembling including contractor's all labour, materials T & P, testing etc. complete.

#### **2.5.54 BEARING**

POT-PTFE bearings elastomeric bearing as per approved drawings shall be utilised under the girder as per approved GAD/ design and its special conditions and specification.

#### **2.5.55 DEFLECTION TEST:**

The deflection test shall be carried out as per additional specifications. Load testing will be paid separately as per relevant item.

**PART – III (A)**

**ADDITIONAL TECHNICAL  
SPECIFICATION**

## **PART – III (A)**

### **ADDITIONAL TECHNICAL SPECIFICATIONS - I**

#### **3.1 STUD SHEAR CONNECTOR**

##### **3.1.1 Material:-**

The stud shear connector and ceramic ferrules shall conform to type SD1/UF as per BS EN ISO 13918-2008. The diameter of ceramic ferrule D 7 as per Figure 13/Table 18 of BS EN ISO 13918 shall be 26. Mechanical properties of stud shear connectors shall be as per ISO 6892/BS EN ISO 13918–2008. Shape of tip of stud shear connectors may be chosen by manufacturer. The stud tip shall be supplied with flux in the form of press fitted aluminium ball or Aluminium spray coating

##### **3.1.2 Welding:-**

The welding of stud shear connectors shall be done by “Drawn arc stud welding with ceramic ferrule” Technique. The stud and the surface to which studs are welded shall be free from scale, moisture, rust and other foreign material. The stud base shall not be painted, galvanized or cadmium plated prior to welding. Welding shall not be carried out when temperature is below 10 degrees Celsius or surface is wet or during periods of strong winds unless the work and the welder are adequately protected. The welds shall be visually free from cracks and shall be capable of developing at least the nominal ultimate strength of studs. The procedural trial for welding the stud shall be carried out when specified by the Engineer

##### **3.1.3 Testing:-**

###### **(a) Appearance test**

The weld to a stud shear connector should form a complete collar around the shank and free from cracks, excessive splashes of weld material, free from injurious laps fins, seams, twist, bends or other injurious defects.

Weld material should have a ‘Steel Blue’ appearance.

###### **(b) Test to check the fixing of shear studs**

All studs need to be checked by a ring test.

1. Ring Test : Involves striking the side of the head of the stud with a 2 kg hammer. A Ringing tone achieved after striking indicates good fusion whereas dull tone indicates a lack of fusion (BS 5400 – 6).

2. Bend Test : Test requires the head of a stud to be displaced laterally by approximate 25% of its height using a 6 kg hammer.
- The weld should then be checked for signs of cracking or lack of fusion
  - Stud should not be bent back as this is likely to damage the weld.
  - The testing rate should be 1 in 50 (BG 5400 – 6).

**3.1.4 Measurements:-**The work shall be enumerated. Its unit is "each".

**3.1.5 Rates:-**The rate shall include the cost of material, labour, equipments, tools and plants, etc. complete required for all operations described above.

## **3.2 Load Testing of Bridge**

### **3.2.1 General**

These guidelines cover testing of superstructures, excluding arches for evaluation of their flexural capacity. Testing for shear capacity is not considered. This test is not intended to assess ultimate load carrying capacity of bridge superstructure.

### **3.2.2 Test Procedures – Method of Loading**

The method of loading should be such as to either simulate the specific class of vehicle or induce in the member(s) the calculated forces, viz., the bending moments at critical sections.


The test loads may be in the form of static loads on wheel/ track imprints of the specific class of vehicle.

### **3.2.3 Static Loads**

### **3.2.4 Simulation of the specific IRC vehicle**

The load effect on a span can be produced by building up pre weighed units on loading imprints spaced as per codal provisions. The imprints are built either with brick masonry or concrete and rolled steel sections placed across pairs of imprints, so that platforms could be built on a group of four imprints for placement of pre weighed units. The area of each platform depends on the magnitude of the load and unit weight of individual unit. A pre weighed unit normally comprises sand or soil filled gunny bags, concrete cubes, bricks etc., which can be carried manually. Otherwise, large concrete blocks, containers of water or (stone) ballast or steel ingots could be used if mechanical handling facilities are available to load and unload them from test vehicles. Fig. below shows a scheme for building up 2 lanes of IRC Class A loading on the carriageway of a bridge. The loads are placed eccentrically

on the carriageway of a bridge in such a way that maximum bending moment is produced in any longitudinal.

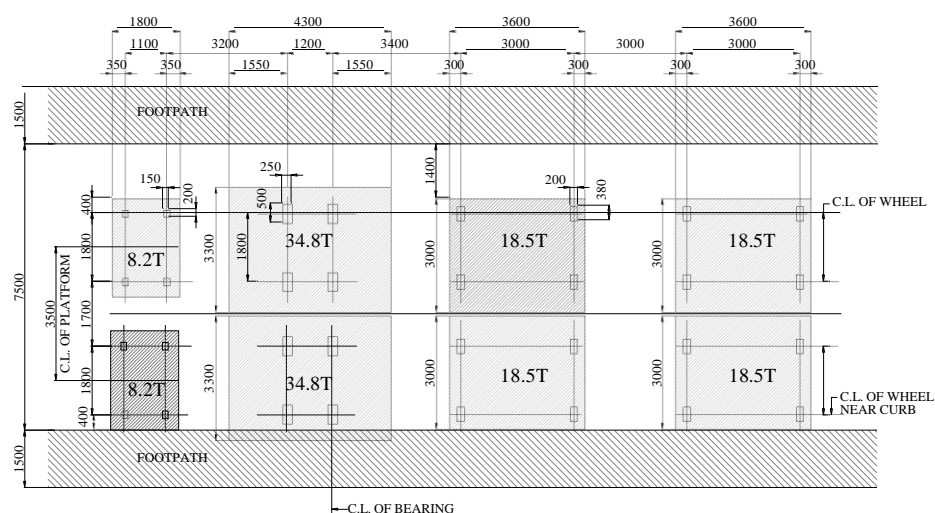

PLACEMENT OF 2-LANES OF IRC CLASS-A LOADING AND FOOTPATH LOADING ON CARRIAGEWAY

### 3.2.5 Other types of static loads

Any configuration which produces the design forces (load effects) in the member(s) could be adopted, for instance uniformly distributed load. Any of the appropriate methods of load distribution between the girders can be adopted in arriving at the test load and its configuration on the span. But the method of distribution of loads should be the same as adopted in the approved design. However, where the approved designs are not available the owner of the bridge should specify the appropriate method of load distribution. In the case of multiple girders, it is possible that the design moments are simultaneously induced in more than one girder. It may well happen that the magnitude of the test load on the span is greater than that of the design IRC vehicle but the forces induced in any member should be always equal to the specified design force of the load test.

### 3.2.6 Loading and Unloading Sequence

**3.2.6.1** The test load shall be applied in stages so that timely action, such as stopping the test, can be taken if any untoward distress is observed at any stage. In most cases,



the design live load effect would be equal to or less than that due to dead load. The dead load is already acting the test load it some specified multiple of live load more than one. The suggested stages of test load placement are 30 percent, 50 percent, 70 percent, 80 percent, 90 percent and 100 percent. Unloading should also be in the same stages. The next incremental loading should be added only after the deflections under the previous load have stabilized and all the stipulated observations are completed.

**3.2.6.2** The selection of first stage of loading depends on the general condition of a bridge and the load carrying capacity theoretically assessed. It is advisable to monitor the appearance and widening of flexural cracks at every stage of loading, so as to decide about placement of next incremental load. It is expected that the load deflection characteristics at every increment are linear and any abnormal behaviour is reflected in the load v/s deflection data. If the deflection observed exceeds the limit prescribed in the code the further loading shall be stopped. Subsequent actions shall be taken in consultation with appropriate authorities. Occasionally, crackling sounds at the locations of expansion joints are heard when the rotation capacity is exceeded, particularly, in balanced cantilever bridges. Spalling of delaminated concrete is also possible during load tests.

### **3.2.7 Preparatory Work**

- All visual defects should be measured, mapped and plotted.
- It should be ensured that bearings are functional.
- Expansion gaps, joints should be cleared of all debris.
- It will be useful to give the surface of the superstructure a coat of white wash, so that appearance of cracks becomes immediately perceptible.

### **3.2.8 Precautions**

- Staging should be stable and safe.
- Staging for instruments and that for observers should be quite independent.
- Staging for instruments should be rigid.
- Due to temperature change, the superstructure may tend to hog or sag; therefore, it should be ensured that when this occurs, contact with the spindle of the dial gauge is not lost. Spindle extensions should be fixed to take care of this.

During the 24 hour retention period of built up load, care shall be taken to cover the pre weighed units with tarpaulin, so that rain or strong winds do not affect the stacking on the platforms.

### **3.2.9 Observations**

The following should be observe, measured and recorded at regular intervals of one hour over a period of 24 hours:

Deflections at critical sections (for instance for simply supported spans at mid-span and at quarter-span. In box girders, it will be useful to record deflections under each of the external ribs).

Appearance of cracks and their development, length, width, location, orientation correlated with load.

Deformation of bearings.


Ambient temperature and related temperature in the body of the structure.

### **3.2.10 Measurement of deflections**

Deflections could be measured with the following devices:

- (a) Dial gauges
- (b) Scale and cursor
- (c) Deflectometers
- (d) Precision level
- (e) Water level

The methods (a) to (c) could be used wherever dry bed is available under the span. Otherwise, methods (d) and (e) can be used by using a reference station at the nearby abutment. When girder bridges are subjected to load tests, it is essential to clear debris in the expansion gaps and lubricate steel bearings to permit free translation and rotational movements of the spans.

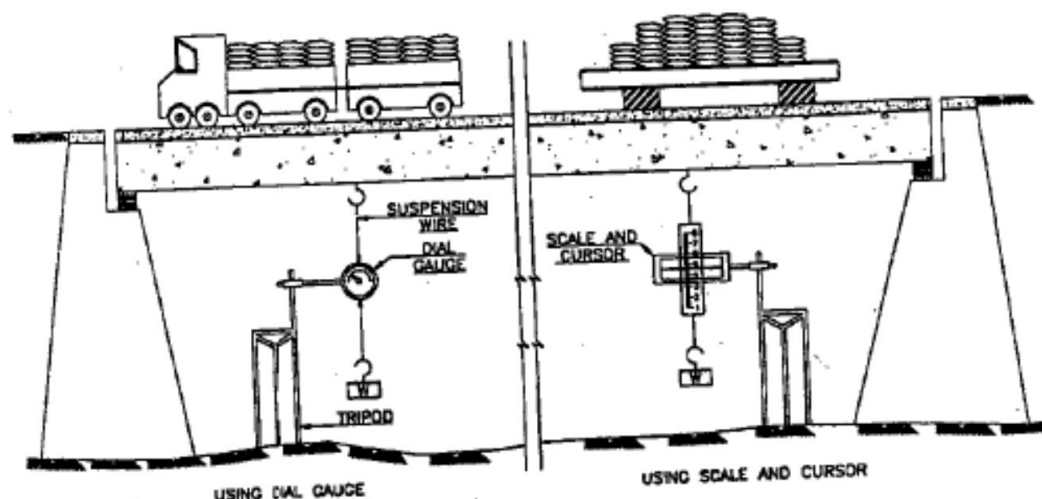

The deflection measurement can be done by suspension wire method at the required locations using dial gauges (Fig.). In this method trestles or posts 1.5m tall would be embedded in firm ground and dial gauges of least count 0.01 mm are clamped to them. The spindles of the dial gauges are connected by a pair of adapters in plumb line with a GI or Invar wire. The wire is made taut by attaching a weight at the end. The method could be partly modified by using a (steel) scale and cursor instead of dial gauge, when the order of anticipated deflection exceeds 100mm. Fig. 2 also shown the scale and cursor method for measurement of large deflections.


### 3.2.11 Procedure for Temperature Correction

A set of thermocouples are to be fixed at different locations of deflection measurement for monitoring temperature of the bridge deck. In absence of thermocouples, hand held instruments could be used wherein a probe could be inserted in a preformed hole in concrete surface, for recording temperature. As a last resort, thermometers could also be suspended from trestles used for deflection measurement to measure the shade temperature. The number of thermocouples/thermometers/probes used could be about half the total number of locations for deflection measurement.

The superstructure tends to hog or sag due to variation in ambient temperature and it is necessary to apply correction to the deflection data during static load test. This is so since the duration of loading or unloading operation in static load test could be for 4-5 hours.

For this purpose, the platforms on masonry imprints meant for building up static loads should be placed in respective positions for observing thermal response of the bridge deck prior to load test. The deflection values and ambient temperature data are generally collected from dawn to dusk for two or three consecutive days at 1 hour intervals. The temperature vs. deflection data are collected on these days and a curve drawn for each station (dial gauge location), which is taken as basic curve for temperature correction.

Usually the temperature – deflection characteristic would be a best fit obtained from a cluster of readings. The deflection reading at any location and temperature during load test, is super-imposed on the basic curve. The difference between the two values give the true deflection for the location under reference, corresponding to the same temperature. Fig. below shows typical characteristic of thermal response, super imposed on load vs. deflection data during a proof test.

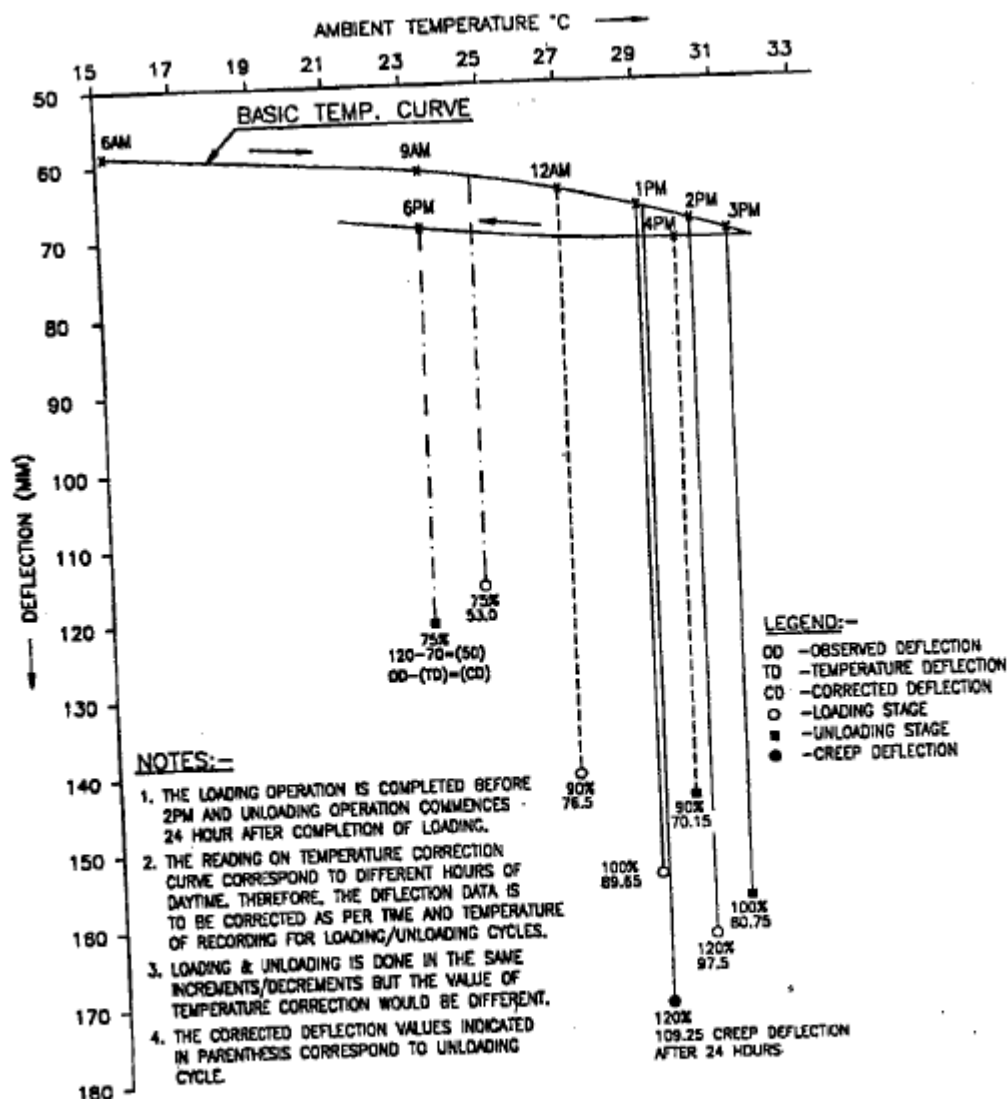

**Fig. 3. Typical basic temperature correction curve with load-deflection data in a load test**

## Precaution

The bridge deck temperature gets affected due to variation in humidity and strong winds on the day. Also, the data gathered on sunny and cloudy days would be different, although the ambient temperature is same.

Therefore, to avoid inconsistencies in the data, it is preferable to choose two identical spans, one for load test and the other for temperature – deflection data and should be monitored simultaneously. This approach reduces the total period of load testing by at least two days.

### 3.2.12 Percentage Recovery of Deflection

The percentage recovery could be calculated for values of deflection. The percentage recovery is calculated at 24 hours after removal of load.

The calculation is done as follows after effecting temperature and/or rotation correction to deflection data:

|  |      |                                      |
|--|------|--------------------------------------|
| Initial value (on dial gauge)  | ...  | R1                                   |
| Final value after placement of test load                                     | ...  | R2                                   |
| [Thereafter, measurements are to be taken at regular intervals of one hour]. |      |                                      |
| Value at 24 hours after placement of test load                               | ...  | R3                                   |
| Value immediately after removal of test load                                 | ...  | R4                                   |
| [Thereafter, measurement are to be taken at regular intervals of one hour]   |      |                                      |
| Value at 24 hours after removal of test load                                 |      | R5                                   |
| Total deflection   | ...  | R3-R1                                |
| Total recovery 24 hrs after removal of test load                             | .... | R3-R5                                |
| Percentage of recovery of deflection   | ...  | $\frac{(R3-R5) \times 100}{(R3-R1)}$ |
| 24 hrs after removal of test load  |      |                                      |

### 3.2.13 Acceptance Criteria

**3.2.13.1** The criterion of acceptance is based on recovery of deflection after removal of test load. It is necessary to specify the quantum of applied load, the duration of the load on the span and the percentage recovery of deflection on removal of load.

**3.2.13.2** For bridges designed for IRC Standard loadings, criteria for load testing of steel, PSC and RCC superstructures are given in table below :Table Acceptance Criteria

| Sl. No. | Type of Bridges | Live Load Intensity for Testing | Duration of Retention of Test Load (Hrs.) | Minimum percentage recovery of Deflection at 24 hrs after removal of Test Load |
|---------|-----------------|---------------------------------|---|--|
|         |                 |                                 |   |  |

|   |                      |   |    |    |
|---|----------------------|---|----|----|
| 1 | Reinforced concrete  | * | 24 | 75 |
| 2 | Prestressed concrete | * | 24 | 85 |
| 3 | Steel                | * | 24 | 85 |
| 4 | Composite            | * | 24 | 75 |

(\* 1.0L plus corresponding impact as per IRC Codes)

A general acceptance criterion for the behavior of a structure under test load is that it shall not show “visible evidence of failure” which include appearance of cracks of width more than 0.3mm, spalling or deflections which are excessive and incompatible with safety requirements.

### 3.4 NON-DESTRUCTIVE INTEGRITY TESTING OF PILE

#### 3.4.1 SCOPE

This specifications covers the methods on non-destructive testing as per IS: 14893 of all types of concrete piles covered in IS 2911 (Part I/Sections 1, 2, 3 and 4).

#### 3.4.2 SITE INFORMATION REQUIRED FOR THE TESTS

The following information is generally required to carry out integrity tests:

- (a) Location of site
- (b) Pile types including size, material and reinforcement
- (c) Layout of piles
- (d) Details of pile installation (including construction and driving sequence and rest periods)
- (e) Number of piles to be tested;
- (f) Subsurface profile/driving details of the piles  
(More if variations are noted)
- (g) Depth of water table and soil investigation report, if any
- (h) Density of concrete; Strength of concrete

- (i) Abnormal conditions noted while driving/boring or concreting of piles. The normal daily report produced by the piling site should contain this information. In addition, any other information concerning planning and conducting the tests including relevant past experiences covering similar test(s) in the area, and
- (j) Details of test piles(s), if any.

### 3.4.3 TYPES OF TESTS

Various methods are available for checking the integrity of concrete piles after installation. In the most widely used method, impulses or vibrations are applied to the pile and measurements made of timings and attenuation of reflected signals.

The commonly used sonic methods, vibration methods, sonic logging techniques, etc, have been tried within the last 15-20 years in different parts of the world. However, the methods based on One Dimensional Stress Wave approach known as Sonic Integrity Testing, a Low Strain Integrity testing or Sonic Echo Testing have been used successfully in various parts of the world. The method is simple and quick enabling dozens of piles to be examined in a single working day without much interference in site activities.

The work carried out on sonic integrity testing of pile in the country has shown its efficiency; in assessing the structural quality of piles and therefore it is appropriate to frame in this code the salient features of this method.

#### 3.4.3.1 The Low Strain Integrity Testing

This is a system of assessing the integrity of piles by the use of low stress wave imparted to the pile shaft and is also known as Sonic Integrity or Sonic Echo Test.. A small metal/hard rubber hammer is used to produce a light tap on top of the pile. The shock travelling down the length of the pile is reflected back from the toe of the pile and recorded through a suitable transducer/accelerometer (also held on top of the pile close to the point of impact) in a computer disk or diskette for subsequent analysis..

The primary shock wave which travels down the length of the shaft is reflected from the toe by the change in density between the concrete and sub-strata. However, if the pile has any imperfections or discontinuities within its length these will set up secondary reflections which will be added to the return signal. (See Fig.).

By a careful analysis of the captured signal and knowledge of the conditions of the ground, age of concrete, etc, a picture of the locations of such problems can be built up. The reflected stress wave can be monitored using either processing technique; the observed signals are amplified and converted into digital display as velocity

versus length or frequency versus mobility records, providing information on structural integrity of piles.


The stress wave velocity and approximate pile lengths are provided as input for the integrity testing. The stress wave velocity is dependent on the Young's modulus and mass density of pile concrete. This value generally lies between 3000-4000 meter per second depending on the grade of concrete used (M15-M25).

3.4.3.2 Normally more than one recording of signals is done until repeatability of signals is achieved. If necessary, averaging of signals is also done to achieve more informative signals. In a suspected pile the test should be repeated at more than one location on top of the pile.

3.4.3.3 The tests shall be conducted on piles whose length is correctly recorded or on test piles where available, to determine the value of stress wave velocity and characteristic or reference signal for comparing the signals for testing subsequent piles.

3.4.3.4 The method of testing involves high skill and use of computerized equipment. Therefore, the tests should be performed and interpreted by trained and experienced personnel.



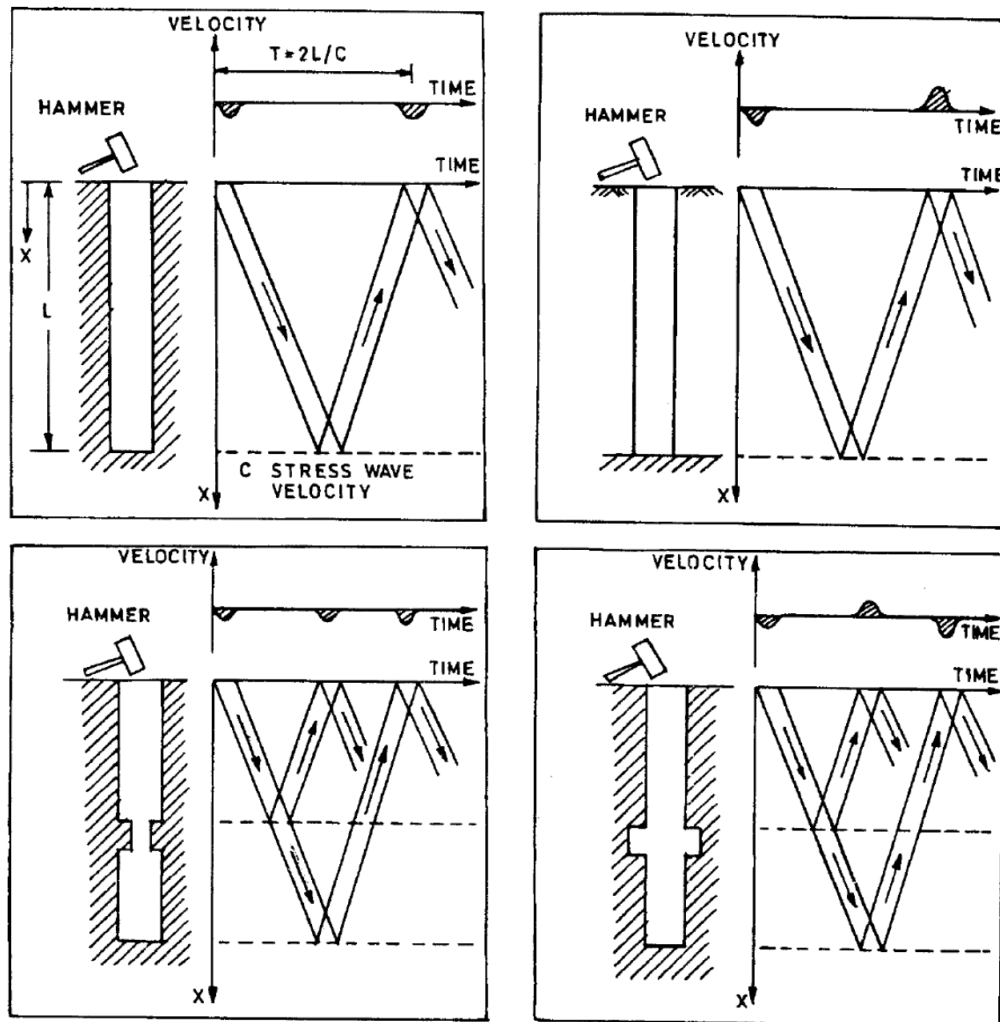

### 3.4.4 Data and Reporting

- (i) The assessment of structural integrity is based on two equally important aspects:
  - a) Quality of signals, and
  - b) Accurate analysis and interpretation of signal.
- (ii) Piles requiring remedial measures should be so marked immediately on completion of the field integrity testing, and rectification, measures selected.
- (iii) The final report should include signals of each integrity test and reflect on the structural condition of piles.

### 3.4.5 GENERAL REQUIREMENTS OF THE TESTS

- (i) Piles shall be trimmed to cut off level or sound concrete level before the test with all laitance removed. No pile cap blindage work should be undertaken prior to the test.

- (ii) The area surrounding the pile should be free from standing water and kept dewatered during the tests.
- (iii) The pile head should be accessible.
- (iv) Testing should be free of work likely to cause disturbance.
- (v) The cast-in-situ piles should not be tested normally before 14 days of casting.
- (vi) The test piles, if available at site, can be used to determine the pulse velocity and characteristic or reference signal generated. Where no test pile is available information can be obtained from cast piles whose length is accurately recorded.

#### 3.4.6 LIMITATIONS OF NDT METHODS

- (i) Non-Destructive Testing of piles does not provide the load carrying capacity of piles.
- (ii) It does not provide information regarding verticality or displacement in position of piles.
- (iii) Minor deficiencies like local loss of cover, small intrusions or type of conditions of materials at the base of piles are undetectable. Integrity testing may not identify all imperfections, but it can be useful tool in identifying major defects within the effective lengths. The test may identify minor impedance variations that may not affect the bearing capacity of piles. In such cases, the engineer should use judgment as to the acceptability of these piles considering other factors such as load redistribution to adjacent pile, load transfer to the soil above the defect, applied safety factors and structural load requirements.
- (iv) Based on the latest information available, the limitations relating to the depths up to which the integrity tests can be carried on piles depends on the surrounding strata and damping within the concrete.
- (v) The present experience of Non-Destructive Testing of piles is up to a diameter of 1500 mm.
- (vi) Soil stiffness or founding on rock of similar density as the pile will attenuate the signals such that there will be little or no toe reflection.
- (vii) The low strain integrity method is applicable to cast – in – situ concrete bored and driven piles. Conclusive results are rarely obtained in case of segmented precast reinforced concrete driven piles or precast piles in pre bored holes.

#### 3.4.7 METHOD OF MEASUREMENTS: It will be measured in number.

#### 3.4.8 PAYMENTS: The rate includes cost of all materials, labour, equipment's & operations required to do this test.

## **PART- III (B)**

### **ADDITIONAL TECHNICAL SPECIFICATIONS – III**

## **PART- III (B)**

# **ADDITIONAL TECHNICAL SPECIFICATIONS – III**

### **1.0 Additional SPECIAL CONDITIONS OF CONTRACT GENERAL:**

In these Special Conditions of Contract the following terms shall have the meaning hereby assigned to them except where the context otherwise requires:

"General Condition of Contract" shall mean General Conditions of Contract – as contained in this Tender/ Bid document vide chapter IV First Sheet.

Standard Specifications shall mean "Indian Railways Unified standard specifications (works and materials) Vol –I &II in Tender form (First sheet).

Standard Schedule Items/Rates shall mean the Items/Rates in the Unified standard schedule of rates (works & materials)-2011

All other terms shall have the same meaning as assigned to them in the General Conditions of Contract and Standard Specifications.

Where there is any conflict in conditions/Specifications contained in various parts, order of precedence will be as given below-

Any foot note given by the Railway in the schedule of quantities and rates.

Description of item in the Schedule of Quantities and rates.

Special Specifications.

Additional Special Conditions/of Contract.

Standard Specifications.

Special Conditions of Contract.

General Conditions of Contract.

Where there is any conflict in the description, Unit, rate etc. of items based on USSOR-2011, as included in the "Schedule of items, Quantities and rate " incorporated in the tender/Contract document on the one hand and the USSOR-2011 on the other hand, USSOR-2011 should prevail.

Every endeavour has been made to avoid any error which can materially affect the basis of the Tender and it is understood that the Contractor has taken upon himself and provided for the risk of any error which may be subsequently and shall make no subsequent claim on account thereof.

#### **1.2 PRODUCTION OF TEST CERTIFICATES:**

The contractor shall have to produce Test Certificates for any items of material procured by him for use in the work as may be called for by the Engineer or his representative to establish that the materials conform to the specification for the works. The Contractor shall produce Test Certificates issued by an authority acceptable to the Engineer in regard to the relevant properties of high tensile steel wires, reinforcement steel or structural steel (as supplied and used by the Contractor) including the country name of manufacturer) .

#### **1.3. PAYMENT OF ROYALTY CHARGES:**

All taxes, royalty charges, etc. of whatever nature in connection with the work including extraction and supply of rubble stone/stone ballast/sand/moorum/earth or any other material used on the work shall have to be borne by the Contractor. The Contractor will be required to obtain a royalty clearance certificate from the concerned Revenue Authorities/Collector and produce the same to the Engineer after completion of the supply but before release of the final bill.

#### **1.4. ROYALTIES AND PATENT RIGHTS:**

The Contractor shall defray the cost of all royalties, fees and other payments in respect of patents, patent rights and licenses which may be payable to patentee, licensee or other person or corporation and shall obtain all necessary licenses.

The contractor shall indemnify, the Railway or any agent, servant or employee of the Railway against any action, claim or proceedings relating to infringement use of any patent or design any alleged patent or design rights and shall pay any royalties or other charges which may be payable in respect of any articles or materials or part thereof included in the contract. In the event of any claim being made or action being brought against the Railway or any agent, servant or employee of the Railway in respect of any such matters , as aforesaid, The contractor shall indemnify notified thereof. Provided that such indemnify shall not apply when such infringement has taken place in complying with the specific direction issued by the Railway but the contractor shall pay any royalties or other charges payable in respect of any such use.

### 1.5. **INCOME TAX**

Income Tax as per rates applicable/amended under the Income Tax Act of work shall be deducted at source unless the contractor is exempted by Income Tax Authorities.

### 1.6 **GST**

GST as applicable from time to time on taxable value of each running account bill shall be paid by DFCCIL.

### 1.7 **PERMITS, FEES, TAXES & ROYALTIES**

Unless otherwise provided in the contract documents, the contractor shall secure and pay for all permits, Government fees and licenses necessary for the execution and completion of the works. The contractor shall pay all taxes and duties except GST tax. **GST will be paid by DFCCIL as per prevailing rate.**

The DFCCIL authorities will not take any responsibility of refund of such taxes/fees. Any violation, in the legal provision of taxes, duties, permits and fees, carried out by the Contractor and detected subsequently shall be sole responsibility of the Contractor and his legal heirs.

### 1.8 **STATUTORY INCREASE IN DUTIES, TAXES ETC**

Tenderers will examine the various provisions of the central Goods and services Tax Act, 2017 (CGST)/ Integrated goods and service tax Act, 2017 (IGST)/ Union Territory Goods and services tax Act, 2017/(UTGST)/respective state's state Goods and services tax Act (SGST) also, as notified by central/state Govt & as amended from time to time and applicable taxes before bidding. Tenders will ensure that full benefit of input Tax Credit (ITC) likely to be availed by them is duly considered while quoting rates.

All the taxes and duties levied by the State and Central Govt. and by Local Bodies at the prevailing rates applicable on the date of receipt of tender shall be fully borne by the Contractor and shall not be reimbursed to him on any account. The tender shall be inclusive of all taxes levies as mentioned in 1.7 above.

Further **DFCCIL** shall not honour any claim arising out of any increase in any of the prevailing statutory duties, taxes, levies, octroi, etc **except GST**. At the time of quoting/bidding contractor should bear the above fact in mind.

The successful tenderer who is liable to be registered under CGST/IGST/UTGST/SGST Act shall submit GSTIN along with other details required

under CGST/IGST/UTGST/SGST Act to DFCCIL immediately after the award of contract, without which no payment shall be released to the contractor. The contractor shall be responsible for deposition of applicable GST to the concerned authority.

#### **1.9. EXCISE DUTY OR ANY OTHER TAXES/DUTIES:**

The contractor shall bear full taxes /duties other **than GST duties levied by state government** and / or Central Government/Local bodies from time to time. This would be entirely a matter between the contractor and the State / Central Government./Local bodies. No claim, what so ever, on this account shall be entertained by DFCCIL.

#### **1.10. ROAD TAX CHARGES:**

Road Tax/Charges levied by Government for movement of vehicles of contractor, used in transportation, shall be borne by the contractor and no re-imburement on this account will be made by the DFCCIL.

#### **1.11. FOREIGN EXCHANGE REQUIREMENTS:**

Any demand of foreign exchange for importing of equipment's and materials shall not be accepted.

#### **1.12 ANTI PROFITEERING CLAUSE.**

The contractor should adhere to anti profiteering provisions as per section 171 of the CGST Act. Where due to change in the rates GST/Change in law, the contractor gets any credits/benefits, the same shall be passed on to DFCCIL by way of reduction in prices. Contractor has to submit the Anti Profiteering declaration as per Form no. 20 and Certificate from CA regarding benefit of input credit tax as per form no. 21.

#### **1.13: EMERGENCY WORKS**

In the event of any accident or failure occurring in the execution of work/ arising out of it which in the opinion of the Engineer requires immediate attention, the Railway may bring its own workmen or other agency/agencies to execute or partly execute the necessary work or carry out repairs if the Engineer-in-charge considers that the contractor(s) is/are not in a position to do so in time without giving any notice and charge the cost thereof, to be determined by the Engineer-in-charge, to the contractor.

#### **1.14. CUTTING/UP ROOTING OF TREES:**

No extra rate shall be paid for cutting or up-rooting trees but the contractor would be authorised to take away the tree observing the forest laws of the land.

**1.15. OBSERVANCE OF BONDED LABOUR SYSTEM (ABOLITION ORDINANCE ACT, 1975):**

The “Bonded Labour System (Abolition Ordinance, 1975)” would apply to the present contract. The contractors shall duly observe the provisions thereof.

**1.16. JURISDICTION OF COURTS:**

If any dispute arises between the parties with respect to this contract, any application or suit shall be instituted only in the court within the local limits of whose jurisdiction, the CGM / NORTH / MUMBAI / DFCCIL Office is situated and both the parties shall be bound by this clause.

**2.0 EXTRA SAFETY PRECAUTIONS**

**2.1 SAFE METHODS:**

The Contractor shall at all times, adopt such safe methods of working as will ensure safety of structures, equipment and labour. Safety rules that should be adhered to are given as guidelines in Annexure C. If at any time, the DFCCIL finds the safety arrangements inadequate or method of working unsafe, the Contractor shall take immediate corrective actions as directed by the Engineer's representative. Any directions in the matter shall in no way absolve the Contractor of his sole responsibility to adopt safe working methods. The Contractor is responsible for providing skilled personnel and adequate expert supervision so as to ensure complete safety.

It is the responsibility of the Contractor to ensure safe loading, transportation and unloading of materials and equipment etc. Any loss or damage caused to adjacent Railway property will have to be made good by the contractor at his/their own cost, failing which recoveries shall be effected from the running bill of the contractor as per the Clause No. 46(1) of the General Conditions of Contract.

The liability arising out of accidents, if any, to persons will be met by the contractors and the Railway will not be responsible for any damage or compensation thereof. The contractor shall follow the provisions laid down in Contract Labour Act, 1972.

The contractor shall be entirely responsible for ensuring safety of his labour, vehicles, plant or equipment while working along or near the track and highways and shall programme his working so as not to interfere with the movement of trains and road traffic. No extra payment shall be allowed to the contractor for all safety precautions to be observed during the execution of the work. The cost of all such precautions shall be deemed to be included in the rates for all items of the schedule.



## **2.2. PRECAUTIONS WHILE WORKING IN THE VICINITY OF TRACK:**

**2.2.1** The contractor shall not allow any road vehicle belonging to him or his suppliers etc., to ply in railway land next to the running line. If for execution of certain works viz. Earthwork for parallel railway line and supply of ballast for new or existing rail line gauge conversion etc. road vehicles are necessary to be used in railway land next to the railway line, the contractor shall apply to the engineer incharge for permission giving the type and no. of individual vehicles, names and license particulars of the drivers, location, duration and timings for such work/movement. The engineer-in charge or his authorised representative will personally counsel examine & certify, the road vehicle drivers, contractor's flagmen and supervisor and will give written permission giving names of road vehicle drivers, contractor's flagmen and supervisor to be deployed on the work, location, period and timing of the work. This permission will be subject to the following obligatory conditions:

The road vehicles and drivers will ply only between sunrise and sunset.

Nominated vehicles and drivers will be utilized for work in the presence of at least one flagman and one supervisor certified for such work.

The vehicles shall ply 6m. Clear of track. Any movement/work at less than 6m and upto minimum 3.5 clear of track centre shall be done only in the presence of DFCIL / Railway employee authorised by the Engineer-incharge. No part of the road; vehicle will be allowed at less than 3.5m from track centre. Cost of such railway employee shall be borne by the railway.

The contractor shall remain fully responsible for ensuring safety & in case of any accident, shall bear cost of all damages to this equipment & men and also damages to railway and its passengers.

Semi-permanent fencing as approved by the Railway Engineer should be provided by the contractor at his own cost along the running line at a distance of 3.5 metres from the centreline of the nearest track at work sites where vehicles/machineries are likely to ply close to the track. This fencing should remain in position till the vehicles/machinery are required to work adjacent to running line.

Engineer-incharge may impose any other condition necessary for a particular work or site.

Suitable scaffolds should be provided for workmen for all works that cannot safely be done from the ground or from solid construction except for such short period work as

can be done safely from ladders. when a ladder is used an extra labour shall be engaged for holding the ladder and if the ladder is used for carrying materials as well, suitable foot holds and hand-holds shall be provided on the ladder and the ladder shall be given an inclination not steeper than 1/4 to 1 (1/4 horizontal to one vertical).

- 2.2.3** Scaffolding or staging more than 3.5 meters above the ground or floor, swung or suspended from an overhead support or erected with stationary support shall have a guard rail properly attached bolted, braced and otherwise secured at least 1 meter high above the floor or platform or staging and extending along the entire length thereof with only such opening as may be necessary for the delivery of materials. Such scaffolding or staging shall be so fastened as to prevent it from swaying from the building or structure.
- 2.2.4** Working platform gangways and stairways should be so constructed that they should not sag unduly or unequally, and where the height of the platform or the gangway or the stairway is more than 3.5 meters above ground level or floor level, they should be closely boarded, should have adequate width and should be suitably fastened as described in the para above.
- 2.2.5** Safe means of access shall be provided to all working platform and other working places. Every ladder shall be securely fixed. No portable single ladder shall be over 10 metres in length while the width between side rails in swung ladder shall in no case be less than 300 mm for ladders upto and including 3.5 metres in length. For longer ladders this width should be increased by at least 20 mm for each additional metre of length. Uniform steps spacing shall not exceed 300 mm. Adequate precautions shall be taken to prevent danger from electrical equipments. No materials on any of the sites of work shall be so stacked or placed as to cause danger or inconvenience to any persons or the public. The contractor shall provide all necessary fencing and lights to protect the public from accident and shall be bound to bear the expenses of the defense. of every suit, action or other proceeding at Law that may be brought by any person for injury sustained owing to neglect of the above precautions and to pay any damages and cost which may be awarded in any suits, action or proceedings to any such persons or which may with the consent of the contractor be paid to compromise any claim by any such persons.
- 2.2.6** Demolition: Before any demolition is commenced and also during the process of the work:

All roads and open areas adjacent to the work site shall either be closed or suitably protected;

No electric cable or apparatus which is liable to be a source of danger over a cable or apparatus used by the operator shall remain electrically charged;

All practical steps shall be taken to prevent danger to persons employed from risk of fire or explosion or flooding;

No floor, roof or other part of the building shall be so overloaded with debris or materials as to render it unsafe.

All necessary personal safety equipment as considered adequate by the Engineer should be kept available for the use of the persons employed on the site and maintained in a condition suitable for immediate use, and the Contractor should take adequate steps to ensure proper use of equipment by those concerned. In addition, workers employed on mixing asphalted materials, cement and lime mortar shall be provided with protective goggle.

workers engaged in white-washing and mixing or stacking of cement bags or any materials which is injurious to the eyes shall be provided with protective goggles; workers engaged in welding works shall be provided with protective goggles; stone breakers shall be provided with protective goggles and protective clothing and seated at sufficiently safe intervals.

**2.2.7** The contractor shall submit the methodology proposed to be adopted for execution of works for approval of the Railway Engineer with a view to ensure safety of trains, passengers & workers and he shall also ensure the methods and arrangements are actually available at site before start of work and contractor's supervisors and workers have clearly understood the safety aspects and requirements to be adopted / followed while executing the work.

**2.2.8** The contractor shall maintain an assurance register at each site, which shall be got signed by both DFCCIL supervisor as well as contractor's supervisor in token of their having understood the safety precautions to be observed at site.

**2.2.9 JOINT PROCEDURE ORDER FOR UNDERTAKING DIGGING WORK IN THE VICINITY OF UNDERGROUND SIGNALLING, ELECTRICAL AND TELECOMMUNICATION CABLES.**

|   |  |
|---|--|
| A | A number of Engineering works in connection with gauge conversion / doubling / third line are in progress on various railways, which require extensive digging work near |
|---|--|

|   |  |
|---|--|
|   | the running track, in close vicinity of the working S&T cables carrying vital safety circuits as well as electrical cables feeding the power supply to Cabins, ASM room, RRI Cabin, Intermediate Block Huts (IBH) etc. Similarly, S&T organization under open line on construction units under CAO/C are executing various signaling and telecommunication works requiring digging of earth for laying of cables or casting of foundations for the erection of signal posts etc. RailTel are also executing the work of laying of quad cable and OFC on various Railways as a part of sanctioned works for exclusive use of Railways for carrying voice and data i.e. administrative and control communication, PRS, FOIS etc. or shared by RailTel Corporation of India Ltd. On certain sections digging is also required for laying of electrical cable and casting of foundation for the erection of OHE masts by Electrical Deptt. Generally, these works are executed by contractors employed by these organizations. |
| B | However, while carrying out these works in the vicinity of working signaling, telecommunication and electrical cables, at times, cable cuts take place due to JCB machines working along the track or during the digging work being done by Contractors carrying out the Civil Engineering Works. Similarly, such cable cuts are also resulting due to works undertaken by S&T or Electrical deptts. Such Cable faults results in the failure of vital signaling and telecommunication circuits.   |
| C | Henceforth, the following joint procedure shall be followed by Engineering, Electrical and S&T (and RailTel organization, wherever such works are being done by them) Officers of the respective divisions and by the Construction Organization, while carrying out any digging work near to existing signaling& telecommunication and electrical cables, so that the instances of cable cut due to execution of works can be controlled and minimized.  |
| 1 | S&T Department (and TailTel, where they have laid the cables) & Electrical Deptts. shall provide a detailed cable route plan showing exact location of cable at an interval of 200m or wherever there is change in alignment so that the same is located easily by the Engineering official/contractor. This cable route plans shall be made available to the DSE/DEN or Dy. CE/C as the case may be by Sr.DSTE/DSTE or Sr.DEE/DEE of the divisions or Dy. CSTE/C or Dy.CEE/C within a reasonable time in duplicate. DSE/DEN or Dy.CE/C or Dy.CEE/C within a reasonable time in duplicate. DSE/DEN or Dy.CE/C will send copies to their field unit i.e. AEN/SE/P.Way& Works.   |
| 2 | Before taking up any digging activity on a particular work by any agency, Sr.DSTE / DSTE or Sr.DEE/DEE of the section shall be approached in writing by the concerned Engg. or S&T or Electrical officer for permitting to undertake the work. After ensuring that the concerned executing agencies, including the contractor have fully understood the S&T and Electrical cable route plan shall permit the work in writing.  |
| 3 | After getting the permission from S&T or Electrical Deptt. as the case may be, the relevant portion of the cable route plan shall be attached to the letter through which permission is issued to the contractor by concerned Engg. official for commencement  |

|   |  |
|---|--|
|   | of work and ensuring that the contractors have fully understood the cable route plan and precautions to be taken to prevent damage to the underground cables. The contractor shall be asked to study the cable plan and follow it meticulously to ensure that the safety of the cable is not endangered. Such a provision, including any penalty for default, should form part of agreement also. It is advisable that a suitable post of SE (Sig) or SE (Tele) or SE (Elect) shall be created chargeable to the estimates of doubling / Gauge conversion, who can help engg. agencies in the execution of the work. However basic responsibility will be of the Department executing the work and the Contractor. |
| 4 | The SE (P.Way) or SE (Works) shall pass on the information to the concerned SE (Sig) or SE (Tele) or SE (Elect) about the works being taken up by the contractors in their sections at least 3 days in advance of the day of the work. In addition Engineering control shall also be informed by SE (P.Way) or SE (Works), which in turn shall pass on the information to the Test Room / Network Operation Centre of RailTel / TPC / Electrical Control.  |
| 5 | On receiving the above information, SE (Sig) or SE (Tele) or SE (Elect) shall visit the site on or before the date of taking up the work and issue permission to the contractor to commence the work after checking that adequate precautions have been taken to avoid the damage to the cables. The permission shall be granted within 3 days of submission of such requests.   |
| 6 | The name of the contractor, his contact telephone number, the nature of the work shall be notified in the Engineering Control as soon as the concerned Engg. official issued the letter authorizing commencement of work to the contractor. Test Room be given a copy and Test Room shall collect any further details from the Engineering Control and shall pass it on to S&T / RailTel& Elect. Officials regularly.  |
| 7 | In case of works being taken up by the State Government, National Highway Authority etc., the details of the permission given i.e. the nature of work, kilometer etc. be given to the Engineering Control including the contract person's number so that the work can be done in a planned manner. The permission letter shall indicate the contact numbers of Test Room / Network Operations Centre of RailTel / TPC/ Elect. Control.   |
| 8 | Where the nature of the work taken up by the Engineering department is such that the OFC or other S&T cables or Electrical cables is to be shifted and relocated, notice of minimum one week shall be given so that the Division / RailTel / Construction can plan the works properly for shifting. Such shifting works shall, in addition, for security and integrity of the cables, be supervised by S&T supervisors / TailTel supervisors / Electrical Supervisors.   |
| 9 | The concerned SE(P.Way), SE(Works / SE(Sig) / SE (Tele) SE (Elect) or RailTel supervisors, supervising the work of the contractor shall ensure that the existing emergency sockets are not damaged in view of their importance in providing communication during accident / emergency.   |

|    |  |
|----|--|
| 10 | In case of minor nature of works where shifting of cable is not required, in order to prevent damage to the cable, the Engineering Contractor shall take out the S&T or optical fibre cable or Electrical cable carefully from the trench and place it properly alongside at a safe location before starting the earthwork under the supervision of SE (Sig) or SE (Tele) or SE (Electrical). The cable shall be reburied soon after completion of excavation with proper care including placement of the brick over the cable by the concerned S&T supervisors or Electrical Supervisors. However, the work will be charged to the concerned engineering works.   |
| 11 | In all the sections where major project are to be taken up / going on RailTel / S&T Deptt. shall deploy their official to take preventive / corrective action at site of work.   |
| 12 | No new OFC/Quad cable shall be laid close to existing track. It shall be laid close to Railway boundary as per extant instructions i.e. 1.0 m from the Railway boundary to the extent possible to avoid any interference with future works (doubling etc). It shall be ensured in the new works of cable laying that the cable route is properly identified with electronic or Concrete markers. Henceforth, wherever cable laying is planned and before undertaking the laying work, the cable route plan of the same shall be got approved from the concerned Sr. DEN or Dy. CE / Constn. to avoid possible damages in future. Such approvals shall be granted within 07 days of submission of the requests. |
| 13 | The works of excavating the trench and laying of the cable should proceed in quick succession, leaving a minimum time between the two activities.  |
| 14 | Any damage caused to OFC/Quad cable or Electrical cable during execution of the work, necessary debit shall be raised on Engineering Department who shall bear the cost of the corrective action.  |
| 15 | All types of bonds i.e. rail bond, cross bond and structure bond shall be restored by the Contractor with a view to keep the rail voltage low to ensure safety of personnel.   |
| 16 | Above joint circular shall be applicable for construction as well as open line organization of Engineering, S&T & Electrical.  |
| 17 | The S&T cable and Electrical cable route plan should be got approved from the concerned Sr. DSTE / DSTE & Sr. DEE / DEE respectively, before undertaking the work and completion cable route plan should be finalized Block section by Block section as soon the work is completed.  |

### 2.2.10 FORM FOR ENGINEERING WORK PERMIT (EWP)

1. Name of the Railway Supervisor
2. Location of work
3. Nature of work
4. Agency
5. Machineries deployed
6. Working hours
7. I have personally checked the arrangements of rope barricading, fencing at turning locations, posting of staff by the railway by the Contractor, erection of display boards training of staff, issue of permits to drivers and I am satisfied that it shall be possible to adhere to the standard safety precautions at site as reproduced in the enclosed Annexure 'S' except those indicated in para 8 below. Further I have made all the departmental arrangement require for adherence of safety precautions.
8. In case of following it shall not be possible to adhere to Annexure 'S' provisions as mentioned below.
9. However in view of Para 8 following extra safety provisions will be taken at site to ensure safety.

**Executive/ DFCCIL**

### Remarks of APM/DFCCIL

#### Remarks of Dy. CPM/DFCCIL

Based on the above certificate, I hereby permit the above work for a period of \_\_\_\_\_ days i.e. upto \_\_\_\_\_.

Dy. CPM/Engg/DFCCIL

Date:

C/- Sr. DSO-BCT, Sr. DEN (N) BCT, AEN concerned Sr. Sectional Engineer (P. Way)  
Sectional Engineer, PWM Concerned (with 5 spare copies).

APM/DFCCIL, In-Charge

PWI © Safety

CGM/North/DFCCIL

#### Notes

1. A copy of this permit on issue shall be pasted on the site order book.
2. Each work location shall require separate EWP



**ANNEXURE 'C'****1.0 Safety precautions: General**

Safe working of contractors: A large number of men and machinery are deployed by the contractors for track renewals, gauge conversions, doublings bridge rebuilding etc. it is therefore essential that adequate safety measures are taken for safety of the trains as well as the work force. The following measures should invariably be adopted.

- i) The contractor shall not start any work without the presence of DFCCIL / Railway supervisor or his representative and contractors supervisor at site.
- ii) Where ever the road vehicles and/or machinery are required to work in the close vicinity of railway line, the work shall be so carried out that there is no infringement to the railway's schedule of dimensions. For this purpose the area where road vehicles and/or machinery are required to ply, shall be demarcated and acknowledged by the Contractor. Special care shall be taken for turning/reversal of road vehicles/machinery without infringing the running track. Barricading shall be provided wherever justified and feasible as per site conditions.
- iii) The look out and whistle caution orders shall be issued to the trains and speed restrictions imposed where considered necessary. Suitable flagmen/detonators shall be provided where necessary for protection of trains.
- iv) The supervisor/workmen should be counselled about safety measures. A competent certificate to the contractor's supervisor as per proforma annexed shall be issued by APM which will be valid only for the work for which it has been issued.
- v) The unloaded ballast/rails/sleepers/other P. Way materials after unloading along track should be kept clear off moving dimensions and stacked as per the specified heights and distance from the running track.
- vi) Supplementary site specific instructions, wherever considered necessary, shall be issued by the Engineer-in-charge.
- (vii) The Engineer-in-charge shall approve the methodology proposed to be adopted by the contractor, with a view to ensure safety of trains, passengers and workers and he shall also ensure that the methods and arrangements are actually available at site before start of the work and the contractor's supervisors and the workers have



clearly understood the safety aspects and requirements to be adopted/followed while executing the work.

There shall be an assurance register kept at each site, which will have to be signed by both, i.e. DFCCIL Supervisor or his representative as well as the contractor's supervisor as a token of their having understood the safety precautions to be observed at site."

### **2.2.11 Supplementary Precautions for working at ROB site.**

- i) A rope having luminous red strip wrapped around it, must be stretched by tying to the OHE masts to indicate the area not to be infringed under any circumstances. The entire area of work should be demarcated by providing rope barricades and sign boards which will enable the workman posted at site and also the lorry drivers to have clear guidelines on movement of vehicles.
- ii) At every 500 mts, locations having adequate space & level for proper turning of vehicles shall be earmarked and a modular, portable 1 Mt. High steel fencing at a distance of 3.5m shall be erected in a length of 20 mts. for turning of vehicles.
- iii) At places of turning of vehicles planned out a safety guard/flagman in special orange colour luminous/reflective uniform shall be posted during execution of the work who shall supervise the turning of vehicles after seeing the movement of trains and shall ensure that under no circumstances the vehicle touches the fencing erected. These safety guards shall also carry Binoculars so as to watch the vehicles/trains from a distance as well for any necessary action by him if need be. Executive/DFCCIL in charge of the work shall ensure that slopes of the nominated places are kept away from the running lines so as to avoid the possibility of any rolling down of vehicles.
- iv) These nominated places shall have the status as of a Station for a run through train and the safety guard/flagman shall stand attentively facing the track and should hold green and red hand signal flags furled up on separate sticks, the green flag in the left hand and red flag in the right hand during day time and a lighted hand signal lamp with white light pointing towards passing trains during night time. If any unsafe condition is noticed on the train he shall attract the attention of Train crew by blowing whistle as well as showing danger or other signal as warranted. At the nominated turning place of each location, a board with text "Vehicle Turning station/W" shall be erected by the safety guard. 'W' indicates the need for whistling by incoming train motorman / driver on the nearest track. In the event of any untoward incident like say a vehicle infringing the track safety guard/flagman shall arrange to stop the train by

- planting short circuit operating clip and putting detonators, showing red hand signal as in case of obstruction on a track.
- v) At such nominated places temporary “whistle boards” shall be erected so as to invite the attention of Motorman/drivers to whistle when passing such locations.
  - vi) At each site where construction vehicles of the contractor are required to ply along the track a patrolman by the Contractor shall be deployed to see that the driver do not have any tendency to come closer to the track and infringe.
  - vii) The Drivers/Motormen of trains plying on the nearest track shall be served with caution orders to look out for any obstruction at the places of work that infringes the train movements.
  - viii) All the authorized Drivers of the road vehicles/machines shall be given a red flag/ red lamp so that in the event of any obstruction they atleast stop the incoming trains.
  - ix) The Executive/DFCCIL incharge shall inspect every site every alternate working day and record his observations in Site order Book clearly indicating if the safety precautions are being adhered to or not /in case of violation or inadequacy, he shall suspend the work and report to APM / DPM or his Superiors.
  - x) APM incharge shall carry out safety inspection once in a week and record his observations in the site order book pointing out deficiencies if any. In case he finds that safety precautions being taken are not as per the Standing procedure order he shall suspend the work and report to Dy. CPM/Engg/DFCCIL and all others as listed in the permit to work.
  - xi) Sectional Engineer as well as APM I/C while taking measurements & recording the bill shall certify that all safety precautions stipulated in General/Special conditions of Contract have been followed by the Contractor.
  - xii) Dy. CPM/Engg/DFCCIL incharge shall carry out detailed safety inspection once in a month of each site and shall scrutinize site order book in respect of adherence to safety precaution once in a fortnight. It shall be the responsibility of each APM to bring his site order books per bearer once in a fortnight to his Dy. CPM/Engg/DFCCIL incharge & put up to him. Dy. CPM/Engg/DFCCIL I/C must return the site order book the same day so as not to keep the site without site order book for more than a working day.

- xiii) All the contractors shall be given copy of the procedure order so that they in turn drill/train their staff.
- xiv) The Contractor shall not allow any road vehicle (even belonging to him or his suppliers etc.) to ply in railway land next to the running line. If for execution of certain works viz. Earthwork for parallel railway line and supply of ballast for new or existing rail line gauge conversion etc. road vehicles are necessary to be used in railway land next to the railway line, the contractor shall apply to the engineer-in-charge for permission giving the type & no. of individual vehicles, names & licence particulars of the drivers, location, duration & timings for such work/movement. The engineer-in-charge or his authorized representative shall personally check the validity of road vehicles, driving license and counsel, examine & certify, the road vehicle Drivers, contractor's flagmen & supervisor and will give written permission giving names or road vehicle drivers, contractor's flagmen and supervisor to be deployed on the work, stating location, period and timing of the work. This permission will be subject to the following obligatory conditions.
  - a) The road vehicles shall NOT ply between sunset and sunrise and when visibility is impaired due to dust storm/for etc. during day hours.
  - b) Nominated vehicles & drivers will be utilized for work in the presence of atleast one flagman & one supervisor certified for such work.
  - c) The vehicles shall ply 6 m clear of track. Any movement/work at less than 6 m upto minimum 3.5m clear of track centre, shall be done only in the presence of DFCCIL employee authorized by the Engineer-in-charge. No part of the road vehicle will be allowed at less than 3.5m from track centre.
- XVII) The movement of lorries near the track shall be prohibited during night as well as during day when visibility & adequate protective measures including lighting shall be ensured & specific approval of Dy. Chief Engineer obtained for each such occasion.
- XVIII) Machines and vehicles which are required to move at less than 8 mts. away from the track, it shall be in the presence of railway employee authorized by Engineer-in-charge.
- XIX) The contractor's representative shall be issued a certificate by DPM/APM to the effect that they have acquired sufficient knowledge about the Safety precautions that are needed to be followed while working near the track.

2.2.12 On receiving the application for permit to work through APM/DPM, Dy.CPM/Engg/DFCCIL© shall issue permit to work to the Sectional Engineer.

2.2.13 A copy of the permit to work shall be endorsed to Sr. DSO-BCT Sr.DEN(N), AEN under SR DEN(N) BCT o, Chief Sectional engineer (P. Way) concerned, Sectional Engineer (P. Way) concerned with 5 spare copies.

### **3.0 Site Lab**

3.1 The contractor shall be set up a site lab with minimum equipment listed below;

1. IS sieve sets for sieve analysis.
2. 15 X 15 X15 cms cubes minimum 15 nos.
3. Cubes for cement test of 7.09 X 7.09 X cm
4. Vicate apparatus.
5. Cube testing machine of minimum 100 T capacities.
6. Measuring cylinder.

**In case they have not brought the aforesaid articles or have not set up the lab, DFCCIL shall set up the same and actual cost plus 10% shall be recovered from the bills.**

### **4.0 Disaster management**

1.7.7.1“All the available vehicles and equipment of the contractor can be drafted by the DFC/Railway Administration in case of accidents/natural calamities involving human lives. The payment for such drafting shall be made according to the rates as shall be fixed by the Engineer. However, if the contractor is not satisfied with the decision of the Engineer in this respect he may appeal to the CGM-DFCCIL/Chief Engineer within 30 Days of getting the decision of the Engineer, supported by analysis of the rates claimed. The CGM-DFCCIL/Chief Engineer's decision after hearing both the parties in the matter would be final and binding on the contractor and the Railway.”

### **5.0 Submission of Photographs and Videos:**

5.1 The contractor shall arrange to submit three sets of minimum 200 Nos. of photographs of size 5"x7" showing various operations and stages of different activities of the project. The photograph shall be taken for every important activity during execution of work as decided by the Engineer for display and record purpose. In addition, the contractor will submit 3 sets of 2 laminated photographs of size 20"x30". If the photograph as listed above are not submitted then recovery of Rs.75,000/- shall be made from the contractor's bill.

5.2 The successful tenderer will be required to prepare video film (on CDROM) recording of entire construction and edit the same with proper commentary. The same shall cover the whole work in duration of about 2 hours. This film shall pictorially represent the entire work of Linking, Various Execution Stages, CRS Inspection and final completion stages. Two copies of video films (On CDROM) shall be handed over to be Railway along with necessary details, instructions, literature etc. The rate includes cost of such filming. Nothing shall be paid on this account. If the contractor fails to submit the Video Film on CDROM then Rs. 1,00,000/- shall be recovered from bill.

#### **6.0 Special Conditions for working of Road Cranes:**

6.1 No machine shall be selected to do any lifting on a specific job until its size and characteristics are considered against the weights, dimensions and lift radii of the heaviest and largest loads.

6.2 The contractor shall ensure that a valid Certificate of Fitness is available before use of Road Cranes.

6.3 Contractor can utilise the services of any competent person as defined in Factories Act, 1948 and approve by Chief Inspector of Factories.

6.4 The laminated photocopies of fitness certificate issued by competent person, the operator's photo, manufacturer's load chart and competency certificate shall always be either kept in the operator cabin or pasted on the visible surface of the lifting appliances.

6.5 All lifting appliances including all parts and gears thereof, whether fixed or movable shall be thoroughly tested and examined by a competent person once at least in every six months or after it has undergone any alterations or repairs liable to affect its strength or stability.

6.6 In addition, it is also advised that for all the works being executed by the Road Cranes, the above stipulations should be checked. These instructions should be strictly observed.

**PART- III (C)**

**ADDITIONAL TECHNICAL  
SPECIFICATIONS**

| S.no.               | MH PWD<br>SOR NO | DESCRIPTION OF WORK   | Reference<br>no | Add.<br>specificat<br>ion          |
|---------------------|------------------|---|-----------------|------------------------------------|
| <b>Schedule 'A'</b> |                  |   |                 |                                    |
| 1                   | 2.07             | Clearing grass and removal of rubbish upto a distance of 50 metres outside the periphery of the area .  | MORTH 201       | MORTH 201                          |
| 2                   | 2.09             | Clearing and grubbing road land including up rooting rank vegetation, grass, bushes, shrubs, sapling sand trees girth upto 300mm, removal of stumps of trees cut earlier and disposal of unserviceable material sands tacking of serviceable material to be used or auctioned upto a lead of 1000 metres including removal and disposal of toporganic soil not exceeding 150 mm in thickness. | MORTH 201       | MORTH 201                          |
| 3                   | 12.04            | Excavation for foundation in hard murum including shoring and strutting,dewatering as necessary and disposing off excavated stuff as directed etc. complete.  | BR 3B           | BR 3 Pg no. 102                    |
|                     |                  | b) 1.50m to 3.00m lift, Add 10%   |                 |                                    |
| 4                   | 12.08            | Excavation for foundation in soft rock including shoring and strutting,dewatering as necessary and disposing off excavated stuff as directed etc. complete.   | BR 3D           | BR 3 Pg no. 102                    |
|                     |                  | b) 1.50m to 3.00m lift, Add 10%   |                 |                                    |
| 5                   | 12.7             | Back filling behind abutment,wing wall and return wall as per drawing sand technical specifications etc. complete.(by granular material)  | MORTH           | MORT and H 2200& 710.1.4 of IRC 78 |
| 6                   | 51.125           | Providing and laying of Plastirib T or equivalent raised profile edge line marking (audible vibratory) with special hot applied thermoplastic road marking compound according to IRC 35 : 2015, Clause 7.7 with 2 mm thick base coat layer above that ribs profile size   | RD              | As directed by Engineer in charge  |

|    |        |   |             |  |
|----|--------|---|-------------|--|
|    |        | of length 40 mm x width 140 mm x height 6mm thick (Total 8 mm thick) at the distance of 250 mm between two ribs including reflectorizing glass beads @ 250 gm / sq. mtr. area. The minimum and maximum width of raised profile should be 150 mm. The thickness of 8 mm profil should be exclusive of surface applied glass beads. The finished surface to be exclusive of surface applied glass beads. The finished surface to be levelled, uniform and free from streaks and holes, to be applied on edge lines. |             |  |
| 7  | 17.37  | Providing and laying weep holes of 100mm diameter PVC pipes as per drawing for abutment returns, return walls etc. Complete.  | BR          | MORT & H (5 <sup>TH</sup> Rev.) 2705, 2706 |
| 8  | 13.07  | Supplying, fitting and fixing in position true to line and level elastomeric bearing including all accessorie as per drawing and technical specification sand IRC:83(Pt-II)section IX and clause 2005 of MoRTH specifications etc. complete.  | MORTH       | MORT and H 2000 and 2200                   |
| 9  | 33.66  | Providing and laying chequered tiles of approved quality of size30cmx30cm, confirming to corresponding I.S.for flooring in required position laid on a bed of 1:4 cement mortar including cement float,filling joint with cement slurry cleaning curing etc. complete.  | BDM         | Bd. M -12 page no. 385                     |
| 10 | 14.5   | Providing 100mm diameter GI water spouts as per detailed drawings in RCC slab and wearing surface / kerb etc. complete.   | BR 55       | BR55 Page no. 150                          |
| 11 | 6.04 b | Ordinary Kilometer Stone  | MORTH 805.1 | MORTH 805.1                                |
| 12 | 11.11  | Providing and laying cement concrete pipe of IS 458:2003 NP-2 class of 900mm diameter in proper line,level and slope including providing and fixing collars in cement mortar 1:2 and curing etc. complete.  | CD 7        | CD 7 Page no. 162                          |



|    |        |  |           |   |
|----|--------|--|-----------|---|
| 13 | 12.72  | Providing and laying of filter media with granular materials/stone crushed aggregates satisfying the requirements laid down in clause 2504.2.2 of MoRTH specifications to a thickness of not less than 600mm with smaller size towards the soil and bigger size towards the wall and provided over the entire surface behind abutment, wing wall and return wall to the full height compacted to a firm condition as per drawing and technical specifications etc. complete. | MORTH     | MORTH and H 2200 & 710.1.4 of IRC 78                |
|    |        |  |           |   |
| 14 | 17.66  | Chipping and dressing of the R.C.C. piles upto 0.60meter including cleaning reinforcement and removal of dismantled materials upto a distance of 50meter beyond the building area etc.for providing pile caps.   | BR        | Specification MORTH & H (5 <sup>TH</sup> REV. )2604 |
|    |        |  |           |   |
| 15 | 43.17  | Providing and fixing 8cm rigid PVC Nahani trap including PVC grating, bend, connecting piece of UPVC pipe upto the outside face of wall,making the good damaged surface and testing etc.complete (Priorapproval of sample and brand by Ex. Engr. is necessary before use)  | BDV 23    | Specfications                                       |
|    |        |  |           |   |
| 16 | 6.04 e | Lettering for cautionary/mandatory signboard sand village name boards  | MORTH 801 | MORTH 801   |
|    |        |  |           |   |
| 17 | 6.19   | Fixing in position Cautionary/Mandatory sign boards in ground with CC1:4:8 block of 60cmx60cmx75cm size etc.complete as directed including all leads.  | MORTH 801 | MORTH 801   |
|    |        |  |           |   |
| 18 | 6.2    | Fixing in position Road Junction/Informatory Sign Board in ground with C.C.1:4:8 block of 60cmx60cmx75cm size including all leads complete.  | MORTH 801 | MORTH 801   |
|    |        |  |           |   |

|    |      |   |             |                    |
|----|------|---|-------------|--------------------|
| 19 | 6.38 | Providing and fixing cautionary/warning sign board of size 60cm.having shape of equilateral triangle with apex point upwards. prepared on 16gauge M.S. sheet including painting with one coat of zinc chromatestoving primer and two coat seach of white background, redborder and back side grays to veenamelled, bonded with cutout of Retroreflective sheet Engineering grade,symbol/letters/numerals/border/arrow,c coated with non peelable crystal clear protective transparent coat retaining 100% reflection including one number of M.S.Angle iron post of size50x50x5mmof3.65m. long in flated at bottom drilled on top in one piece without joint painted with white and black bands of 30cm. fixing board and post with 2Nos. high strength G.I.bolts and nuts of size10mm dia. and 20mm long including all taxes,conveying,fixing in ground with cement concrete 1:4:8 block of 60cmx60cmx75cm size etc. | IRC-67-2012 |                    |
|    |      |   |             |                    |
| 20 | 12.4 | Excavation for foundation in hard murum including shoring and strutting,dewatering as necessary and disposing off excavated stuff as directed etc. complete.( Box cutting road surface to proper slope)   | BR 3B       | BR. 3 Page no. 102 |
|    |      | b) 1.50m to 3.00m lift, Add 10%   |             |                    |
| 21 | 6.09 | Supplying and Fixing of Molded Shank Raised Pavement Markers/Cat'sEye made of polycarbonate and ABS moulded body and reflective panels with microprismatic lens capable of providing total internal reflection of the lightentering the lens face and shall support a load of 16000kg tested inaccordance to ASTM D4280 Type Hand complying to Specification so fCategory A of MORTH Circular NoRW/NH/33023/10-97DOIIDt11.06.1997.The height,width and length shall not exceed 50mm,100mm and 102+/-2mm and with minimum reflective area of 13Sq cm on each side and the slope to the base shall be 35+/-5 degree. The strength of detachment of the integrated cylindrical shanks, (of diameter not less than 19+/-2mm and height not less than 30+/-2mm) from the body is to be a minimum value of 500Kg. Fixing will be by drilling holes on the road for the shanks to go inside,without nail                     | MORTH 804   | MORTH 804          |

|    |       |  |           |                                   |
|----|-------|--|-----------|-----------------------------------|
|    |       | sand using epoxy resin based adhesive as per manufacturer's recommendation and complete as directed by the engineer. The contractor shall submit a two year warranty for satisfactory field performance including stipulated retro-reflectance of the reflecting panel, to the Engineer.   |           |                                   |
| 22 | 35.2  | Providing and applying priming coat over new /old steel and other metal surfaces including preparing the surface by thoroughly cleaning oil, grease ,dirt and other foreign matter and scoured with wire brushes ,fine steel wool, scrapper sand sand paper, scaffolding etc. complete.  | BDO 8 D   | As directed by Engineer in charge |
| 23 | 35.07 | Providing and applying two coats of synthetic enamel paint of approved colour to new/old structural steel work and wood work in buildings, includin scaffolding if necessary, cleaning and preparing the surface (excluding primer coat) etc. complete.  | BDO 5     | Bd. O. Page no. 405               |
| 24 | 1.39  | Preparation of Land Acquisition proposal including collection of 7/12 and 8/A documents marking alignment on village maps, area calculation, preparation of proposal, printing, binding,etc.complete and submission of 5sets more ever liasoning and coordination with revenue authorities with compliance if any until finalisation of award including Joint measurement of the alignment. For new alignment. |           | As directed by Engineer in charge |
| 25 | 2.27  | Providing earthwork in embankment with approved materials obtained from departmental land upto lead of 50m. including all lifts, laying in layers of 20cm.to 30cm.thickness breaking clods, dressing to the required lines,curves ,grades & section, watering and compaction with vibratory roller to achieve not less than 97% of standard proctor density etc. complete.                                     | MORTH 305 | MORTH 305                         |
|    |       |  |           |                                   |

### Schedule 'B'

| S.no. | MH SOR NO | DESCRIPTION OF WORK | Reference no | Add. specification |
|-------|-----------|---------------------|--------------|--------------------|
|-------|-----------|---------------------|--------------|--------------------|

|   |        |  |        |  |
|---|--------|--|--------|--|
| 1 | 15.126 | Providing and laying <b>cast in situ/ready mix M35 RCC for 1200 mm diameter bored piles</b> each of load capacity as per design and of specified diameter of as directed, placed through steel shell sunk to the required depth through all strata except rock, excluding provision of reinforcement including placing concrete by tremie arrangement, compaction of concrete and with drawal of steel shell with fully automatic microprocessor based PLC with SCADA enabled with reversible drum type mixer/concrete batch mix plant (panmixer) etc. complete. with fine aggregates of required specifications (Natural sand/ VSI sand finely washed etc ) | BR     | BR-21 Page - 124 MORTH - 1100 and 1700       |
| 2 | 17.31  | Providing and laying plain in situ/ready mix M-35 cement concrete of trap/granite/quartzite/gneiss/crushed stone metal mechanically mixed, <b>placed in foundation</b> and compacted by vibration including necessary bailing out water, curing concrete batch mixplant/pan mixer with fine aggregates of required specifications (Natural sand/VSI sand finely washed etc)(excluding dewatering by pump) for 14 days RCC Grade. With Concrete Mixer   | BR     | MORT & H ( 5 <sup>TH</sup> Rev.)1700         |
| 3 | 12.55  | Providing and laying in situ/ready mix controlled grade of M15 of trap/granite/quartzite/gneiss metal for RCC works in cut off walls/curtain walls including necessary scaffolding, centering, compacting by vibrator, finishing and curing etc. complete.(with fully automatic microprocessor based PLC with SCADA enabled with reversible drum type mixer/concrete batch mixplant (pan mixer)with natural/artificial sand, excluding reinforcement)  | BR 59a | As directed by Engineer in charge            |
| 4 | 17.5   | Providing and laying in situ/ready mix M-35 cement concrete of trap/granite/quartzite/gneiss metal for cast in situ R.C.C . <b>solid piers, column</b> etc. including provision of V shaped false joints to form suitable panels on the faces to approve design with compacting by vibrating and curing complete. Including plywood/steel formwork, centering (excluding dewatering by means of pump) and including bailing out water and including CM 1:3 curing complete. a) Height  | BR     | MORT&H(5 <sup>TH</sup> REV.) 1700,2204, 2304 |

|   |       |   |    |  |
|---|-------|---|----|--|
|   |       | upto 5 M. (With Concrete Mixer) i) Height up to 5 m, normal rate.   |    |  |
| 5 | 17.5  | <p>Providing and laying in situ/ready mix M-35 cement concrete of trap/granite/quartzite/gneiss metal for cast in situ <b>R.C.C. solid piers, column</b> etc. including provision of Vs haped false joints to form suitable panels on the faces to approve design with compacting by vibrating and curing complete. Including plywood/steel formwork, centering (excluding dewatering by means of pump) and including bailing out water and including CM 1:3 curing complete.</p> <p>a) Height upto 5 M. (With Concrete Mixer)</p> <p>i) Height up to 5 m, normal rate.</p> | BR | MORT&H(5 <sup>TH</sup> REV.)<br>1700,2204,<br>2304 |
|   |       | ii) Height 5 to 7.50 m, add 5 percent extra over basic rate.  |    |  |
|   |       | iii) Height 7.50 to 10 m, 7.50 percent extra.   |    |  |
| 6 | 17.55 | <p>Providing and laying in situ/ready mix controlled M-35 cement concrete of of trap/granite/quartzite/gneiss metal for reinforced cement concrete <b>caps over piers and abutments</b> including necessary scaffolding plywood/steel formwork, compacting by vibrating, finishing in CM1:3 and curing etc complete (Excluding reinforcement) With reversible drum type mixer/concrete batch mix plant (pan mixer).with fine aggregates of required specifications (Natural sand/VSI sand finely washed etc )</p>   | BR | MORT&H(5 <sup>TH</sup> REV.)<br>1700,2205,<br>2304 |
| 7 | 17.62 | <p>Providing and laying in situ/ready mix M-40 cement concrete of trap/granite/quartzite/gneiss metal for reinforced cement concrete block below the bearing including necessary scaffolding, plywood/steel formwork, compaction by vibrating, finishing in CM1:3 and curing complete (Excluding reinforcement) Using reversible drum type mixer/concrete batch mix plant(pan mixer)with fine aggregates of required specifications (Natural sand/VSI sand finely washed etc )(wearing coat, pedestal &amp; seismic arrestor)</p>   | BR | MORT&H(5 <sup>TH</sup> REV.)<br>1700,2205,<br>2304 |

|    |       |  |           |   |
|----|-------|--|-----------|---|
| 8  | 14.9  | <p>Providing and laying in situ/ready mix M-40 controlled cement concrete of trap/granite/quartzite/gneiss metal for RCC work in <b>solid/deck slab</b> etc. including ramming, vibrating, curing, formwork, centering and finishing in cement plaster excluding reinforcement etc. complete.(with fully automatic microprocessor based PLC with SCADA enabled concrete batch mix plant/pan mixer and Natural/VSI standard Artificial Sand)</p> <p>iii) Height 7.50 to 10 m, 7.50 percent extra.(basic rate =8138)</p>   | BR        | BR.38(a)<br>Page no. 135 and B.7,<br>page No. 38    |
| 9  | 14.92 | <p>Providing and laying in situ/ready mix M-40 controlled cement concrete of trap/granite/quartzite/gneiss metal for RCC work in <b>main/cross girders</b>, diaphragms etc. including ramming, vibrating, curing, formwork, centering and finishing in cement plaster excluding reinforcement etc. complete.(with fully automatic microprocessor based PLC with SCADA enabled concrete batch mix plant /pan mixer and Natural /VSI standard Artificial Sand)</p> <p>iii) Height 7.50 to 10 m, 7.50 percent extra. (basic rate =8138)</p>   | BR        | BR.38(b and c) Page no. 135 and B.7,<br>page No. 38 |
| 10 | 7.37  | <p>Providing Reinforced cement concrete <b>crash barrier</b> at the edges of the road, approaches to bridge structure and medians, constructed with R.C.C. M30 Grade concrete with HYSD reinforcement conforming to IRC:21 and dowel bars 25mm dia,450mm long at expansion joints filled with pre-moulded asphalt filler board, keyed to the structure on which it is built and installed as per design given in the enclosure to MOST circular No.RW/NH-33022/1/94-DO dated 24 June 1994 as per dimensions in the approved drawing and at locations directed by the Engineer, all as specified etc. complete. Spec:MORT and H 2013 CI 811 Page No 360</p> | MORTH 809 | MORTH 809   |

|    |       |   |                   |                                       |
|----|-------|---|-------------------|---------------------------------------|
| 11 | 50.45 | Construction of Reinforced Earth Wall in M-35 Block Facia by Providing and Laying CE marked Knitted and PVC coated Polyester Uniaxial Geogrid (Techgrid) of Tech fab India indegeniously manufactured from selected hight enacitypolyesteryarn with high molecular weight (>25000g/mol), and low car boxy lend group(<30mmol/kg) for Reinforced soil wall (extruded PP geogrids & Polyesterstrips & Geostrips, Steel Strips not allowed & not accepted) with granular fill of PHi-32 degree (design is to be carried out in accordance with BS-8006/FHWA) with concrete block by M-35 as facia, casting & erection of blocks with Techgrid, providing & laying levelling pad by M-15, providing and laying coping beam by M-35, providing and laying 300 mm thick filter media etc. completed as per necessary drawing and instruction of Engineer-in-charge. Excluding providing, laying and compacting selected back fill and retained fill behind the wall, excavation and ground improvement, if any. There in forced earth wall and slope should have 100% coverage of 5m width Knitted and PVC coated Polyester Geogrid. (Coating of Geogrid/Reinforcing geosynthetic material with LDPE, Latex, Bitumen and any other coating will not be allowed and will not be accepted). (Specification: MORTH Section-3100) with prior approval of concerned Superintending Engineer. | MORTH Section-700 | As directed by engineer - in - charge |
|    | a     | a) RE Wall Height 1 to 4 meter  |                   |                                       |
|    | b     | b) RE Wall Height 4 to 6 meter  |                   |                                       |
|    | c     | c) RE Wall Height 6 to 8 meter  |                   |                                       |
|    | d     | d) RE Wall Height 8 to 10 meter   |                   |                                       |
|    | e     | e) RE Wall Height 10 to 12 meter  |                   |                                       |
|    |       |   |                   |                                       |
| 12 | 14.59 | Providing and laying of RCC in M30 grade approach slab including reinforcement and formwork complete with fully automatic microprocessor PLC with SCADA enabled reversible drum type mixer/concrete batch mixplant (panmixer) as per drawings and technical specifications etc. complete with fine aggregate so required specifications (Natural sand / VSI sand finely washed etc )  |                   |                                       |

| Schedule 'C' |           |   |              |                       |
|--------------|-----------|---|--------------|-----------------------|
| S.no.        | MH SOR NO | DESCRIPTION OF WORK   | Reference no | Add. specification    |
| 1            | 26.33     | Providing and fixing in position TMT-FE-500 bar reinforcement of various diameters for R.C.C. pilecaps, footings, foundations, slabs, beams columns, canopies, staircase, newels,chajjas,lintel spardis, copings, fins, arches etc.as per detailed designs, drawing sand schedules. including cutting, bending, hooking the bars, binding with wi res or tack welding and supporting as required complete.  | BDF 17       | Bd. F.17, Page No.306 |
| 2            | 26.33     | Providing and fixing in position TMT-FE-500 bar reinforcement of various diameters for R.C.C. pilecaps, footings, foundations, slabs, beams columns, canopies, staircase, newels,chajjas,lintel spardis, copings, fins, arches etc.as per detailed designs, drawing sand schedules. including cutting, bending, hooking the bars, binding with wires or tack welding and supporting as required complete. <b>(Super structure)</b>                              | BDF 17       | Bd. F.17, Page No.306 |
| 3            | 26.33     | Providing and fixing in position TMT-FE-500 bar reinforcement of various diameters for R.C.C. pilecaps, footings, foundations, slabs, beams columns, canopies, staircase, newels,chajjas,lintel spardis, copings, fins, arches etc.as per detailed designs, drawing sand schedules. including cutting, bending, hooking the bars, binding with wi res or tack welding and supporting as required complete. <b>(Pier cap, pedestal, dirt wall &amp; seismic)</b> | BDF 17       | Bd. F.17, Page No.306 |
| 4            | 26.33     | Providing and fixing in position TMT-FE-500 bar reinforcement of various diameters for R.C.C. pilecaps, footings, foundations, slabs, beams columns, canopies, staircase, newels,chajjas,lintel spardis, copings, fins, arches etc.as per detailed designs, drawing sand schedules. including cutting, bending, hooking the bars, binding with wi res or tack welding and supporting as required complete. <b>(Pier retaing wall)</b>                           | BDF 17       | Bd. F.17, Page No.306 |



|   |       |  |        |                                       |
|---|-------|--|--------|---------------------------------------|
| 5 | 26.33 | Providing and fixing in position TMT-FE-500 bar reinforcement of various diameters for R.C.C. pilecaps, footings, foundations, slabs, beams columns, canopies, staircase, newels, chajjas, lintel spandis, copings, fins, arches etc. as per detailed designs, drawing and schedules. including cutting, bending, hooking the bars, binding with wire or tack welding and supporting as required complete.<br><b>(Approach slab &amp; wearing slab &amp; wearing coat crash barrier)</b>                                     | BDF 17 | Bd. F.17,<br>Page No.306              |
| 6 | 26.33 | Providing placing and Driving in position 6 millimeter mild steel liner for R.C.C. Piles upto required depth with 12mm thick mild steel cutting edge of 0.50m length at bottom including fabricating cutting the mild steel sheet to required diameter and shape, welding the joints and driving with the help of required machineries including all materials labours and lifts etc. complete as directed by the Engineer in charge.  |        | As directed by engineer - in - charge |
|   | 22.57 | Upto 3.00 meter deep liner   |        |                                       |
|   | 22.58 | Charge From 3.00 to 9.50 meter deep liner  |        |                                       |
| 7 | 23.01 | Providing and fabricating structural steel work in rolled sections like joists, channels, angles, tees etc. as per detailed design and drawings or as directed including cutting, fabricating, hoisting, erecting, fixing in position making riveted/bolted/welded connections without connecting plates, braces etc. and including one coat of anti corrosive paint and over it two coats of oil painting of approved quality and shade etc. complete.<br><b>(for Railing, Staircase railing, Inspection platform etc.)</b> | BDC 2  | Bd.C.2 Page No. 275                   |
|   |       |  |        |                                       |

### Schedule 'D'

| S.no. | MH SOR NO | DESCRIPTION OF WORK  | Reference no | Add. specification |
|-------|-----------|--|--------------|--------------------|
| 1     | 2.35      | Providing, laying and spreading soil on a prepared subgrade, pulverizing, mixing the spread soil in place with rotavator with 3 percents laked lime with minimum content of 70 percent of CaO, grading with motor grader | MORTH 402    | MORTH 402          |

|   |      |   |           |           |
|---|------|---|-----------|-----------|
|   |      | and compacting with the road roller at OMC to achieve at least 98 percent of the max dry density to form a layer of sub base.   |           |           |
| 2 | 3.01 | Construction of granular subbase by providing close graded Material, mixing in a mechanical mix plant at OMC, carriage of mixed Material to work site, spreading in uniform layers with motor grader/Paver on prepared surface and compacting with vibratory roller to achieve the desired density, complete as per clause 401-- Plant Mix Method and Grading - I Material  | MORTH 401 | MORTH 401 |
| 3 | 3.23 | Wet Mix Macadam--Providing, laying, spreading and compacting grade stone aggregate to wet mix macadam specification including premixing the Material with water at OMC in mechanical mix plant carriage of mixed Material by tipper to site, laying in uniform layers with paver in sub-base/base course on well prepared surface and compacting with vibratory roller to achieve the desired density. Laying By Grader/Paver.  | MORTH 406 | MORTH 406 |
| 4 | 3.44 | DENSE BITUMINOUS MACADAM: Providing and laying dense bituminous macadam using crushed aggregates of Grading 1, premixed with bituminous binder of specified grade of Bitumen @4.50 percent by weight of total mix and filler, transported to site with VTS, laid over a previously prepared surface, finished to the required grade, level, alignment, and rolling to achieve the desired density for 76-100 mm compacted thickness. USING B at ch mix type hot mix plant with SCADA, Sensor Paver, Vibratory roller with Stone Dust filler. (VG-30 bulk bitumen rates are considered to arrive at rates) | MORTH 505 | MORTH 507 |
| 5 | 3.48 | BITUMINOUS CONCRETE:-Providing and laying bituminous concrete using crushed aggregates of grading 1, premixed with bituminous binder @5.20 percent by weight of total mix and filler, transported to site with VTS, laid over a previously prepared surface, finished to the required grade, level, alignment, and rolling to achieve the desired compaction for 50mm compacted thickness with specified grade of Bitumen, Excluding prime/tackcoat. For Bitumen of specified grade--USING B at ch mix type hot mix plant with SCADA, Sensor Paver, Vibratory roller with Stone Dust filler. (VG-30       | MORTH 507 | MORTH 509 |

|   |       |   |           |                 |
|---|-------|---|-----------|-----------------|
|   |       | bulk bitumen rates are considered to arrive at rates)   |           |                 |
| 6 | 4.01  | Providing bituminous TypeA liquid seal coat on bituminous surface including supplying all materials and bitumen of specified grade preparing existing road surface, heating and applying bitumen@0.98 Kg Sqm. by mechanical means, spreading chips and rolling, by static roller having weight 8 to 10MT. etc. complete. (VG-30 bulk bitumen rates are considered to arrive at rates) | MORTH 513 | MORTH 513       |
| 7 | 14.68 | Providing and laying of a strip seal expansion joint catering to maximum horizontal movement upto 70 mm to be installed by the manufacturer / supplier to their authorized representative ensuring compliance to the manufacturers instruction for installation as per approved drawings and standard specifications etc. complete.   | MORTH     | MORT and H 2600 |
|   |       |   |           |                 |

### Schedule 'E'

| S.no. | MH SOR NO | DESCRIPTION OF WORK  | Reference no | Add. specification |
|-------|-----------|--|--------------|--------------------|
| 1     | NS/1      | Epoxy painting.<br>Supplying and applying epoxy paint of approved quality on surfaces of abutment, abutment caps, returns, piers, pier caps, PSC girders/slabs, deck slab, parapet walls, crash barriers etc. confirming to the specifications laid down in the special conditions of contract. The rate inclusive of contractor's own paint, material, equipments, machineries, labour, taxes, with all lead, lift, scaffolding staging, etc. complete. (Rates are for finished item and will be paid after application as per specification. |              |                    |

## **TECHNICAL SPECIFICATIONS**

### **1.0 PREAMBLE:-**

1.1 The Technical Specifications contained herein shall be read in conjunction with the other Bidding Documents as specified in this Volume.

### **1.2 Site Information:-**

1.2.1 The information given here under provided elsewhere is given in good faith by the Employer but the Contractor shall satisfy himself regarding all aspects of site conditions and no claim will be entertained on the plea that the information supplied by the Employer is erroneous or insufficient.

### **2.0 GENERAL REQUIREMENTS:-**

The technical specifications in accordance with which the entire work described herein after shall be constructed and completed by the Contractor shall comprise of the "SPECIFICATION"

2.1 The "SPECIFICATION" for each item is attached with tender is based on following.

(1) "SPECIFICATION FOR ROAD AND BRIDGE WORKS" (Fifth Revision printed in year 2013) issued by the Ministry of Road Transport & Highways (MORT & H), Government of India and Published by the Indian Roads Congress, hereinafter to as MORT & H Specifications.

(2) The General Technical Specifications for Road works.

(3) The General Technical Specifications for Bridge works.

Note:- (2) To (3) are Conventional Specifications Booklets usually attached for (R&B) Works.

2.2 If, a particular clause (which is incorporated in "SPECIFICATION") of specification booklets (1) to (3) above is Amended / Modified/ Added upon then the Amendment/ Modification/Addition shall supersede the relevant clause incorporated in " SPECIFICATION"

2.3 In, so far as Amended / Modified / Added Clause may come in conflict or be inconsistent with any of the provisions of the MORT & H Specifications under reference, the Amended/Modified/ Added Clause and the additional specifications shall always prevail.

2.4 In the absence of any definite provisions on any particular issue in the aforesaid Specifications, reference may be made to the latest codes and specification, of IRC and BIS in that order. Where even these are silent, the construction and completion of the works shall conform to sound engineering practice as approved by the ' Engineer' and , in case of any dispute arising out of the interpretation of the above, the decision of the 'Engineer' shall be final and binding on the Contractor.

## **PART – III (C)**

### **ADDITIONAL TECHNICAL SPECIFICATIONS-III**

#### **DETAILED SPECIFICATIONS AND SPECIAL CONDITIONS**

**01:** Clearing and grubbing road land including uprooting rank vegetation grass bushes, shrubs, sapling and trees girth up to 300 mm removal of stumps of trees cut earlier and disposal of unserviceable materials (C) By mechanical means in area of light jungle.

1. Before starting the work, the site shown on plans shall be cleared of all obstructions, loose stones and materials, rubbish of all kinds as well as all trees and brush wooden except those marked for preservation, the roots being entirely grubbed up. No trees are to be cut down before obtaining the instruction from Engineer-in-charge.
2. The stuff obtained from clearance shall be stacked in such a place and in such a manner as ordered by the Engineer-in-charge and the ground shall be left in a perfectly clean condition.
3. In jungle clearing, all trees, not specifically marked for preservation, bamboos, jungle wood and brush wood shall be cut down, their roots rubbed up. All wood and material available shall be stacked as directed by the Engineer-in-charge.
4. All holes or hollows, whether originally or produced by digging up roots shall be carefully filled up with earth, well rammed and levelled up neatly as directed.
5. After completion of the work, but before its acceptance, the site shall be cleared of all scaffolding, surplus materials and rubbish etc. as per contract. No extra payment shall be made for site.
6. The rate for this item of work shall be for the complete job and shall be paid at the lump sum rate tendered for the work on completion of the entire work.

#### **Measurements for Payment**

Clearing the site before commencement and after completion of the work shall be measured on L.S. basis in terms of Job.

#### **Acceptance**

Acceptance of clearing the site before commencement and after completion of the work shall be based on visual inspection of the work for compliance with the above specifications to the satisfaction of the Engineer.

#### **Rate**

1. The Contract unit rates for the Clearing the site before commencement and after completion of the work shall be paid/payable in full for carrying out the required operations including full compensation for all labour, materials, tools, equipment and incidentals necessary to complete the work. These will also include removal of stumps and roots of trees less than 300 mm in girth as well as stumps left over after cutting of trees carried out by another agency of the Contractor or Government, excavation and backfilling to required density, where necessary, and handling, salvaging, piling and disposing of the cleared materials with all lifts and up to a lead of 1000 m.
2. The Contract unit rate for clearing the site before commencement and after completion of the work is on Job basis.

**02:** Felling trees of the girth (measured at a height of 1 m above ground (level), including cutting of trunks and branches, removing the roots and stacking of serviceable material and disposal of unserviceable material. Beyond 60cm girth upto & including 120cm girth.

Work shall be carried out as per specification / condition of above item no. 1 of schedule A of the tender document.

**03:** Excavation for foundation in sand, gravel, clay, soft, soils and murrum etc. including soring strutting and dewatering as necessary and disposing off the excavated stuff as directed (A) up to 3 m depth and lead upto 100 m for 10 cum with all lead and lift.

#### **MORTH 304.1. Scope**

Excavation for structures shall consist of the removal of material for the construction of foundations for bridges, culverts, retaining walls, headwalls, cut-off walls, pipe culverts and other similar structures, in accordance with the requirements of these Specifications and the lines and dimensions shown on the drawings or as indicated by the Engineer, work shall include construction of the necessary cofferdams and cribs their subsequent removal; all necessary sheeting, shoring, bracing, and pumping; the removal of all logs, stumps, grubs and other matter and obstructions, necessary for placing the foundations; trimming bottoms of excavations; backfilling and clearing up the site the disposal of all surplus material.

#### **MORTH 304.2 Classification of Excavation**

All materials involved in excavation shall be classified by the Engineer in the following manner:

(a) Soil

This shall comprise topsoil, turf, sand, silt, loam, clay, mud, peat, black cotton soil, soft shale or loose murrum, a mixture of these and similar material which yields to the ordinary application of pick, spade and/or shovel, rake or other ordinary digging implement. Removal of gravel or any other nodular material having dimension in any one direction not exceeding 75 mm occurring in such strata shall be deemed to be covered under this category.

### **Authority for classification**

The classification of excavation shall be decided by the Engineer and his decision shall be final and binding on the Contractor. Merely the use of explosives in excavation will not be considered as a reason for higher classification unless blasting is clearly necessary in the opinion of the Engineer.

## **MORTH 304.3. Construction Operations**

### **MORTH 304.3.1. Setting out**

After the site has been cleared according to Clause 201, the limits of excavation shall be set out true to lines, curves and slopes to Clause 301.3.1.

### **MORTH 304.3.2. Excavation:**

Excavation shall be taken to the width of the lowest step of the footing and the sides shall be left plumb where the nature of soil allows it. Where the nature of soil or the depth of the trench and season of the year do not permit vertical sides, the Contractor at his own expense shall put up necessary shoring, strutting and planking or cut slopes to a safer angle or both with due regard to the safety of personnel and works and to the satisfaction of the Engineer.

The depth to which the excavation is to be carried out shall be as shown on the drawings, unless the type of material encountered is such as to require changes, in which case the depth shall be as ordered by the Engineer. Propping shall be undertaken when any foundation or stressed zone from an adjoining structure is within a line of 1 vertical to 2 horizontal from the bottom of the excavation.

Where blasting is to be resorted to, the same shall be carried out in accordance with Clause 302 and all precautions indicated therein observed. Where blasting is likely to endanger adjoining foundations or other structures, necessary precautions such as controlled blasting, providing rubber mat cover to prevent flying of debris etc. shall be taken to prevent any damage.

### **MORTH 304.3.3. Dewatering and protection:**



Normally, open foundations shall be laid dry. Where water is met with in excavation due to stream flow, seepage, springs, rain or other reasons, the Contractor shall take adequate measures such as bailing, pumping, constructing diversion channels, drainage channels, bunds, depression of water level by well-point system, cofferdams and other necessary works to keep the foundation trenches dry when so required and to protect the green concrete/masonry against damage by erosion or sudden rising of water level. The methods to be adopted in this regard and other details thereof shall be left to the choice of the Contractor but subject to approval of the Engineer. Approval of the Engineer shall, however, not relieve the Contractor of the responsibility for the adequacy of dewatering and protection arrangements and for the quality and safety of the works.

Where cofferdams are required, these shall be carried to adequate depths and heights, be safely designed and constructed and be made as watertight as is necessary for facilitating construction to be carried out inside them. The interior dimensions of the cofferdams shall be such as to give sufficient clearance for the construction and inspection and to permit installation of pumping equipment's, etc., inside the enclosed area.

If it is determined beforehand that the foundations cannot be laid dry or the situation is found that the percolation is too heavy for keeping the foundation dry, the foundation concrete shall be laid under water by tremie pipe only. In case of flowing water or artesian springs, the flow shall be stopped or reduced as far as possible at the time of placing the concrete.

Pumping from the interior of any foundation enclosure shall be done in such a manner as to preclude the possibility of the movement of water through any fresh concrete. No pumping shall be permitted during the placing of concrete or for any period of at least 24 hours thereafter, unless it is done from a suitable sump separated from the concrete work by a watertight wall or other similar means.

At the discretion of the Contractor, cement grouting or other approved methods may be used to prevent or reduce seepage and to protect the excavation area.

The Contractor shall take all precautions in diverting channels and in discharging the drained water as not to cause damage to the works, Crops or any other property.

#### **MORTH 304.3.4. Preparation of foundation:**

The bottom of the foundation shall be levelled both longitudinally and transversely or stepped as directed by the Engineer. Before footing is laid, the surface shall be slightly watered and rammed. In the event of excavation having been deeper than that shown on the drawings or as otherwise ordered the Engineer, the extra depth shall be made up with concrete masonry of the foundation at the cost of the Contractor. Ordinary filling shall not be used for the purpose to bring the foundation to level.

When rock or other hard strata is encountered, it shall be freed of all soft and loose material, cleaned and cut to a firm surface either level and stepped as directed by the Engineer. All seams shall be denuded out and filled with cement mortar or grout to the satisfaction of the Engineer. In the case of excavation in rock, annular space around footing shall be filled with lean concrete (1:3:6 nominal mix) upto the top level of rock.

If the depth of fill required is more than 1.5m above the top of the footing, filling upto 1.5m above top of footing shall be done with lean concrete (1:3:6 nominal mix) followed by boulders grouted with cement.

When foundation piles are used, the excavation of each pit shall be substantially completed before beginning pile-driving operations therein. After pile driving operations in a given pit are completed, all loose and displaced materials therein shall be removed to the elevation of the bottom of the footings.

**MORTH 304.3.5. Slips and slip-outs:**

If there are any slips or slip-out in the excavation, these shall be removed by the Contractor at his own cost.

**MORTH 304.3.6. Public safety:**

Near towns, villages and all frequented places, trenches and foundation pits shall be securely fenced, provided with proper caution signs and marked with red lights at night to avoid accidents. The Contractor shall take adequate protective measures to see that the excavation operations do not affect or damage adjoining structures. For safety precautions, guidance may be taken from IS: 3764.

**MORTH 304.3.7. Backfilling:**

Backfilling shall be done with approved material after concrete or masonry is fully set and carried out in such a way as not to cause undue thrust on any part of the structure. All space between foundation masonry or concrete and the sides of excavation shall be refilled to the original surface in layers not exceeding 150 mm compacted thickness. The compaction shall be done with the help of suitable equipment such as mechanical tamper, rammer, plate vibrator etc., after necessary watering, so as to achieve a density not less than the field density before excavation.

**MORTH 304.3.8. Disposal of surplus excavated materials:**

All the excavated materials shall be the property of the Government. Where the excavated material is to be used in the construction of embankment as directed by Engineer in-charge. It shall be directly deposited at the required location within 100 meters' lead. Payment will be made 50% of accepted rate of item no. 4 of Schedule 'A'.

All hard materials, such as, hard murrum, rubble, etc., not intended for use as above shall be stacked neatly on specified land as directed by the Engineer with all lifts

Unsuitable and surplus material not intended for use within the lead specified above shall also, if necessary, be transported with all lifts and lead and disposed of or used as directed by the Engineer.

#### **MORTH 304.4. Measurements for Payment**

Excavation for structures shall be measured in cu. m. for each class of material encountered, limited to the dimensions shown on the drawings or as directed by the Engineer. Excavation over increased width, cutting of slopes, shoring, shuttering and planking shall be deemed as convenience for the Contractor in executing the work and shall not be measured and paid for separately.

Foundation sealing, dewatering, including pumping shall be deemed to be incidental to the work unless separate provision is made for in the Contract

#### **MORTH 304.5. Rates**

##### **MORTH 304.5.1.**

The Contract unit rate for the items of excavation for structures shall be payment in full for carrying out the required operations including full compensation for:

1. Setting out;
2. Construction of necessary cofferdams, cribs, sheeting, shoring and bracing and their subsequent removal;
3. Removal of all logs, stumps, grubs and other deleterious matter and obstructions, for placing the foundations including trimming of bottoms of excavations;
4. Foundation sealing, dewatering including pumping when no separate provision for it is made in the Contract;
5. Backfilling, clearing up the site and disposal of all surplus material within all lifts and leads and
6. All labour, materials, tools, equipment, safety measures, diversion of traffic and incidentals necessary to complete the work to Specification.

##### **MORTH 304.5.2.**

The Contract unit rate for preparation of rock foundation shall be full compensation for cutting, trimming and cleaning the foundation surface and filling/sealing of all seams with cement grout or mortar including all materials, labour and incidentals required for completing the work.

**05:** Excavated in large boulders and soft rock by welding including shoring, strutting and dewatering as necessary and disposing of the excavated stuff as directed.

As per the detailed specifications of MORTH Cl. No. 304, Pg. no. 59.

**06:** Empty boring through all. sorts of strata for providing 1.20 M dia. R.C.C. bored piles to required depth including providing necessary casting pipe with all plants and equipment's as required complete.

Boring for 1.2 Mt. dia. R.C.C. bored piles shall be carried out using rotary or percussion type equipment. Unless otherwise approved by the Engineer, the diameter of the bore-holes shall be not more than the inside diameter of the liner.

A minimum of 2.0 m length of top of bore or the length as shown on the drawing shall invariably be provided with casing/liner to ensure against loose soil falling into the bore. In cases in which the side soil can fall into the hole, it is necessary to stabilize the side of the bore hole with drilling mud, or a suitable steel casing. The casing may be left in position permanently specially in cases where the aggressive action of the ground water is to be avoided, or in the case of piles built in water or in cases where significant length of piles could be exposed due to scour.

The metal casing shall be of sufficient thickness and strength to hold its original form and show no harmful distortion after it and adjacent casings have been driven and driving core, if any, has been withdrawn.

For bored cast-in-situ piles, casing/ liner shall be driven open ended with a pile driving hammer capable of achieving penetration of the liner to the length shown on the drawing or as approved by the Engineer. Materials inside the casing shall be removed progressively by air lift, grab or percussion equipment or other approved means.

Where bored cast-in-situ piles are used in soils liable to flow, the bottom of the casing shall be kept enough in advance of the boring tool to prevent the entry of soil into the casing, thus preventing the formation of cavities and settlements in the adjoining ground. The water level in the casing should generally be maintained at the natural ground water level for the same reasons. The joints of the casing shall be made as tight as possible to minimize in flow of water or leakage of slurry during concreting.

The drilling mud such as bentonite suspension shall be maintained at a level sufficiently above the surrounding ground water level to ensure the stability of the strata which is being penetrated throughout the boring process until the pile has been concreted.

Where bentonite suspension is used to maintain the stability of the bore-hole, it is essential that the properties of the material be carefully controlled at stages of mixing, supply to the

bore-hole and immediately before concrete is placed. It is usual to limit:

The density of bentonite suspension to 1.05 g/cc.

The marsh cone viscosity between 30 and 40.

The pH value between 9.5 and 12.

The silt content less than 1 per cent.

The liquid limit of bentonite not less than 400 per cent.

These aspects shall act as controlling factors for preventing contamination of bentonite slurry for clay and silt.

The bores shall be washed by bentonite flushing to ensure clean bottom at two stages viz. after completion of boring and prior to concreting after placing of reinforcement cage. Flushing of bentonite shall be done continuously with fresh bentonite slurry till the consistency of inflowing and out-flowing slurry is similar.

Prior to the lowering of the reinforcement cage into the pile shaft, the shaft shall be cleaned of all loose materials. Cover to reinforcing steel shall be maintained by suitable spacers.

Any liner or bore-hole which is improperly located or shows partial collapse that would affect the load carrying capacity of the pile, shall be rejected or repaired as directed by the Engineer at the cost of the Contractor.

The measurement shall be in Running meters of the piles ordered in writing by the Engineer-in-charge, measured from ground level to the bottom of pile foundation.

Unit rate includes boring through all sorts of strata, providing necessary materials, labour and equipment to complete the work. Steel for reinforcement, liner and concrete for piles will be paid separately.

**07:** Providing and laying filter media 600mm thick as directed at the back of abutments, returns and wing walls as per detailed specifications.

As per the detailed specifications of "MORTH Cl. No. 2504, Pg. no. 709"

**08:** Road marking with hot applied thermoplastic compound with reflectorizing glass beads on road surface providing and laying hot applied thermoplastic compound 2.5 CM thick including reflectorizing glass beads @ 250 gms /sq mt area thickness of surface applied glass bead as per IRC 35 the finished surface to be level uniform and free from streaks and holes.

As per the detailed specifications of "MORTH Cl. No. 803.4, Pg. no. 338"

**09:** Providing Weep holes in RCC abutment, Return wall and retaining wall with 100 mm dia

AC pipe and non-corrodible grating and geotextile, extending through the full width of the structure with slope of 1V:20H etc. complete as per drawing and technical specification.

As per the detailed specifications of "MORTH Cl. No. 2706, Pg. no. 755"

**10:** Providing and Fixing in position fully moulded restrained elastomeric bearing as per detailed drawings.

1. The term 'bearings' in this case shall refer to an elastomeric bearing consisting of one or more elastomer slabs bonded to metal plates during manufacture so as to form a sandwich arrangement, while 'Bearings Pads' shall denote single unreinforced elastomer slabs.

2. The elastomer to be used for bearings shall be made from natural or synthetic rubber and satisfy the physical properties given below. The test pieces required for the tests shall be selected from the centre layer of the bearings while making up the selection.

| Sr. No. | Items  | ASTM Designation      | Requirement   |
|---------|--|-----------------------|---|
| (i)     | Durometer Hardness   | D – 2240              | 55 to 70  |
| (ii)    | Ultimate Tensile Strain percent  | D - 412               | 450 for 55 grade,<br>400 for 60 grade<br>300 for 70 grade                 |
| (iii)   | Tensile Strength Kg/Sqcm   | D -412                | 175 Minimum<br>135 minimum for natural rubber of hardness greater than 65 |
| (iv)    | Adhesion to Metal Kg/cm  | D – 429<br>(Method B) | 9   |
| (v)     | Tear Resistance Kg/cm  | D – 624 40<br>(DIEC)  |   |
| (vi)    | Compression set 22 hrs. at 70 °C%  | D – 395<br>(Method B) | 25 maximum  |
| (vii)   | Ozone resistance 22% strain 100 hrs. at 380 ° C ± 10 ° C<br>(1 part per million in air by volume)                    | D – 1149              | No craks  |
| (Viii)  | Accelerated ageing 70 hours, 1000C Hardness increase<br>Tensile strength reduction,<br>Elongation at break reduction | D – 573               | 10 points<br>15 % of original<br>25 % of original                         |
| (ix)    | Low temperature stiffness young's  | D – 797               | 700 maximum   |

|  |                          |  |  |
|--|--------------------------|--|--|
|  | modulus – 40 ° C Kg/Sqcm |  |  |
|--|--------------------------|--|--|

3. Adhesive used in bearing location or attachment to bridge decks shall be subject to the approval by the Engineer in-charge. It shall be of high viscosity resins, which are cold setting and free of solvent. Adhesive shall not be used to bond layers of cured elastomer. Mild steel used for plate reinforcement shall comply with the requirements of relevant I.S. The Contractor shall furnish to the Engineer in-charge a certificate by the Manufacturer that the elastomer and fabric (if used) in the elastomeric bearing conforms to all the above requirements. The certification shall be supported by a certified copy of the results of tests, performed by the Manufacturer upon samples of the elastomer and fabric to be used in the bearings.

The contractor shall, whenever required, during the course of manufacture arrange and offer all facilities for the purpose of inspection and test of all or any of the material used therein, to any officer as directed by the Engineer-in-charge and the bearings and similar parts shall be used in the superstructure except on the production of certificate of acceptance thereof from the Directorate of Inspection whenever necessary. All the inspection charges shall be payable by the contractor.

4. The thickness of a single layer bearing shall not exceed 20 percent of the least plan dimension. The thickness of any internal layer of elastomer shall not be less than 6 mm. nor greater than 12 mm. The thickness of outer plates shall be not less than 3 mm. and that of inner plate not less than 1.5 mm. Metal plates in which dowels are located shall be, in general, not less than 6 mm. thick. The edges of all plates shall be lightly rounded to approximately 5 mm. The metal plates referred above should not be composed of thinner plates joined together. Laminated Bearings shall have side cover of elastomer of minimum thickness of 6 mm. to protect the ends of the steel plates and to give a reduced surface strain to that occurring at the edge of the bonded plates but shall not be considered in evaluation of deformations. The cover of elastomer at the top and bottom surfaces shall not be less than 3 mm. or more than half the thickness of internal layer. The outer cover at top and bottom surfaces having thickness less than half that of a single internal layer and not exceeding 3 mm. may be considered as a simple protection and need not therefore be considered in calculating deflections. Where above elastomer covers are provided, there is no objection to keeping the thickness of top most and bottom most plates same as that of inner plates.

5. Bearing shall be set back from the edge of a bearing surface a distance not less than the thickness of the layer of elastomer in contact with bearing surface to allow for spreading of the elastomer under load. Bearings may be located in position by means of dowels or studs or other devices, or bonded to the structure with approved adhesives which shall generally be of the high viscosity resin type cold setting and free from solvent. For spans on an inclined grade and without hinge bearings the sole plates shall be provided and the same bevelled so that masonry surfaces and the bearing shall be kept horizontal. To facilitate



maintenance, the ends of trusses and plate girders shall preferably be supported on plates or pedestals so that there is at least 15 centimetres clearance between the bottom chord or flange and the substructure. The plan dimensions of the bearings to be finally adopted shall preferably be selected from series 'R' 20 of IS : 1076. The arrangement of placing only one bearing under a girder shall be permitted. Further, bearings of different sizes must not be placed next to each other to support a span. The bearings shall be fully moulded when metal laminations are used. These laminated elastomeric bearings shall consist of one or more elastomer slabs bonded to metal plates so as to form a sandwich arrangement. Such fully moulded bearings shall be manufactured to required size. The bond between elastomers and metal or fabric shall be such that, when a sample is tested for separation, failure shall occur within the elastomers and not between the elastomer and metal.

6. The contractor shall get the bearings tested for the physical properties and performance of bearings. The test pieces required for the test shall be selected from the Central layer of bearing making up the selection. For the Size of the test pieces and method of tests etc. the relevant A.S.T.M. Standard shall be followed. The tests shall be carried out in a recognised laboratory acceptable to the department for all the necessary tests required by the Department. The specimen for tests as may be required shall be supplied by the contractor at his own cost and the testing charges shall also be fully borne by the contractor. Only those bearings which pass the tests satisfactorily will be accepted and will be permitted to be used. The Department shall not accept any responsibility for the cost of bearings rejected.

7. (i) Tolerances on length and width 0, + 5 mm.

(ii) Tolerances on thickness for single layer pad.  $\pm 0.5$  mm.

(iii) Tolerance on total thickness

'h' of finished bearings.

$10 < h \leq 30$  mm :  $\pm 0.5$  mm.

$30 < h \leq 50$  mm :  $\pm 0.8$  mm.

$50 < h \leq 80$  mm :  $\pm 0.9$  mm.

$80 < h \leq 120$  mm :  $\pm 1.1$  mm.

(iv) The parallelism of the individual elastomer laminations for a finished bearing, shall not exceed the tolerances specified at (ii) above when measured at the extremities of the laminations.

8. Proper arrangement shall be made to avoid corrosion of metal plates or deteriorating of adhesive by encasing the bearings totally in elastomer or by some other method approved by the Engineer-in-charge.

9. (i) When bearing assemblies on plates are shown on the drawing to be placed (not embedded) directly on concrete, the concrete bearing area shall be constructed slightly above grade and shall be finished by grinding.

(ii) It shall be ensured that bearings are set truly level and in exact position as indicated on the drawings so as to have full and even bearing on the seats. Thin mortar pads (not exceeding 12 mm.) may be made to meet with this requirements.



- (iii) It shall be ensured that the bottoms of the girders to be received on the bearings are plane at the location of these bearings and care shall be taken that the bearing are not displaced while placing the girders.
- (iv) Before fixing the elastomeric bearings the concrete surface on which the bearings is to be placed shall be wood float finished to a level plane which shall not vary more than 1.5 mm from a straight edge placed in any direction across the area
- (v) The position of the bearings shall be accurately marked on the pier/abutment cap and the area where the bearings are to be located levelled accurately.
- (vi) The concrete surface shall be free from any loose material and cleared of any grease oil, paint etc., and it shall be dry at the time of fixing.
- (vii) The surface of elastomer shall be free from any foreign material.
- (viii) Once prepared, the concrete or elastomer shall not be touched with bare hand.
- (ix) The bearings shall be covered with canvas or a suitable covering material to protect from direct sun-light and weather until the concrete on superstructure is cast
- (x) The bearings shall be fixed in position with epoxy resin adhesive of approved quality.
- (xi) The concreting of superstructure shall be taken up only after ensuring that the adhesive for fixing the bearings or pier/abutment cap has set.

10. Unit rate shall be cubical contents of the bearing measured in Cu.cm.

11. The rate for each type of bearings shall include the cost of supplying and fixing the bearings in position complete. The rate shall also include the cost of samples and their testing as desired by the Engineer-in-charge. The rate shall also include the cost of adhesives for fixing them.

**11:** Providing Vertical Joints between retaining walls, abutments, etc. (providing Pre-moulded asphalt filler joints as per drawings 12mm)

As per the detailed specifications of "MORTH Cl. No. 2604, Pg. no. 725"

**12:** Providing, fabricating and fixing in position GI Drainage Spout arrangements having 100 mm dia. Pipe B class with necessary bend, fixing to GI chamber, GI grating, providing and applying one coat of primer & two coat of anticorrosive paint, etc. complete as per drawing and as per specifications.

As per the detailed specifications of "MORTH Cl. No. 2705, Pg. no. 754"

**13:** Providing and fixing 100 dia. runner and down take GI pipe to drain water from drainage spout with necessary fixtures including cost of all materials, labours, bends, fixtures,

specials etc. Complete as per drawing and Sp. And as per direction of engineer.

## **2705 DRAINAGE SPOUTS**

Drainage along longitudinal direction shall be ensured by sufficient number of drainage fixtures embedded in the deck slab. The spouts shall be of not less than 100 mm in diameter and shall be of corrosive resistant material such as galvanised steel with suitable cleanout fixtures. The spacing of drainage spouts shall not exceed 10 m. The discharge from drainage spout shall be kept away from the deck structure by means of suitable down pipes upto 500 mm above High Flood Level, in case of viaducts in urban areas, the drainage spouts should be connected with suitably located runners and down pipes to discharge the surface run-off into drains provided at ground level.

### **2705.1 Fabrication**

The drainage assembly shall be fabricated to the dimensions shown on the drawings. All materials shall be corrosion resistant;. Steel components shall be of mild steel conforming to IS:226. The drainage assembly shall be seam welded for water tightness and then hot-dip galvanized.

### **2705.2 Placement**

The galvanized assembly shall be given two coats of bituminous paint before placement. The whole assembly shall be placed in true position, lines and levels as shown on the drawings with necessary cutouts in the shuttering for deck slab and held in place firmly. Where the reinforcements of the deck are required to be cut, equivalent reinforcements shall be placed at the corners of the cut out.

### **2705.3 Finishing**

After setting of the deck slab concrete, the shrinkage cracks around the assembly shall be sealed with polysulphide sealant or bituminous sealant as per IS:1834 and the excess sealant trimmed to receive the wearing coat. After the wearing coat is completed, similar sealant shall be provided to cover at least 50 mm on the wearing coat surface all round the drainage assembly.

**14:** J type M20 Anchor bolt as per drawing including threading as shown in the drawing for

standard octagonal pole type BOP 7030 all complete.

As per the detailed specifications of "MORTH Cl. No. 1900, Pg. no. 585"

**15:** Structural Steel: - Base plate of 225 x 225 x 16 mm thick with adjustment of hole. MS plate 6mm thick 20mm wide 150mm long including welding to the base plate all complete.

As per the detailed specifications of "MORTH Cl. No. 1900, Pg. no. 585"

**16:** 50 mm Dia PVC pipe for entry cable pipe.

As per the detailed specifications of "MORTH Cl. No. 2705, Pg. no. 754"

**17:** 50 mm Dia PVC pipe for crash barrier.

As per the detailed specifications of "MORTH Cl. No. 2705, Pg. no. 754"

**18:** Providing and laying chequered precast cement concrete tiles 22mm thick with aggregate of sizes upto 6mm in floors, treads of steps and landings on 20mm thick bed of C.M. 1:6 (1-cement : 6-sand) or L.M. 1:1.5(1-Lime putty : 1.5 coarse sand) joint with neat cement slurry with pigments to match the shade of the tiles. (up to 10 ton).

1. Chequered tiles: -

Chequered terrazzo tiles 22mm thick with marble chips of size upto 6mm in floor on 25mm thick bed or C.M 1:5 jointed with neat cement slurry mixed with pigment to match the shade of the tiles including rubbing and polishing etc. complete, light shade using white cement.

2.Fixing Tiles

2.1The tiles before laying shall be soaked in water for at least two hours. Neat grey cement grout at 3.3 kg/cement/sq.mt. of honey like consistency shall be spread over the mortar bedding at directed. The edges of the tile be smeared with neat cement slurry. The tiles shall be well pressed and gently tapped with a wooden mallet till they are properly bedded and in level with the adjoining tiles. There shall be no hollows in bed or joints. The joint between the tiles shall be as thin as possible in straight line or as per pattern.

2.2 The tiles shall not have staggered joints. The joint shall be true to centre line both ways. The Nehni trap coming in the flooring shall be so positioned that it granting shall replace only one tile as far as possible. Where full size tiles cannot be fixed, they shall be cut(sawn) to be required size and the edges rubbed smooth to ensure straight and true joints. The

joint shall be filled with gray cement grout with wire brush or trowel to a depth of 5mm and loose material removed. White cement shall be used for pointing the joints. After fixing the tile finally in an even plane the flooring shall be kept wet and allowed to nature undisturbed for 7 days.

2.3 Cleaning: The surplus cement grout that may have come out of the joint shall be cleared off before it sets. Once the floor has set, it shall be carefully washed, cleared by dilute acid and dried. Proper precaution and measure shall be taken to ensure that the tiles are not damaged in any way till the completion of the construction.

3.0 Mode of measurements and payment:

3.1 The work done shall be measured in sq.mt. for visible area of work done. The length and width of the flooring shall be measured not-between the faces of skirting or dados or plastered face of wall as the case may be. The paving under dado or skirting shall not be measured. No deduction shall be made nor extra paid of any opening in the floor of area upto 0.1 sq.mt. Nothing extra shall be paid for laying the floors at different levels in the same rooms.

3.2 The rate shall be for a unit of one sq. metre.

**19:** Providing PVC. 100 mm. diameter water spouts including necessary iron gratings as per drawings.

1. Material for the water spout shall be as mentioned in the item as per MORTH standard drawing and shall be got approved from the Engineer-in-charge.

2. Water spout shall be 100 mm. internal dia. cast iron grating shall be provided at the entry and shall be fixed in the recess so as to be flush with the road surface. The quality and size of the grating shall be got approved from the Engineer-in-charge. The water spouts shall project at least 10 cm. outside the concrete and shall be rigidly fixed in it. The grating and C.I. pipes shall be painted with two coats of anticorrosive black bitumen paint.

3. Measurement shall be per number of water spout fixed.

4. Unit rate includes cost of all materials, labour and tools to complete the work.

**20:** Painting two coats after filling the surface with synthetic enamel paint in all shades on crash barrier concrete surfaces.

## **Material**

### **(A) Oil paints:**

Oil paints shall be of the specified colour and as approved. The ready mixed paints shall only be used. However, if ready mixed paint of specified shade or tint is not available white ready mixed paint with approved stainer will be allowed in such a case the contractor shall ensure that the shade of the paint so allowed shall be uniform.

All the paints shall meet with the following general requirements

(i) Paint shall not show excessive setting in a freshly opened full can and shall easily be ready Spread with a paddle to a smooth homogeneous state. The paint shall show no curdling, levering caking or colour separation and shall be free from lumps and skins

(ii) The paint as received shall brush easily, possess good leveling properties and show no running or sagging tendencies

(iii) The paint shall not skin within 48 hours in a three quarters filled closed container

(iv) The paint shall dry to a smooth uniform finish free from roughness, grit unevenness and other imperfections

Ready mixed paint shall be used exactly as received from the manufacturers and generally according to their instructions and without any admixtures whatsoever

### **Enamel paints:**

The enamel paint shall satisfy in general requirements in specification of oil paints, Enamel paint shall conform to I.S. 2933-1975.

### **Workmanship**

**General :** The materials required for work of painting work shall be obtained directly from approved manufactures or approved dealer and brought to the site in maker's drums; kegs. etc. with seal unbroken.

All materials not in actual use shall be kept properly protected, lids of containers shall be kept closed and surface of paint in open or partially open containers covered with a thin layer of turpentine to prevent formation of skin. The materials which have become state or flat due to improper and long storage shall not be used. The paint shall be stirred thoroughly in its container before pouring into small containers. While applying also, the paint shall be continuously stirred in smaller container. No left over paint shall be put back into stock tins. When not in use the containers shall be kept properly closed.

If for any reasons, things is necessary, the brand of thinner recommended by the manufacturer shall be used.

The surface to be painted shall be thoroughly cleaned and dusted. All rust, dirt and grease shall be thoroughly removed before painting is started. No painting on exterior or other exposed part o the work shall be carried out in wet, dam p or otherwise unfavorable weather and all the surfaces shall be thoroughly dry before painting work is started.

### **Application of paint:**

Brushing operations are to be adjusted to the spreading capacity advised by the manufacture of particular paint. The paint shall be applied evenly and smoothly by means of crossing and laying off. The crossing and laying off consists of covering the area over with paint, brushing the surface hard for the first time over and then brushing alternately in opposite directions two or three times and then finally brushing lightly in a direction at right angles to the same. In this process, no brush marks shall be left after the -laying off is finished. The full process of crossing and laying off will constitute one coat.

Each coat shall be allowed to dry completely and lightly rubbed with very fine grade of sand-paper and loose particles brushed off before next coat is applied. Each coat shall vary slightly in shade and shall be got approved from Engineer-in-charge before next coat is started.

Each coat the last shall be lightly rubbed down with sand paper of fine pumice stone and cleaned of dust before the next coat is applied. No hair marks from the brush or logging of paint puddles in the corners of panels, angles of moldings etc. shall be left on the work.

Special care shall be taken while painting over bolts, nuts, rivets, overlaps etc. Approved best quality brushes shall be used.

#### **MODE OF MEASUREMENT & PAYMENT:**

The unit rate Painting two coats (including priming coat) on new R.C.C. shall include the cost of all materials, tools and plant required for mixing paint, placing & painting in position, all required specials and jointing adhesive compound, finishing as per direction of the Engineer-in-charge, and all other incidental expenses as shown on the drawings and according to these specifications. They shall also include the cost of making, fixing and removing of all scaffolding and forms required for the work.

The rate of Painting two coats (including priming coat) on new R.C.C. shall include the cost of all labour, materials tools and plant scaffolding and all incidental expenses as described herein above.

The Painting two coats (including priming coat) on new R.C.C. work shall be measured for its length and width or Height limiting dimensions to those specified on plan or as directed.

**The payment will be made on square Meter basis of the finished work.**

**21:** Providing & fixing ordinary Kilometre stone of precast C.C. 1:2:4 including necessary reinforcement as per I.R.C. type design in C.C. 1:4:8 including letter & paints etc. complete (For N.H., S.H. & M.D.R.).

1. Kilometer stone shall be of approved quality and shall be either black Rajula stone or of precast 1:2:4 R.C.C. as specified in the item.
2. The size manner of fixing painting and lettering of K.M. stone specification as per I.R.C. 8(Type design for Highway kilometer stones.) The fixing of K.M. stone shall be carried out in ordinary concrete of grade specified in the item using broken metal field metal or gravel The measurement for payment shall be made per No of K.M. stone fixed in position
3. Unit rate for kilometre stone include the cost of all materials, labour, tools, fixing, finishing curing lettering and painting as directed by the Engineer-in-charge.

**22:** Providing and fixing marble slab including engraving and painting complete.

(A) size 75 cm x 60 cm x 4 cm

1. Marble plate shall be white and of approved quality and shall be of size as mentioned in the item. Lettering shall be done by V-shape engraving and shall be filled with black paint of approved quality, lettering shall be done as directed by the Engineer-in-charge. The Marble plate shall be fixed in neat cement at a place as directed by the Engineer-in-charge. Cement shall conform to relevant IS Specification.
2. Measurement shall be per number of marble plate fixed.
3. Unit rates includes cost of all material labour and tools to complete the work

**23:** Supplying and fixing reinforced concrete heavy duty non-pressure pipes with collars for culverts carrying heavy traffic as per IS 458-1991 specifications including setting the pipes in C.M. 1:2 watering and laying (to level or slopes) of class NP3 of following internal diameters . (vii) 900mm dia. (vi) 900 mm dia.

**Scope & specifications of works include:**

1. This shall consist of furnishing and installing reinforced cement concrete pipe of the type diameter and length required at the location shown on the drawings or as ordered by the Engineer-in-charge.

2. Reinforced concrete pipe shall be of **NP3** type conforming to the requirements of IS : 458 and shall be of dia. as specified in the item. Each consignment of cement concrete pipes shall be inspected, if necessary and approved by the Engineer-in-charge either at the place of manufacture or at the site before their incorporation in the works.

NP3, NP2 and NP1 pipes are used for R.C.C. Pipes. Where the testing of pipes will not be feasible the contractors will have to produce a certificate from the' manufacturer on company's letter head in the given' hereinafter from.

Production of such certificate will not however relieve the Contractor from his responsibility of supplying pipes of required standard and will have to bear the loss or damage caused to the work on account of defects found subsequently during execution. It will also be necessary to purchase these pipes from manufacturer having standard equipments for carrying out various tests as per IS : 458 at his factory.

#### **Form of Certificate for NP-3, NP-2, NP-1 Pipes**

We \_\_\_\_\_

Manufacturer or R.C.C. Pipes produce R.C.C. pipes as per the requirement of IS : 458 and also carry out the required test at out place, We have acquired equipments for carrying out test and are prepared to carry out tests at our factory sites. We have experience of manufacturing of pipes of years. The pipes supplied by us to M/S.\_\_\_\_\_.

Satisfy the requirement of IS: 458

Date: \_\_\_\_\_

Place: \_\_\_\_\_



Manufacturer's Sign \_\_\_\_\_

3. No pipes shall be placed in position until the foundations have been approved by the Engineer-in charge. Where two or more pipes are to be laid adjacent to each other, they shall be separated by a distance equal to at least half the diameter of the pipe subject to minimum of **900 mm**. The laying of pipes on the prepared foundation shall start from the outlet and proceed towards the inlet and be completed to the specified lines and grades. The pipes shall be fitted and matched so that when laid in works they form a culvert with a smooth uniform invert. Any pipe found defective or damaged during laying shall be removed at the cost of Contractor.
4. The pipes shall be jointed either by collar joint or by flush joint in the former case the collars shall be of R.C.C. 150 to 200 mm. wide and having the same strength as the pipes to be jointed. Caulking space shall be between 13 and 20 mm. according to the diameter of the pipes caulking material shall be slightly wet mix of cement and sand in the ratio of 1:2 rammed with caulking irons. Before caulking the collar shall be so placed that its centre coincides with that of pipes and an even annular space is left between the collar and the pipes. Flush joint may be shaped to form a self centering joint with a joining space 13 mm wide. The joining space shall be filled with cement mortar 1:2 (1 cement : 2 sand) mixed sufficiently dry to remain in position when forced with a trowel or rammer. Care shall be taken to fill all voids and excess mortar shall be removed. All joints shall be made with care so that their interior surface is smooth and consistent with the interior surface of the pipes. After finishing, the joint shall be kept covered and damp for at least four days.
5. R. C. C. pipes shall be measured along their centre between their inlet and outlet ends in **linear metres**.
6. The rate for the pipes shall include the cost of pipe including loading, unloading, handling, storing laying in position and joining complete.

**24:** Providing and laying filter media 600mm thick as directed at the back of abutments, returns and wing walls as per detailed specifications.

As per the detailed specifications of "MORTH Cl. No. 2504, Pg. no. 709"

**25:** As per specification of IS Code: 2911 (Part-I), for pile chipping.

**26:** Providing, laying and jointing in true line and level 110 diameter U.P.V.C (Type B) conforming to IS 13592-1992 with one end plain and other end socketed with rubber ring, & fittings conforming to ISI 14735-1999 of approved make for drainage system pipe line, pipe shall be jointed with each other with rubber lubricant, pipe shall be fixed on wall using of PVC clamp of the size 110 mm diameter x 149 mm length x 145 mm height at every 2000 mm centre to centre or shall be concealed in walls as directed including necessary fittings such as bends, shoes etc. including testing of pipes and joints and jointed with adhesive solvent cement including cost of all materials.

## **1.0. Materials**

- 1.1.** The pipes shall be standard I.S.I. mark U.P.V.C. SWR Type B pipe of specified dia.
- 1.2.** The fittings, clamps etc. required for specified dia. bore pipes shall be of best quality and makes as approved by the Engineer-in-charge. Necessary accessories with inner/ outer brass thread shall be used as required and instruction by Engineer in charge.

## **2.0. Workmanship**

### **2.1. Cutting, Laying & Jointing**

- 2.1.1.** When the tubes are to be cut or rethreaded, the ends shall be carefully filed out so that no obstruction to bore is offered. The ends of the tubes shall then be threaded conforming to the requirements of I.S. 554-1955 with pipe dies and taps carefully in such a manner that it will not result in slackness of joints when the two pieces are screwed together.
- 2.1.2.** The taps and dies shall be used only for straightening screw threads which have becoming bent or damaged and shall not be used for turning of the threads so as to

make them slack as the latter procedure may not result in the water tight joint. The screw threads for tube and fitting shall be protected from edge until they are fitted.

**2.1.3.** In jointing the tubes, the inside of the socket and the screwed end of the tubes shall be oiled and smeared with white or red lead and wrapping around with a few turns of fine spun yarn round the screwed end of the tube. The end shall then be tightly screwed in the socket, tees, etc. with a pipe wrench. Care shall be taken that all times free from dust and dirt during fixing. But from the joints shall be removed after screwing. After laying the open ends of the pipes shall be temperately plugged to prevent access of water, soil, or any other foreign matter. Jointing shall be carried out with proper chemical adhesive material and allow to dry.

**2.1.4.** Any threads exposed after jointing shall be painted or in the case of underground piping thickly coated with approved anti-corrosive paint to prevent corrosion.

## **2.2. Fixing concealed to wall, ceiling & floors.**

**2.2.1.** In case of fixing concealed cement point to walls or ceilings, these shall run on the surface of the wall, or ceiling (not in chase) unless otherwise specified. The fixing shall be done by means of standard pattern, holder clamps keeping the pipes about 15 mm. clear of the wall. When it is found necessary to pattern, holder clamps keeping the pipes about 15 mm. clear of the wall. When it is found necessary to conceal the pipes and when specified so, chasing may be adopted or pipe fixed inducts or recesses etc. provided that there is sufficient space to work on the pipe with usual tools. The pipe shall not ordinarily be buried in walls or solid floors, where unavoidable, pipe may be buried for short distances provided that adequate protection is given against damage and where so required joints are not buried. Where required M.S. tube sleeve shall be fixed at a place a pipe is peasant through a wall or floor for expansion and contraction and other movements. In case the pipe is embedded in walls or floors, it should be painted with anti-corrosive bitumastic paint of approved quality. The pipe should not come in contact with lime mortar or lime concrete as the pipe is affected by lime. Under the floors, the pipe shall be laid in layer of sand filling.

**2.2.2.** All pipes and fittings shall be fixed truly vertical and horizontal unless unavoidable.

The pipes shall be fixed to walls with standard pattern clamps of required size and shape, one end of which shall be properly plugged or cemented into walls with cement mortar 1:3 (1 cement : 3 coarse sand) and the other tightened round the pipes to hold it securely. These clamps shall be spaced at regular intervals in straight lengths at 2 MC/C interval in horizontal run and 2.5 m. interval in vertical run. For pipe of 15 mm. dia. up to 25 mm. dia the holes in the walls and floors shall be made by drilling with chisel or jumper and not by dismantling the brick work or concrete. However for bigger diameter pipes the holes shall be carefully made (1 cement : 3 coarse sand), and properly finished to match the adjacent surface.

**2.3. Testing of joints :**

**2.3.1.** After laying and jointing, the pipes and fillings shall be inspected under working conditions of pressure and flow. Any joints found liken shall be redone, and ail leaking pipes removed and replaced without extra cost.

**2.3.2.** The pipes and fittings after they are laid shall be tested to hydraulic pressure of 6 Kg./Sq cm. The pipe shall be slowly and carefully charged with water allowing all air to escape and avoiding all shocks and water hammer. The draw off takes and stop cock shall then be closed and specified hydraulic pressure shall be applied gradually. The pressure gauge must be accurate. The pipes and fittings shall be tested in sections as the work laying proceeds, keeping, the joints exposed for inspection during the testing.

**3.0. Mode of measurements and payment**

**3.1.** The description of the item shall, unless otherwise stated be held to include where necessary conveyance and delivery, handling, unloading, storing fabrication, hoisting, all labour for finishing to required shape and size, setting, fitting in position straight, cutting and waste return of packing etc.

- 3.2.** The length shall be measured on running meter basis of finished work. The length shall be taken along the centre line of the pipe and fittings. The pipes fixed to wall, ceiling, floors etc shall be measured and paid under this item.
- 3.3.** All the work shall be measured in decimal system as fixed in its place, subject to tolerance given below unless otherwise stated.
- (i) Dimension shall be measured to the nearest 0.01 meter.
- (ii) Area shall be worked out to the nearest 0.01 sq. meter.
- 3.4.** All measurements of cutting shall unless otherwise stated be held to include the consequent waste.
- 3.5.** In case of fitting of unequal bore, the target bore shall be measured for the test.
- 3.6.** Testing of pipe lines fittings, and joints include for providing all plant appliances necessary for obtaining access to the work to be tested and carrying out the tests.
- 3.7.** The rate includes U.P.V.C. SWR Type B pipe with screwed socket joints to gather with all fittings (such as bends, sockets, elbows, tees, crosses, short pieces, clamps and plugs, unions etc.) and fixing complete with clamping wall hooks, wooden plug etc. and also curing, screwing and waste and for making forged (or hand made) bends on piping as required. Connector shall be inserted where required or directed. The rate also includes cutting through walls, floors etc. and their making good and painting exposed threads with anti-corrosive paint as above and testing where tubes are to be fixed to wall, ceiling and flooring, the rates shall not include painting of pipes, providing sleeves and sand filling under floor for which separate payment shall be made.
- 3.8.** The rate shall be for a unit of one running meter.

**27:** Providing & Fixing Village name boards made out of 2mm. Aluminium sheet size 90 x 60 cms rectangle per the design of IRC - 67 - 2015 Pre treated with phosphating

process & acid etching : coated with one coat of epoxy primer and two coats of best quality epoxy paint reflectorised with retro reflective sheeting as per latest M.O.S.T Specification :Letters and numerals sound be as per IRC-30-1968, 3.1 M long ( 2 no's) Stand post and frame fabricated from suitable size iron angle of 50 x 50 x 5mm : painted with best quality epoxy coating in black and white bends the details of symbol or inscription / numerals for each board shall be as per the instruction for of Engineer-in-charge, The fixing at site shall be in 1;2;4 CC block of size 45 x 45 x 60cms. for each leg. including excavation curing etc. comp. under the supervision of engineer in charge.(B) High intensity Grade.

The Village board shall conform to IRC 67-2015 and ninth schedule of the motor vehicle Act. It shall be providing & fixed as directed by the Engineer in charge.

## **1.2 Traffic Signs having retro-reflective sheeting:**

### **1.2.1 General Requirement:**

The retro-reflective used the sign shall be consist of white or colored sheeting a smooth surface outer surface has the property of retro-reflection over its entire surface. It shall be weather resistant and show lifting or curling and shall have negligible shrinkage or expansion. A certificate of having tested the sheeting for properties in an unprotected outdoor exposure facing the sun for two years and its having passed these tests shall be obtained from a reputed laboratory by the manufacturer of the sheeting. The Type of sheeting to be used would depend upon the type, Functional hierarchy and importance of the road.

### **1.2.2 High Intensity Grade Sheetting:**

#### **1.2.2.1 Encapsulated Lens Type:**

This sheeting be of encapsulated lens type consisting of spherical glass lens element, adhered to a resin and encapsulated by flexible, transparent proof plastic having a smooth surface. The retro reflective surface after cleaning with soap and water and in dry condition shall have the minimum co-efficient of retro-reflection (determined in accordance with ASTM Standard e: 810) as indicated in Table 800-1.

TABLE 800-1 ACCEPTABLE MINIMUM CO-EFFCINT OF RETRO REFLECTIVE FOR HIGH INTENSITY GRADE SHEETING (CANDELAS PER LUX SQURE METOD).

| Observation Angle (In degrees) | Entrance Angle (In degrees) | White | Yellow | Orange | Green /Red | Blue |
|--------------------------------|-----------------------------|-------|--------|--------|------------|------|
|                                |                             |       |        |        |            |      |

|     |     |     |     |     |    |     |
|-----|-----|-----|-----|-----|----|-----|
| 0.2 | -4  | 250 | 170 | 100 | 45 | 20  |
| 0.2 | +30 | 150 | 100 | 60  | 25 | 11  |
| 0.5 | -4  | 95  | 62  | 30  | 15 | 7.5 |
| 0.5 | +30 | 65  | 45  | 25  | 10 | 5.0 |

When totally wet, the sheeting shall not less than 90% of the values of retro reflectance indicated in Table 800-1. At the end of 7 years. The sheeting retain at least 75% of its original retro-reflectance.

### 1.3.2 Engineering Grade Sheeting:

This sheeting shall be enclosed lens type consisting of microscopic lens element embedded beneath the surface of a smooth, flexible, transparent, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum coefficient of retro-reflection (determine in accordance with ASTM Standard E-810) as Table 800-2.

TABLE 800-2 ACCEPTABLE MINIMUM CO-EFFICIENT OF RETRO REFLECTIVE FOR ENGINEERING GRADE SHEETING (CANDELAS PER LUX SQUARE METHOD).

| Observation Angle (In degrees) | Entrance Angle (In degrees) | White | Yellow | Orange | Green | Red  | Blue |
|--------------------------------|-----------------------------|-------|--------|--------|-------|------|------|
| 0.2                            | -4                          | 70    | 50     | 25     | 9.0   | 14.5 | 4.0  |
| 0.2                            | +30                         | 30    | 22     | 7.0    | 3.5   | 6.0  | 1.7  |
| 0.5                            | -4                          | 30    | 25     | 13.5   | 14.5  | 7.5  | 2.0  |
| 0.5                            | +30                         | 15    | 13     | 4.0    | 2.2   | 3.0  | 0.8  |

1.12.3 When totally wet, the sheeting shall not show less than 90% of the values of retro-reflectance indicated in table 800-2 At the end of 5 years, The sheeting shall retain at least 50% of its original retro-reflectance.

**1.1.3 Messages /Borders:** The messages (legends, letters, numerals etc.) and borders shall either be screen-printed or of cut-outs. Screen-Printing shall be processed and finished with materials and in a manner specified by the sheeting manufacturer. Cut outs shall be of material as specified by the sheeting manufacturer and shall be bonded with the sheeting in the manner specified by Manufacturer.

**1.1.4** For screen-printed transparent colored areas on white sheeting, the co-efficient shall not be less than 50 % of the values corresponding color in table 800-1(a),800-1(b) as applicable.

**1.1.5** Cut out message and border, wherever used, shall be made out of retro-reflective sheeting (as per Clause1.12) except those in black which shall be of non-reflective sheeting.

**1.1.6** Color: Unless otherwise specified the general color scheme shall be stipulated in IS:5 “Color for ready Mixed Paints.”

Blue IS Color No.166: French Blue

Red IS Color No.537: Signal Red

Green IS Color No.284: Indian Green

Orange IS Color No.591: Deep Orange

The color shall be durable and uniform in acceptable but when viewed in day or under normal headlight at night.

**1.1.7 Adhesives :** The sheeting shall be either have a pressure sensitive of the aggressive tack type requiring no heat, Solvent or removable liner (removable by peeling without soaking in water or other solvent) and shall be suitable for the type material of the base plate used for the sign. The adhesive shall form a durable bond to smooth, corrosion and weather resistance surface of the base plate such that it shall be possible to remove the sheeting from the sign base in one piece by sharp instrument. In case of pressure-sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer specification.

**1.1.8 Refurbishment:** Where existing signs are specified for the refurbishment, the sheeting shall have a semi-rigid aluminum backing pre-coated with aggressive-tack type pressure sensitive adhesive. The adhesive shall be suitable for type of material used for the sign and should thoroughly bond that material.

**1.1.9 Fabrication:**



1.1.9.1 Surface to be refectories shall be prepared to receive the retro-reflective sheeting. The smooth plain surface before the application of retro-reflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves between all cleaning and preparation operation and application of reflective sheeting/primer.

1.1.9.2 Complete sheets of the material shall be used on the signs except where it is unavoidable. At splices sheeting with pressure sensitive adhesive shall be overlapped not less be 5 mm. Sheeting with heat –activated adhesive may be spliced with an overlapped not less than 5mm or butted with gap or butted with a gap not exceeding 0.75mm. Where screen printing with transparent color is proposed, only but jointing shall be used. Cut out to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

1.1.10 Warranty Durability: For each lot of sheeting procured, the contractor shall obtain from the manufacturer a 7 Years warranty for satisfactory field performance including stipulated retro-reflectance of the sheeting of high intensity grade and 5 years warranty for the engineering grade and submit the same to the Engineer. In addition, a 7 years and a five years warranty for satisfactory in field performance of the finished sign with retro-reflective sheeting of high intensity grade and engineering grade respectively, inclusive of the screen printed or cut-out letters/legends and their bonding and their bonding to the retro-reflective to the retro-reflective sheeting shall be obtained from the contractor/supplier and passed on to the Engineer.

## **1.2 Installation:**

1.2.1 Sign post their foundation and sign mounting shall be so constructed as to hold in a proper and permanent position against the normal storm wind loads or displacement by vandalism. Normally signs with an area 0.9 Sq.m. shall be mounted on a single post, and for greater area two or more supports shall be provided. Sign supports may be of mild steel, reinforced concrete or galvanized iron (G.I.). Post –end shall be firmly fixed to the ground by means of properly designed foundation. The work of foundation shall conform to relevant specification as specified.

1.2.2 All components of signs and supports, other than the reflective portion and G.I. Posts shall be thoroughly decaled, cleaned, primed concrete or G.I. Posts. After the must have been tightened, The tails of the bolts shall be painted with three coats of red lead paint.

1.2.3 The signs shall be fixed to the posts by welding in the case of steel post and by bolts and washers of suitable size in the case or reinforced concrete or G.I. Posts. After the nuts have been tightened, the tails of the bolts shall be furred over with a hammer to prevent removal.

### **1.3 Measurement for payment:**

The measurement for standard cautionary, mandatory and information sign shall be In number of different types of signs supplied and fixed as per above detail and specification.

### **1.4 Rate:**

The contract unit shall be payment in full for the cost of making the road sign. Including all material, installing it at the site and incidentals to complete the work in accordance with the specification.**28:** Providing & Fixing sign boards made out of 2mm. Aluminium sheet size 1 Meter x 1 Meter cms as per the design given by engineer in charge, Pre treated with phosphating process & acid etching : coated with one coat of epoxy primer and two coats of best quality epoxy paint reflectorised with retro reflective sheeting as per latest M.O.S.T Specification, Letters and numerals should be as per IRC -30-2015, 3.1 M long ( 2 nos) Stand post and frame fabricated from suitable size iron angle of 35 x 35 3mm & 50 x 50 x 5mm 75 x 75 x 6mm : painted with best quality epoxy coating in black and white bends the details of symbol or inscription / numerals for each board shall be as per the instruction for of Engineer-in-charge, The fixing at site shall be in 1;2;4 CC block of size 45 x 45 x 60cms. for each leg. including excavation curing etc. comp. under the supervision of engineer in charge.(B) High intensity Grade.

The sign board shall conform to IRC 67-2015 and nineth schedule of the motor vehicle Act. It shall be providing & fixed as directed by the Engineer in charge.

## **1.2 Traffic Signs having retro-reflective sheeting:**

### **1.2.1 General Requirement:**

The retro-reflective used the sign shall be consist of white or colored sheeting a smooth surface outer surface has the property of retro-reflection over its entire surface. It shall be weather resistant and show lifting or curling and shall have negligible shrinkage or expansion. A certificate of having tested the sheeting for properties in an unprotected outdoor exposure facing the sun for two years and its having passed these tests shall be obtained from a reputed laboratory by the manufacturer of the sheeting. The Type of sheeting to be used would depend upon the type, Functional hierarchy and importance of the road.

### **1.2.2 High Intensity Grade Sheeting:**

#### **1.2.2.1 Encapsulated Lens Type:**

This sheeting be of encapsulated lens type consisting of spherical glass lens element, adhered to a resin and encapsulated by flexible, transparent proof plastic having a smooth

surface. The retro reflective surface after cleaning with soap and water and in dry condition shall have the minimum co-efficient of retro-reflection (determined in accordance with ASTM Standard e: 810) as indicated in Table 800-1.

TABLE 800-1 ACCEPTABLE MINIMUM CO-EFFICIENT OF RETRO REFLECTIVE FOR HIGH INTENSITY GRADE SHEETING (CANDELAS PER LUX SQUARE METOD).

| Observation Angle (In degrees) | Entrance Angle (In degrees) | White | Yellow | Orange | Green /Red | Blue |
|--------------------------------|-----------------------------|-------|--------|--------|------------|------|
| 0.2                            | -4                          | 250   | 170    | 100    | 45         | 20   |
| 0.2                            | +30                         | 150   | 100    | 60     | 25         | 11   |
| 0.5                            | -4                          | 95    | 62     | 30     | 15         | 7.5  |
| 0.5                            | +30                         | 65    | 45     | 25     | 10         | 5.0  |

When totally wet, the sheeting shall not less than 90% of the values of retro reflectance indicated in Table 800-1. At the end of 7 years. The sheeting retain at least 75% of its original retro-reflectance.

### 1.3.2 Engineering Grade Sheeting:

This sheeting shall be enclosed lens type consisting of microscopic lens element embedded beneath the surface of a smooth, flexible, transparent, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum coefficient of retro-reflection (determine in accordance with ASTM Standard e-810) as Table 800-2.

TABLE 800-2 ACCEPTABLE MINIMUM CO-EFFICIENT OF RETRO REFLECTIVE FOR ENGINEERING GRADE SHEETING (CANDELAS PER LUX SQUARE METOD).

| Observation Angle (In degrees) | Entrance Angle (In degrees) | White | Yellow | Orange | Green | Red  | Blue |
|--------------------------------|-----------------------------|-------|--------|--------|-------|------|------|
| 0.2                            | -4                          | 70    | 50     | 25     | 9.0   | 14.5 | 4.0  |
| 0.2                            | +30                         | 30    | 22     | 7.0    | 3.5   | 6.0  | 1.7  |

|     |     |    |    |      |      |     |     |
|-----|-----|----|----|------|------|-----|-----|
| 0.5 | -4  | 30 | 25 | 13.5 | 14.5 | 7.5 | 2.0 |
| 0.5 | +30 | 15 | 13 | 4.0  | 2.2  | 3.0 | 0.8 |
|     |     |    |    |      |      |     |     |

1.12.3 When totally wet, the sheeting shall not show less than 90% of the values of retro-reflectance indicated in table 800-2 At the end of 5 years, The sheeting shall retain at least 50% of its original retro-reflectance.

1.1.3 **Messages /Borders:** The messages (legends, letters, numerals etc.) and borders shall either be screen-printed or of cut-outs. Screen-Printing shall be processed and finished with materials and in a manner specified by the sheeting manufacturer. Cut outs shall be of material as specified by the sheeting manufacturer and shall be bonded with the sheeting in the manner specified by Manufacturer.

1.1.4 For screen-printed transparent colored areas on white sheeting, the co-efficient shall not be less than 50 % of the values corresponding color in table 800-1(a),800-1(b) as applicable.

1.1.5 Cut out message and border, wherever used, shall be made out of retro-reflective sheeting (as per Clause1.12) except those in black which shall be of non-reflective sheeting.

1.1.6 Color: Unless otherwise specified the general color scheme shall be stipulated in IS:5 "Color for ready Mixed Paints."

Blue IS Color No.166: French Blue

Red IS Color No.537: Signal Red

Green IS Color No.284: Indian Green

Orange IS Color No.591: Deep Orange

The color shall be durable and uniform in acceptable but when viewed in day or under normal headlight at night.

1.1.7 **Adhesives** : The sheeting shall be either have a pressure sensitive of the aggressive tack type requiring no heat, Solvent or removable liner (removable by peeling without soaking in water or other solvent) and shall be suitable for the type material of the base plate used for the sign. The adhesive shall form a durable bond to smooth, corrosion and weather resistance surface of the base plate such that it shall be possible to remove the sheeting from the sign base in one piece by sharp instrument. In case of pressure-

sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer specification.

**1.1.8 Refurbishment:** Where existing signs are specified for the refurbishment, the sheeting shall have a semi-rigid aluminum backing pre-coated with aggressive-tack type pressure sensitive adhesive. The adhesive shall be suitable for type of material used for the sign and should thoroughly bond that material.

**1.1.9 Fabrication:**

1.1.9.1 Surface to be refectories shall be prepared to receive the retro-reflective sheeting. The smooth plain surface before the application of retro-reflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves between all cleaning and preparation operation and application of reflective sheeting/primer.

1.1.9.2 Complete sheets of the material shall be used on the signs except where it is unavoidable. At splices sheeting with pressure sensitive adhesive shall be overlapped not less be 5 mm. Sheeting with heat –activated adhesive may be spliced with an overlapped not less than 5mm or butted with gap or butted with a gap not exceeding 0.75mm. Where screen printing with transparent color is proposed, only but jointing shall be used. Cut out to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

1.1.10 Warranty Durability: For each lot of sheeting procured, the contractor shall obtain from the manufacturer a 7 Years warranty for satisfactory field performance including stipulated retro-reflectance of the sheeting of high intensity grade and 5 years warranty for the engineering grade and submit the same to the Engineer. In addition, a 7 years and a five years warranty for satisfactory in field performance of the finished sign with retro-reflective sheeting of high intensity grade and engineering grade respectively, inclusive of the screen printed or cut-out letters/legends and their bonding and their bonding to the retro-reflective to the retro-reflective sheeting shall be obtained from the contractor/supplier and passed on to the Engineer.

**1.2 Installation:**

1.2.1 Sign post their foundation and sign mounting shall be so constructed as to hold in a proper and permanent position against the normal storm wind loads or displacement by vandalism. Normally signs with an area 0.9 Sq.m. shall be mounted on a single post, and for greater area two or more supports shall be provided. Sign supports may be of mild steel, reinforced concrete or galvanized iron (G.I.).Post –end shall be firmly fixed to the ground by means of properly designed foundation. The work of foundation shall conform to relevant specification as specified.

1.2.2 All components of signs and supports, other than the reflective portion and G.I. Posts shall be thoroughly decaled, cleaned, primed concrete or G.I. Posts. After the must have been tightened, The tails of the bolts shall be painted with three coats of red lead paint.

1.2.3 The signs shall be fixed to the posts by welding in the case of steel post and by bolts and washers of suitable size in the case or reinforced concrete or G.I. Posts. After the nuts have been tightened, the tails of the bolts shall be furred over with a hammer to prevent removal.

### **1.3 Measurement for payment:**

The measurement for standard cautionary, mandatory and information sign shall be In number of different types of signs supplied and fixed as per above detail and specification.

### **1.4 Rate:**

The contract unit shall be payment in full for the cost of making the road sign. Including all material, installing it at the site and incidentals to complete the work in accordance with the specification.

**29:** Providing and fixing Junction Board made out of 2mm aluminium sheet, size 244 x 122 cms rectangle, as per the design of IRC-67-2015. Pre treated with phosphating process and acid etching coated with one coat of epoxy primer and two coats of best quality epoxy paint, reflctorized with retro reflective sheeting as per the latest M.O.S.T. specification, Letters and numerals should be as per IRC-30-1968. 3.1 Mt. long (2 nos.) stand post and frame fabricated from suitable size iron angle of 50 x 50 x 5 mm, 75 x 75 x 6 mm; painted with best quality epoxy coating in black and white bends. The details of symbol or inscription/ numerals for each board shall be as per the instruction of engineer in charge. The fixing at site shall be in 1:2:4 CC block of size 45 x 45 x 60 cms for each leg, including excavation curing etc. complete under the supervision of Engineer-In-Charge (A) Engineer grade.

### **801.1. General**

**801.1.1.** The colour, configuration, size and location of all traffic signs for highways other than Expressways shall be in accordance with the Code of Practice for Road Signs,IRC: 67 or as shown on the drawings. For Expressways, the size of the signs, letters and their placement shall be as specified in the Contract drawings and relevant Specifications. In the absence of any details or for any missing details, the signs shall be provided as directed by the Engineer.

**801.1.2.** The signs shall be reflectorized as shown on the drawings or as directed by the Engineer. When they are of reflectorized type, they shall be of retro-reflectorised type and made of encapsulated lens type reflective sheeting vide Clause 801.3, fixed over aluminium sheeting as per these Specifications.

**801.1.3.** In general, cautionary and mandatory signs shall be fabricated through process of screen printing. In regard to informatorily signs with inscriptions, either the message could be printed over the reflective sheeting, or cut letters of non-reflective black sheeting used for the purpose which must be bonded well on the base sheeting as directed by the Engineer.

## **801.2. Materials**

The various materials and fabrication of the traffic signs shall conform to the following requirements:

**801.2J. Concrete :** Concrete shall be of the grade shown on the Contract drawings or otherwise as directed by the Engineer.

**801.2.2. Reinforcing steel:** Reinforcing steel shall conform to the requirement of IS:1786 unless otherwise shown on the drawing.

**801.2.3. Bolts, nuts, washers:** High strength bolts shall conform to IS : 1367 whereas precision bolts, nuts, etc., shall conform to IS: 1364.

**801.2.4. Plates and supports:** Plates and support sections for the sign posts shall conform to IS: 226 and IS: 2062 or any other relevant IS Specifications.

**801.2.5. Aluminium:** Aluminium sheets used for sign boards shall be of smooth, hard and corrosion resistant aluminium alloy conforming to IS : 736-Material designation 24345 or 1900. 311

**801.2.6.** Signs with a maximum side dimension not exceeding 600 mm shall not be less than 1.5 mm thick. All others shall be at least 2 mm thick. The thickness of the sheet shall be related to the size of the sign and its support and shall be such that it does not bend or deform under the prevailing wind and other loads.

**801.2.7.** In respect of sign sizes not covered by IRC:67, the structural details (thickness, etc.) shall be as per the approved drawings.

## **801.3. Traffic Signs Having Retro-reflective Sheeting**

**801.3.1.** General requirements: The retro-reflective sheeting used on the sign shall consist of the white or coloured sheeting having a smooth outer surface which has the property of retro-reflection over its

entire surface. It shall be weather-resistant and show colour fastness. It shall be new and unused and shall show no evidence of cracking, scaling, pitting, blistering, edge lifting or curling and shall have negligible shrinkage or expansion. A certificate of having tested the sheeting for these properties in an unprotected outdoor exposure facing the sun for two years and its having passed these tests shall be obtained from a reputed laboratory, by the manufacturer of the sheeting. The reflective sheeting shall be either of Engineering Grade material with enclosed lens or of High Intensity Grade with encapsulated lens. The type of the sheeting to be used would depend upon the type, functional hierarchy and importance of the road.

**801.3.2.** High intensity grade sheeting: This sheeting shall be of encapsulated lens type consisting of spherical glass lens, elements adhered to a synthetic resin and encapsulated by a flexible, transparent water-proof plastic having a smooth surface. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum coefficient of retro-reflection (determined in accordance with ASTM Standard E : 810) as indicated in Table 800-1.

**TABLE 800.1. ACCEPTABLE MINIMUM COEFFICIENT OF RETRO.**

**REFLECTION FOR HIGH INTENSITY GRADE SHEETING**

| Observation Angle (In degrees) | Entrance Angle (In degrees) | White | Yellow | Orange | Green / Red | Blue |
|--------------------------------|-----------------------------|-------|--------|--------|-------------|------|
| 0.2                            | -4                          | 250   | 170    | 100    | 45          | 20   |
| 0.2                            | +30                         | 150   | 100    | 60     | 25          | 11   |
| 0.5                            | -4                          | 95    | 62     | 30     | 15          | 7.5  |
| 0.5                            | +30                         | 65    | 45     | 25     | 10          | 5.0  |

**(CANDELAS PER LUX PER SQUARE METRE)**

When totally wet, the sheeting shall not show less than 90 per cent of the values of retro reflectance indicated in Table 800-1. At the end of 7 years, the sheeting shall retain at least 75 per cent of its original retro-reflectance.

**801.3.3.** Engineering grade sheeting: This sheeting shall be of enclosed lens type consisting of microscopic lens elements embedded beneath the surface of a smooth,



flexible, transparent, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retroreflective surface after cleaning with soap and water and in dry condition shall have the minimum coefficient of retro- reflection (determined in accordance with ASTM Standard: E-S'IO) as indicated in Table SOO-2.

TABLE 800.2. ACCEPTABLE MINIMUM COEFFICIENT OF RETRO.  
REFLECTION FOR ENGINEERING GRADE SHEETING

| Observation Angle (In degrees) | Entrance Angle (In degrees) | White | Yellow | Orange | Green | Red  | Blue |
|--------------------------------|-----------------------------|-------|--------|--------|-------|------|------|
| 0.2                            | -4                          | 70    | 50     | 25     | 9.0   | 14.5 | 4.0  |
| 0.2                            | +30                         | 30    | 22     | 7.0    | 3.5   | 6.0  | 1.7  |
| 0.5                            | -4                          | 30    | 25     | 13.5   | 4.5   | 7.5  | 2.0  |
| 0.5                            | +30                         | 15    | 13     | 4.0    | 2.2   | 3.0  | 0.8  |

(CANDELAS PER LUX PER SQUARE METRE)

When totally wet, the sheeting shall not show less than 90 per cent of the values, of retro-reflection indicated in Table SOO-2. At the end of 5 years, the sheeting shall retain at least 50 per cent of its original retro-reflectance.

**801.3.4. Messages/borders:** The messages (legends, letters, numerals etC.) and borders shall either be screen-printed or of cut-outs. Screen printing shall be processed and finished with materials and in a manner specified by the sheeting manufacturer. Cut-outs shall be of materials as specified by the sheeting manufacturer and shall be bonded with the sheeting in the manner specified by the manufacturer.

**801.3.5.** For screen-printed transparent coloured areas on white sheeting, the co-efficient of retro-reflection shall not be less than 50 per cent of the values of corresponding colour in Tables SOO-I and 800-2, as applicable.

**801.3.6.** Cut-out me~sages and borders, wherever used, shall be made out of retro-reflective sheeting (as per Clause S01.3.2 or S01.3.3 as applicable), except those in black which shall be of non-reflective sheeting.

**801.3.7. Colour:** Unless otherwise specified, the general colour scheme shall be as stipulated in IS : 5 "Colour for Ready Mixed Paints", viz.

|        |   |    |        |          |              |
|--------|---|----|--------|----------|--------------|
| Blue   | - | IS | Colour | No. 166: | French Blue  |
| Red    | - | IS | Colour | No. 537: | Signal Red   |
| Green  | - | IS | Colour | No. 284: | India Green  |
| Orange | - | IS | Colour | No. 591: | Deep Orange. |

The Colours shall be durable and uniform in acceptable hue when viewed in day light or under normal headlights at night.

**801.3.8. Adhesives:** The sheeting shall, either have a pressure sensitive adhesive of the aggressive-tack type requiring no heat, solvent or other preparation for adhesion to a smooth clean surface, or a tack free adhesive activated by heat, applied in a heat-vacuum applicator, in a manner recommended by the sheeting manufacturer. The adhesive shall be protected by an easily removable liner (removable by peeling without soaking in water or other solvent) and shall be suitable for the type of material of the base plate used for the sign. The adhesive shall form a durable bond to smooth, corrosion and weather resistant surface of the base plate such that it shall not be possible to remove the sheeting from the sign base in one piece by use of sharp instrument. In case of pressure-sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer's Specifications. Sheeting with adhesives

requiring use of solvents or other preparation for adhesive shall be applied strictly in accordance with the manufacturer's instructions.

**801.3.9. Refurbishment:** Where existing signs are specified for refurbishment, the sheeting shall have a semi-rigid aluminium backing pre-coated with aggressive-tack type pressure sensitive adhesive. The adhesive shall be suitable for the type of material used for the sign and should thoroughly bond with that material..

**801.3.10. Fabrication :**

**801.3.10.1.** Surface to be reflectorized shall be effectively prepared to receive the retro-reflective sheeting. The aluminium sheeting shall be de-greased either by acid or hot alkaline etching and all scale/dust removed to obtain a smooth plain surface before the application of retroreflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves, between all cleaning and preparation operation and application of reflective sheeting/primer. There shall be no opportunity for metal to come in contact with grease, oil or other contaminants prior to the application of retro-reflective sheeting.

**801.3.10.2.** Complete sheets of the material shall be used on the signs except where it is unavoidable; at splices, sheeting with pressure sensitive adhesives shall be overlapped not

less than 5 mm. Sheeting with heat-activated adhesives may be spliced with an overlap not less than 5 mm or butted with ~ gap not exceeding 0.75 mm. Where screen printing with transparent colours is proposed, only butt jointing shall be used. The material shall cover the sign surface evenly and shall be free from twists, cracks and folds. Cut-outs to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

**801.3.11. Warranty and durability :** The Contractor shall obtain from the manufacturer a seven-year warranty for satisfactory field performance including stipulated retro-reflectance of the retro-reflective sheeting of high intensity grade and a five year warranty for the adhesive sheeting of engineering grade. and submit the same to the Engineer. In addition, a seven year and a five year warranty for satisfactory in-field performance of the furnished sign with retro-reflective sheeting of high intensity grade and engineering grade respectively, inclusive of the screen printed or cut out letters/legends and their bonding to the retio-reflective sheeting shall be obtained from the Contractor/supplier and passed on to the Engineer. The Contractor/supplier shall also furnish a certification that the signs and materials supplied against the assigned work meets all the stipulated requirements and carry the stipulated warranty.

Processed and applied in accordance with recommended procedures, the reflective material shall be weather resistant and, following cleaning, shall show no appreciable discolouration, cracking, blistering or dimensional change. and shall not have less than 50 per cent of the specified minimum reflective intensity values (Tables 800-1 and 800-2) when subjected to accelerated weathering for 1000 hours, using type E or EH Weather meter(AASHTO Designation M 268).

#### **801.4. Installation**

**801.4.1.** Sign posts, their foundations and sign mountings shall be so constructed as to hold these in a proper and permanent position against the normal storm wind loads or displacement by vandalism. Normally, signs with an area upto 0.9 sq. m. shall be mounted on a single post, and for greater area two or more supports shall be provided. Sign supports may be of mild steel, reinforced concrete or galvanised iron (G.I). Post- end(s) shall be firmly fixed to the ground by means of properly designed foundation. The work of foundation shall conform to relevant Specifications as specified.

**801.4.2.** All components of signs and supports, other than the reflective portion and OJ. posts shall be thoroughly descaled, cleaned, primed and painted with two coats of epoxy paint. Any part of mild steel

(M.S.) post below ground shall be painted with three coats of red lead paint.

**801.4.3.** The signs shall be fixed to the posts by welding in the case of steel posts and by bolts and washers of suitable size. After the nuts have been tightened, the tails of the bolts shall be furred over with a hammer to prevent removal.

**801.5. Measurements for Payment** The measurement of standard cautionary, mandatory and information signs shall be in numbers of different types of signs supplied and fixed, while for direction and place identification signs, these shall be measured by area in square metres.

**801.6. Rate** The Contract unit rate shall be payment in full for the cost of making the road sign, including all materials, installing it at the site and incidentals to complete the work in accordance with the Specifications.

**30:** Providing and fixing cautionary warning sign board made of 2mm aluminium sheet size 90X90X90 cms. Equilateral triangle as per the design of IRC-67-2015 pretreated with phosphating process & acid catching with one coat of epoxy primer and two coats of best quality epoxy paint reflectioned with retro reflective sheeting as per latest MOST specification 3.1 mt. long stand post and frame fabricated from suitable size iron angle of 35X35X3mm. 75X75X6mm as required .painted with best quality epoxy coating in black and white bands, the details of symbol for board shall be as per the instruction of engineer-in-charge. the fixing at site shall be in 1;2:4 cc block of size 45X45X60 cms for each leg including excavation curing etc. complete under the supervision of engineer in charge (high intensity grade).

This work shall consist of Providing and fixing Cautionary Sign Board and shall be carried out as per relevant detailed specification .

**31:** Box cutting the road surface to proper slope and camber for making a base for road work including removing the excavated stuff and depositing on the road side slope as directed upto 50m lead.

The sub grade / sub base / base to receive the water bound macadam course shall be prepared to the specified grade and camber and made of dust and other extraneous materials. Any nets of soft places shall be corrected in on approved manner and rolled until firm.

Cutting shall be paid on cross section area as established by the longitudinal level and cross sections for this purpose. The work shall be started after the initial longitudinal section of the ground and cross sections are taken and recorded.

The final surface shall confirm to proper profile, camber and super elevation etc. as directed by the Engineer. The earthwork shall be paid on sectional measurements, cross sectional etc. taken.

No allowance or payments shall be made for materials excavated prior to the taking of level by the Engineer.

The rate is inclusive of cutting in all soil and murrum including removal of all shrubs, jungle cutting, cutting stuff in slopes, side drain bank etc. complete.

This item also includes the clearing the sides and demarking the line as per requirement and cutting out the existing tress on the road side, not extra payment will be paid for.

At the time of preparing final bill, the road formation in embankment and cutting shall have be perfect condition true to grade, camber and side slope duly dressed and damages due to rain cuts etc. during entire working period shall have to be done by the contractor.

The work taken in length shall be completed in all respects viz. width, grades, camber, side drains, side slopes etc. and measurements for incomplete work shall not be taken otherwise.

#### 1.0 Mode of Measurement & Payment :

The unit rate box cutting shall include the cost of all materials, tools and plant required for excavation in all type of soils in grade and camber, line and levels and finishing as per direction of the Engineer-in-charge, excavation and all other incidental expenses for producing item of box cutting of specified breadth and depth and grade to complete the item or its components as shown on the drawings and according to these specifications.

The box cutting shall be measured for its cross section area and compacting volumes in cubic metres by the method of average areas.

The rate will be made on Cubic Meter basis of the finished work.

**Item no.32:** As per the detail of item and and as instructed by engineer-in-charge.

### **SCHEDULE FOR TESTING OF MATERIALS :-**

For ensuring quality control and workmanship Various tests prescribed below for materials shall be taken at periodical intervals as stipulated below. The materials shall be got tested at Government recognized Laboratory (R&B) or field Laboratory of GERI (R&B) for which 1% of the estimated amount put to tender shall be recovered from the contractor from the RA bills and final bills and the testing charges shall be paid to the GERI by the Government . However if the charges increase over 1% no excess recovery shall be made from the contractor as per resolution of B & C department dated 10th May 1985 vide TNC/ 1085/ (4)/ S

| It. No. as per schedule "B" | Brief description of materials to be tested | Qty of material | Prescription of test which shall be carried out                  | Frequency at which test shall be carried out  | Total No of test to be taken. |
|-----------------------------|---|-----------------|--|---|-------------------------------|
| 1]                          | Coarse Aggregate                            |                 | - Gradation test<br>- Impact value<br>- Flakiness and elongation | 1 to 100 cm      1 test<br>100 to 500 cm      3 test<br>500 to 1500 cm      5 test<br>1500 to 5000 cm      7 test<br><br>Minimum 1 test/ work |                               |
| 2]                          | Grit  |                 | - Stripping value  | As above  |                               |
| 3]                          | Granular materials                          |                 | - Gradation<br>- Atterbeg limits                                 | As above  |                               |
| 4]                          | Murum                                       |                 | - P I Value  | One test per 50 cum.  |                               |
| 5]                          | Sand/ quarry spall                          |                 | - Silt content<br>- Gradation<br>- CBR test                      | One test per work/ season<br><br>One test per 200 cmt.<br><br>One test per work   |                               |
| 6]                          | Asphalt                                     |                 | 1 Penetration test as per IS                                     | 1 to 10 tanker      1 test  |                               |

|    |          |  |  |   |        |  |
|----|----------|--|--|---|--------|--|
|    |          |  | 1203                                     | 11 to 20 tanker   | 2 test |  |
|    |          |  | 2 Ductility test as per IS 1208          | 21 to 50 "  | 3 test |  |
|    |          |  | 3 Specific gravity test as per IS 1202   | 51 to 100 "   | 4 test |  |
|    |          |  | 4 Softening point test as per IS 1204    | Remaining every 50"                                     | 1 test |  |
|    |          |  | 5 Viscosity test as per IS 1206          |   |        |  |
| 7] | Cement   |  | - Consistency                            | Up to 50 MT   | 1 test |  |
|    |          |  | - Setting time                           | 100 MT  | 2 test |  |
|    |          |  | - Compressive strength                   | 200 MT  | 3 test |  |
|    |          |  | - Fineness                               | 300 MT  | 4 test |  |
|    |          |  | - Chemical analysis                      | 500 MT  | 5 test |  |
|    |          |  | - Soundness                              | 800 MT  | 6 test |  |
|    |          |  |  | 1300 MT   | 7 test |  |
|    |          |  |  | and 8 test for larger consignment                       |        |  |
| 8] | CC Cubes |  | - Compressive Strength (I.S. 519 – 1959) | 1 to 5 cms  | 1 No   |  |
|    |          |  |  | 6 to 15 cms   | 2 No   |  |
|    |          |  |  | 16 to 20 cms  | 3 No   |  |
|    |          |  |  | 21 to 50 cms  | 4 No   |  |
|    |          |  |  | 51 and above  | 4 + 1  |  |
|    |          |  |  | (For each additional 50 m <sup>3</sup> or part thereof) |        |  |

|     |                                       |  |   |   |  |
|-----|---------------------------------------|--|---|---|--|
| 9]  | Water                                 |  | - Chemical test   | Once for approval of source of supply   |  |
| 10] | Steel                                 |  | - Tensile Strength<br>- Yield Stress<br>- Elongation<br>- Size                            | 1 test/ 40 tonnes/ per category   |  |
| 11] | Bricks                                |  | - Water absorption<br>- Efflorence<br>- Size<br>- Compressive Strength                    | 1 test per 50,000 bricks  |  |
| 12] | Prime coat/<br>Tack coat              |  | - Quality of binder<br>- Binder temperature for application<br>- Rate of spread of binder | Number of samples per lot and test as per IS:73<br><br>At regular close intervals<br><br>Two test per 500 m <sup>2</sup> and not less than two test per day   |  |
| 13] | Carpet and Seal coat mix/ B.M/ M.S.S. |  | - Quality of binder<br>- Grading<br><br>- Temperature of binder                           | Number of samples per lot and test as per IS:73<br><br>1 test on individual contents and mix aggregate from the dryer for each 100 tonnes of mix subject to minimum of two test per plant per day<br><br>At regular close intervals |  |



- Binder content One test for each 100 vide 45 IMD tonnes of mix subject to 2172 mini. of Two per day
- Rate of spread Regular control through of mix materials checks on layer thickness

|     |                   |  |  |   |  |
|-----|-------------------|--|--|---|--|
| 14] | Granular Sub-base |  | <ul style="list-style-type: none"> <li>- Gradation</li> <li>- Atterberg limits</li> <li>- Moisture content prior to compaction</li> <li>- Density of compacted layer</li> <li>- Deleterious constituents</li> <li>- C.B.R.</li> </ul>                      | <p>As mentioned under serial number 3</p> <p>As mentioned under serial number 3</p> <p>As mentioned under serial number 3</p> <p>One test per 500 m<sup>2</sup></p> <p>As required</p> <p>As required</p>     |  |
| 15] | Wet Mix Macadam   |  | <ul style="list-style-type: none"> <li>- Aggregate Impact Value</li> <li>- Grading</li> <li>- Flakiness and Elongation Index</li> <li>- Atterberg limits of portion of aggregate passing 425 micron sieve</li> <li>- Density of compacted layer</li> </ul> | <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 3</p> <p>One test per 500 m<sup>2</sup></p> |  |

|     |                     |  |  |  |  |
|-----|---------------------|--|--|--|--|
| 16] | Water Bound Macadam |  | <ul style="list-style-type: none"> <li>- Aggregate Impact Value</li> <li>- Grading</li> <li>- Flakiness Index and Elongation index</li> <li>- Atterberg limits of binding material</li> <li>- Atterberg limits of portion of aggregate passing 425 micron sieve</li> </ul> | <p>As mentioned under serial number 1</p> <p>As mentioned under serial No.1 As mentioned under serial number 1</p> <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 1</p>   |  |
| 17] | Earthwork           |  | <ul style="list-style-type: none"> <li>- Sand Content [IS: 2720 (Part-4)]</li> <li>- Plasticity Test [IS:2720 (Part-5)]</li> <li>- Density Test [IS:2720 (Part-8)]</li> <li>- Moisture Content Test [IS :2720 (Part-2) ]</li> <li>- CBR Test</li> </ul>                    | <p>2 tests per 3000 cubic metres of soil</p> <p>2 tests per 3000 cub. metres of soil.</p> <p>2 tests per 3000 cubic metres of soil.</p> <p>One test for every 250 cubic metres of soil.</p> <p>One CBR test for every 3000 cum. at least or closer as and when required by the Engineer.</p> |  |

The Number of tests will be as per Manual of quality control or latest Govt. G.R./Circular and it will be considered final

The contractor shall have to pay 1% of the estimated cost put to tender towards all testing of materials and the same shall be deducted from their bills for the works.

Testing charges of GERI shall be borne by Govt. No refund be made nor extra charges over 1% shall be recoverable from the contractor.

If directed by the Engineer in charge, the materials intended to be used for the work but not included in the above schedule shall also be got tested at Government recognized Laboratory or field Laboratory.

Executive Engineer

Signature of contractor

**FOR SCHEDULE “B”**

**Item no. 01:** Marking out the centre line of the bridge and various other component structures and complete lining out and levelling with theodolite levels including constructing necessary masonry pillars for lines and levels and establishing necessary bench marks etc. as directed.

The Centre line axis of the Rail Over Bridge with approaches shall be surveyed along their lengths. Centre line pegs for Rail Over Bridge with approaches including foundation pegs at each location and at suitable distance of 3.0 m c/c along the approach on each side shall be fixed.

All deviation angles of the central line axis for the Rail Over Bridge with approaches including tangent distances shall be demarcated with pegs fixed in to the ground.

The rate on Lump sum basis shall include all equipment/theodolite/total station survey instruments, necessary survey party, supply and fixing of pegs including, fixing of pillars for intermediate stations labour, materials required in completing the job as required, as per direction of Engineer-in-charge.

The rate shall be paid on lump sum basis for completed item as directed.

**Item no. 02:** Earth work for embankment including breaking clods dressing with all lead and lift and including watering, rolling, and consolidation of sub-grade in layers at O.MC. to required dry density including filling the depressing which occur during the process using

Vibratory roller 8.T. to 10 T (from borrow area within 5 km lead).

Work shall be carried out as per specification/condition as per clause No.2.3 of TECHNICAL SPECIFICATION of the Tender Document.

Mode of measurement shall be as per Para 2.3.28 TECHNICAL SPECIFICATION of the Tender Document.

**Item no. 03:** Providing and laying controlled cement concrete M 35 for R.C.C. bored piles of 1.20 M dia. including ramming, vibrating and finishing, Excluding T.M.T Reinforcement complete.

**1701.** The work shall consist of furnishing and placing structural concrete and incidental construction in accordance with these specifications and in conformity with the lines, grades and dimensions, as shown -on the drawings or as directed by the Engineer.

#### **1702. MATERIALS**

All materials shall conform to Section 1000 of MORT&H Specifications.

#### **1703 GRADES OF CONCRETE**

The grades of concrete shall be designated by the characteristic strength as given in Table 1700-1 , where the characteristic strength is defined as the strength of concrete below which not more than 5 per cent of the test results are expected to fall.

**TABLE 1700-1.**

| Grade Designation | characteristic Compressive strength of 150 mm cubes at 28 days, In MPa |
|-------------------|--|
| M 15              | 15   |
| M 20              | 20   |
| M 25              | 25   |
| M 30              | 30   |
| M 35              | 35   |
| M 40              | 40   |

|      |    |
|------|----|
| M 45 | 45 |
| M 50 | 50 |
| M 55 | 55 |

- 1.** Nominal Mix Concrete is made on the basis of nominal mix proportioned by weight of its main ingredients – cement, coarse and fine aggregates and water.
- 2.** Standard concrete is made on the basis of design mix proportioned by weight of its ingredients, which in addition to cement, aggregates and water, may contain chemical admixtures to achieve certain target values of various properties in fresh condition, achievement of which is monitored and controlled during production by suitable tests. Generally, concrete of grades up to M50 are included in this type.
- 3.** High Performance Concrete is similar to standard concrete but contains additional one or more mineral admixtures providing binding characteristics and partly acting as inert filler material which increases its strength, reduces its porosity and modifies its other properties in fresh as well as hardened condition. Concrete of grades upto M90 are included in this type.
- 4.** For concrete of grades higher than M90, the design parameters may be obtained from specialized literature and experimental results.

**1703.2** The minimum grades of concrete and corresponding minimum cement content and maximum water/cement ratios for different exposure conditions shall be as indicated in Table 1700-2.

**1703.3** For concrete subjected to sulphate attack the minimum grades of concrete, minimum cement content and maximum water/cement ratios and types of cement for different concentration of sulphate content shall be as indicated in Table 1700-3.

**Table 1700-2 : Requirement of Concrete for Different Exposure Condition**  
**Using 20mm Aggregate**

| Exposure Condition | Maximum Water<br>Cement Ratio | Minimum Cement<br>Content, kg/m <sup>3</sup> | Minimum Grade of<br>Concrete |
|--------------------|-------------------------------|--|------------------------------|
| Moderate           | 0.45                          | 340  | M25                          |
| Server             | 0.45                          | 360  | M30                          |
| Very Server        | 0.40                          | 380  | M40                          |

**Note:**

- (i) All three provisions given in the above table for a particular exposure condition, shall be satisfied.
- (ii) The term cement for maximum w/c ratio and minimum cement content shown in Table includes all cementitious materials mentioned in Clause 1715.2. The maximum limit of flyash and ground granulated blast furnace slag in the blended cement shall be as specified in IS:1489(Part 1) and IS:455 respectively.
- (iii) For plain cement concrete, with or without surface reinforcement, the minimum grade of concrete can be lowered by 5MPa and maximum water/cement ratio exceeded by 0.05.

Cement content shown in the above table shall be increased by 40 kg/m<sup>3</sup> for use of 12.50 mm nominal size aggregates and decreased by 30 kg/m<sup>3</sup> for use of 40mm nominal size aggregates.

**1704. PROPORTIONING OF CONCRETE**

Prior to the start of construction, the Contractor shall design the mix in case and submit to the Engineer for approval, the proportions of materials, including admixtures to be used. Water-reducing admixtures (including plasticizers or super-plasticizers) may be used at the Contractor's option, subject to the approval of the Engineer. Other types of admixtures shall be prohibited, unless specifically permitted by the Engineer.

**1704.1. Requirements of Consistency**

The mix shall have the consistency which will allow proper placement and consolidation in the required position. Every attempt shall be made to obtain uniform consistency.

The optimum consistency for various types of structures shall be as indicated in Table 1700-4. or as directed by the Engineer. The slump of concrete shall be checked as per IS:516.

**TABLE 1700-4.**

| TYPE   | SLUMP (mm) |
|--|------------|
| (a) Structures with exposed inclined surface requiring low slump concrete to allow proper compaction<br><br>(b) plain cement concrete                                      | 10 - 25    |
| 2. RCC structures with widely spaced reinforcements; e.g. solid columns, piers, abutments, footings, well iteming  | 40 - 50    |
| 3. RCC structures with fair degree of congestion of reinforcement; e.g. pier and abutment caps, box culverts well curb, well cap, walls with thickness greater than 300 mm | 50 - 75    |
| 4. RCC and PSC structures with highly congested reinforcements e.g. deck slab girder:, box girders, walls with thickness less than 300 mm                                  | 75 - 125   |
| 5. Underwater concreting through tremie 200<br><br>e.g. bottom plug, cast-in-situ piling.  | 150 - 200  |

## **1704.2. Requirements for Designed Mixes**

### **1704.2.1. Target mean strength**

The target mean strength of specimen shall exceed the specified characteristic compressive strength by at least the “current margin”.

- (i.) The current margin for a concrete mix shall be determined by the Contractor and shall be taken as 1.64 times the standard deviation of sample test results taken from at least 40 separate batches of concrete of nominally similar proportions produced at site by the same plant under similar supervision, over a period exceeding 5 days, but not exceeding 6 months.
- (ii.) Where there is insufficient data to satisfy the above, the current margin for the initial design mix shall be taken as given in Table 1700-5 :

**TABLE 1700-5.**

| Concrete Grade | Current Margin<br>(MPa) | Mean Strength<br>(MPa) |
|----------------|-------------------------|------------------------|
| M 15           | 10                      | 25                     |
| M 20           | 10                      | 30                     |
| M 25           | 11                      | 36                     |
| M 30           | 12                      | 42                     |
| M 35           | 12                      | 47                     |
| M 40           | 12                      | 52                     |
| M 45           | 13                      | 58                     |
| M 50           | 13                      | 63                     |
| M 55           | 14                      | 69                     |

The initial current margin given in the Table 1700-5 shall be used till sufficient data is available to determine the current margin as per sub-clause (i) above

#### **1704.2.2. Trial mixes**



The Contractor shall give notice to enable the Engineer to be present at the making of trial mixes and preliminary testing of the cubes. The Contractor shall prepare trial mixes, using samples of approved materials typical of those he proposes to use in the works, for all grades to the Engineer's satisfaction prior to commencement of concreting. The initial trial mixes shall generally be carried out in an established laboratory approved by the Engineer. In exceptional cases, the Engineer may permit the initial trial mixes to be prepared at the site laboratory of the Contractor, if a full-fledged concrete laboratory has been established well before the start of construction, to his entire satisfaction. In all cases complete testing of materials forming the constituents of proposed Design Mix shall have been carried out prior to making trial mixes.

Sampling and testing procedures shall be in accordance with these specifications.

When the site laboratory is utilized for preparing initial mix design, the concreting plant and means of transport employed to make the trial mixes shall be similar to that proposed to be used in the works.

Test cubes shall be taken from trial mixes as follows. For each mix, set of six cubes shall be made from each of three consecutive batches. Three cubes from each set of six shall be tested at an age of 28 days and three at an earlier age approved by the Engineer. The cubes shall be made, cured, stored, transported and tested in accordance with these specifications. The average strength of the nine cubes at 28 days shall exceed the specified characteristic strength by the current margin minus 3.5 MPa.

### **1704.2.3. Control of strength of design mixes**

#### **(a) Adjustment to Mix Proportions**

Adjustments to mix proportions arrived at in the trial mixes shall be made subject to the Engineer's approval, in order to minimize the variability of strength and to maintain the target mean strength. Such adjustments shall not be taken to imply any change in the current margin.

#### **(b) Change of Current Margin**

When required by the Engineer, the Contractor shall recalculate the current margin in accordance with Clause 1704.2.1. The recalculated value shall be adopted as directed by the Engineer, and it shall become the current margin for concrete produced subsequently.

#### **(c) Additional Trial Mixes**

During production, the Contractor shall carry out trial mixes and tests, if required by the Engineer, before substantial changes are made in the material or in the proportions of the materials to be used, except when adjustments to the mix proportions are carried out in accordance with sub-clause (a) above.

#### **1704.4. Additional Requirements**

Concrete shall meet with any other requirements as specified on the drawing or as directed by the Engineer. Additional requirements shall also consist of the following Overall limits of deleterious substances in concrete:

(a) The total chloride content of all constituents of concrete as a percentage of mass of cement in mix shall be limited to values given below:

- Prestressed Concrete : 0.1 per cent
- Reinforced concrete exposed to chlorides in service : 0.2 per cent  
(e.g. structures located near Sea coast)
- Other reinforced concrete construction : 0.3 per cent

The total sulphuric anhydride ( $\text{SO}_4$ ) content of all the constituents of concrete as a percentage of mass cement in the mix shall be limited to 4 per cent.

#### **1740.5. Suitability of Proposed Mix Proportions**

The Contractor shall submit the following information for the Engineer's approval

- (a) Nature and source of each material
- (b) Quantities of each material per cubic meter of fully compacted concrete
- (c) Either of the following :
  - i) appropriate existing data as evidence of satisfactory previous performance for the target mean strength, current margin, consistency and water/cement ratio and any other additional requirements) as specified
  - ii) Full details of tests on trial mixes.
  - iii) Statement giving the proposed mix proportions for nominal mix concrete.

Any change in the source of material or in the mix proportions shall be subject to the Engineer's prior approval.

#### **1705. ADMIXTURES**

Use of admixtures such as super plasticizers for concrete may be made with the approval of the Engineer.

As the selection of an appropriate concrete admixture is an integral part of the mix design, the manufacturers shall recommend the use of any one of his products only after obtaining complete knowledge of all the actual constituents of concrete as well as methodologies of manufacture, transportation and compaction of concrete proposed to be used in the project

#### **1706. SIZE OF COARSE AGGREGATE**

The size (maximum nominal) of coarse aggregates for concrete to used in various components shall be given as Table 1700-7.

**TABLE 1700-7.**

| Description  | Nominal Size of Coarse Aggregate (mm) |
|--|---------------------------------------|
| RCC well curb  | 20                                    |
| RCC/PCC well steining  | 40                                    |
| Well cap or Pile Cap   | 40                                    |
| Solid type piers and abutments   | 40                                    |
| RCC work in girders, slabs, wearing coat, kerb, approach slab, hollow piers and abutments, pier/abutment caps, piles | 20                                    |
| PSC work   | 20                                    |
| Any other item   | As specified by Engineer              |

Maximum nominal size of aggregates shall also be restricted to the smaller of the following values :

- (a) 10 mm less than the minimum lateral clear distance between main reinforcements
- (b) 10 mm less than the minimum clear cover to the reinforcements

The proportions of the various individual size of aggregates shall be so adjusted that the grading produces densest mix and the grading curve corresponds to the maximum nominal size adopted for the concrete mix.

**1707. EQUIPMENT**

Unless specified otherwise, equipment for production, transportation and compaction of concrete shall be as under:

(a) For Production of Concrete:

- (i) Concrete batching and mixing plant fully automatic with minimum capacity of 15 cu.m. Per hour.

All measuring devices of the equipment shall be maintained in a clean and serviceable condition. Its accuracy shall be checked over the range in use, when set up at each site and thereafter periodically as directed by the Engineer.

The accuracy of the measuring devices shall fall within the following limits:

|  |  |
|--|--|
| Measurement of Cement  | $\pm 3$ per cent of the quantity of cement in each batch                                 |
| Measurement of Water   | $\pm 3$ per cent of the quantity of water in each batch                                  |
| Measurement of Aggregate   | $\pm 3$ per cent of the quantity of aggregate in each batch                              |
| Measurement of Admixture   | $\pm 5$ per cent of the quantity of admixture in each batch                              |
| For Concrete Transportation<br>Powered hoists,<br>Chutes<br>Buckets handled by cranes<br>Transit truck mixer<br>Concrete pump<br>Concrete distributor booms<br>Belt-conveyor<br>Cranes with skips<br>Tremies | : depending upon actual requirement minimum 2 tonnes capacity minimum 0.5 tonne capacity |
| For Compaction of Concrete :<br>i) Internal vibrators<br>ii) Form vibrators<br>iii) Screed vibrators   | size 25 mm to 70 mm minimum 500 watts full width of carriageway (upto two lanes)         |

**1708. MIXING CONCRETE**

Concrete shall be mixed in a concrete batching and mixing plant, as per these specifications. Hand mixing shall not be permitted. The mixer or the plant shall be at an approved location considering the properties of the mixes and the transportation arrangements available with the Contractor. The mixer or the plant shall be approved by the Engineer.

Mixing shall be continued till materials are uniformly distributed and a uniform colour of the entire mass is obtained, and each individual particle of the coarse aggregate shows complete coating of mortar containing its proportionate amount of cement. In no case shall mixing be done for less than 2 minutes.

Mixers which have been out of use for more than 30 minutes shall be thoroughly cleaned before putting in a new batch. Unless otherwise agreed to by the Engineer, the first batch of concrete from the mixer shall contain only two thirds of the normal quantity of coarse aggregate. Mixing plant shall be thoroughly cleaned before changing from one type of cement to another.

**1709. TRANSPORTING, PLACING AND COMPACTION OF CONCRETE**

The method of transporting and placing concrete shall be approved by the Engineer. Concrete shall be transported and placed as near as practicable to its final position, so that no contamination, segregation or loss of its constituent materials takes place. Concrete shall not be freely (bopped into place from a height exceeding 1.5 metres.

When concrete is conveyed by chute, the plant shall be of such size and design as to ensure practically continuous flow. Slope of the chute shall be so adjusted that the concrete flows without the use of excessive quantity of water and without any segregation of its ingredients. The delivery end of the chute shall be as close as possible to the point of deposit. The chute shall be thoroughly flushed with water before and after each working period and the water used for this purpose shall be discharged outside the formwork.

All formwork and reinforcement contained in it shall be cleaned and made free from standing water, dust, snow or ice immediately before placing of concrete.

No concrete shall be placed in any part of the structure until the approval of the Engineer has been obtained.

If concreting is not started within 24 hours of the approval being given, it shall have to be obtained again from the Engineer. Concreting then shall proceed continuously over the area between the construction joints. Fresh concrete shall not be placed against concrete

which has been in position for more than 30 minutes unless a proper construction joint is formed.

Except where otherwise agreed to by the Engineer, concrete shall be deposited in horizontal layers to a compacted depth of not more than 450 mm when internal vibrators are used and not exceeding 300 mm in all other cases.

Concrete when deposited shall have a temperature of not less than 5 degrees Celsius, and not more than 40 degrees Celsius. It shall be compacted in its final position within 30 minutes of its discharge from the mixer, unless carried in properly designed agitators, operating continuously, when this time shall be within 1 hour of the addition of cement to the mix and within 30 minutes of its discharge from the agitator. It may be necessary to add retarding admixtures to concrete if trials show that the periods indicated above are unacceptable. In all such matters, the Engineer's decision shall be final.

Concrete shall be thoroughly compacted by vibration or other means during placing and worked around the reinforcement, tendons or duct formers, embedded fixtures and into corners of the formwork to produce a dense homogeneous void-free mass having the required surface finish. When vibrators are used, vibration shall be done continuously during the placing of each batch of concrete until the expulsion of air has practically ceased and in a manner that does not promote segregation. Over vibration shall be avoided to minimise the risk of forming a weak surface layer. When external vibrators are used, the design of formwork and disposition of vibrator shall be such as to ensure efficient compaction and to avoid surface blemishes. Vibrations shall not be applied through reinforcement and where vibrators of immersion type are used, contact with reinforcement and all inserts like ducts etc. shall be avoided. The internal vibrators shall be inserted in an orderly manner and the distance between insertions should be about one and a half times the radius of the area visibly affected by vibration. Additional vibrators in serviceable condition shall be kept at site so that they can be used in the event of breakdowns.

Mechanical vibrators used shall comply with IS:2502, IS:2506, IS:2514 and IS:4656.

#### **1710. CONSTRUCTION JOINTS**

Construction joints shall be avoided as far as possible and in no case the locations of such joints shall be changed or increased from those shown on the drawings, except with express approval of the Engineer. The joints shall be provided in a direction perpendicular to the member axis.

Location, preparation of surface and concreting of construction joints shall conform to the additional specifications given in *Appendix 170011 of MORT&H*

**1711. CONCRETING UNDER WATER**

When it is necessary to deposit concrete under water, the methods, equipment, materials and proportions of mix to be used shall be got approved from the Engineer before any work is started. Concrete shall contain 10 per cent more cement than that required for the same, mix placed in the dry.

Concrete shall not be placed in water having a temperature below 5 degrees Celsius. The temperature of the concrete, when deposited, shall not be less than 16 degrees Celsius, nor more than 40 degrees Celsius.

Coffer dams or forms shall be sufficiently tight to ensure still water conditions, if practicable, and in any case to reduce the flow of water to less than 3 metres per minute through the space into which concrete is to be deposited. Coffer dams or forms in still water shall be sufficiently tight to prevent loss of mortar through the joints in the walls. Pumping shall not be done while concrete is being placed, or until 24 hours thereafter. To minimize the formation of laitance, great care shall be exercised not to disturb the concrete as far as possible while it is being deposited.

All under water concreting shall be carried out by tremie method only, using tremie of appropriate diameter. The number and spacing of the tremies should be worked out to ensure proper concreting. The tremie concreting when started should continue without interruption for the full height of the member being concreted. The concrete production and placement equipment should be sufficient to enable the underwater concrete to be completed uninterrupted within the stipulated time. Necessary stand-by equipment should be available for emergency situation.

The top section of the tremie shall have a hopper large enough to hold one full batch of the mix or the entire contents of the transporting bucket as the case may be. The tremie pipe shall not be less than 200 mm in diameter and shall be large enough to allow a free flow of concrete and strong enough to withstand the external pressure of the water in which it is suspended, even if a partial vacuum develops inside the pipe. Preferably, flanged steel pipe of adequate strength for the job shall be used. A separate lifting device shall be provided for each tremie pipe with its hopper at the upper end. Unless the lower end of the pipe is equipped with an approved automatic check valve, the upper end of the pipe shall be plugged with a wadding of gunny sacking or other approved material before delivering the concrete to the tremie pipe through the hopper, so that when the concrete is forced down from the hopper to the pipe, it will force the plug (and along with it any water in the pipe) down the pipe and out of the bottom end, thus establishing a continuous stream of concrete. It will be necessary to raise slowly the tremie *in* order to allow a uniform flow of concrete, but it shall not be emptied so that water is not allowed to enter above the concrete in the pipe. At all times after placing of concrete is started and until all

the required quantity has been placed, the lower end of the tremie pipe shall be kept below the surface of the plastic concrete. This will cause the concrete to build up from below instead of flowing out over the surface and thus avoid formation of layers of laitance. If the charge in the tremie is lost while depositing, the tremie shall be raised above the concrete surface and unless sealed by a check valve, it shall be replugged at the top end, as at the beginning, before refilling for depositing further concrete.

For concreting of RCC bored piles, the bores shall be washed by bentonite flushing to ensure clean bottom at two stages viz. after completion of boring and prior to concreting after placing of reinforcement cage. Flushing of bentonite shall be done continuously with fresh bentonite slurry till the consistency of inflowing and out-flowing slurry is similar.

Wherever practicable, concrete should be placed in a clean dry hole. Where concrete is placed in dry and there is casing present, the top 3 m of the pile shall be compacted using internal vibrators. The concrete shall invariably be poured through a tremie with a funnel so that the flow is directed and concrete can be deposited in the hole without segregation.

Care shall be taken during concreting to prevent as far as possible the segregation of the ingredients. The displacement or distortion of reinforcement during concreting shall be avoided.

The concrete shall be properly graded, shall be self-compacting and shall not get mixed with soil, excess water, or other extraneous matter. Special care shall be taken in silty clays and other soils with the tendency to squeeze into the newly deposited concrete and cause necking. Sufficient head of green concrete shall be maintained to prevent inflow of soil or water into the concrete.

The placing of concrete shall be a continuous process from the toe level to the top of the pile. To prevent segregation, a tube or tremie pipe as appropriate shall be used to place concrete in all piles.

To ensure compaction by hydraulic static heads, rate of placing concrete in the pile shaft shall not be less than 6 m (length of pile) per hour.

The diameter of the finished pile shall not be less than that specified and a continuous record shall be kept by the Engineer as to the volume of concrete placed in relation to the pile length cast.

Before concreting under water, the bottom of the hole shall be cleaned of drilling mud and all soft or loose material very carefully. In case a hole is bored with use of drilling mud, concreting should not be taken up when the specific gravity of bottom slurry is more than 1.2. the drilling mud should be maintained at 1.5 m above the ground water level.



Concreting under water for cast-in-situ concrete piles may be done either with the use of tremie method or by the use of an approved method specially designed to permit under placement of concrete.

General requirements and precautions for concreting under water are as follows :

- (a) The concreting of a pile must be completed in one continuous operation. Also, for bored holes, the finishing of the bore, cleaning of the bore, lowering of reinforcement cage and concreting of pile for full height must be accomplished in one continuous operation without any stoppage.
- (b) The concrete should be coherent, rich in cement with high slump and restricted water cement ratio.
- (c )The tremie pipe will have to be large enough with due regard to the size of aggregate. For 20 mm aggregate the tremie pipe should be of diameter not less than 150 mm and for larger aggregate, larger tremie pips may be necessary.
- (d)The first charge of concrete should be placed with a sliding plug pushed down the tube ahead of it to prevent mixing of water and concrete.
- (e)The tremie pipe should always penetrate well into the concrete with an adequate margin of safety against accidental withdrawal if the pipe is surged to discharge the concrete.
- (f)The tremie shall be water-tight throughout its length and have a hopper attached at its head by a water-tight connection.
- (g)The tremie pipe shall be lowered to the bottom of the bore-hole, allowing water of drilling mud to rise inside it before pouring concrete.
- (h)The pile should be concreted wholly by tremie and the method of deposition should not be changed part way up the pile to prevent the laitance from being entrapped within the pile.
- (i) All tremie tubes should be scrupulously cleaned after use.

The minimum embedment of cast-in-situ concrete piles into pile cap shall be 150 mm. Any defective concrete at the head of the completed pile shall be cut away and made good with new concrete. The clear cover between the bottom reinforcement in pile cap from the top of the pile shall be not less than 25 mm. The reinforcement in the pile shall be exposed for full anchorage length to permit it to be adequately bonded into the pile cap. Exposing such length shall be done carefully to avoid damaging the rest of the pile.

Concrete in piles shall be cast upto a minimum height of 600 mm above the designed top level of pile, which shall be stripped off at the time of construction of pile cap.

**TOLERANCES****Permissible Tolerances for Pile**

Bored piles

|   |  |       |
|---|--|-------|
| Variation in cross-sectional dimensions             |  | 10 mm |
| Variation from vertical or specified rake           |  |       |
| Variation in the final position of the head in plan |  |       |
| Variation of level of top piles                     |  |       |

**1716. TESTS AND STANDARDS OF ACCEPTANCE**

**1716.1.** Concrete shall conform to the surface finish and tolerance as prescribed in these specifications for respective components.

**1716.2.** Random sampling and lot by lot of acceptance inspection shall be made for the 28 days cube strength of concrete.

**1716.2.1.** Concrete under acceptance shall be notionally divided into lots for the purpose of sampling, before commencement of work. The delimitation of lots shall be determined by the following:

No individual lot shall be more than 30 cu.m. in volume

At least one cube forming an item of the sample representing the lot shall be taken from concrete of the same grade and mix proportions cast on any day.

Different grades of mixes of concrete shall be divided into separate lots.

Concrete of a lot shall be used in the same identifiable component of the bridge

**1716.2.2. Sampling and testing**

1. Concrete for making 3 test cubes shall be taken from a batch of concrete at point of delivery into construction, according to procedure laid down in IS: 1199.

2.A random sampling procedure to ensure that each of the concrete batches forming the lot under acceptance inspection has equal chance of being chosen for taking cubes shall be adopted.

3. 150 mm cubes shall be made, cured and tested at the age of 28 days for compressive strength in accordance with IS:516. The 28-day test strength result for each cube shall form an item of the sample.

**1716.2.3. Test specimen and sample strength :** Three test specimens shall be made from each sample for testing at 28 days. Additional cubes may be required for various purposes such as to determine the strength of concrete at 7 days or for any other purpose.

The test strength of the sample shall be the average of the strength of 3 cubes. The individual variation should not be more than  $\pm 15$  per cent of the average.

**1716.2.4. Frequency :** The minimum frequency of sampling of concrete of each grade shall be in accordance with Table 1700-8

**TABLE 1700-8**

| Quantity of Concrete In work, m <sup>3</sup> | No. of samples   |
|--|--|
| 1 – 5  | 1  |
| 6 – 15                                       | 2  |
| 16 – 30                                      | 3  |
| 31-50  | 4  |
| 51 and above                                 | 4 plus one additional sample for each additional 50 m <sup>3</sup> or part thereof |

At least one sample shall be taken from each shift of work.

#### **1716.2.5. Acceptance criteria**

##### **Compressive Strength**

When both the following conditions are met, the concrete complies with the specified compressive strength:

- (a) The mean strength determined from any group of four consecutive samples should exceed the specified characteristic compressive strength.
- (b) Strength of any sample is not less than the specified characteristic compressive strength minus 3 MPa.

The quantity of concrete represented by the test results include the batches from which the first and last samples were taken, together with all intervening batches.

### **Chloride and Sulphate Content**

The total chloride and sulphuric anhydride ( $\text{SO}_3$ ) content of all the constituents of concrete as a percentage of mass of cement in the mix shall not exceed the values given in this section of the specifications.

#### **1716.3. Density of Fresh Concrete**

Where minimum density of fresh concrete is specified, the mean of any four consecutive samples shall not be less than the specified value and any individual sample result shall not be less than 97.5 per cent of the specified value.

**1716.4. Density of Hardened Concrete :-** Where minimum density of hardened concrete is specified, the mean of any four consecutive samples shall not be less than the specified value and any individual sample result shall not be less than 97.5 per cent of the specified value.

#### **1716.5. Permeability Test**

The concrete should pass the following test if it is properly compacted and is not considered permeable.

- (a) Prepare a cylindrical test specimen 150 mm dia and 160 mm high
- (b) After 28 days of curing, the test specimen is fitted in a machine such that the specimen can be placed in water under pressure upto 7 bars. A typical machine is shown in *Appendix 1700 III*.
- (c) At first a pressure of one bar is applied for 48 hours, followed by 3 bars for 24 hours and 7 bars for next 24 hours.

(d) After the passage of the above period, the specimen is taken out and split in the middle by compression applied on two round bars on opposite sides above and below.

(e) The water penetration in the broken core is to be measured with a scale and the depth of penetration assessed in mm (max. permissible limit 25 mm).

**1716.6.** If the concrete is not able to meet any of the standards of acceptance as prescribed, the effect of such deficiency on the structure shall be investigated by the Contractor as directed by the Engineer. The Engineer may accept the concrete as sub-standard work. Any additional work required by the Engineer for such acceptance shall be carried out by the Contractor at his cost. In case the concrete is not found to be acceptable after investigation, the Contractor shall remove the rejected concrete forthwith.

#### **1501. Form work**

Formwork shall include all temporary or permanent forms required for forming the concrete of the shape, dimensions and surface finish as shown on the drawing or as directed by the Engineer, together with all props, staging, centering, scaffolding and temporary construction required for their support. The design, erection and removal of formwork shall conform to IRC:87 "Guidelines for Design and Erection of Falsework for Road Bridges" and these specifications.

#### **1502. MATERIALS FOR FORM WORK**

All materials shall comply with the requirements of IRC:87. Materials and components used for formwork shall be examined for damage or excessive deterioration before use / re-use and shall be used only if found suitable after necessary repairs. In case of timber formwork, the inspection shall not only cover physical damages but also signs of attacks by decay, rot or insect attack or the development of splits.

Forms shall be constructed with metal or timber. The metal used for forms shall be of such thickness that the forms remain true to shape. All bolts should be countersunk. The use of approved internal steel ties or steel or plastic spacers shall be permitted. Structural steel tubes used as support for forms shall have a minimum wall thickness of 4 mm. Other

materials conforming to the requirements of IRC:87 may also be used if approved by the Engineer.

### **1503. DESIGN OF FORMWORK**

**1503.1.** The Contractor shall furnish the design and drawing of complete formwork (i.e. the forms as well as their supports) for approval of the Engineer before any erection is taken up. If proprietary system of formwork is used, the Contractor shall furnish detailed information as per *Appendix 150011* to the Engineer for approval.

Not with standing any approval or review of drawing and design by the Engineer, the Contractor shall be entirely responsible for the adequacy and safety for formwork.

**1503.2.** The design of the formwork shall conform 10 provisions of IRC:87. It shall ensure that the forms can be conveniently removed without disturbing the concrete. The design shall facilitate proper and safe access to all parts of formwork for inspection.

**1503.3.** In the case of prestressed concrete superstructure, careful consideration shall be given to redistribution of loads on props due to prestressing.

### **1504. WORKMANSHIP**

**1504.1.** The formwork shall be robust and strong and the joints shall be leak-proof.

Ballies shall not be used as staging. Staging must have cross bracings and diagonal bracings in both directions. Staging shall be provided with an appropriately designed base plate resting on firm strata.

**1504.2.** The number of joints in the formwork shall be kept to a minimum by using large size panels. The design shall provide for proper “soldiers” to facilitate alignment. All joints shall be leak proof and must be properly sealed. Use of PVC JOINT sealing tapes, foam rubber or PVC T-section is essential to prevent leakage of grout.

**1504.3.** As far as practicable, clamps shall be used to hold the forms together. Where use of nails is unavoidable minimum number of nails shall be used and these shall be

left projecting so that they can be withdrawn easily. Use of double headed nails shall be preferred.

**1504.4.** Use of ties shall be restricted, as far as practicable. Wherever ties are used they shall be used with HDPE sheathing so that the ties can easily be removed. No parts prone to corrosion shall be left projecting or near the surface. The sheathing shall be grouted with cement mortar of the same strength as that of the structure.

**1504.5.** Unless otherwise specified, or directed, chamfers or fillets of sizes 25 mm x 25 mm shall be provided at all angles of the formwork to avoid sharp corners. The chamfers, beveled edges and mouldings shall be made in the formwork itself. Opening for fixtures and other fittings shall be provided in the shuttering as directed by the Engineer.

**1504.6.** Shuttering for walls, sloping members and thin sections of considerable height shall be provided with temporary openings to permit inspection and cleaning out before placing of concrete.

**1504.7.** The formwork shall be constructed with pre camber to the soffit to allow for deflection of the formwork. Pre-camber 10 allow for deflection of formwork shall be in addition to that indicated for the permanent structure in the drawings.

**1504.8.** Where centering trusses or launching trusses are adopted

for casting of superstructure, the joints of the centering trusses, whether welded, riveted or bolted should be thoroughly checked periodically. Also, various members of the centering trusses should be periodically examine J for proper alignment and unintended deformation before proceeding with the concreting. They shall also be periodically checked for any deterioration in quality due to steel corrosion.

**1504.9.** The formwork shall be so made as to produce a finished concrete true to shape, line and levels and dimensions as shown on the drawings, subject to the tolerances specified in respective sections of these specifications, or as directed by the Engineer.

**1504.10.** Where metal forms are used, all bolts and rivets shall be countersunk and well ground to provide a smooth, plane surface. Where timber is used it shall be well seasoned, free from loose knots, projecting nails, splits or other defects that may mar the surface of concrete.

**1504.11.** Forms shall be made sufficiently rigid by the use of ties and bracings to prevent any displacement or sagging between supports. They shall be strong enough to withstand all pressure, ramming and vibration during and after placing the concrete. Screw jacks or hard wood wedges where required shall be provided to make up any settlement in the formwork either before or during the placing of concrete.

**1504.12.** The formwork shall take due account of the calculated amount of positive or negative camber so as to ensure the correct final shape of the structures, having regard to the deformation of false work, scaffolding or propping and the instantaneous or deferred deformation due to various causes affecting prestressed structures.

**1504.13.** Suitable camber shall be provided to horizontal members of structure, specially in long spans to counteract the effects of deflection. The formwork shall be so fixed as to provide for such camber.

**1504.14.** The formwork shall be coated with an approved release agent that will effectively prevent sticking and will not stain the concrete surface. Lubricating (machine oils) shall be prohibited for use as coating.

#### **1505. FORMED SURFACE AND FINISH**

The formwork shall be lined with material approved by the Engineer so as to provide a smooth finish of uniform texture and appearance. This material shall leave no stain on the concrete and so fixed to its backing as not to impart any blemishes. It shall be of the same type and obtained from only one source throughout for the construction of any one structure. The contractor shall make good any imperfections in the resulting finish as required by the Engineer. Internal ties and -embedded metal pans shall be carefully detailed and their use shall be subject to the approval of the Engineer.

#### **1506. PRECAUTIONS**



- (i) Special measures in the design of formwork shall be taken to ensure that it does not hinder the shrinkage of concrete. The soffit of the formwork shall be so designed as to ensure that the formwork does not restrain the shortening and/or hogging of beams during prestressing. The forms may be removed at the earliest opportunity subject to the minimum time for removal of forms with props retained in position.
- (ii) Where necessary, formwork shall be so arranged that the soffit form, properly supported on props only can be retained in position for such period as may be required by maturing conditions
- (iii) Any cut-outs or openings provided in any structural member to facilitate erection of formwork shall be closed with the same grade of concrete as the adjoining structure immediately after removal of formwork ensuring watertight joints.
- (iv) Provision shall be made for safe access on, to and about the formwork at the levels as required.
- (v) Close watch shall be maintained to check for settlement of formwork during concreting. Any settlement of formwork during concreting shall be promptly rectified.
- (vi) Water used for curing should not be allowed to stagnate near the base plates supporting the staging and should be properly drained.

#### **1507. PREPARATION OF FORMWORK BEFORE CONCRETING**

The inside surfaces of forms shall, except in the case of permanent form work or where otherwise agreed to by the Engineer be coated with a release agent supplied by approved manufacturer or of an approved material to prevent adhesion of concrete to the formwork. Release agents shall be applied strictly in accordance with the manufacturer's instructions and shall not be allowed to come into contact with any reinforcement or pre-stressing tendons and anchorages. Different release agents shall not be used in formwork for exposed concrete.

Before re-use of forms, the following actions shall be taken:

The contact surfaces of the forms shall be cleaned carefully and dried before applying a release agent.

It should be ensured that the release agent is appropriate to the surface to be coated. The same type and make of release agent shall be used throughout on similar formwork materials and different types should not be mixed.

The form surfaces shall be evenly and thinly coated with release agent the vertical surface shall be treated before horizontal surface and any excess wiped out.

The release agent shall not come in contact with reinforcement or the hardened concrete.

All forms shall be thoroughly cleaned immediately before concreting.

The Contractor shall give the Engineer due notice before placing any concrete in the forms to permit him to inspect and approve the formwork, but such inspection shall not relieve the contractor of his responsibility for safety of formwork, men, machinery, materials and finish or tolerances of concrete.

#### **1508. REMOVAL OF FORMWORK**

The scheme for removal of formwork (i.e. de-shuttering and de-centering) shall be planned in advance and furnished to the Engineer for scrutiny and approval. No formwork or any part thereof shall be removed without prior approval of the Engineer.

The formwork shall be so removed as not to cause any damage to concrete. Centering shall be gradually and uniformly lowered in such a manner as to permit the concrete to take stresses due to its own weight uniformly and gradually to avoid any shock or vibration.

Where not specifically approved, the time of removal of formwork (when ordinary Portland Cement is used without any admixtures at an ambient temperatures exceeding 10 degrees Celsius) shall be as under:

|   |  |
|---|--|
| Walls, piers, abutments, columns and vertical faces of structural members | 12 to 48 hours as may be decided by the Engineer |
|---|--|

|   |         |
|---|---------|
| Soffits of Slabs (with props left under)  | 3 days  |
| Props (left under slabs)                  | 14 days |
| Soffit of Girders (with props left under) |         |
| Props (left under girders)                |         |

Where there are re-entrant/angles in the concrete sections, the formwork should be removed at these sections as soon as possible after the concrete has set, in order to avoid cracking due to shrinkage of concrete.

#### **1509. RE-USE OF FORMWORK**

When formwork is dismantled, its individual components shall be examined for damage and damaged pieces shall be removed for rectification. Such examination shall always be carried out before being used again. Before re-use all components shall be cleaned of deposits of soil, concrete or other unwanted materials. Threaded parts shall be oiled after cleaning.

All bent steel props shall be straightened before re-use. The maximum deviation from straightness is 1/600 of the length. The maximum permissible axial loads in used props shall be suitably reduced depending upon their condition. The condition of the timber components, plywood and steel shuttering plates shall be examined closely for distortion and defects before re-use.

#### **1510. SPECIALISED FORMWORK**

Specialised formwork may be required in the case of slip form work, underwater concreting, segmental construction etc. Such specialised form-work shall be designed and detailed by competent agencies and a set of complete working drawings and installation instructions shall be supplied to the Engineer. The site personnel shall be trained in the erection and dismantling as well as operation of such specialised formwork. In case proprietary equipment is used, the supplier shall supply drawings, details, installation

instructions, etc., in the form of manuals along with the formwork. Where specialised formwork is used, close co-ordination with the design of permanent structure is necessary.

For slip form the rate of slipping the formwork shall be designed for each individual case taking into account various parameters including the grade of concrete, concrete strength, concrete temperature, ambient temperature, concrete admixtures, etc. In the case of segmental construction, the concrete mix shall be normally designed for developing high early strength so that the formwork is released as early as possible.

In order to verify the time and sequence of striking/removal of specialised formwork, routine field tests for the consistency of concrete and strength development are mandatory and shall be carried out before adoption.

For specialised formwork, the form lining material may be either plywood or steel sheet of appropriate thickness. Plywood is preferred where superior quality of surface is desired, whereas steel sheeting is normally used where large number of repetitions are involved.

#### **1717. MEASUREMENTS FOR PAYMENT**

Structural concrete shall be measured in cubic metres. In reinforced or prestressed concrete, the volume occupied by reinforcement or prestressing cables and sheathing shall not be deducted.

#### **1718. RATE**

The contract unit rate for structural concrete shall cover costs of all materials, labour, tools, plant and equipment required for mixing, transporting and placing in position, vibrating and compacting, finishing and curing as per this Section or as directed by the Engineer, including all incidental expenses, sampling and testing, quality assurance and supervision. The contract unit rate for concrete shall also include the cost of providing, fixing and removing formwork required for concrete work as per Section 1500 of MORT& H specification.

**(a):** Providing and casting in-situ controlled cement concrete of M35 grade for RCC work for Pile cap, foundation for pier, abutment, RCC Stair Case and retaining walls with 20/40mm down coarse aggregate of the required size for any depth including dewatering, scaffolding centring, shuttering, mixing, placing in position, consolidating with mechanical vibrators, curing, deshuttering carefully, making good the damages, fixing embedment, inserts, pockets, wherever necessary as per specification and drawing.

This work shall consist of providing and casting in situ controlled cement concrete M 35 grade for PIER up to height 5.0 m ,5.0 m to 10.0 m and 10.0m to 15.0m .

Formwork, concrete and reinforcement for piers shall conform to relevant sections of these specifications. In case of concrete piers, the number of horizontal construction joints shall be kept minimum. Construction joints shall be avoided in splash zones unless specifically permitted by the Engineer and provided they are treated in accordance with special provisions. No vertical construction joint shall be provided. The work shall conform strictly to the drawings or as directed by the Engineer.

In case of tall piers use of slip form shall be preferred. The design, erection and raising of slip form shall be subject to special specifications which will be furnished by the Contractor. The concrete shall also be subject to additional specifications as necessary. All specifications and arrangements shall be subject to the approval of the Engineer.

The surface of foundation shall be scrapped with wire brush and all loose materials removed. In case reinforcing bars projecting from foundations are coated with cement slurry, the same shall "be removed by tapping, hammering or wire brushing. Care shall be taken to remove all loose materials around reinforcements. Just before commencing masonry or concrete work, the surface shall be thoroughly wetted.

**The item shall be measured & paid as finished work in Cum.**

**(b):** Providing & filling in foundation with ordinary cement concrete M 15 mix and providing necessary vertical pin headers including formwork vibrating ramming & curing complete.

Ordinary cement concrete of specified Grade shall be carried out in accordance with the following specification.

1. In case of ordinary concrete, mix is not required to be designed by preliminary tests and proportions of cement, fine aggregates and coarse aggregates are specified by volume as given in table below for different grades of concrete designated as ordinary M. 100, M. 150, M.200 and M.250.
2. In the designation of a concrete mix, letter "M" refers to the mix and the number the specified 28 days works cube compressive strength of that mix on 150 mm. cubes expressed in kg/cm<sup>2</sup>.
3. The ordinary concrete mix shall generally be specified by volume. For cement which normally comes in bags and is used by weight, volume shall be worked out taking 50 kg. of cement as 0.035 cubic meter in volume. While measuring aggregate by volume, shaking, ramming or hammering shall not be done. Proportioning of sand shall be as per its dry volume. In case it is dump, allowance for "bulking" shall be made as per IS : 2386 (Part-III).
4. Ingredients required for ordinary concrete containing one 50 Kg. bag of cement of different proportions of mix shall be as given in Table below.

**TABLE**

| Grade of Concrete                    | Mix By Volume | Total Quantity of dry aggregates by volume per 50 Kg. of cement, to be taken as sum of the individual volumes of fine and coarse aggregates max | Proportion of fine aggregate to coarse aggregate   | Quantity of water per 50 kg. of cement max. |
|--------------------------------------|---------------|---|--|---|
| 1                                    | 2             | 3   | 4  | 5   |
| <b>(1 Cubic meter = 1000 Litres)</b> |               |   |  |   |
| <b>Ordinary</b>                      |               |   |  | <b>Litres</b>                               |
| M.100                                | 1:3:6         | 300   | General 1:2 for fine aggregate to coarse aggregate by volume but subject to a upper limit of 1:1. ½ & a lower limit of 1:3 | 34  |
| M.150                                | 1:2:4         | 220   |  | 32  |
| M.200                                | 1:1.1/2:3     | 160   |  | 30  |
| M.250                                | 1:1:2         | 100   |  | 27  |

**NOTE-** The proportions of the aggregates shall be adjusted from upper limit to lower limit progressively as the grading of the fine aggregates becomes finer & the maximum size of coarse aggregate becomes larger.

**Example-** For an average grading of fine aggregate (that is Zone II of IS : 383-1963) the proportions shall be 1: 1 1/2, 1:2 and 1:3 for maximum size of aggregates 10 mm, 20 mm and 40 mm respectively (after carrying out sieve analysis).

**Note-2** A mix leaner than M.100 (1:3:6) may be used for non- structural parts, if provided in the contract. In such case grading of aggregates shall be by volume. Other requirements for mixing, placing & curing shall be the same.

5. Following shall be the maximum nominal size of coarse aggregate for the different items of work:

| Sr. No. | Item of Construction  | Maximum nominal size of Coarse aggregate  |
|---------|---|---|
| (i)     | R.C.C. well curb. R.C.C. well steining and R.C.C. Piles   | 40 mm   |
| (ii)    | R.C.C. well steining  | 63 mm   |
| (iii)   | Well cap or pile cap; solid type piers, abutment and wing-walls, and their pier caps  | 40 mm   |
| (iv)    | R.C.C. works in cross girders deck slab, wearing coats, kerb, light posts, blast walls, approach slab etc. and hollow type piers, abutments, wing-walls and their pier caps | 20 mm   |
| (v)     | R.C.C. bearings.  | 20 mm   |
| (vi)    | For any other item of construction not covered by items (i) to (v)  | As specified on the drawing or as desired by the Engineer-In-charge in case it is not specified on drawing. |

6. For heavily reinforced concrete members as in the case of ribs of main beams nominal maximum size of aggregate shall usually be restricted to 5 mm. less than the minimum lateral clear distance between the main bars or 5 mm. less than the minimum cover to the reinforcement, whichever is the smaller.

7. Fine aggregate shall be clean, hard, coarse sand. It shall be free from dust and such other substances. The sand be got approved by the Engineer-in-charge.

8. All materials shall be stored as to prevent their deterioration or intrusion of their quality and fitness for the work. Any material which has deteriorated or has been damaged or is otherwise considered defective by the Engineer-in-charge shall not be used in the works.
9. Cement shall be stored above the ground level in perfectly dry and water tight sheds. Wherever bulk storage containers are used, their capacity should be sufficient to cater to the requirements at site and should be cleaned at least once every 3 to 4 months. The aggregate shall be stored in such a way as to prevent admixture of foreign materials. Different size of fine or coarse aggregate shall be stored in separate stock-piles sufficiently away from the each other to prevent intermixing the materials.
10. The water for mixing shall be potable water to satisfaction of the Engineer-in-charge. The quantity of water shall be just sufficient to produce a dense concrete of required workability for the job.
11. For all work concrete shall be mixed in a mechanical mixer which along with other accessories shall be kept in first class working condition and so maintained throughout the construction. Mixing shall be continued till materials are uniformly distributed and uniform colour of the entire mass is obtained and each individual particle of the coarse aggregate show complete coating of mortar containing its proportionate amount of cement. In no case shall the mixing be done for less than 2 minutes after all ingredients have been put into the mixer.
12. When hand mixing is permitted by the Engineer-in-charge for small jobs or for certain other reasons. It shall be done on a smooth watertight platform large enough to allow efficient turning over of the ingredients of concrete before and after adding water. Mixing platform shall be so arranged that no foreign material shall get mixed with concrete nor does the mixing water flow out. Cement in required number of bags shall be placed in a uniform layer on top of the measured quantity of fine and coarse aggregate, which shall also be spread in a layer of uniform thickness on the mixing platform. Dry coarse and fine aggregate and cement shall then be mixed thoroughly by turning over to get a mixture of uniform colour. Enough water shall then be added gradually through a rose can and the mass turned over till a mix of required consistency is obtained. In hand mixing quantity of cement shall be increased by 10 per cent above that specified.
13. Mixers which have been-out of use for more than 30 minutes shall be thoroughly cleaned before putting in a new batch. Unless otherwise agreed to be the Engineer-in-charge, the first batch of concrete from the mixer shall contain only two thirds of normal quantity of coarse aggregate. Mixing plant shall be thoroughly cleaned before changing from one type of cement to another.



14. The method of transporting and placing concrete shall be approved by the Engineer-in-charge. Concrete shall be so transported and placed that no contamination, segregation or loss of its constituent material takes places. All form work and reinforcement contained in it shall be cleaned and made free from standing water, dust, snow or ice immediately before placing of concrete. No concrete shall be placed in any part of the structure until the approval of the Engineer-in-charge has been obtained.
15. If concreting is not started within 24 hours of the approval being given, it shall have to be obtained again from the Engineer-in-charge. Concreting being given, it shall proceed continuously over the area between construction joints. Fresh concrete shall not be placed against concrete which has been in position for more than 30 minutes unless a proper construction joint is formed. Concrete shall be compacted in its final position within 30 minutes of its discharge from the mixer unless carried in properly design agitators, operating continuously, when this time shall be within 2 hours of the addition of cement to the mix and within 30 minutes of its discharge from the agitator. Except where otherwise agreed to be the Engineer-in-charge, concrete shall be deposited in horizontal layers to a compacted depth of no more than 0.45 meter when internal vibrators are used and not exceeding 0.30 meter in all other cases.
16. Unless otherwise agreed to by the Engineer-in-charge concrete shall not be dropped into place from a height exceeding 2 meters. When trucking or chutes are used they shall be kept clean and used in such a way as to avoid segregation. When concreting has to be resumed on a surface which has hardened, it shall be roughened, swept, clean, thoroughly wetted and covered with a 13 mm. thick layer of mortar composed of cement and sand in the same ratio as in the concrete mix itself. This 13 mm. layer of mortar shall be freshly mixed and placed immediately before placing of new concrete. Where concrete has not fully hardened, all laitance shall be removed by scrubbing the well surface with wire or bristle brushes, care being taken to avoid dislodgement of any particles of coarse aggregate. The surface shall then be thoroughly wetted, all free water removed and then coated with neat cement grout. The first layer of concrete to be placed on this surface shall not exceed 150 mm. in thickness, and shall be well rammed against old work particular attention being given to corners and close spots.
17. All concrete shall be compacted to produce a dense homogeneous mass with the assistance of vibrators, unless otherwise permitted by the Engineer-in-charge for exceptional cases, such as concreting under water, where vibrators cannot be used. Sufficient vibrators in serviceable condition shall be kept at site so that spare equipment is always available in the event of break downs.
18. Immediately after compaction, concrete shall be protected against harmful effects of weather, including rain, running water, shocks, vibration, traffic, rapid temperature changes, frost and driving out process. It shall be covered with wet sacking, hessian or

other similar absorbent material approved by the Engineer-in-charge soon after the initial set, and shall be kept continuously wet for a period of not less than 14 days from the date of placement. Masonry work over the foundation concrete may be started after 48 hours of its laying but the curing of concrete shall be continued for a minimum period of 14 days from work shall include all temporary or permanent forms required for forming the concrete, together with all temporary construction required for their support. Form work shall however be divided into following two distinct categories :-

- (1) Shuttering i.e., form work required for forming the concrete.
- (2) Scaffolding i.e., form-work required for supporting shuttering.

Forms for shuttering shall be constructed only in metal suitably lined. Forms for scaffolding shall be constructed of metal or timber. Both shuttering and scaffolding shall be of substantial-rigid construction and shuttering shall be true to shape and dimensions shown on the drawings. All bolts and rivets shall be counter-sunk and well ground to provide a smooth, plane surface.

19. Forms shall be mortar-tight and shall be made sufficiently rigid by the use of ties and bracings to prevent any displacement or sagging between supports, They shall be strong enough to withstand all pressure, ramming and vibration, without deflection from the prescribe lines occurring during and after placing the concrete. Screw jacks or hard wood wedges where required shall be provided to make up any settlement in the formwork either before or during the placing of concrete. Suitable camber shall be provided in horizontal members of structure, especially in long spans to counteract the effects of any fixed as to provide for such camber. Forms shall be so constructed as to be removable in sections in the desired sequence, without damaging the surface of concrete or disturbing other sections. Unless otherwise specified or directed, chambers or fillets of sizes 25 mm x 25 mm shall be provided at all angles of formwork to avoid sharp corners.
20. The inside surfaces of shuttering shall, except in the case of permanent form work or where otherwise agreed to by the Engineer-in- charge, be coated with an approved material to prevent adhesion of concrete to the form work. Release agents shall be applied strictly in accordance with the manufacturer's instructions and shall not be allowed to come into contact with any reinforcement or pre-stressing tendons and anchorages. Different release agents shall not be used in form work for concrete which will be visible in the finished works.
21. Special measures shall be taken to ensure that the form work does not hinder the shrinkage of concrete because without these cracking could occur before formwork is removed. Wherever applicable arrangements must be made to ensure that the form work does not restrain the shortening and hogging of the beams or slabs during

tensioning of the tendon's. The form work should take due account of the calculated amount of positive or negative camber so as to ensure the correct final shape of the structures having regard to the deformation of a false work, scaffolding or propping and the instantaneous or deferred deformation due to various causes affecting pre-stressed structures. Where there are re-entrant angles in the concrete sections the form work should be removed, at those sections as soon as possible after the concrete has set in order to avoid cracking due to shrinkage of concrete. Formwork shall be tight enough to prevent any appreciable loss of cement during vibrations; suitable tolerances should be provided in the formwork. Immediately before concreting all forms shall be thoroughly cleaned. Contractor shall give the Engineer-in-charge due notice before pouring any concrete in the forms to permit him to inspect and accept the false work and forms as to their strength alignment and general fitness, but such inspection shall not relieve the contractor of his responsibility for safety of men, machinery, materials and for results obtained.

22. The Engineer-in-charge shall be informed in advance by the contractor of his intention to strike any formwork. While fixing the time for removal of formwork, due consideration shall be given to local conditions, character of the structure, the weather and other conditions that influence the setting of concrete and of the materials used in the mix. Where field operations are controlled by strength tests of concrete, the removal of the load-supporting or soffit forms may commence when concrete has attained strength equal to at least twice the stress to which the concrete will be subjected at the time of striking props including the effect of any further addition of loads. When field operations are not controlled by strength tests of concrete the vertical forms of beams, columns and walls may be removed after 2 days. The props of slabs and beams may be removed after 14 and 21 days respectively. All formwork shall be removed without causing any damage to the concrete. Centering shall be gradually and uniformly lowered in such a manner as to permit the concrete to take stresses due to its own weight uniformly and gradually. Where internal metal ties are permitted, they or their removable parts shall be extracted without causing any damage to the concrete and remaining holes filled with mortar. No permanently embedded metal part shall have less than 25 mm. cover to the finished concrete surface. Where it is intended to reuse the formwork, it shall be cleaned and made good to the satisfaction, of the Engineer-in-charge.

23. Immediately after the removal of forms, all exposed bars or bolts passing through the Cement concrete member and used for shuttering or any other purpose shall be cut inside the cement concrete member to a depth of at least 25 mm. below the surface of the concrete and the resulting holes be filled by cement mortar. All fins caused by form joints, all cavities produced by the removal of form ties and all other holes and depressions, honey comb spots, broken edges or corners and other defects, shall be thoroughly cleaned, saturated with water and carefully pointed and rendered true with

mortar of cement and fine aggregate mixed in the proportions used in the grade of concrete that is being finished and of as dry as consistency as is possible to use. Considerable pressure shall be applied in filling and pointing to ensure thorough filling in all voids. Surfaces which have been pointed shall be kept moist for a period of twenty four hours. If rock pockets/honeycombs, in the opinion of the Engineer-in-charge are of such an extent or character as to affect the strength of the structure materially or to endanger the life of the steel reinforcement, he may declare the concrete defective and require the removal and replacement of the portions of the structure affected.

24. In the case of reinforced concrete work workability shall be such that the concrete surrounds and properly grips all reinforcement. The degree of consistency, which shall depend upon the nature of work and methods of vibration of concrete shall be determined by regular slump tests. Following slump shall be adopted for different types of works.

| Type of Work |   | Slumps                       |                                  |
|--------------|---|------------------------------|----------------------------------|
|              |   | Slump where vibrator is used | Slump where vibrator is not used |
| 1            | Mass concrete in RCC foundations, footings and retaining walls. | 10 mm to 25 mm               | 80 mm                            |
| 2            | Beams, slabs and columns simply reinforced.                     | 25mm to 40 mm                | 100 to 120 mm                    |
| 3            | Thin R.C.C. section or congested steel.                         | 40 mm to 50 mm               | 125 to 150 mm                    |

25. Works strength tests shall be made in accordance with IS : 516. Each test shall be conducted on ten specimens, five of which shall be tested at seven days and the remaining five at 28 days. The samples of concrete shall be taken on each day of concreting and cubes shall be made at the rate of one for every 5 cubic meter of concrete or a part thereof. However, if concreting done in a day is less than 15 cubic meter, the minimum number of cubes can be reduced to 6 with the specific permission of the Engineer-in-charge. Similar works tests shall be carried out whenever the quality and grading of materials is charged irrespective of the quantity of concrete poured. The number of specimens may be suitably increased as deemed necessary by the Engineer-in-charge when procedure of tests given above reveal a poor quality of concrete and in other special cases.
26. The average strength of the group of cubes cast for each day shall not be less than the specified works cube-strength. 20 per cent of the cubes cast for each day may

- have values less than the specified strength, provided the lowest value is not less than 85 per cent of the specifies strength.
27. R.C.C. work shall have exposed concrete surface. Centering design and its erection shall approved by The Engineer-in-charge. One carpenter with helper will invariably be kept present throughout the period of concreting. Movement of labour and other persons shall be totally prohibited over reinforcement laid in position. For access to different parts, suitable mobile platforms shall be provided so that steel reinforcement in position is not disturbed. For ensuring proper cover, mortar blocks of suitable size shall be cast and tied to the reinforcement. Timber, kapchi or metal pieces shall not be used for this purpose. Concreting of important structural members shall always be done in the presence and under the supervision of departmental person not below the rank of Asstt. Engineer/Addi.Asstt.Engineer, Overseer or as instructed by the Engineer-in-charge. After removal of form work checks that concrete produced is of good quality plastering shall not be allowed to the expressed faces of concrete.
28. In reinforced concrete the volume occupied by reinforcement shall not be deducted. The slab shall be measured as running continuously through and the beam as the portion below the slab.
29. All necessary labour, materials, equipment, etc., for sampling, preparing test cubes, curing etc., shall be provided by the Contractor. Testing of the materials and concrete may be arranged by the Engineer-in-charge in an approved laboratory at the cost of the contractor.
30. The payment will be made on cumt. basis of the finished work.
31. The unit rate for concrete shall include the cost of all materials, labour, tools and plan required for mixing, placing in position, vibrating and compacting finishing as-per directions of the Engineer-in-charge, curing and all other incidental expenses for producing concrete of specified strength to complete the structure or its components as show on the drawings and according to these specifications. The rate shall also include the cost of making/fixing and removing of all centers and forms required for the work.

Ⓒ: Providing and casting in sit controlled cement M35 for RCC work in piers and abutment return wall as per drawing including centering shuttering scaffolding where necessary currying vibrating curing and finishing complete A)height from 0.0 to 5.0 m

This work shall consist of providing and casting in situ controlled cement concrete M 350 grade for PIER up to height 5.0 m ,5.0 m to 10.0 m and 10.0m to 15.0m .

Formwork, concrete and reinforcement for piers shall conform to relevant sections of these specifications. In case of concrete piers, the number of horizontal construction joints shall be kept minimum. Construction joints shall be avoided in splash zones unless specifically permitted by the Engineer and provided they are treated in accordance with special provisions. No vertical construction joint shall be provided. The work shall conform strictly to the drawings or as directed by the Engineer.

In case of tall piers use of slip form shall be preferred. The design, erection and raising of slip form shall be subject to special specifications which will be furnished by the Contractor. The concrete shall also be subject to additional specifications as necessary. All specifications and arrangements shall be subject to the approval of the Engineer.

The surface of foundation shall be scrapped with wire brush and all loose materials removed. In case reinforcing bars projecting from foundations are coated with cement slurry, the same shall be removed by tapping, hammering or wire brushing. Care shall be taken to remove all loose materials around reinforcements. Just before commencing masonry or concrete work, the surface shall be thoroughly wetted.

**The item shall be measured & paid as finished work in Cum.**

**(d):** Providing and casting in situ controlled cement concrete M35 for RCC works on pier cap, abutment cap and dirt wall including controlled cement concrete or pedestals of required drawings, centering shuttering, scaffolding wherever necessary laying vibrating curing and finishing complete.

This work shall consist of providing and casting in situ controlled cement concrete M 35 grade for works in pier cap, seismic arrester, dirt wall of required detailed .

The locations and levels of pier cap, pedestals and bolts for fixing bearings shall be checked carefully to ensure alignment in accordance with the drawings of the bridge.

The surface of cap shall be finished smooth and shall have a slope for draining of water as shown on the drawings or as directed by the Engineer. For short span slab bridges

with continuous support on pier caps, the surface shall be cast horizontal. The top surface of the pedestal on which bearings are to be placed shall also be cast horizontal.

The surface on which elastomeric bearings are to be placed shall be wood float finished to a level plane which shall not vary more than 1.5 mm from straight edge placed in any direction across the area. The surface on which other bearings (steel bearings, pot bearings) are to be placed shall be cast about 25 mm below the bottom level of bearings and as indicated on the drawings.

The item shall be measured & paid as finished work in Cum.

**( e):** Providing and casting in situ controlled cement concrete M40 for RCC works for Pedestal, Seismic Arrestor, Wearing Coat and Deck Slab including controlled cement concrete or pedestals of required drawings, centering shuttering, scaffolding wherever necessary laying vibrating curing and finishing complete .

Formwork, reinforcement and concrete shall conform to relevant sections of these specifications.

The locations and levels of pier cap, pedestals and bolts for fixing bearings shall be checked carefully to ensure alignment in accordance with the drawings of the bridge.

The surface of cap shall be finished smooth and shall have a slope for draining of water as shown on the drawings or as directed by the Engineer. For short span slab bridges with continuous support on pier caps, the surface shall be cast horizontal. The top surface of the pedestal on which bearings are to be placed shall also be cast horizontal.

The surface on which elastomeric bearings are to be placed shall be wood float finished to a level plane which shall not vary more than 1.5 mm from straight edge placed in any direction across the area. The surface on which other bearings (steel bearings, pot bearings) are to be placed shall be cast about 25 mm below the bottom level of bearings and as indicated on the drawings.



**(f):** Providing and casting in situ controlled cement concrete M35 for R.C.C. work in superstructure including centering, shuttering scaffolding, ramming, vibrating curing and finishing complete. (I) Deck slab

The item shall be measured & paid as finished work in Cum.

**(g):** Providing and casting in situ controlled cement concrete M-35 for R.C.C. work in superstructure including centering, shuttering scaffolding, ramming, vibrating curing and finishing complete. (A) T-Beam and Deck slab type of superstructure. (II) Main and cross Girder

The item shall be measured & paid as finished work in Cu.m.

**(h):** Providing and casting in -situ controlled cement concrete of M 40 grade for RCC crash Barrier & Parapet with 20 mm down coarse aggregate of the required size including formwork, shuttering, placing in position, consolidation with mechanical vibrators curing finishing, de-shuttering carefully, marking good the damages, fixing embedment, inserts, pockets, wherever necessary as directed and as per drawing with F3 type exposed concrete finish and formwork as directed by Engineer - in -charge, etc. complete as per specification.

The item shall be measured & paid as finished work in Cu.m

**(i):** Reinforced earth Retaining wall (Reinforced Earth Retaining Walls for have for main components as under: a) Excavation for foundation, Foundation concrete & cement concrete grooved seating in the foundation for facing elements (facia material), b) Facia material & its placement c) Assembling, joining with facing elements and laying of the reinforcing elements, d) earth fill with granular material which is to be retained by the wall. Facing elements of RCC.

### **3101: SCOPE**



The work covers construction of reinforced soil structures together with the construction of earthwork in layers, assembly and placing of reinforcing elements and facia elements during the construction process and all associated works.

The work shall include the design and construction of the reinforced soil structure and ground improvement measures required, if any.

The reinforced soil retaining structures can be used as, (i) Reinforced soil retaining wall, (ii) Reinforced soil abutment, (iii) Reinforced soil slope

Reinforced soil structures with slope face angles steeper than 70° are categorized as reinforced soil walls and those with slope face angle less than 70° are considered as reinforced soil slopes.

### **3102 DESIGN**

Guidelines for design are given in

Annexure-I

### **3103 REINFORCING ELEMENT**

**3103.1** The reinforcing element shall be metallic in the form of strips (aluminum alloy strip, copper strip, carbon steel strip, galvanised steel strip, stainless steel strip, ladder) or mats of metal (steel grids, woven and welded steel wire meshes) or synthetic (PET, HDPE, PVA, PP) reinforcement in the form of grid or strip or strap or combination of metallic or synthetic or any other proprietary material which may be approved by the Engineer and shown on the drawings

**3103.2** Aluminum alloy strip shall comply with BS:1470 quality 5454 in the H 24 condition.

**3103.3** Copper strip shall comply with BS:2870 quality C 101 or C 102 in the 1/2 H condition and shall have 0.2 percent proof stress of not less than 180 N/mm<sup>2</sup>.

**3103.4** Carbon steel strip shall comply with BS EN 10025 or IS:2062 and have a silicon content of not more than 0.55 percent. The fabricated element shall be galvanized in accordance with IS:4759 and IS:2629 and the minimum zinc coating weight shall not be less than 1000gm/sq.m

The steel strips with minimum bearing and shear strength of 490N/mm<sup>2</sup> shall comply with the requirements of BS EN 10025, Grade S 355 JR, or IS:2062 grade Fe 490, except the elongation (on base metal) for which minimum 22 percent is acceptable.

The panel lugs shall be manufactured from hot-rolled steel strips with the same steel quality and grades as specified above, except that the minimum zinc coating weight not less than 600 gm/sq.m.

All permanent metallic connectors (exposed to soil), tie strips and lugs shall be hot dip galvanized. Nuts/ bolts (fasteners) shall be galvanized as per requirements of IS: 1367-Part 3. Nuts/ bolts (fasteners) shall be of grade 10.9.

For all metallic components, where holes or penetrations are made through the reinforcing elements to accommodate connection such as bolts, pins, or other, the cross section thickness and/or width of metallic component shall be increased to account for section loss caused by the hole or penetration.

**3103.5** Stainless steel strip shall comply with BS: 1449 (Part 2) quality 315 S 31 or 3/6 S 33 except that the material shall be cold rolled to provide a 0.2 percent proof stress of not less than 400 N/mm<sup>2</sup> and the tensile strength shall not be less than 540 N/mm<sup>2</sup>.

**3103.6** All metallic components buried in soil shall be of electrolytically compatible materials.

**3103.7 Geotextile, Geogrids and other Geosynthetic Materials used as Reinforcing Elements**

**3103.7.1 Geotextile**

High strength high tenacity geotextile fabrics used as reinforcement in the construction of reinforced slopes or in the base of reinforced soil structure as reinforcement, shall be considered as reinforcing element and shall satisfy all the requirements stipulated for geosynthetic reinforcing elements, in Clause 3103.7.2.

Geotextile fabric used for separation, filtration and/ or drainage shall satisfy the requirements given in relevant Clauses of Section 700 Geosynthetics.

**3103.7.2 Geogrids**

The manufacturer of geogrids, geotextiles, geostrips, polymeric strips or straps, polymeric ties or any other geosynthetic material, including any proprietary geosynthetic material, for use as reinforcing element shall fulfill the following requirements:

- a) Shall have ISO ( ISO-9001) or CE Certification for manufacturing process and quality control, and
- b) The product shall have certification for use as soil reinforcing material from an agency accredited for certifying geosynthetic reinforcement products.
- c) The manufacturer shall provide test reports from an independent laboratory with valid accreditation, for all the tests needed to establish all the reduction factors listed below

|           |   |
|-----------|---|
| $RF_{CR}$ | Reduction factor for creep.                           |
| $RF_{ID}$ | Reduction factor for installation damage              |
| $RF_w$    | Reduction factor for weathering                       |
| $RF_{CH}$ | Reduction factor for chemical/ environmental effects. |
| $f_s$     | Factor for the extrapolation of data                  |

All the above factors shall be determined in accordance with the provisions of ISO/TR 20432- "Guide to the determination of long-term strength of geosynthetics for soil reinforcement."

### **Project Specific Tests/Data**

Test for the ultimate tensile strength shall be carried out on a random sample for each grade of reinforcement as per ISO-10319. The test results shall be accompanied by stress-strain curves showing strength at 2% and 5% strain and strain/elongation at failure.

The manufacturer shall also provide the results of ultimate tensile strength for each lot and all grades of reinforcement proposed for use in the project.

Annual Average Daily Temperatures (AADT)/design temperature of the project site shall be worked out and values of reduction factor for creep  $RF_{CR}$  and for  $RF_{CH}$  shall be provided as per procedures given in ISO/TR-20432.

Tests shall be carried out to provide values of

- i) Pull-out coefficient as per ASTM D 6706 "Standard Test Method for Measuring Geosynthetic Pullout Resistance in Soil" and
- ii) Coefficient of interaction between reinforced fill soil and geogrids as per ASTM D 5321-"Standard Test method for Determining the Coefficient of Soil and Geosynthetic or Geosynthetic and Geosynthetic Friction by the Direct Shear method" or as per IS: 13326: Part 1-1992 "Method of test for the evaluation of interface friction between geosynthetics and soil: Part 1 Modified direct shear technique" for all types of geogrids.

One set of project specific tests shall be conducted at third party accredited laboratory or at a reputed institute.

Each roll shall have at least one identification label with roll number and product type.

### **3104 EARTH FILL**

The fill material in the reinforced soil zone shall have drained or effective angle of friction not less than 30°, measured in accordance with IS:2720 (Part 13), by conducting a drained direct shear test. In case the fill material has 25 percent or more particles of 4.75 mm or larger, drained shear test using large shear box may be conducted (IS:2720:Part 39:Section 1). The gradation of fill soil shall be as per following limits.

| <b>Sieve Size</b> | <b>Percentage Passing</b> |
|-------------------|---------------------------|
| 75 mm             | 100%                      |
| 425 micron        | 0-60%                     |
| 75 micron         | less than 15              |
| PI                |                           |

Materials with more than 15 percent passing 75 micron sieve, but less than 10 percent of particles smaller than 15 microns are acceptable provided **PI** is less than 6 and angle of friction is not less than 30°.

Fly ash may be used as fill material in reinforced soil walls provided its angle of internal friction is not less than 300 and P1 is less than 6. Gradation requirements need not be

completely satisfied. Reference may be made to IRC Guide lines on Use of Flyash in Road Embankments (IRC:SP-58). Fly ash shall also satisfy requirements concerning pH and environmental conditions of the fill vis-a-vis the reinforcement type as specified in Clause 3014.1.

The fill material used in the reinforced soil zone shall be free from organic or other deleterious materials and shall not react adversely (chemically, electrically or biologically) with the reinforcement material and/or facia material.

Properties of fill soil in the reinforced zone, unreinforced zone (or retained/back fill) soil and the foundation soil shall be determined accurately during the construction phase, as per quality assurance plans and directions of Engineer so as to ensure that these are the same as those considered in the design phase.

The fill soil in the unreinforced zone shall conform to the requirements specified in the design.

### **3104.1 Environmental Conditions of Fill**

#### **3104.1.1 Steel Reinforcement**

Where galvanized steel reinforcement is used, the fill material shall be free draining granular material and shall meet the following requirements as per Table 3100.1.

**Table 3100.1 : Recommended Limits of Electrochemical Properties for Reinforced Fills with Steel Reinforcement**

| Property    | Criteria      | Test Method  |
|-------------|---------------|--------------|
| Resistivity | > 3000 ohm-cm | AASHTO T-288 |
| pH          | > 5 and < 10  | AASHTO T-289 |
| Chlorides   | < 100 PPM     | ASTM D 4327  |
| Sulphates   | < 200 PPM     | ASTM D 4327  |

#### **3104.1.2 Geosynthetic Reinforcement**

Where geosynthetic reinforcement is used for reinforcing elements manufactured from polyester yarn, pH value of the fill material shall be between 3 and 9, and for reinforcing elements manufactured from PVA, PP and HDPE, the pH value shall be greater than 3.

### **3105 FACIA MATERIAL**

**3105.1 The facing system shall be one of the following**

- a) Precast reinforced concrete panels
- b) Precast concrete blocks and precast concrete hollow blocks.
- c) Gabion facing
- d) Wrap around facing using geosynthetics
- e) Metallic facing, prefabricated in different shapes including welded wire grid and woven steel wire mesh
- f) Other proprietary and proven systems Facing shall be

sufficiently flexible to withstand any deformation of the fill and foundations.

The facia units to be adopted in the project shall be shown in the drawings and shall be approved by the Engineer.

**3105.1.1 Precast Reinforced Concrete Panels**

The minimum thickness of precast concrete panels shall be 180 mm including facing textures, logos and embellishments. The grade of concrete shall be minimum M35. The concrete shall conform to the requirements of Section 1700 of these Specifications.

Facia panel systems shall have provision of both horizontal and vertical gaps to prevent concrete to concrete contact. The horizontal gap between the facing elements shall be maintained by provision of Ethylene Propylene Diene Monomer (EPDM) pad. Bedding material shall consist of either cement mortar or a durable gasket seating such as resin bonded cork, bitumen bonded cork or EPDM.

The joints between the panels shall be covered from inside with non-woven geotextile strips glued to the facing element ensuring full coverage of joints. Synthetic glue shall be used for this purpose. The width of the geotextile strip shall not be less than 100 mm.

**3105.1.2 Precast Concrete Blocks/Segmental Blocks/Modular Blocks**

Precast concrete blocks are dry cast and shall be manufactured from fully automatic block making machines. The minimum grade of concrete shall be M 35 for all kinds of modular blocks. In case of hollow blocks, the hollow area shall not exceed 40 percent of the cross sectional area of the block. The outer side of the block shall have minimum thickness of 100 mm.

**3105.1.3 Gabion Facia**

Where gabion facia is used, it shall conform to the provisions of BS 8006-1:2010 and EN 14475 and made of mechanically fabricated and selvedged double twisted hexagonal mesh. Wire used for the double twisted mesh shall be hot dip galvanized as per IS:4826 —heavily coated and soft type, with wire and mesh properties in accordance with EN-10223 with minimum Zn or Zn + alloy coating as per EN-10244 and 0.5 mm thick PVC coating as per EN-10245 and 150-527.

#### **3105.1.4      Wrap Around Facing using Geosynthetics**

Where geosynthetics, including geogrids are used as wrap around facia, these shall form a part of the reinforcing element. The wrap around shall have adequate length to resist pull out and the wrap around length shall be calculated on the basis of safety in pull out. Wrap around facia shall be protected by suitable means, against adverse effects of natural forces.

#### **3105.1.5      Metallic Facing, Prefabricated in Different Shapes Including Welded Wire Grid, Steel Sheet and Woven Steel Wire Mesh**

Where steel sheet and steel grids facings are used for facing, steel for steel sheet shall be as per 85:1449-Part 1 and steel grids shall conform to BS:4482, BS:4483 and BS:4489.

Where mechanically woven steel wire mesh in wrap around form is used for facing, the steel wire mesh (IS:4826, IS:280, IS:13360, EN:10218, EN:10223, EN:14475) shall be with mechanical selvedging and bottom panel shall continue as an integrated tail mesh.

Where welded steel wire mesh units in wrap around form (EN:10079, EN:10080, and EN:ISO 1461, EN:14475) are used as facing, the bottom panel shall continue as an integrated tail mesh.

3105.2 Facia type adopted shall be given in the design shown with complete details in the drawings. The system supplier shall provide any test data to satisfy the Engineer regarding the properties and suitability of the facia system adopted, if so required.

Where facia such as wrap around or gabion or welded wire and woven steel wire mesh facings have been used and where climate conditions are appropriate, a green finish shall be provided where specified.

### **3105.3 Connection between the Facia and Reinforcement**

Connection between the facia panels and the reinforcing element shall be by using either nut or bolt, HDPE inserts with bodkin joint, hollow embedded devices, polymeric/steel strips/ rods/pipes, fibre glass dowels or any other material shown in the drawings. The connection between the panel and the reinforcement shall provide for 100 percent of the long term design strength of the reinforcing element in continuity.

In case of modular block facia and other type of facia such as gabion facia, where the reinforcement is held by friction between the facia block and the reinforcement, the connection strength shall be determined as per ASTM D 6638 "Standard Method of Test for Determining Connection Strength between Geosynthetic Reinforcement and Segmental Concrete Units."

The available connection strength shall satisfy the design requirements and shall not be less than the maximum possible tensile force that the reinforcement layer under consideration may be subjected to.

## **3106 CONSTRUCTION DETAILS**

### **3106.1 Depth of Foundation**

A strip footing, minimum 350 mm wide and 150 mm thick in M15 grade plain concrete, shall be provided at founding level to receive the facia or the bottom most reinforcement.

The depth of embedment below the finished ground level at the foot of the wall shall not be less than 1000 mm. In case rock is met above founding level, the depth of embedment shall be adjusted as per ground conditions.

### **3106.2 Laying of Reinforcement**

The reinforcing elements shall be placed at right angles to the face of the wall or design axis,

with greater cross-sectional dimension in the horizontal plane and the length shall be as

shown in the drawings. Reinforcing elements such as geogrids, shall be stretched and held by driving nails or pegs at the farther end.

### **3106.3 Facing Batter**



It may be necessary to set facing unit at an additional batter than as provided in the drawings since there is a tendency for initially positioned units of facia to lean outward as the fill material is placed and compacted. Care and caution shall be taken to accommodate this phenomenon. At the end of the construction, the face may have a slight residual inward batter.

### **3106.4 Drainage**

Drainage bay shall be provided as shown in the drawings. The width of the drainage bay shall be 600 mm behind the facing element.

The drainage material shall conform to the specifications of the filter media as per Clause 2504.2.2 of these Specifications.

### **3106.5 Laying and Compaction**

The reinforcing elements shall be laid free from all kinks, damage and displacement during placing, spreading, leveling and compaction of the fill. The programme of filling shall be such that no construction plant moves directly on the reinforcement.

All construction plant having a mass exceeding 1500 kg shall be kept at least 2.0 m away from the face of slope or wall.

In the area up to 2.0 m from the face of slope or wall, the following compaction plant shall be used:

- i ) Vibratory roller having a weight per metre width not exceeding 1300 kg  
with total weight not exceeding 1500 kg
- ii) Vibratory plate compactor of maximum weight 1000 kg
- iii) Vibro tamper having a weight not exceeding 75 kg

Before allowing the movement of vehicles over the reinforcement, a minimum compacted thickness of 150 mm shall be provided over the reinforcement and the speed of the vehicles shall be restricted to 10 km/hr.

During construction of reinforced fill, the retained material beyond the reinforcement at the rear of the structure shall be maintained at the same level as reinforced fill. Fill shall not be placed on surface that contains mud, organic soil or area that have not met compaction requirement.

The thickness of compacted layer shall not be more than 200 mm, compacted to 97 percent of maximum laboratory density measured as per 15:2720 (Part 8).

### **3106.6 Construction and Serviceability Tolerances**

The construction tolerances shall be as per the following:

Casting of pre-cast RCC panels: All elements shall be manufactured within the following tolerances:

All dimensions within  $\pm 5$  mm

Evenness of the front face:  $\pm 5$  mm over 1500 mm

Difference between lengths of two diagonals: 5mm  
Max

Thickness: + 5 mm (-) 0 mm

**Table 3100.2: Tolerances for Faces of Retaining Walls and Abutments**

|  | <b>Tolerance</b>  |
|--|---|
| Location of plane of structure             | $\pm 50$ mm — metallic reinforcement<br>$\pm 75$ mm — synthetic reinforcement         |
| Bulging (Vertical) and Bowing (Horizontal) | $\pm 20$ mm in 4.5 m template (Metallic)<br>$\pm 30$ mm in 4.5 m template (Synthetic) |
| Steps at joints                            | $\pm 10$ mm   |

### **Dimensional Tolerances for Modular Blocks**

Dimensions of modular concrete blocks shall not differ more than  $\pm 2.5$  mm for length and width and  $\pm 1.5$  mm in height.

### **Minimum Vertical Movement Capacities of Facing Systems**

Minimum vertical movement capacities required for facing systems to cope with vertical internal settlement of reinforced fill shall be as below:

**Table 3100.3: Minimum Vertical Movement Capacities of Facing Systems**

|                 |  |
|-----------------|--|
| Structural Form | Minimum Vertical Movement Capacity of System       |
| Discrete panels | Joint closure of 1 in 150 relative to panel height |

|   |   |
|---|---|
| Full height panels                      | Vertical movement capacity of connections 1 in 150 relative to panel height |
| Semi-elliptical facings                 | Vertical distortion of 1 in 150 relative to panel height                    |
| Geotextile/ Geogrid wrap-around facings | No specific limit except for appearance or serviceability considerations    |

### **3106.7 Capping Beam, Crash Barrier and Friction Slab**

Capping beam, crash barrier and friction slab shall be provided as per the design and drawings.

## **3107 REINFORCED SOIL SLOPES**

This section deals with construction of reinforced soil structures that have a slope face angle flatter than 70°.

### **3107.1 Reinforcing Elements**

Any type of material used as reinforcing element for the construction of a reinforced soil slope shall meet all the requirements provided in the Clause 3103. Any Geosynthetic material used as reinforced element of the construction of a reinforced soil slope shall meet all the requirement in Clause 3103.7.

### **3107.2 Fill Material**

The fill material used as the reinforcing fill in the reinforced soil slope shall meet all the requirements for fill material specified in Clause 3104. However the friction angle of the fill material in this case shall not be less than 28°.

### **3107.3 Facia for Reinforced Soil Slope**

Facia of reinforced soil slope shall be one of the following types

- a) Wrap around facing using geosynthetics
- b) Gabion facing
- c) Metallic facing, prefabricated in different shapes including welded wire grid and woven steel wire mesh.
- d) Precast reinforced concrete panels

- e) Precast concrete blocks and precast concrete hollow blocks.

The specifications for the materials used for above facing types shall be as provided in **Clause 3105.1**.

### **3107.3.1 Wrap Around Facia using Prefabricated Geosynthetic Bags**

Where specified wrap around facia using prefabricated geosynthetic bags shall be used in the construction of reinforced soil slopes for slope angles less than 45'. Such type of facia shall conform to the provisions in EN:14475.

### **3107.4 Connection between the Facia and Reinforcement**

Connection between facia and reinforcement in the reinforced soil slope shall satisfy the design requirements.

**3107.5** Facia type adopted shall be given in the design and shown with complete

details in the drawings. The system supplier shall provide any test data to satisfy the Engineer regarding the properties and suitability of the facia system adopted, if so required by the Engineer.

Where facia such as wrap around or gabion or welded wire and woven steel wire mesh facings have been used and where climate conditions are appropriate, a green finish shall be provided where specified.

### **3107.6 Laying and Compaction**

Laying of the reinforcement in the reinforced soil slope and the compaction of the fill shall conform to the provisions of Clause 3106.5.

## **3108 SYSTEM RESPONSIBILITY, PERFORMANCE BOND**

### **3108.1 System Responsibility**

If specified in the contract, the system supplier shall provide performance bond in conformance with the contract requirements. The performance bond shall be valid for atleast 20 years.

## **3109 MEASUREMENT FOR PAYMENT**

### **3109.1 Reinforced Soil Wall**

The measurement for payment for reinforced soil wall shall be in square metres of finished work of each face and shall be measured in the plane of final inclination specified in the drawings. The measurement of length shall be the finished work along the length of the road. The measurement of height along the slope shall be done from the top level of the footing on which the fascia element is placed to the top of the capping beam.

Measurement for friction slab and crash barrier shall be in linear metres.

### **3109.Reinforced Soil Slope**

The measurement for payment for reinforced soil slope shall be in square metres of finished work of each face and shall be measured in the plane of final inclination specified in the drawings. The measurement of length shall be the finished work along the length of the road. The measurement of height along the slope shall be done from the top of the levelling pad, where provided, to the top of the embankment. Where leveling pad is not provided, the height shall be measured, in the final plane of inclination specified in the drawings, from the bottom of the slope face.

### **3110.RATES**

The rate shall include cost of material, labour, plant, royalties, handling, storage and transportation expenses, cost of bed block, leveling pad, fascia elements, capping beam, connectors, reinforcing elements, scaffolding, supply of the specified filter media material, supply of soil fill for the reinforced as well as unreinforced zone of the quality specified in the contract, plating, spreading and compaction through mechanical means.

The rate shall include full compensation for design, drawings and testing of materials.

The rate shall include the cost of investigations, design and construction of ground improvement measures.

The payment for friction slab and crash barrier shall be made separately.

**1:** Providing Sand & filling in approach portion of RE Wall (as per MORTH section 3100) including laying of earth as per specification for compaction in 250 mm thick loose layers and dressing(MORTH specification Cl. by mechanical means using motor grader including 305.3.5) watering the earth to bring the earth upto required OMC including rolling with the use of vibratory roller when earth is at suitable moisture content with desired field density not less than 97% of maximum dry density (modified proctor test). The material for filling shall conform to IRC Highway Research Board's special report No. 16.

**REINFORCED FILL SPECIFICATIONS**

The reinforced fill shall be a select granular fill with the following properties:

- Peak drained or effective angle of friction of compacted fill (as per IS 2720: part 13) shall be minimum 28°.
- % fines (passing 75 micron sieve) shall be less than 15%. Sieve Analysis test shall performed as per IS 2720 (part 4),
- Material with more than 15% passing 75 micron sieve, but less than 10% of of particle smaller than 15 microns are acceptable provided PI is less than 6 and angle of friction is not less than 280
- The fill material shall be free from organic and any other deleterious matter and shall not react adversely (chemically, electrically or biologically) with the reinforcement material and / or facia material.
- Liquid limit & Plastic Limit test shall performed as per IS 2720 (Part 5). Plasticity index shall be less than 6.
- Co-efficient of uniformity (Cu) shall be  $\geq 2$ .
- Top 500 mm of fill below Subgrade shall satisfy the effective CBR criteria with Subgrade material in addition to the above requirement.
- Recommended guidelines for gradation of the reinforced soil are given below:

| Sieve Size (mm) | % Finer |
|-----------------|---------|
| 75              | 100     |
| 4.75            | 85-100  |
| 0.425           | 60-90   |
| 0.075           | < 15    |

Plasticity Index (PI) shall not exceed 6 and  $C_u > 2$

**RETAINED FILL SPECIFICATIONS**

- Peak drained or effective angle of friction of compacted fill (as per IS 2720: Part 13) shall be minimum of 30°.
- The fill shall be compacted to 95% of the maximum laboratory density obtained from modified protocol compaction test performed as per IS 2720 (Part 8)
- Fill within 0.5m of the bottom of pavement (subgrade) shall be compacted to a minimum of 98% of the MDD.

- The liquid limit and plasticity index (performed as per IS 2720: Part 5) of the fill shall be restricted to 40 and 20 respectively.
- The organic content shall be limited to 5% and the fill shall be free from deleterious matter.
- If Fly ash is used as retained fill then it shall be in conformity with IRC-SP 58. Top 500 mm of retained fill below Subgrade shall satisfy the effective CBR criteria with Subgrade material in addition to the above requirements.

#### DRAINAGE BAY

Drainage Bay shall be provided as shown in the approved drawings. The width of the drainage bay shall be 600 mm behind the facing element.

Backfill and drainage material to be separated by permeable non-oven geotextile

#### TESTS FOR REINFORCED AND RETAINED FILL

The soil which is proposed to be used as reinforced fill shall be tested to ascertain the suitability for required quantity, grading, type and availability of required quantity etc. The soil to be used as retained fill behind the reinforced fill, in case it is not natural soil, shall be tested for its shear characteristics and permeability to evaluate earth pressure, drainage characteristics etc. for external stability of the wall.

The backfill is tested at two stages. The first stage is to ascertain the suitability of the fill while the second stage to ensure that the backfill envisaged in design is used during construction. To ascertain the suitability of the fill, samples should be drawn from the borrow area by drawing a grid of 25 m c/c to full depth, logging and sampling for ascertaining suitability of the borrow material as per MORTH 2013 Specifications. Following tests shall be carried out as per Indian Standards.

i) Sieve Analysis - IS: 2720 Part - 2 tests per 3000 cu.m. of soil

ii) Atterberg Limit Tests- IS: 2720 Part- 5-2 tests per 3000 cu.m. of soil

iii) Compaction Tests - IS: 2720 relevant part corresponding to modified as well

as Standard Proctor test - 2 tests per 3000 cu.m. of soil

iv) Direct Shear Tests - IS: 2720 Part 13 & 39 to ascertain the peak angle of shearing resistance. The tests should be done at 95 percent of Modified Proctor Density at -2 percent of OMC at a frequency of 1 per 3000 cu.m. of fill.

During construction the quality control should be exercised by conducting one set of density test of 3000 sq.m. of compacted area considering the importance of compaction in reinforced soil walls. (Clause 903.2.2 of MORTH 201 3) One set shall consist of 6 tests. The density tests shall be carried out in accordance with IS-2720 Part 28. Density measurement by nuclear gauge may be carried out as an alternative. For such a test the number of tests per set shall be doubled. If the retained fill is borrowed tests mentioned above should be carried out at same frequency of reinforced fill. Frequency during construction shall be as per MORTH 2013 Specifications.

### DRAINAGE AGGREGATE

The drainage material shall consist of clean crushed stone or gravel with particle size gradation as shown below (as per IRC SP : 102- 2014 )

Sieve Analysis test shall performed as per IS 2720 (Part 4) and one test is recommended per 250 cum of drainage material. Percentage passing through different size of sieve is given in the following table:

| Sieve size | %age finer |
|------------|------------|
| 37.5 mm    | 90-100%    |
| 20 mm      | 80-100%    |
| 12.50 mm   | 0-20%      |

Besides meeting gradation requirement it is to be ensured that the aggregates are not friable, flaky, elongated and are sound in strength.

### **Rate:**

The Contract unit rates for the items of all labour, material, tools, equipment and incidentals necessary to com etc. the work to the Specifications & payment shall be done in Cu.m.

**2:** Construction of compacted coarsed granular subbase (Grade-I crushed B.T materials of 53 mm to 26.5 mm @ 35 %,26.5 mm to 4.75 mm @ 45% ,Below 2.36 mm @ 20 %) by providing close graded material , mixing in a mechanical mix plant at OMC,carriage of a mix material to work site, spreading uniform layers with motor grader on prepared surface and compacting with vibratory power roller to achieve desire density , complete clause as per 401.



**401.1 Scope :**

This work shall consist of laying and compacting well graded material on prepared sub grade in accordance with the requirements of these specifications. The material shall be laid in one or more layers sub base and upper sub base (termed as sub base herein after) as necessary according to lines, grades and cross sections shown on the drawings or as directed by the Engineer.

**401.2 Materials:**

**401.2.1** The materials to be used for the work shall be crushed stone of required grading. The material shall be free from organic or other deleterious constituents and confirm to the coarse graded granular sub base grading I as mentioned below.

**TABLE 400-2.****GRADING FOR COARSE GRADED GRANULAR SUB-BASE****MATERIALS.**

| IS sieve Designation | Percent by weight passing the IS sieve. Grading I |
|----------------------|---|
| 75.0 mm              | 100   |
| 53.0 mm              | —   |
| 26.5 mm              | 55 – 75   |
| 9.5 mm               | —   |
| 4.75 mm              | 10 – 30   |
| 2.365 mm             |   |
| 0.425 mm             |   |
| 0.075 mm             | < 10  |
| CBR Value (Minimum)  | 30  |

Material passing 425 micron (0.425 mm) sieve for all the three grading when tested according to IS : 2720 (Part 5) shall have liquid limit and plasticity index not more than 25 and 6 percent respectively.

**401.2.2 Physical requirements:**

The materials shall have a 10 percent fines value of 50 KN or more (for sample in soaked condition) when tested in compliance with B.S.: 812 (Part 111). The water absorption value of the coarse aggregate shall be determined as per IS : 2386 (Part 3) : if this value is greater than 2 percent, the soundness test shall be carried out on the material delivered to site as per IS : 383.

**401.3 Strength of sub-base.**

It shall be ensured prior to actual execution that the material to be used in the sub base satisfies the requirements of CBR and other physical requirements when compacted and finished.

When directed by the Engineer, this shall be verified by performing CBR tests in the laboratory as required on specimens remolded at field dry density and moisture content and any other tests for the "Quality" of materials, as may be necessary.

**401.4 Construction Operations:****401.4.1 Preparation of Sub grade:**

Immediately prior to the laying of sub-base, the sub grade already finished to Clause 301 or 305 as applicable shall be prepared by removing all vegetation and other extraneous matter, lightly sprinkled with water, if necessary and rolled with two passes of 80-100 KN smooth wheeled roller.

**401.4.2 Spreading and compacting:**

The sub-base material of grading specified in the Contract shall be spread on the prepared sub grade with the help of a motor grader of adequate capacity, its blade having hydraulic controls suitable for initial adjustment and for maintaining the required slope and grade during the operation or other means as approved by the Engineer.

When the sub-base material consists of combination of materials mentioned in Clause 401.2.1, of this item mixing shall be done mechanically by the mix in place method.

Manual mixing shall be permitted only where the width of laying is not adequate for mechanical operations, as in small-sized jobs. The equipment used for mix-in-place construction shall be a rotator or similar approved equipment capable of mixing the material to the desired degree. If so desired by the Engineer, trial runs with the equipment shall be carried out to establish its suitability for the work.

Moisture content of the loose material shall be checked in accordance with IS:2720 (Part 2) and suitably adjusted by sprinkling additional water from a truck mounted or trailer

mounted water tank and suitable for applying water uniformly and at controlled quantities to variable widths of surface of other means approved by the Engineer so that, at the time of compaction, it is from 1 percent above to 2 percent below the optimum moisture content corresponding to IS:2720 (Part 8). While adding water, due allowance shall be made for evaporation losses. After water has been added, the material shall be processed by mechanical or other approved means like disc barrows, rotators until the layer is uniformly wet.

Immediately thereafter, rolling shall start. If the thickness of the compacted layer does not exceed 100 mm, a smooth wheeled roller of 80 to 100 KN weight may be used. For a compacted single layer upto 225 mm the compaction shall be done with help of a vibratory roller of minimum 80 to 100 KN static weight with plain drum or pad foot drum or heavy pneumatic tyred roller of minimum 200 to 300 KN weight having a minimum tyre pressure of 0.7 MN/ M<sup>2</sup> or equivalent capacity roller capable of achieving the required compaction. Rolling shall commence at the lower edge and proceed towards the upper edge longitudinally for portions having unidirectional cross fall and super elevation and shall commence at the edges and progress towards the centre for portions having cross fall on both sides each pass of the roller shall uniformly overlap not less than one third of the track made in the preceding pass. During rolling, the grade and cross fall (camber) shall be checked and any high sports or depressions, which become apparent, corrected by removing or adding fresh material. The speed of the roller shall not exceed 5 Km per hour.

Rolling shall be continued till the density achieved is at least 98 percent of the maximum dry density for the material determined as per IS : 2720 (Part 8). The surface of any layer of material on completion of compaction shall be well closed, free from movement under compaction equipment and from compaction planes, ridges, cracks or loose material. All loose, segregated or otherwise defective areas shall be made good to the full thickness of layer and re-compacted.

#### **401.5 Surface Finish and Quality Control of work:**

The surface finish of construction shall conform to the requirements of Clause 902 of MORT & H specifications. Control on the quality of materials and works shall be exercised by the Engineer in accordance with Section 900 of MORT & H specifications.

#### **401.6 Arrangements for Traffic:**

During the period of construction, arrangement of traffic shall be maintained in accordance with Clause 112 of MORT & H specifications.

**401.7 Measurements for Payment:** Granular sub base shall be paid as finished work in position on cross sectional measurements and computing the volume of GSB work in cubic meters by average area method.

The protection of edges of granular sub base extended over the full formation as shown in the drawing shall be considered incidental to the work of providing granular sub-base and as such no extra payment shall be made for the same.

**401.8 Rate:**

The Contract unit rate for granular sub base shall be payment in full for carrying out the required operations including full compensation for:

- [i] Making arrangements for traffic to Clause 112 as above except for initial treatment to verges, shoulders and construction of diversions.
- [ii] Furnishing all materials to be incorporated in the work including all royalties, fees, rents where necessary and all leads and lift.
- [iii] All labour, tools, equipment and incidentals to complete the work to the specifications.
- [iv] Carrying out the work in part widths of road where directed, and
- [v] Carrying out the required tests for quality control.

**3:** Providing and laying wet mix base course macadam 250 mm in Two layer using machine crushed chips as per required gradation mixing with required optimum quantity of water conveying the mix to site and spreading to grade and camber with mechanical paver consolidation by vibratory roller including material, labour, plant and machinery and equipment etc. complete.

**406.1 SCOPE**

This work shall consist of laying and compacting clean, crushed, graded aggregate and granular material, premixed with water, to a dense mass on a prepared subgrade sub base/ base or existing pavement as the case may be in accordance with the requirements of these specifications. The material shall be laid in one or more layers as necessary to lines, grades and cross-sections shown on the approved drawings or as directed by the Engineer.

The thickness of a single compacted Wet Mix Macadam layer shall not be less than 75mm. When vibrating or other approved types of compacting equipment are used, the compacted depth of a single layer of the sub-base course may be increased to 20cm upon approval of the Engineer.

This work shall also consist of the application of a single coat of low viscosity liquid bituminous material to a porous granular surface preparatory to the superimposition of bituminous treatment or mix..

## **406.2 MATERIALS**

### **406.2.1 AGGREGATES**

#### **406.2.1.1 PHYSICAL REQUIREMENTS :**

Course aggregates shall be crushed stone. If crushed gravel / shingle is used, not less than 90 percent by weight of the gravel / shingle pieces retained on 4.75 mm sieve shall have at least two fractured faces. The aggregates shall conform to the physical requirements set forth in Table 400-10 below.

**TABLE 400-1 PHYSICAL REQUIREMENT OF COARSE AGGREGATES FOR WET MIX MACADAM FOR SUB-BASE / BASE COURSES**

| Test   | Test Method                     | Requirements     |
|--|---------------------------------|------------------|
| 1.*Los Angeles Abrasion value                            | IS : 2386 (Part-4)              | 40 percent (Max) |
| Aggregate impact value                                   | IS : 2386 (Part-4) or IS : 5640 | 30 percent (Max) |
| 2. Combined Flakiness and Elongation indices ( Total )** | IS : 2386(PART-1)               | 30 percent (Max) |

\* Aggregates may satisfy requirements of either of the two tests.

\*\* To determine this combined proportion, the flaky stone from a representative sample should first be separated out. Flakiness index is weight of flaky stone metal divided by weight of stone sample only the elongated particles be separated out from the remaining (non flaky stone metal. Elongation index is weight of elongated particles divided by total non flaky particles. The value of flakiness index and elongation index so found are added up.

If the water absorption value of the coarse aggregate greater than 2 percent, the soundness test shall carried out on the material delivered to site as per 2386 (Part – 5).

**406.2.1.2 Grading requirements :**

The aggregates shall conform to the grading given in Table 400-11

**TABLE 400-11. GRADING REQUIREMENTS OF AGGREGATES FOR WET MIX MACADAM.**

| <b>IS Sieve Designation</b> | <b>Percent by weight Passing the IS sieve</b> |
|-----------------------------|---|
| 53.00 mm                    | 100   |
| 45.00 mm                    | 95-100  |
| 26.50 mm                    | -   |
| 22.40 mm                    | 60-80   |
| 11.20 mm                    | 40-60   |
| 4.75 mm                     | 25-40   |
| 2.36 mm                     | 15-30   |
| 600.00 micron               | 8-12  |
| 75.00 micron                | 0-8   |

Materials finer than 425 micron shall have plasticity index (P.I ) not exceeding 6.

The final gradation approved within these limits shall be well graded from coarse to fine and shall not vary from the low limit on one sieve to the high limit on the adjacent sieve or vice-versa.

**502.2 Materials for prime coat**

**502.2.1 Primer:** The choice of a emulsion bituminous primer shall depend upon the porosity characteristics of the surface to be primed as classified in IRC: 16 These are :

- (i) Surface of low porosity: such as wet mix macadam and water bound macadam.
- (ii) Surfaces of medium porosity; such as cement stabilized soil base,
- (iii) Surfaces of high porosity; such as a gravel base.

**Primer viscosity :**

The type and viscosity of the primer shall comply with the requirements of IS 8887, as sampled and tested for bituminous primer in accordance with these standards. Guidance on viscosity and rate of spray is given in Table 500-1.

**TABLE 500-1. VISCOSITY REQUIREMENT AND QUANTITY OF LIQUID BITUMINOUS PRIMER**

| Type of Surface | Kinematic Viscosity of Primer at 60° C ( Centistokes ) | Quantity of Liquid Bituminous Material per 10 Sq.M. (kg) |
|-----------------|--|--|
| Low porosity    | 30 – 60  | 6 to 9   |
| Medium porosity | 70 – 140   | 9 to 12  |
| High porosity   | 250 – 500  | 12 to 15   |

**Choice of primer :** The primer shall be emulsion bitumen complying with IS 8887 of a type and grade as specified in the Contract or as directed by the Engineer. The use of medium curing cutback as per IS 217 shall be restricted only for sites at sub-zero temperatures or for emergency applications as directed by the Engineer.

**502.2 Weather and Seasonal Limitations**

Bituminous primer shall not be applied to a wet surface (see 502.4.2) or during a dust storm or when the weather is foggy, rainy or windy or when the temperature in the shade is less than 10° C. Surfaces which are to receive emulsion primer should be damp. But no free or standing water shall be present.

**406.3 Construction Operation :**

**404.3.1** Preparation of base: The surface of the subgrade/sub-base/base to receive the water bound macadam course shall be prepared to the specification lines and cross fall (camber) and made free of dust and other extraneous material. Any ruts or soft yielding places shall be corrected in an approved manner and rolled until firm surface is obtained if

necessary by sprinkling water. Any sub-base/base/surface irregularities, where predominant, shall be made good by providing appropriate type of profile corrective course (levelling course) to clause 501 of these specifications.

As far as possible, laying water bound macadam course over an existing thick bituminous layer may be avoided since it will cause problems of internal drainage of the pavement at the interface of two courses. It is desirable to completely pick out the existing thin bituminous wearing course where water bound macadam is proposed to be laid over it. However, where the intensity of rain is low and the interface drainage facility is efficient, water bound macadam can be laid over the existing thin bituminous surface by cutting 50 mm x 50 mm furrows at an angle of 45 degrees to the centre line of the pavement at one metre intervals in the existing road. The directions and depth of furrows shall be such that they provide adequate bondage and also serve to drain water to the existing granular base course beneath the existing thin bituminous surface.

#### **406.3.2 Provision of lateral confinement of aggregates :**

While constructing wet mix macadam arrangement shall be made for the lateral confinement of wet mix. This shall be done by laying materials in adjoining shoulders along with that of wet mix macadam layer and following the sequence of operations described in Clause 407.4.1 as below.

### **407.4 Construction Operations:**

**407.4.1 Shoulder:** The sequence of operations shall be such that the construction of paved shoulder is done in layers each matching the thickness of adjoining pavement layer. Only after a layer of pavement and corresponding layers in paved and earth shoulder portion have been laid and compacted, the construction of next layer of pavement and shoulder shall be taken up.

Where the materials in adjacent layers are different, these shall be laid together and the pavement layer shall be compacted first. The corresponding layer in paved shoulder portion shall be compacted thereafter, which shall be followed by compaction of earth shoulder layer. The adjacent layers having same material shall be laid and compacted together.

In all cases where paved shoulders have to be provided along side of existing carriageway, the existing shoulders shall be excavated in full width and to the required depth as per clause 301.3.7 under no circumstances, box cutting shall be done for construction of shoulders.



Compaction requirement of earthen shoulder shall be as per table 300-2 in the case of bituminous courses, work on shoulder (earthen/hard/paved), shall start only after the pavement course has been laid and compacted.

During all stages of shoulder (earth/hard/paved) construction, the required cross fall shall be maintained to drain off surface water

Regardless of the method of laying, all shoulder construction material shall be placed directly on the shoulder. Any spilled material dragged on to the pavement surface shall be immediately removed, without damage to the pavement, and the area so affected thoroughly cleaned.

#### **406.3.4 Preparation of mix:**

Wet Mix Macadam shall be prepared in an approved mixing plant of suitable capacity having provision for controlled addition of water and forced / positive mixing arrangement like pug-mil or pan type mixer or concrete batching plant.

Optimum moisture for mixing shall be determined in accordance with IS : 2720 (Part – 8) after replacing the aggregate fraction retained on 22.4 mm sieve with material of 4.75 micron to 22.4 mm size. While adding water, due allowance should be made for evaporation losses. However, at the time of compaction, water in the wet mix should not vary from the optimum value by more than agreed limits. The mixed material should be uniformly wet and so segregation should be permitted.

#### **406.3.4 Spreading of mix:**

Immediately after mixing, the aggregates shall be spread uniformly and evenly upon the prepared sub grade / sub-base / base in required quantities. In no case should these be dumped in heaps directly on area where these are to be laid nor shall their hauling over a partly completed stretch be permitted.

The mix may be spread either by a paver finisher or motor grader. For portions where mechanical means cannot be used, manual means as approved by the Engineer shall be used. The motor grader shall be capable of spreading the material uniformly all over the surface. Its blade shall have hydraulic control suitable for initial adjustments and maintaining the same so as to achieve the specified slop and grade.

The paver finisher shall be self – propelled, having the following features:

- (i) Loading hoppers and suitable distribution mechanism

(ii) The screed shall have tamping and vibrating arrangement for initial compaction to the layer as it is spread without rutting or otherwise marring the surface profile.

(iii) The paver shall be equipped with necessary control mechanism so as to ensure that the finished surface is free from surface blemishes.

The surface of the aggregate shall be carefully checked with templates and all high or low spots remedied by removing or adding aggregate as may be tested by depth blocks during construction.

No segregation of larger and fine particles should be allowed. The aggregates as spread should be allowed. The aggregates as spread should be of uniform gradation with pockets of fine materials.

#### **406.3.5 Compaction:-**

After the mix has been laid to the required thickness, grade and care full / camber the same shall be uniformly compacted, to the full depth with suitable roller. If the thickness of single compacted layer does not exceed 100mm, as smooth wheel roller of 80 to 100 KN weigh may be used. For a compacted single layer up to 200mm, the compaction shall be done with the help of vibratory roller of minimum static weight of 80 to 100 KN or equivalent capacity roller. The speed of the roller shall not exceed 5 km/h. In portions having unidirectional cross fall / super elevation rolling shall commence from the lower edge and progress gradually towards the upper edge. Thereafter, roller should progress parallel to the center line of the road. Uniformly over-lapping each preceding track by at least one fourth width until the entire surface has been rolled. Alternate trips of the roller shall be terminated in stops at least 1 m away from any preceding stop.

In portions in camber, rolling should at the edge with the roller running forward and backward until the edges have been firmly compacted. The roller shall the progress gradually towards the center parallel to the center line of the road uniformly overlapping each of the preceding track by at least one – Fourth width until the entire surface has been rolled.

Any displacement occurring as a result of reversing of the direction of a roller or from any other caused shall be corrected at once as specified and / or removed and made good.

Along forms, Kerbs, walls or other places not accessible to the roller, the mixture shall be thoroughly compacted with mechanical tampers or a plate compactor. Skin patching of an area without scarifying the surface to permit proper bonding of the added material shall not be permitted.

Rolling should not be done when the sub grade is soft or yielding or when it caused a wave-like motion in the sub – base/ base course or sub grade. If irregularities develop during

rolling which exceed 12mm when tamped with a 3 meter straight edge, the surface should be loosened and premixed material added or removed as required before rolling again so as to achieve a conforming to the desired grade and cross fall. In no case should the use of unmixed material be permitted to make up the depressions.

Rolling shall be continued till the density achieved is at least 98 per cent of the maximum dry the material as determined by the method outlined in IS : 2720 ( Part-8 )

After completion, the surface of any finished layer shall be well-close, free from movement under compaction equipment or any compaction planes, ridges, cracks and loose material. All loose, segregated or otherwise defective areas shall be made good to the full thickness of the layer and re-compacted.

#### **406.3.6 Setting and drying:**

After final compaction of wet mix macadam course, the road shall be allowed to dry for 24 hours.

### **Construction**

#### **502.4.1 Equipment :**

The Primer distributor shall be a self-propelled or towed bitumen pressure sprayer equipped for spraying the material uniformly at specified rates and temperatures. Hand spraying of small areas. Inaccessible to the distributor, or as directed by the Engineer.

**502.4.2 Preparation of road surface :** The surface to be primed shall be prepared in accordance with Clauses **501.8** .

**501.8** This work shall consist of preparing an existing granular surface and shall be performed on such widths and lengths as shown on the drawing or as directed by the Engineer

Immediately prior to applying the primer the surface shall be carefully swept clean of dust and loose particles, care being taken not to disturb the inter locked aggregate. This is best achieved when the surface layer is slightly moist (lightly sprayed with water and the surface allowed to dry) and the surface should be kept moist until the primer is applied.

**502.4.3 Application of emulsion bituminous primer:** The viscosity and rate of application of the primer shall be at rate of 7.5 Kg / 10 Sq.m. as directed. The

bituminous primer shall be sprayed uniformly in accordance with Clause 501. The method for application of the primer will depend on the type of equipment to be used, size of nozzles, pressure at the spray bar and speed of forward movement. The Contractor shall demonstrate at a spraying trial, that the equipment and method to be used is capable of producing a uniform spray, within the tolerances specified.

**502.4.4 Curing of primer and opening to traffic:** A primed surface shall be allowed to cure for at least 24 hours or such other period as is found to be necessary to allow all the volatiles to evaporate before any subsequent surface treatment or mix is laid. Any unabsorbed primer shall first be blotted with an application of sand, using the minimum quantity possible. A primed surface shall not be opened to traffic other than that necessary to lay the next course. A very thin layer of clean sand may be applied to the surface of the primer, to prevent the primer picking up under the wheels of the paver and the trucks delivering bituminous material to the paver.

**502.5 Quality Control of Work :**

For control of the quality of materials supplied and the works carried out, the relevant provisions of Section 901 of MORT & H specifications shall apply

**406.4 Opening to Traffic:**

Preferably no vehicular traffic of any kind should be allowed on the finished wet mix macadam surface till it has dried and the wearing course laid.

**406.5 Surface Finish and Quality control of work**

**406.5.1 Surface evenness:**

The surface finish of construction shall conform to the requirements of Clause 902 of MORT & H specifications.

**406.5.2 Quality Control:**

Control on the quality of materials and works shall be exercised by the Engineer in accordance with section 901 of MORT & H specifications

**406.6 Rectification of Surface Irregularity:**

Where the surface irregularity of the wet mix macadam course exceeds the permissible tolerances or where the course is otherwise defective due to subgrade soil getting mixed with the aggregates, the full thickness of the layer shall be scarified over the affected area. Reshaped with added premixed material or removed and replaced with fresh premixed material as applicable and recomputed in accordance with Clause 406.3 of this item. The area treated in the aforesaid manner shall not be less than 5m long and 2m wide. In no case shall depressions be filled up with unmixed and ungraded material or fines.

**406.6.7 Arrangement for Traffic:**

During the period of construction, arrangement of traffic shall be done as per Clause 112 of MORT & H specifications

**406.8 Measurements for Payment:**

Wet mix macadam shall be paid as finished work in position on cross sectional measurements and computing the volume of WMM work in cubic meters by average area method including cost of providing & applying emulsion Bitumen primer coat @ 7.5 kg/10 Sq.m. of the area where WMM are carried out.

**406.9 Rate:** The Contract unit rate for wet mix macadam shall be payment in full for carrying out the required operations including full compensation for all components listed below.

- i) Making arrangement for traffic to Clause 112 as above Except for initial treatment to verges, shoulders and Construction of diversions:
- ii) Furnishing wet materials to be incorporated in the work including all royalties, fees, rents where necessary and all leads and lifts;
- iii) All labour, tools, equipment and incidentals to complete the work to the specifications;
- iv) Carrying out the work in part widths of road where directed; and
- v) Carrying out the required tests for quality control.

**4:** Providing and laying DBM using crushed stone aggregate BT chips as per required gradation and using emulsion asphalt as a tack coat @ 2.5 kg / 10 sqmt and the VG-30 grade asphalt at 45 kg/MT) by total weight of mix hot laid process using drum mix plant including heating and mixing asphalt & materials by drum mix process transporting the mix and laying by paver finisher including consolidation with vibratory roller including cost of

material, labour, machinery equipment and fuel , oil , lubricant for plant and machinery using contractor's own plant and machineries etc. complete

### **507.1. Scope**

This work shall consist of construction in a single layer of DBM on a previously prepared base or sub-base. The thickness of a single layer shall be 50mm

### **507.2. Materials**

**507.2.1. Bitumen:** The bitumen shall be paving bitumen of Penetration Grade complying with Indian Standard Specifications for “Paving Bitumen” IS: 73, and of the penetration indicated in Table 500-10 for dense bitumen macadam.

**507.2.2. Coarse aggregates:** The coarse aggregates shall consist of crushed rock, crushed gravel or other hard material retained on the 2.36 mm sieve. They shall be clean, hard, durable, of cubical shape, free from dust and soft or friable matter, organic or other deleterious substances. Where the Contractor's selected source of aggregates have poor affinity for bitumen, as a condition for the approval of that source, the bitumen shall be treated- with an approved anti-stripping agent, as per the manufacturer's recommendations, without additional payment. Before approval of the source, the aggregates shall be tested for stripping. The aggregates shall satisfy the physical requirements specified in Table 500-8, for dense bituminous macadam.

Where crushed gravel is proposed for use as aggregate, not less than 90% by weight of the crushed material retained on the 4.75 mm sieve shall have at least two fractured faces.

**507.2.3. Fine aggregates:** Fine aggregates shall consist of crushed or naturally occurring mineral material, or a combination of the two, passing the 2.36mm sieve and retained on the 75 micron sieve. They shall be clean, hard, durable, dry and free from dust, and soft or friable matter, organic or other deleterious matter.

The fine aggregate shall have a sand equivalent value of not less than 50 when tested in accordance with the requirement of 18:2720 (Part 37).

The plasticity index of the fraction passing the 0.425 mm sieve shall not exceed 4. when tested in accordance with IS: 2720 (Part 5)

**TABLE 500-8. PHYSICAL REQUIREMENTS FOR COARSE  
AGGREGATE FOR DENSE GRADED BITUMINOUS MACADAM**

| Property            | Test   | Specification                |
|---------------------|--|------------------------------|
| Cleanliness(dust)   | Grain size analysis  | Max 5% passing 0.075mm sieve |
| Particle shape      | Flakiness and Elongation Index (Combined) <sup>2</sup>           | Max 30%                      |
| Strength*           | Los Angeles Abrasion Value <sup>3</sup>                          | Max 35%                      |
|                     | Aggregate Impact Value <sup>4</sup>                              | Max 27%                      |
| Durability          | Soundness:<br><br>Sodium Sulphate<br><br>Magnesium Sulphate      | Max 12%<br><br>Max 18%       |
| Water Absorption    | Water absorption <sup>6</sup>                                    | Max 2%                       |
| Stripping           | Coaling and Stripping of Bitumen Aggregate Mixtures <sup>7</sup> | Minimum retained coating 95% |
| Water Sensitivity** | Retained Tensile Strength <sup>8</sup>                           | Min80%                       |

- Notes :
- |   |                     |
|---|---------------------|
| 1. IS : 2386 Part 1   | 5. IS : 2386 Part 5 |
| 2. IS : 2386 Part 1   | 6. IS : 2386 Part 3 |
| (the elongation test to be done only on non-flaky aggregates in the sample) |                     |
| 3. IS: 2386 Part 4*   | 7. IS: 6241         |
| 4. IS: 2386 Part 4*   | 8. AASHTOT283**     |

\* Aggregate may satisfy requirements of either of these two tests.

\*\* The water sensitivity test is only required if the minimum retained coating in the stripping test is less than 95%.

**507.2.4. Filler :** Filler shall consist of finely divided mineral matter such as rock dust, hydrated lime or cement approved by the Engineer.

The filler shall be graded within the limits indicated in Table 500-9.

**TABLE 500-9. GRADING REQUIREMENTS FOR MINERAL FILLER**

| IS Sieve (mm) | Cumulative per cent passing by weight of total aggregate |
|---------------|--|
| 0.6           | 100  |
| 0.3           | 95-100   |
| 0.075         | 85-100   |

The filler shall be free from organic impurities and have a Plasticity Index not greater than 4. The Plasticity Index requirement shall not apply if filler is cement or lime. When the coarse aggregate is gravel, 2 per cent by weight of total aggregate, shall be Portland cement or hydrated lime and the percentage of fine aggregate reduced accordingly. Cement or hydrated lime is not required when the limestone aggregate is used. Where the aggregates fail to meet the requirements of the water sensitivity test in Table 500-8, then 2 per cent by total weight of aggregate, of hydrated lime shall be added without additional cost.

**507.2.5. Aggregate grading and binder content:** When tested in accordance with IS:2386 Part 1 (wet sieving method), the combined grading of the coarse and fine aggregates and added filler for the particular mixture shall fall within the limits shown in Table 500-10, for dense bituminous macadam grading 1 or 2 as specified in the Contract. The type and quantity of bitumen, and appropriate thickness, are also indicated for each mixture type.

**TABLE 500-10. COMPOSITION OF DENSE GRADED BITUMINOUS MACADAM PAVEMENT LAYERS**

| Grading                          | 1  | 2     |
|----------------------------------|--|-------|
| Nominal aggregate size           | 40mm   | 25mm  |
| Layer Thickness                  | 80-100 mm  | 50 mm |
| <b>IS Sieve<sup>1</sup> (mm)</b> | <b>Cumulative % by weight of total aggregate passing</b> |       |
| 45                               | 100  |       |
| 37.5                             | 95-100   | 100   |



|   |          |               |
|---|----------|---------------|
| 26.5  | 63-93    | 90-100        |
| 19  | --       | 71-95         |
| 13.2  | 55-75    | 56-80         |
| 9.5   | --       | --            |
| 4.75  | 38-54    | 38-54         |
| 2.36  | 28-42    | 28-42         |
| 1.18  | --       | --            |
| 0.6   | --       | --            |
| 0.3   | 7-21     | 7-21          |
| 0.15  | --       | --            |
| 0.075   | 2-8      | 2-8           |
| Bitumen content %<br>by mass of total<br>mix <sup>2</sup> | Min4.0   | Min 4.5       |
| Bitumen grade<br>(pen)                                    | 65 or 90 | 60/70 (VG-30) |

Notes: 1. The combined aggregate grading shall not vary from the low limit on one sieve to the high limit on the adjacent sieve.

2. Determined by the Marshall method.

### 5073. Mixture Design

**5073.1. Requirement for the mixture:** Apart from conformity with the grading and quality requirements for individual ingredient the mixture shall meet the requirements set out in Table 500-11.

**TABLE 500-11. REQUIREMENTS FOR DENSE GRADED BITUMINOUS MACADAM**

|  |   |
|--|---|
| Minimum stability (kN at 60°C)           | 9.0   |
| Minimum flow (mm)                        | 2   |
| Maximum flow (mm)                        | 4   |
| Compaction level (Number of blows)       | 75 blows on each of the two faces of the specimen |
| Per cent air voids                       | 3-6   |
| Percent voids in mineral aggregate (VMA) | See Table 500-12 below.                           |
| Per cent voids filled with bitumen (VFB) | 65-75   |

The requirements for minimum per cent voids in mineral aggregate (VMA) are set out in Table 500-12.

**TABLE 500-12. MINIMUM PER CENT VOIDS IN MINERAL AGGREGATE (VMA)**

| Nominal Maximum Particle Size <sup>1</sup> (mm) | Minimum VMA Percent Related to Design Percentage Air Voids |      |      |
|---|--|------|------|
|   | 3.0  | 4.0  | 5.0  |
| 9.5   | 14.0   | 15.0 | 16.0 |
| 12.5  | 13.0   | 14.0 | 15.0 |
| 19.0  | 12.0   | 13.0 | 14.0 |
| 26.5  | 11.0   | 12.0 | 13.0 |
| 37.5  | 10.0   | 11.0 | 12.0 |

Notes: 1. The nominal maximum particle size is one size larger than the first sieve to retain more than 10 per cent.

2. Interpolate minimum voids in the mineral aggregate (VMA) for design air voids values between those listed.

**507.3.2. Binder content:** The binder content shall be optimized to achieve the requirements of the mixture set out in Table 500-11 and the traffic volume specified in the Contract. The Marshall method for determining the optimum binder content shall be adopted as described in The Asphalt Institute Manual MS-2, replacing the aggregates retained on the 26.5 mm sieve by the aggregates passing the 26.5 mm sieve and retained on the 22.4 mm sieve, where approved by the Engineer.

Where 40 mm dense bituminous macadam mixture is specified, the modified Marshall method described in MS-2 shall be used. This method requires modified equipment and procedures; particularly the minimum stability values in Table 500-11 shall be multiplied by 2.25, and the minimum flow shall be 3 mm.

**507.3.3. Job mix formula:** The Contractor shall inform the Engineer in writing, at least 20 days before the start of the work, of the job mix formula proposed for use in the works, and shall give the following details:

- (i) Source and location of all materials:
- (ii) Proportions of all materials expressed as follows where each is applicable:
  - (a) Binder type, and percentage by weight of total mixture;
  - (b) Coarse aggregate/Fine aggregate/Mineral filler as percentage by weight of total aggregate including mineral filler;
- (iii) A single definite percentage passing each sieve for the mixed aggregate:
- (iv) The individual gradings of the individual aggregate fractions, and the proportion of each in the combined grading.
- (v) The results of tests enumerated in Table 500-11 as obtained by the Contractor;
- (vi) Where the mixer is a batch mixer, the individual weights of each type of aggregate, and binder per batch.
- (vii) Test results of physical characteristics of aggregates to be used;
- (viii) Mixing temperature and compacting temperature.

The job Mix Formula shall be based on the Mix Design Prepared by GERI Or Govt. Approved Laboratory and The Same Shall be got approved from Executive Engineer.

While establishing the job mix formula, the Contractor shall ensure that it is based on a correct and truly representative sample of the materials that will actually be used in the work and that the mixture and its different ingredients satisfy the physical and strength requirements of these Specifications.

Approval of the job mix formula shall be based on independent testing by the Engineer for which samples of all ingredients of the mix shall be furnished by the Contractor as required by the Engineer.

The approved job mix formula shall remain effective unless and until a revised Job Mix Formula is approved. Should a change in the source of materials be proposed, a new job mix formula shall be forwarded to the Engineer for approval before the placing of the material.

**507.3.4. Plant trials - permissible variation in job mix formula:**

Once the laboratory job mix formula is approved, the Contractor shall carry out plant trials at the mixer to establish that the plant can be set up to produce a uniform mix conforming to the approved job mix formula. The permissible variations of the individual percentages of the various ingredients in the actual mix from the job mix formula to be used shall be within the limits as specified in Table 500-13. These variations are intended to apply to individual specimens taken for quality control tests in accordance with Section 900.

**TABLE 500-13. PERMISSIBLE VARIATIONS FROM THE JOB MIX FORMULA**

| Description                             | Permissible variation |                |
|---|-----------------------|----------------|
|   | Base/binder course    | Wearing coarse |
| Aggregate passing 19nun sieve or larger | ±8%                   | ±7%            |
| Aggregate passing 13.2mm, 9.5mm         | ±7%                   | ±6%            |
| Aggregate passing 4.75mm                | ±6%                   | ± 5%           |
| Aggregate passing 2.36mm, 1.18mm, 0.6mm | ±5%                   | ±4%            |
| Aggregate passing 0.3mm, 0. 15mm        | ±4%                   | ±3%            |
| Aggregate passing 0.075mm               | ±2%                   | ± 1.5%         |

|                    |       |       |
|--------------------|-------|-------|
| Binder content     | ±0.3% | ±0.3% |
| Mixing temperature | ±10°C | ±10°C |

Once the plant trials have demonstrated the capability of the plant, and the trials are approved, the laying operation may commence. Over the period of the first month of production for laying on the works, the Engineer shall require additional testing of the product to establish the reliability and consistency of the plant.

**507.3.5. Laying Trials:** Once the plant trials have been successfully completed and approved, the Contractor shall carry out laying trials, to demonstrate that the proposed mix can be successfully laid, and compacted all in accordance with Clause 501. The laying trial shall be carried out on a suitable area which is not to form part of the works, unless specifically approved in writing, by the Engineer. The area of the laying trials shall be a minimum of 100 sq.m. of construction similar to that of the project road, and it shall be in all respects, particularly compaction, the same as the project construction, on which the bituminous material is to be laid.

The Contractor shall previously inform the Engineer of the proposed method for laying and compacting the material. The plant trials shall then establish if the proposed laying plant, compaction plant, and methodology is capable of producing satisfactory results. The density of the finished paving layer shall be determined by taking cores, no sooner than 24 hours after laying, or by other approved method.

Once the laying trials have been approved, the same plant and methodology shall be applied to the laying of the material on the project, and no variation of either shall be acceptable, unless approved in writing by the Engineer, who may at his discretion require further laying trials.

#### **507.4. Construction Operations**

**507.4.1: Weather and seasonal limitations:** The provisions of Clause 501.5.1 of MORT &H shall apply.

**507.4.2. Preparation of base:** The base on which Dense Graded Bituminous Material is to be laid shall be prepared in accordance with Clauses 501 and 902 of MORT&H specifications as appropriate, or as directed by the Engineer. The surface shall be thoroughly swept clean by a mechanical broom, and the dust removed by compressed air. In locations where-mechanical broom cannot access, other approved methods shall be used as directed by the Engineer.

**507.4.3. Geosynthetics:** Where Geosynthetics are specified in the Contract this shall be in accordance with the requirements stated in Clause 703 of MORT& H specifications.

**507.4.4. Stress absorbing layer:** Where a stress absorbing layer is specified in the Contract, this shall be applied in accordance with the requirements of Clause 522 of MORT& H specifications.

**507.4.5. Prime coat:** Where the material on which the dense bituminous macadam is to be laid is other than a bitumen bound layer, a prime coat shall be applied, as specified, in accordance with the provisions of Clause 502 of MORT&H specifications or as directed by the Engineer.

**507.4.6. Tack coat:** Tack coat shall be applied as specified, in accordance with the provisions of Clause 503 as under

### **503 Tack Coat :-**

#### **503.1 Scope :-**

This work shall consist of the application of a single coat of 80/100(VG-10) grade bitumen on prepared surface preparatory to the superimposition of a bituminous mix, when specified in the contract or instructed by the engineer.

#### **503.2 Materials :-**

**503.2.1 Binder :-** The binder used for tack coat shall be paving bitumen of penetration grade 60/70 grade complying with Indian Standard specification for “Paving Bitumen” IS:73.

#### **503.3 Weather and Seasonal Limitations :-**

Bituminous material shall not be applied to a wet surface or during a dust storm or when the weather is foggy, rainy or windy or when the temperature in the shade is less than 10° C.

#### **503.4 Construction :-**

##### **503.4.1 Equipment :-**

The tack coat distributor shall be a self-propelled or towed bitumen pressure sprayer equipped for spraying the material uniformly at a specified rate, hand spraying of small areas, inaccessible to the distributor in narrow strips, shall be sprayed with a pressure hand sprayer or as directed by the Engineer.

**503.4.2 Preparation of base :-**

The surface on which the tack coat is to be applied shall be clean and free from dust, dirt and any extraneous material and other wise prepared in accordance with the requirements of Clauses-501.8 & 513 as appropriate. Immediately before the application of the tack coat the surface shall be swept clean with a mechanical broom and high-pressure air jet or by other means as directed by the Engineer.

**503.4.3 Application of tack coat :- (as per IRC - 16 - 2008)**

The application on tack coat shall be at 2.5 Kg/ 10 Sq.mt. as specified in the contract and shall be applied uniformly.

The method of application of the tack coat will depend on the type of equipment to be used size of nozzles, pressure at the spray bar, and speed of forward movement. The contractor shall demonstrate at a spraying trial that the equipment and method to be used is capable of producing a uniform spay, within the tolerances specified.

**507.4.7. Mixing and transportation of the mixture:** The provisions as specified in Clauses 501.3 and 501.4 shall apply.

**501.3 Mixing :-** Premixed bituminous materials, including bituminous macadam dense bituminous macadam semi dense bituminous concrete and bituminous concrete and bituminous concrete, shall be prepared in a hot mix plant of adequate capacity and bituminous concrete, shall be prepared in a hot mix plant of adequate capacity and capable of yielding a mix of proper and uniform quality with thoroughly coating aggregates. Appropriate mixing temperatures can be found in 500.5 of these specifications, the difference in temperature between the binder and aggregate should at no time exceed 14<sup>0</sup> C. In order to ensure uniform quality of the mix and belief writing of aggregates, the hot mix plan shall be calibrated from time to time.

If a continuous mixing plant is to be used for mixing the bituminous bound macadam, the Contractor Must demonstrate by laboratory analysis that the cold feed combined grading is within the grading limits specified for the bituminous bound material. In the case of a designed job mix, the bitumen and filter content shall be derived using this combined grading. Further debits she available in the Manual for Construction and Supervision of bituminous works.

**501.4 Transporting :-**

Bituminous materials shall be transported in clean insulated vehicles, and unless other wise agreed by the Engineer, shall be covered while in transit or awaiting tipping, Subject to the approval of am Engineer, a thin coating of diesel or lubricating oil may be

applied to the interior of the vehicle to prevent sticking and to facilitate discharge of the material.

**507.4.8. Spreading:** The provisions of Clauses 501.5.3 and 501.5.4 as stated under shall apply.

**501.5.3. Spreading:** Except in areas where a mechanical paver cannot access, bituminous materials shall be spread, levelled and tamped by an approved self-propelled paving machine. As soon as possible after arrival at site, the materials shall be supplied continuously to the paver and laid without delay.

The rate of delivery of material to the paver shall be regulated to enable the paver to operate continuously. The travel rate of the paver, and its method of operations, shall be adjusted to ensure an even and uniform flow of bituminous material across the screed, free from dragging, tearing and segregation of the material. In areas with restricted space where a mechanical paver cannot be used, the material shall be spread, raked and levelled with suitable hand tools by experienced staff, and compacted to the satisfaction of the Engineer.

The minimum thickness of material laid in each paver pass shall be in accordance with the minimum values given in the relevant parts of these Specifications. When laying binder course or wearing course approaching an expansion joint of a structure, machine laying shall stop 300mm short of the joint. The remainder of the pavement up to the joint, and the corresponding area beyond it, shall be laid by hand, and the joint or joint cavity shall be kept clear of surfacing material.

Bituminous material, with a temperature greater than 145°C, shall not be laid or deposited on bridge deck waterproofing systems, unless precautions against heat damage have been approved by the Engineer. Hand placing of pre-mixed bituminous materials shall only be permitted in the following circumstances:

- (i) For laying regulating courses of irregular shape and varying thickness.
- (ii) In confined spaces where it is impracticable for a paver to operate.
- (iii) For footways.
- (iv) At the approaches to expansion joints at bridges, viaducts or other structures.
- (v) For laying mastic asphalt in accordance with Clause 515.
- (vi) For filling of potholes.
- (vii) Where directed by the Engineer.



Manual spreading of pre-mixed wearing course material or the addition of such material by hand-spreading to the paved area, for adjustment of level, shall only be permitted in the following circumstances:

- (i) At the edges of the layers of material and at gullies and manholes.
- (ii) At the approaches to expansion joints at bridges, viaducts or other structures.
- (iii) As directed by the Engineer.

**501.5.4. Cleanliness and overlaying:** Bituminous material shall be kept clean and uncontaminated. The only traffic permitted to run on bituminous material to be overlaid shall be that engaged in laying and compacting the next course or, where a binder course is to be sealed or surface dressed, that engaged on such surface treatment. Should any bituminous material become contaminated the Contractor shall make it good to the satisfaction of the Engineer, in compliance with Clause 501.8.

Binder course material shall not remain uncovered by either the wearing course or surface treatment, whichever is specified in the Contract, for more than three consecutive days after being laid. The Engineer may extend this period, by the minimum amount of time necessary, because of weather conditions or for any other reason. If the surface of the base course is subjected to traffic, or not covered within three days, a tack coat shall be applied, as directed by the Engineer.

**507.4.9. Rolling:** The general provisions of Clauses 501.6 and 501.7 shall apply, as modified by the approved laying trials. The compaction process shall be carried out by the same plant, and using the same method, as approved in the laying trials, which may be varied only with the express approval of the Engineer in writing.

#### **501.6. Compaction**

Bituminous materials shall be laid and compacted in layers which enable the specified thickness, surface level regularity requirements and compaction to be achieved. Compaction of bituminous materials shall commence as soon as possible after laying. Compaction shall be substantially completed before the temperature falls below the minimum rolling temperatures stated in the relevant part of these Specifications. Rolling of the longitudinal joints shall be done immediately behind the paving operation. After this, rolling shall commence at the edges and progress towards the centre longitudinally except that on super elevated and unidirectional cambered portions, it shall progress from the lower to the upper edge parallel to the centre line of the pavement. Rolling shall continue until all roller marks have been removed from the surface. All deficiencies in the surface after laying shall be made good by the attendants behind the paver, before initial rolling is commenced. The initial or breakdown rolling shall be done with 8-10 tonnes dead weight

smooth-wheeled rollers. The intermediate rolling shall be done with 8-10 tonnes dead weight or vibratory roller or with a pneumatic tyred roller of 12 to 15 tonnes weight having nine wheels, with a tyre pressure of at least 5.6 kg/sq.cm. The finish rolling shall be done with 6 to 8 tonnes smooth wheeled tandem rollers.

Where compaction is to be determined by density of cores the requirements to prove the performance of rollers shall apply in order to demonstrate that the specified density can be achieved. In such cases the Contractor shall nominate the plant, and the method by which he intends to achieve the specified level of compaction and finish at temperatures above the minimum specified rolling temperature. Laying trials shall then demonstrate the acceptability of the plant and method used.

Bituminous materials shall be rolled in a longitudinal direction, with the driven rolls nearest the paver. The roller shall first compact material adjacent to joints and then work from the lower to the upper side of the layer, overlapping on successive passes by at least one-third of the width of the real roll or, in the case of a pneumatic-tyred roller, at least the nominal width of 300mm

In portions with super-elevated and uni-directional camber, after the edge has been rolled, the roller shall progress from the lower to the upper edge.

Rollers should move at a speed of not more than 5 km per hour. The roller shall not be permitted to stand on pavement which has not been fully compacted, and necessary precautions shall be taken to prevent dropping of oil, grease, petrol or other foreign matter on the pavement either when the rollers are operating or standing. The wheels of rollers shall be kept moist with water, and the spray system provided with the machine shall be in good working order, to prevent the mixture from adhering to the wheels. Only sufficient moisture to prevent adhesion between the wheels of rollers and the mixture should be used. Surplus water shall not be allowed to stand on the partially compacted pavement.

#### **501.7. Joints**

Where longitudinal joints are made in pre-mixed bituminous materials, the materials shall be fully compacted and the joint made flush in one of the following ways; only method (iii) shall be used for transverse joints:

- (i) by beating the joints with an approved joint heater when the adjacent width is being laid, but without cutting back or coating with binder. The heater shall raise the temperature of the full depth of material, to within the specified range of minimum rolling temperature and maximum temperature at any stage for the material, for a width not less than 75 mm. The Contractor shall have equipment available, for use in the event of a heater breakdown, to form joints by method (iii);

- (ii) by using two or more pavers operating in echelon, where this is practicable, and in sufficient proximity for adjacent widths to be fully compacted by continuous rolling;
- (iii) by cutting back the exposed joint, for a distance equal to the specified layer thickness, to a vertical face, discarding all loosened material and coating the vertical face completely with 80/100 penetration grade hot bitumen, or cold-applied bitumen, or polymer modified adhesive bitumen tape with a minimum thickness of 2 mm, before the adjacent width is laid.

All joints shall be offset at least 300 mm from parallel joints in the layer beneath or as directed, and in a layout approved by the Engineer. Joints in the wearing course shall coincide with either the lane edge or the lane marking, whichever is appropriate. Longitudinal joints shall not be situated in wheel track zones.

#### **507.5. Opening to Traffic**

The newly laid surface shall not be open to traffic for at least 24 hrs after laying and completion of compaction, without the express approval of the Engineer in writing.

#### **507.6. Surface Finish and Quality Control of Work**

The surface finish of the completed construction shall conform to the requirements of Clause 902 of MORT&H specifications. All materials and workmanship shall comply with the provisions set out in Section 900 of MORT&H Specification.

#### **507.7. Arrangements for Traffic**

During the period of construction, arrangements for traffic shall be made in accordance with the provisions of Clause 112 of MORT &H specifications.

#### **507.8. Measurement for Payment**

The payment shall be made on the tonnage basis of the weight of mix aggregates and bitumen. For this purpose, the contractor shall have to install a weigh-bridge of suitable capacity for the purpose of weighing dumpers at suitable place at his cost as directed. Weight of empty dumpers and weight of loaded dumper will be recorded in bound and numbered register on plant site.

Department will be free to get some loaded dumpers test checked at other weight bridge. Weigh bridge will be periodically got calibrated and verified from weight and measure authorities.

For the purpose of application of tack coat, if the theoretical area as per sanctioned estimate for basic of tonne differs with the actual area of work done in the field then the reduction in or addition to payment shall have to be effected to the contractor on pro-rata basis depending upon the area reduced or exceeded respectively.

Weight of mix materials will be done in presence of responsible person, not less than the rank of Supervisor of Department and the measurements shall be recorded by the Deputy Executive Engineer or Assistant Engineer or Additional Assistant Engineer, if so authorized. Record of each dumper will be mentioned separately in bond and numbered register which will be maintained by the Department representatives and signed by the contractor. Proper gate pass system shall be established for the vehicle coming to the plant site and going from the site. The location of the K.M. hectometer and meter in which individual dumpers are unloaded shall be recorded carefully.

#### **507.9. Rate**

The contract unit rate for Dense Graded Bituminous Macadam shall be payment in full for carrying out the all required operations as specified. The rate shall include the provision of bitumen at 4.50 per cent by weight of the total mixture.

No payment shall be made for Extra Consumption of Bitumin which is due to variation in proportion of Bitumin in Mix Design and specified in the Description of item above.

The rate shall include for all components listed below.

- (i) Making arrangements for traffic to clause 112 except for initial treatment to verge, shoulders and construction of diversions.
- (ii) Preparation of the surface to revive the materials.
- (iii) Providing all materials to be incorporated in the work including arrangement for stock yards. All royalties, fees rents where necessary and all leads and lifts.
- (iv) Mixing transporting, laying and compacting the mix as specified.
- (v) All labour, tools equipment, plant including installation of hot mix plant, power supply units and all machinery incidental to complete the work to these specification.
- (vi) Carrying out the work in part widths of the road where directed.
- (vii) Carrying out all tests for control of quality, and
- (viii) The rate shall cover the provision of bitumen at the rate specified in the contract, with the provision that the variation in actual percentage of bitumen used will be assessed and the payment adjusted accordingly.
- (ix) The rate for premixed material are to include for all wastage in cutting of joints etc.

- (x) The rates are to include for all necessary testing mix design transporting and testing of samples, and cores. If there is not a project specific : laboratory, the contractor must arrange to carry out all necessary testing at an outside laboratory approved by the Engineer, and all costs incurred are deemed to be included in the rate quoted for the material.
- (xi) The cost of all plant and laying trials as specified to prove the mixing and laying methods is deemed, to be included in the contractor's rates for the materials.

**5:** Providing and laying 30 mm Bitumen concrete using crushed stone aggregate BT chips as per required gradation and the VG-30 grade asphalt at 54 kg/MT)by total weight of mix hot laid process using hot mix plant including heating and mixing asphalt & materials by hot mix process transporting the mix and laying by paver finisher including consolidation with vibratory roller including cost of material, labour, machinery equipment and fuel , oil , lubricant for plant and machinery using contractor's own plant and machineries etc. complete.

**6:** Providing and applying priming coat with emulsion SS1 grade at the rate of 7.50 kg/ 10 Sq.mt. including cost of asphalt and preparing the surface heating, and applying etc. complete.

### **502.1 Scope**

This work shall consist of the application of a single coat of low viscosity liquid bituminous material to a porous granular surface preparatory to the superimposition of bituminous treatment or mix..

### **502.2 Materials**

**502.2.1 Primer:** The choice of a emulsion bituminous primer shall depend upon the porosity characteristics of the surface to be primed as classified in IRC: 16 These are :

- (iv) Surface of low porosity: such as wet mix macadam and water bound macadam.
- (v) Surfaces of medium porosity; such as cement stabilized soil base,

- (vi) Surfaces of high porosity; such as a gravel base.

- **Primer viscosity :**

The type and viscosity of the primer shall comply with the requirements of IS 8887, as sampled and tested for bituminous primer in accordance with these standards. Guidance on viscosity and rate of spray is given in Table 500-1.

**TABLE 500-1. VISCOSITY REQUIREMENT AND QUANTITY OF LIQUID BITUMINOUS PRIMER**

| Type of Surface | Kinematic Viscosity of Primer at 60° C ( Centistokes ) | Quantity of Liquid Bituminous Material per 10 Sq.M. (kg) |
|-----------------|--|--|
| Low porosity    | 30 – 60  | 6 to 9   |
| Medium porosity | 70 – 140   | 9 to 12  |
| High porosity   | 250 – 500  | 12 to 15   |

- **Choice of primer :** The primer shall be emulsion bitumen complying with IS 8887 of a type and grade as specified in the Contract or as directed by the Engineer. The use of medium curing cutback as per IS 217 shall be restricted only for sites at sub-zero temperatures or for emergency applications as directed by the Engineer.

### **502.3 Weather and Seasonal Limitations**

Bituminous primer shall not be applied to a wet surface (see 502.4.2) or during a dust storm or when the weather is foggy, rainy or windy or when the temperature in the shade is less than 10° C. Surfaces which are to receive emulsion primer should be damp. But no free or standing water shall be present.

**Construction****502.5.1.1 Equipment :**

The Primer distributor shall be a self-propelled or towed bitumen pressure sprayer equipped for spraying the material uniformly at specified rates and temperatures. Hand spraying of small areas. Inaccessible to the distributor, or as directed by the Engineer.

**502.4.2 Preparation of road surface :** The surface to be primed shall be prepared in accordance with Clauses **501.8** .

**501.8** This work shall consist of preparing an existing granular surface and shall be performed on such widths and lengths as shown on the drawing or as directed by the Engineer

Immediately prior to applying the primer the surface shall be carefully swept clean of dust and loose particles, care being taken not to disturb the inter locked aggregate. This is best achieved when the surface layer is slightly moist (lightly sprayed with water and the surface allowed to dry) and the surface should be kept moist until the primer is applied.

**502.4.3 Application of emulsion bituminous primer:** The viscosity and rate of application of the primer shall be at rate of 7.5 Kg / 10 Sq.m. as directed. The bituminous primer shall be sprayed uniformly in accordance with Clause 501. The method for application of the primer will depend on the type of equipment to be used, size of nozzles, pressure at the spray bar and speed of forward movement. The Contractor shall demonstrate at a spraying trial, that the equipment and method to be used is capable of producing a uniform spray, within the tolerances specified.

**502.4.4 Curing of primer and opening to traffic:** A primed surface shall be allowed to cure for at least 24 hours or such other period as is found to be necessary to allow all the volatiles to evaporate before any subsequent surface treatment or mix is laid. Any unabsorbed primer shall first be blotted with an application of sand, using the minimum quantity possible. A primed surface shall not be opened to traffic other than that necessary to lay the next course. A very thin layer of clean sand may be applied to

the surface of the primer, to prevent the primer picking up under the wheels of the paver and the trucks delivering bituminous material to the paver.

#### **502.6 Quality Control of Work :**

For control of the quality of materials supplied and the works carried out, the relevant provisions of Section 901 of MORT & H specifications shall apply.

#### **502.6 Arrangements for Traffic**

During construction operations, arrangements for traffic shall be made in accordance with the provisions of Clause 112 of MORT & H specifications.

#### **502.7 Measurement for Payment**

Prime coat shall be measured in terms of surface area of application in square meters.

**7:** Providing and casting in situ controlled cement concrete concrete M-30 for approach slab including formwork curing and finishing complete.

Formwork, reinforcement and concrete shall conform to relevant sections of these specifications.

The item shall be measured & paid as finished work in Cum.

**8:** Providing and applying one coat of Epoxy phenolic primer of DFT 50 microns and two coats of Epoxy phenolic coating of DFT 100 microns each for RCC Element or any other equivalent epoxy coating system to all concrete surfaces exposed to atmosphere in substructure and superstructure including cost of material labour, transportation, scaffolding and preparing the surface by cleaning, washing, brushing, sand/grit blasting etc complete and as directed by engineer and as per specification. ( Paint shall be approved from Engineer and tested from approved Laboratory) (Total DFT = 50+100+100 = 250 microns) **(As per ASTM D – 4541).**



**2607.1. Components**

Strip seal expansion joint shall comprise the following items:

- i) Edge beams - This special claw leg profiled member shall be of extruded rolled steel section combining good weldability with notch toughness.
- ii) Strip seal - This shall be of chloroprene with high tear strength, insensitive to oil, gasoline, and ozone. It shall have high resistance to aging. This component, provided to ensure water tightness, shall have bulbous shape of the pan of the seal which is inserted into the groove, provided in the edge beam. The seal should be vulcanized in single operation for minimum full length of joint.
- iii) Rigid Anchorage - This shall be welded to the edge beam at staggered distance.
- iv) Anchor loops - This shall be made of weld able steel connecting the rigid anchorage with, deck reinforcement

**2607.2. Material**

- a) Edge beams of this special section are at present being directly imported in India. The steel shall conform to steel grade Rst 37-2 of German Standard or equivalent.
- b) Chloroprene of strip seal shall conform to clause 915.1 of RC:83 (Pan II). The properties of chloroprene shall conform to Table 2600-1
- c) Anchorage steel shall conform to IS:2061
- d) Anchor loop shall conform to 13:2062.

**TABLE 2600-1. STRIP SEAL ELEMENT SPECIFICATION**

Sealing element is made of chloroprene and must be a extruded section. The working movement range of the sealing element shall be at least 80 nun with a maximum of 100 mm at right angles to the joint and  $\pm 40$  mm parallel to the joint

| PROPERTY  | SPECIFIED VALUE  |
|---|--|
| Hardness  | 63±5 Shore A   |
| Tensile Strength  | Min 11 MPa   |
| Elongation at fracture  | Min 350 per cent                                       |
| Tear Propagation Strength   |  |
| Longitudinal  | Min 10 N/mm  |
| Transverse  | Min 10 N/mm  |
| Shock Elasticity  | Min 25 per cent  |
| Abrasion  | Min 220 mm <sup>3</sup>                                |
| Residual Compressive Strain<br>(22 h/70 deg C/30 per cent strain)                           | Max 28 per cent  |
| Ageing in hot air (14<br>days/70 deg C) Change in<br>hardness Change in<br>tensile strength | Max +5 Shore A<br>Max -20 per cent<br>Max -20 per cent |
| Change in elongation at fracture  |  |
| Ageing in ozone<br>(24 h/50pphm/25 deg C/20 per cent<br>strain)                             | No cracks  |

|   |                 |
|---|-----------------|
| Swelling behavior in Oil<br>(116 h/25 per cent Q ASTM Oil no. |                 |
| Volume Change   | Max 5per cent   |
| Change in hardness  | Max 10 Shore A  |
| ASTM Oil no.3   |                 |
| Volume Change   | Max 25 per cent |
| Change in hardness  | Max 20 Shore A  |
| Cold Hardening Point  | Min -35 deg C   |

#### **26073. Fabrication (Pre-installation)**

- a) Rolled steel profiles for edge beams shall be long enough to cater for a 2-lane carriageway. These shall be cut to size of actual requirements by meant of a metre box saw. Alignment of the cut-to-size steel profiles shall then be made in accordance with the actual bridge cross-section on work tablet. For this purpose, the contour of bridge cross-section shall be sketched onto these tables. After the steel profiles are aligned, they will be chucked to the tables by means of screw clamps and tacked by arc welding.
- b) Anchor plates shall be cut to the required size by gat cutting. These shall be welded to the edge beams.
- c) Anchor loops shall be bent to the required shape and welded to anchor plates.
- d) The finally assembled joints shall then be clamped and transported to the work site.

#### **2607.4. Handling and Storage**

- 1) For transportation and storage, auxiliary brackets shall be provided to hold the joint assembly together.
- 2) The manufacturer shall supply either directly to the Engineer . or to the Bridge Contractor all the materials of strip seal joints including sealants and all other

accessories for the effective installation of the jointing.

- 3) Expansion joint material shall be handled with care. It shall be stored under cover on suitable lumber padding by the Contractor to prevent damage. Any damage occurring after delivery shall be made good at the Bridge Contractor's expense to the satisfaction of the Engineer.

#### **2607.5.Installation**

**2607.5.1.** The width of the gap to cater for movement due to thermal effect, prestress, shrinkage and creep, superstructure deformations (if any) and sub-structure deformations (if any) shall be determined and intimated to the manufacturer. Depending upon the temperature at which the joint is likely to be installed, the gap dimension shall be preset.

**2607.5.2.** Taking the width of gap for movement of the joint into account, the dimensions of the recess in the decking shall be established in accordance with the drawings or design data of the manufacturer. The surfaces of the recess shall be thoroughly cleaned and all dust and debris removed. The exposed reinforcement shall be suitably adjusted to permit unobstructed lowering of the joint into the recess.

**2607.5.3.** The recess shall be shuttered in such a way that dimensions in the joint drawing are maintained. The formwork shall be tight.

**2607.5.4.** Immediately prior to placing the joint, the presetting shall be inspected. Should the actual temperature of the structure be different from the temperature provided for presetting, correction of the presetting shall be done. After adjustment, the brackets shall be tightened again.

**2607.5.5.** The joint shall be lowered in a pre-determined position. Following placement, of the joint in the prepared recess, the joint shall be levelled and finally aligned and the anchor loops on one side of the joint welded to the exposed reinforcement bars of the structure. Upon completion, the same procedure shall be followed for the other side of the joint. With the expansion joint finally held at both sides, the auxiliary brackets shall be released, allowing the joint to take up the movement of the structure.

**2607.5.6.** High quality concrete shall then be filled into the recess. The packing concrete must feature low shrinkage and have the same strength as that of the superstructure, but in any case not less than M 35 grade. Good compaction and careful curing of concrete is particularly important. After the concrete has cured, the movable installation brackets still in place shall be removed.

**2607.5.7.** Rolled up neoprene strip seal shall be cut into the required length and inserted between the edge beams by using a crow bar pushing the bulb of the seal into the steel grooves of the edge beams. A landing to a bead shall be formed in the thickened end of the edges of the seal which would force the thickened end against the steel beam due to wedge effect when the strip seal is buttoned in place.

**2607.5.8.** As soon as the concrete in the recess has become initially set, a sturdy ramp shall be placed over the joint to protect the exposed steel beams and neoprene seals from site traffic. Expansion joint shall not be exposed to traffic loading before the carriageway surfacing is placed.

**2607.5.9.** The carriageway surfacing shall be finished flush with the top of the steel sections. The actual junction of the surfacing/wearing coat with the steel edge section shall be formed by a wedge shaped joint with a sealing compound. The horizontal leg of the edge beam shall be cleaned beforehand. It is particularly important to ensure thorough and careful compaction of the surfacing in order to prevent any premature depression forming in it.

### **Acceptance Test**

- (i) All steel elements shall be finished with conform corrosion protection system.
- (ii) For neoprene seat, the acceptance test shall conform to the requirement & Stipulated in Table 2600-1. It shall also be stretch tested. If a manufacturer is to supply this type of joint, they will have to produce a test certificate accordingly conducted in a recognised laboratory, in India or abroad.
- (iii) In view of the importance of the built up edge beam\*, special investigation of fatigue strength of this section with anchorages to withstand  $2 \times 10^6$  load change cycles without

showing signs of damage, will be required. The supplier shall have to produce a test certificate in this regard, conducted in a recognised laboratory, in India or abroad.

- (iv) The manufacturer shall produce test certificates indicating that anchorage system had been tested in a recognised laboratory to determine optimum configuration of anchorage assembly under dynamic bating.
- (v) The manufacturer shall satisfy the Engineer that water tightness test for the type of joint has been carried out in a recognised laboratory to check the water tightness trader a water pressure of 4 bars.
- (vi) As strip seal type of joint if specialised in nature generally of the proprietarytype, the manufacturer shall be required to produce evidence of satisfactory performance of this type of joint.

## **2608. TESTS AND STANDARDS OF ACCEPTANCE**

The materials shall be tested in accordance with these specifications and shall meet the prescribed criteria.

The work shall conform to these specifications and shall meet the prescribed standards of acceptance.

## **2609. MEASUREMENTS FOR PAYMENT**

The expansion joint shall be measured in running metres. For filled joints, the rate per running metre shall include the cost of sealant for the depth provided in this drawing.

## **2610. RATE**

The contract unit rate shall include the cost of all material, labour, equipment and other incidental charges for fixing the joints complete in all respects as per these specifications in the case of Bridge Contractor supplying the expansion joint. If the manufacturer supplies the expansion joint directly to the Engineer, the cost of installation, handling and fixing shall be borne by the Bridge Contractor.

**Construction joints and keys**

1. Construction joints will be as shown on the drawing or as approved by Engineer.
2. Concrete shall be placed without interruption until completion of work between construction joints. If stopping of concreting becomes unavoidable anywhere, a properly formed construction joint shall be made with the approved of Engineer.
3. Dowels for concrete work, not likely to be taken up in the near future, shall be coated with cement slurry and encased in lean concrete as indicated on the drawings or as directed by Engineer.
4. Before resuming concreting on a surface which has hardened all laitance and loose stone shall be thoroughly removed by wire brushing / hacking and surface washed with high pressure water jet and treated with thin layer of cement slurry for vertical joints and a 15 mm thick layer of cement sand mortar for horizontal layers, the ratio of cement and sand being the same as in the concrete mix.
5. When concreting is to be resumed on a surface which has not fully hardened, all laitance shall be removed by wire brushing, the surface wetted, free water removed and a coat of cement slurry applied. On this a layer of concrete not exceeding 150 mm thickness shall be placed and well rammed against the old work. Thereafter work shall proceed in the normal way.

**9:** Providing and fixing in position Strip Seal Type Expansion Joint (for movement upto 60mm) as per detailed drawing MORTH specification.

The rate is inclusive of supplying, fixing with contractor's own materials, equipments, machineries, labour, transport, testing, bolts, socket tubes, neoprene sheet/cap etc. complete. The rate is finished item complete and will be paid after fixing in all respect.

The Contractor shall procure Strip Seal Expansion Joint, confirming to relevant MORTH specification from M/s. Sanfield (India) Ltd. / METCO or from reputed manufactures of Strip Seal Expansion Joint with prior approval of Engineer-in-charge.

**2607.1. Components**

Strip seal expansion joint shall comprise the following items:

- v) Edge beams - This special claw leg profiled member shall be of extruded rolled steel section combining good weld ability with notch toughness.
- vi) Strip seal - This shall be of chloroprene with high tear strength, insensitive to oil, gasoline, and ozone. It shall have high resistance to aging. This component, provided to ensure water tightness, shall have bulbous shape of the pan of the

seal which is inserted into the groove, provided in the edge beam. The seal should be vulcanized in single operation for minimum full length of joint.

vii) Rigid Anchorage - This shall be welded to the edge beam at staggered distance.

viii) Anchor loops - This shall be made of weld able steel connecting the rigid anchorage with, deck reinforcement

## 2607.2. Material

- e) Edge beams of this special section are at present being directly imported in India. The steel shall conform to steel grade Rst 37-2 of German Standard or equivalent.
- f) Chloroprene of strip seal shall conform to clause 915.1 of RC:83 (Pan II). The properties of chloroprene shall conform to Table 2600-1
- g) Anchorage steel shall conform to IS:2061
- h) Anchor loop shall conform to IS:2062.

### TABLE 2600-1. STRIP SEAL ELEMENT SPECIFICATION

Sealing element is made of chloroprene and must be an extruded section. The working movement range of the sealing element shall be at least 80 mm with a maximum of 100 mm at right angles to the joint and  $\pm 40$  mm parallel to the joint

| PROPERTY                  | SPECIFIED VALUE         |
|---------------------------|-------------------------|
| Hardness                  | 63 $\pm$ 5 Shore A      |
| Tensile Strength          | Min 11 MPa              |
| Elongation at fracture    | Min 350 per cent        |
| Tear Propagation Strength |                         |
| Longitudinal              | Min 10 N/mm             |
| Transverse                | Min 10 N/mm             |
| Shock Elasticity          | Min 25 per cent         |
| Abrasion                  | Min 220 mm <sup>3</sup> |



|   |  |
|---|--|
| Residual Compressive Strain<br>(22 h/70 deg C/30 per cent strain)                           | Max 28 per cent  |
| Ageing in hot air (14<br>days/70 deg C) Change in<br>hardness Change in<br>tensile strength | Max +5 Shore A<br>Max -20 per cent<br>Max -20 per cent |
| Change in elongation at fracture  |  |
| Ageing in ozone<br>(24 h/50pphm/25 deg C/20 per cent<br>strain)                             | No cracks  |
| Swelling behaviour in Oil<br>(116 h/25 per cent Q ASTM Oil no.<br>Volume Change             | Max 5 per cent   |
| Change in hardness<br>ASTM Oil no.3   | Max 10 Shore A   |
| Volume Change   | Max 25 per cent  |
| Change in hardness  | Max 20 Shore A   |
| Cold Hardening Point  | Min -35 deg C  |

### 26073. Fabrication (Pre-installation)

- e) Rolled steel profiles for edge beams shall be long enough to cater for a 2-lane carriageway. These shall be cut to size of actual requirements by means of a metre box saw. Alignment of the cut-to-size steel profiles shall then be made in

accordance with the actual bridge cross-section on work tablet. For this purpose, the contour of bridge cross-section shall be sketched onto these tables. After the steel profiles are aligned, they will be chucked to the tables by means of screw clamps and tacked by arc welding.

- f) Anchor plates shall be cut to the required size by gas cutting. These shall be welded to the edge beams.
- g) Anchor loops shall be bent to the required shape and welded to anchor plates.
- h) The finally assembled joints shall then be clamped and transported to the work site.

#### **2607.4. Handling and Storage**

- 4) For transportation and storage, auxiliary brackets shall be provided to hold the joint assembly together.
- 5) The manufacturer shall supply either directly to the Engineer or to the Bridge Contractor all the materials of strip seal joints including sealants and all other accessories for the effective installation of the jointing.
- 6) Expansion joint material shall be handled with care. It shall be stored under cover on suitable lumber padding by the Contractor to prevent damage. Any damage occurring after delivery shall be made good at the Bridge Contractor's expense to the satisfaction of the Engineer.

#### **2607.5. Installation**

**2607.5.1.** The width of the gap to cater for movement due to thermal effect, prestress, shrinkage and creep, superstructure deformations (if any) and sub-structure deformations (if any) shall be determined and intimated to the manufacturer. Depending upon the temperature at which the joint is likely to be installed, the gap dimension shall be preset.

**2607.5.2.** Taking the width of gap for movement of the joint into account, the dimensions of the recess in the decking shall be established in accordance with the drawings or design data of the manufacturer. The surfaces of the recess shall be thoroughly cleaned and all dust and debris removed. The exposed reinforcement shall be suitably adjusted to permit unobstructed lowering of the joint into the recess.

**2607.5.3.** The recess shall be shuttered in such a way that dimensions in the joint drawing are maintained. The formwork shall be tight.

**2607.5.4.** Immediately prior to placing the joint, the presetting shall be inspected. Should the actual temperature of the structure be different from the temperature provided for presetting, correction of the presetting shall be done. After adjustment, the brackets shall be tightened again.

**2607.5.5.** The joint shall be lowered in a pre-determined position. Following placement, of the joint in the prepared recess, the joint shall be levelled and finally aligned and the anchor loops on one side of the joint welded to the exposed reinforcement bars of the structure. Upon completion, the same procedure shall be followed for the other side of the joint. With the expansion joint finally held at both sides, the auxiliary brackets shall be released, allowing the joint to take up the movement of the structure.

**2607.5.6.** High quality concrete shall then be filled into the recess. The packing concrete must feature low shrinkage and have the same strength as that of the superstructure, but in any case not less than M 35 grade. Good compaction and careful curing of concrete is particularly important. After the concrete has cured, the movable installation brackets still in place shall be removed.

**2607.5.7.** Rolled up neoprene strip seal shall be cut into the required length and inserted between the edge beams by using a crow bar pushing the bulb of the seal into the steel grooves of the edge beams. A landing to a bead shall be formed in the thickened end of the edges of the seal which would force the thickened end against the steel beam due to wedge effect when the strip seal is buttoned in place.

**2607.5.8.** As soon as the concrete in the recess has become initially set, a sturdy ramp shall be placed over the joint to protect the exposed steel beams and neoprene seals from site traffic. Expansion joint shall not be exposed to traffic loading before the carriageway surfacing is placed.

**2607.5.9.** The carriageway surfacing shall be finished flush with the top of the steel sections. The actual junction of the surfacing/wearing coat with the steel edge section shall

be formed by a wedge shaped joint with a sealing compound. The horizontal leg of the edge beam shall be cleaned beforehand. It is particularly important to ensure thorough and careful compaction of the surfacing in order to prevent any premature depression forming in it.

### **Acceptance Test**

- (vii) All steel elements shall be finished with conform corrosion protection system.
- (viii) For neoprene seat, the acceptance test shall conform to the requirement & Stipulated in Table 2600-1. It shall also be stretch tested. If a manufacturer is to supply this type of joint, they will have to produce a test certificate accordingly conducted in a recognised laboratory, in India or abroad.
- (ix) In view of the importance of the built up edge beam\*, special investigation of fatigue strength of this section with anchorages to withstand 2x10\* load change cycles without showing signs of damage, will be required. The supplier shall have to produce a test certificate in this regard, conducted in a recognised laboratory, in India or abroad.
- (x) The manufacturer shall produce test certificates indicating that anchorage system had been tested in a recognised laboratory to determine optimum configuration of anchorage assembly under dynamic bating.
- (xi) The manufacturer shall satisfy the Engineer that water tightness test for the type of joint has been carried out in a recognised laboratory to check the water tightness trader a water pressure of 4 bars.
- (xii) As strip seal type of joint if specialised in nature generally of the proprietary type, the manufacturer shall be required to produce evidence of satisfactory performance of this type of joint.

### **2608. TESTS AND STANDARDS OF ACCEPTANCE**

The materials shall be tested in accordance with these specifications and shall meet the prescribed criteria.

The work shall conform to these specifications and shall meet the prescribed standards of acceptance.

## **2609. MEASUREMENTS FOR PAYMENT**

The expansion joint shall be measured in running metres. For filled joints, the rate per running metre shall include the cost of sealant for the depth provided in this drawing.

## **2610. RATE**

The contract unit rate shall include the cost of all material, labour, equipment and other incidental charges for fixing the joints complete in all respects as per these specifications in the case of Bridge Contractor supplying the expansion joint. If the manufacturer supplies the expansion joint directly to the Engineer, the cost of installation, handling and fixing shall be borne by the Bridge Contractor.

### **Construction joints and keys**

6. Construction joints will be as shown on the drawing or as approved by Engineer.
7. Concrete shall be placed without interruption until completion of work between construction joints. If stopping of concreting becomes unavoidable anywhere, a properly formed construction joint shall be made with the approved of Engineer.
8. Dowels for concrete work, not likely to be taken up in the near future, shall be coated with cement slurry and encased in lean concrete as indicated on the drawings or as directed by Engineer.
9. Before resuming concreting on a surface which has hardened all laitance and loose stone shall be thoroughly removed by wire brushing / hacking and surface washed with high pressure water jet and treated with thin layer of cement slurry for vertical joints and a 15 mm thick layer of cement sand mortar for horizontal layers, the ratio of cement and sand being the same as in the concrete mix.
10. When concreting is to be resumed on a surface which has not fully hardened, all laitance shall be removed by wire brushing, the surface wetted, free water removed and a coat of cement slurry applied. On this a layer of concrete not exceeding 150 mm thickness shall be placed and well rammed against the old work. Thereafter work shall proceed in the normal way.

**10:** Providing Pylon consists of cast-in-situ concrete of M30 grade exposed finish as per drawing and as directed by engineer in-charge. Rate includes providing required shuttering and form work but excluding stone slab & carving. (Reinforcement shall be paid in respective item.)

- a. Work shall be carried out as per specification/condition as per clause No.2.1 and 2.2 TECHNICAL SPECIFICATION of the Tender Document.
- b. All necessary labour, materials, cement equipment, etc., for sampling, preparing test cubes, curing etc., shall be provided by the Contractor. Testing of the materials and concrete may be arranged by the Engineer-in-charge in an approved laboratory at the cost of the contractor.
- c. The payment shall be made on cum. basis of the finished work. The unit rate of concrete shall include the cost of all materials, cement, labour, tools and plant required for mixing, placing in position, vibrating and compacting finishing etc. complete.
- d. The payment for steel will be paid separately under relevant item.

**11:** Providing and casting in situ reinforced cement concrete M30 grade controlled cement concrete in Kerb, protection wall around pier, etc. using 6mm to 20mm machine crushed well graded stone aggregate, sand of approved quality, OPC 53 grade cement with contractor's own concrete mix design as approved by client etc complete as per specification. The rate is inclusive of all materials, including necessary mixing in fully automatic batch mix plant, transportation, curing, vibrating, placing in position, shuttering, formwork, de-shuttering carefully , making good the damages, fixing embedment, inserts, pockets, wherever necessary, with all lead & lift with contractors labour, tools & plants machineries, as required with F3/U3 type exposed concrete finish and form mark .

This work shall consist of providing and casting in situ controlled cement concrete M 30 grade for **Kerb** shall be carried out as per relevant detailed specification of Item of this contract.

The item shall be measured & paid as finished work in Cum.

**12:** PRIMER & PROTECTIVE COATING-providing and laying the external decorative waterproof & Protective coating system for concrete and masonry shall be MASTERSEAL

200H , a single component elastomeric crack bridging acrylic coating applied at an average thickness of 50 micro DFT in two coat the product shall be applied on suitability primed sub state using MASTERSEAL 399 as primer . The product must be crack bridging elongation type with elongation at break , exceeding 200% & tensile strength exceeding 2 MPa The system shall exhibit excellent bond strength with the substrate at least exceeding 1.0 MPa , when tested as per ASTM D 4541

Scope and specifications of work to be done as per the details in item above and test results of ASTM D 4541 and as desired by Engineer-in-Charge.

**13:** As per ASTM D 5882 -96 code of American Society for testing on cast in situ RCC pile of 1200 mm dia.

**14:** The work will be executed as the item details and as instructed by engineer-in-charge.

### **DETAILED SPECIFICATIONS AND SPECIAL CONDITIONS** **FOR SCHEDULE “C”**

**A:** Providing and placing in position High Yield Strength Deformed (HYSD) bars reinforcement (TMT Fe 500D grade) conforming to IS 1786 of all categories.....etc.

#### **1. GENERAL**

- a. This work shall consist of furnishing and placing **TMT Fe 500D Conforming to IS 1786 -2008** reinforcement, bars (intentioned) of the shape and dimensions shown on the drawings and conforming to these Specifications or as approved by the Engineer in charge.
- b. The work shall be carried out as per clause 2.4.1, 2.4.2, 2.4.3 and 2.4.4 TECHNICAL SPECIFICATION of the Tender Document.
- c. The payment shall be made for over lapping beyond the standard length of bar only.
- d. The payment for steel will be paid separately under relevant item

#### **2. Binding wire**

- a. Mild steel binding wire shall be of 1.63 mm or 1.22 mm (16 to 18 gauge diameter

and shall conform IS 280-1972.

- b. The use of black wire will be permitted for binding reinforcement bars. It shall be free from dirt, paint, grease or oil, oil scale or loose or thick rust and any other undesirable coating which may prevent adhesion of cement mortar at the time of binding.
- c. Only new binding wire shall be delivered to the site all binding wire shall be inspected before binding to its position and defective brittle, rusted, used wire, shall be discarded.

### 3. MODE OF MEASUREMENTS & PAYMENT

- a. For the purpose of payment the bar shall be measured correct up to 10 mm length and weight payable works out at the rate specified below,

|   |       |               |     |       |               |
|---|-------|---------------|-----|-------|---------------|
| 1 | 6 mm. | 0.22 Kg./Rmt. | 8.  | 20 mm | 2.47 Kg./Rmt. |
| 2 | 8 mm  | 0.39 Kg./Rmt. | 9.  | 22 mm | 2.98 Kg./Rmt. |
| 3 | 10 mm | 0.62 Kg./Rmt. | 10. | 25 mm | 3.86 Kg./Rmt. |
| 4 | 12 mm | 0.89 Kg./Rmt. | 11. | 28 mm | 4.84 Kg./Rmt. |
| 5 | 14 mm | 1.21 Kg./Rmt. | 12. | 32 mm | 6.32 Kg./Rmt. |
| 6 | 16 mm | 1.58 Kg./Rmt. | 13. | 36 mm | 7.99 Kg./Rmt. |
| 7 | 18 mm | 2.00 Kg./Rmt. | 14. | 40 mm | 9.87 Kg./Rmt. |

- b. The rate for reinforcement includes cost of steel binding wires, with all leads and lifts, cutting, bending, binding, and placing in position as shown on the drawings and as directed.
- c. The rate shall be for a unit of one M.T.

**B:** Providing and installing 6 mm MS liner for bored-cast-in-situ concrete piles including applying protective coating as per drawing and specification and as directed by Engineer.

Work shall be carried out as per specification/condition as per clause No.2.3.14 of TECHNICAL SPECIFICATION of the Tender Document.

Mode of measurement shall be in MT basis of liner provided as directed by Engineer in Charge.



**DETAILED SPECIFICATIONS AND SPECIAL CONDITIONS**  
**FOR STEEL GIRDER FABRICATIONS:-**

- (A) The work of fabrication, launching etc shall be carried out as per specifications/conditions mentioned at clause no.2.4 and 2.5. of TECHNICAL SPECIFICATION of the Tender Document and as per approved structural drawing/design
- (B) Contractor should inform in writing to Engineer in charge from time to time regarding fabrication stages of the girder in work shop and should provide all facilities to the representative of engineer in charge for frequent inspections during fabrication.
- (C) **Stage of Payment:** Payment shall be made as per clause 2.4.5.2(ii) and 2.4.5.3 of TECHNICAL SPECIFICATION of the Tender Document.
1. All the parts of the girder shall be metalized and the girder parts which are not to be metalized shall be advised by the Engineer in-charge.
  2. **Metalizing:** The entire surface to be metalized shall be sand blasted before metalizing so that surface is thoroughly clean and free from grease, oil, rust, moisture and any other foreign matter.
  3. **Clean prior to Blasting:** Grease, paint and other foreign matter should be removed from the area to be sprayed as well as the adjoining areas.
  4. **Sand Blasting:** The surface shall be thoroughly cleaned and roughened by compressed air blasting or centrifugal blasting with a suitable abrasive material like sharp, coarse sand of grain size between 600 microns and 1.7 mm a minimum of 40% should be retained on a 850 micron sieve.
  5. The surface shall be comparable in roughness with a reference surface produced in accordance with Appendix a of IS: 5905 and shall provide an adequate key for the subsequently sprayed metal coating. The girder components shall have one coat of primer when received at site from Manmade and shall have to be cleaned as above.
  6. **Metal spraying:** The metal spraying shall be carried out as soon as possible after surface preparation but, in any case, within such period that the surface is still completely clean, dry and without visible oxidation. It deterioration in the surface to be coated is observed by comparison with a freshly prepared metal surface or similar

quality which has undergone the same preparation, the preparation treatment should be repeated on the surface to be coated.

7. The wire method shall be used for the purpose of metalising, the diameter of the wire being 3mm to 5 mm. Specified thickness of coating shall be applied within 4 hours or blasting and the surface must be completely coated to the specified thickness within 8 hours of blasting.
8. **Purity of Aluminum:** The chemical composition of aluminum to be sprayed shall be 99.5% aluminum conforming to IS: 2590-1964.
9. **Appearance of the coating:** The surface of the sprayed coating shall be of uniform texture and free from lumps, coarse areas and loosely adherent particulars.
10. **Thickness of coating:** The nominal thickness of the coating shall be 150 microns. The minimum thickness shall not less than 115 microns.
11. **Inspection:** Determination of local thickness: The minimum local thickness shall be determined by the method of described below.

Equipment for measuring thickness: Any magnetic or electromagnetic thickness meter that will measure local thickness of a known standard with an accuracy of +/- 10%.

Magnetic thickness measuring gauge : Electrometer may be used for measuring the thickness of coating as specified in IS 5203-1965.

Method of Test for Adhesion: The sprayed metal coating shall be subjected to an adhesion test using the method as described below.

Using a straight edge and hardened steel scribe which has been ground to a sharp 30 degree point, scribe two parallel lines at a distance apart equal to approximately 10 times the average coating thickness. Inscribing the two lines, apply enough pressure on each occasion to cut through the coating to the base metal in a single stroke.

If any part of the coating between the lines breaks away from the base metal, it shall be deemed to have failed the test.

12. **Re-treatment of defective areas:** Any defective area shall be cleaned of all sprayed metal by blasting or other suitable means and re-prepared to conform to the requirement of para 1 of re-spraying, where the defect has been solely due to too thin a coating, sprayed metal of the same quality may be added, provided that the surface has been kept dry and is free from visible contamination, as specified in para 6.1 of IS 5905.
  - a) 1<sup>st</sup> coat with wash primer/Etch primer of SSPCT/IS-5666 and 2<sup>nd</sup> coat of zinc chrome

- primer to IS: 104.
- b) After hard drying of zinc chrome primer, one coat of aluminum paint to IS 2339 (brushing or spraying as required) shall be applied.
  - c) Corrosion pits and caps between members connected together should be filled with putty before applying final coating. The putty shall conform to IS 419-1967 or other suitable compound approved by the department.
  - d) Linseed oil, raw or boiled, used for mixing paints shall correspond to IS: 77-1976.
13. Site painting: After steel work is erected at site, a second cover coat of aluminum paint to IS: 2339 (brushing or spraying as required) shall be applied after touching up the primer.
14. In case of metalizing at site, priming coat as well as both the coats of aluminum paint will be applied at the site and each coat will be applied after drying of the previous coat.
15. **Thickness of coating:** Minimum thickness of all the coatings, including metalising will be 175 microns.
16. Safety precautions: Safety precautions should be taken as specified in IS: 6586 which is described below.
17. The normal precautions against fumes and dust hazards, such as wearing of mask and proper ventilation should be observed and that no special dangers arise during the spraying of aluminum and zinc.
18. Any warning printed on the containers by the paint manufacturer should be strictly observed and the user should consult him in all cases of doubt regarding health and fire hazards arising from the use of the product.

|  |  |
|--|--|
| <b><u>Item no.</u></b><br><b><u>NS/4</u></b> | Supplying, fabricating and fixing of mild steel of any size such as M.S. steel angles, plates, I-beams, channels, pipes etc. |
|--|--|

1. The work shall be carried out as per specifications/conditions mentioned at clause no.2.4.
2. This item includes fabricating Girders / Rail clusters, bearing plate, etc. with contractor's own mild steel of various rolled section including I beam and channels as per drawing/ details given by the Engineer in charge and assembling etc. All the mild steel sections

shall be procured by the contractor and shall conform to IS 226 of 1975. The fabrication of steel work will be done strictly as per Indian Railway Unified standard specification Vol-I (2010) to the extent applicable to this work.

3. Weight of the structural member to be fabricated and erected will be worked out on the basis of the length of different structural steel members shown in the DFCCIL/Railways final fabrication drawing and book weight of the section actually used.
4. No separate payment for nuts and bolts and other fittings/fastenings shall be made and the rate is deemed to have been included, while taking measurement weight of the same shall not be accounted for.
5. In case the structural sections and nuts, bolts specified in the approved DFCCIL/Railway's fabrication drawings are not available, the tenderer/s will be at liberty to use alternate sections with the approval of the DFCCIL/Railway Administration in each case. However it may please be noted that no extra payment for the difference in weight on account of the use of alternate higher section will be paid. The payment will be made for the weight of the steel sections as per approved final fabrication drawings. Only difference of weight on account of use of alternative heavier sections can however be allowed, for payment, subject to certification by the main producer that the prescribed sections are not being manufactured. The rate includes making the surface good for application of one coat of approved quality red oxide and two or more coats ( to achieve good and even surface) of good quality synthetic enamel paints , transportation , labour, T&P, welding, bolting and riveting , erection etc. complete.
6. The contractor has to produce the test certificate for the steel brought to site and for test check same may be sent for testing. In case the testing material does not conform to the relevant IS Specifications, it will be summarily rejected. The cost of all such tests is to be borne by the contractor. The contractor at his own cost shall do one test per 50 MT of steel or part thereof from approved Govt. Laboratory.
7. The weight shall be calculated as per the standard unit weight of the section as per the ISI Hand Book. If any extra quantity of steel over and above shown in the drawing and over the standard scale laid down has been used by the contractor or for any other reasons such as wastage or bad workmanship, the cost of this excess will not be paid by the DFCCIL. The overlap shall be paid only if the length of section exceeds the standard length available in market.
8. The rate quoted by the contractor includes all labour, T&P, machinery, taxes, electricity etc.

**9. MODE OF PAYMENT/MEASUREMENT**

- (i) 90 % payment will be done after erection and application of one coat of red oxide.
- (ii) 10 % payment will be done after painting the sections with two coats of good quality synthetic enamel paint.

10. The payment shall be made on the prorata basis i.e. actual work done at site and MT shall be the basis of the measurement. No payment shall be released under this item unless the test certificate produced by the contractor and the same is got approved by the Engineer in Charge.

|  |                                |
|--|--------------------------------|
| <b><u>Item no.</u></b><br><b><u>NS/5</u></b> | Pot cum PTFE Bearings.....etc. |
|--|--------------------------------|

**Pot cum PTFE Bearings.....**

Pot type bearing shall consist of metal piston supported by a disc or unreinforced elastomer confined within a metal cylinder to take care of rotation. Horizontal movement, if required, shall with a system of sealing rings be provided by sliding surfaces of PTFE pads sliding against stainless steel mating surfaces. The pot bearings shall consist of cast steel assemblies or fabricated structural steel assemblies.

Provision of IRC-983 (Part I) shall be applicable for all metallic elements. Provisions of IRC: 83 (Part II) shall be applicable for all elastomer elements. When any items are not converted by IRC: 83 (Parts I and II), the same shall be as per guidelines given hereunder and BS: 5400 (Sections 9.1. and 9.2), except that no natural rubber shall be permitted. If there is any conflict between BS on the one hand and IRC on the other, the provisions of IRC will be guiding.

Combination bearings using any judicious combination and sliding element shall be permitted. As for example.

| Name | Rotation element | Sliding Element | Generally for  |
|------|------------------|-----------------|----------------|
| POT  | POT              | None            | Vertical load. |

|                        |                   |               |                                    |
|------------------------|-------------------|---------------|------------------------------------|
| Elastomer              | Elastomer         | None *        | Horizontal Buffer                  |
| POT PTFE               | POT               | PTFE-SS<br>** | Vertical load and horizontal load. |
| Spherical Knuckle PTEE | Spherical Knuckle | PTFE-SS**     | Vertical load and horizontal load. |
| Elastomer PTFE         | Elastomer         | PTFE-SS<br>** | Transverse Guide.                  |
| Elastomer SS **        | Elastomer         | SS-SS **      | Transverse Guide.                  |

Elastomer shall permit movement by shear.

\*\* Stainless Steel.

### **Fabrication.**

The surface mating with the PTFE in the sliding pair shall be corrosion resistant stainless steel, normally, the stainless steel from the upper component. The stainless steel shall overlap the PTFEE after full movement on all sides. If stainless steel sheet is used, it should be bonded by continuous welding along the edges. Adhesive or any other bonding can be approved by the Engineer in charge. The surface shall be prepared by thorough cleaning to remove grease, dust or any other foreign substance. PTFE modular sheets of then sliding pair shall be located by confinement assisted by bonding. Confined PTFE shall be recessed into the metal backing plate. The shoulders of the recess shall be sharp and square to restrict the flow of PTFE.

The thickness of the PTFE shall not be less than 4.5 mm with projection above the recess not exceeding 2.0 mm. When the piston is subjected to tilting, the seal must slide along the wall and alter its shape according to the angle of tilt. At the same time, it must be sufficiently rigid to bridge the gap between the piston and the wall of the pot. However, the percentage of plan area of the lubrication capacities to the gross area shall not exceed 25 per cent. The depth of the cavity shall not exceed 2.0mm.

The diameter to thickness ratio of the confined elastomer shall not exceed 15. The surface of the confined elastomer shall be smooth.

A seal shall be provided to prevent extrusion of the confined elastomer between the piston and the pot wall. The seal should stay functional under the loads and rotations acting on it. Additional seal must slide along the wall and after its shape according to the

angle of tilt. At the same time, it must be sufficiently rigid to bridge the gap between the piston and the wall of the post.

The hardness of the piston and pot wall at their contact region shall be minimum 350 BHN to reduce wear. The surface finish of the post base in contact with the confined elastomer shall be very smooth.

All bearings shall be installed with anchor and anchor screws or some similar device such that while replacing, the bearings can be removed with minimum lifting of the superstructure.

The external surfaces of the assemblies shall be completely cleaned by sand blasting. After sand blasting, dust shall be removed from the surface using clean and dry compressed air or a clean brush after which suitable coating shall be applied.

Pot bearings including all parts as shown on the drawings shall be fully assembled at the manufacturer's works to ensure proper fitting of all parts.

### **Materials.**

The pot PTFE bearings shall be purchased through the RDSO approved suppliers / manufactures only.

### **Steels.**

Structural steel shall conform to IS : 2062, as applicable.

Cast steel shall conform to Gr.280-520 W of IS 1030. 00 to 0.5 per cent copper may be added to increase the corrosion resistance properties.

Stainless steel shall conform to AISI : 304 to X04Cr18Ni9 of IS : 6911 for ordinary applications. For applications with adverse/corrosive environment, the stainless steel shall conform to AISI : 316 L. Or 02Cr17Ni12Mo2 of IS :6911.

### **PTFE**

PTFE (poly tetra fluoro ethylene) shall be of unfilled pure virgin quality. It shall be free sintered. The mechanical properties of unfilled PTFE shall comply with Grade A of BS : 3784.

### **Elastomer.**

The confined elastomer inside pot will have the following properties : (a) Hardness IRHD : IS : 3400 (Part II) 50 + 5 b ) Min tensile strength Mpa IS : 3400 (Part I) 15.5 c) Min elongation at break,) shall be as per Table Max compression set and) "Properties of Elastomer".

#### Properties of Elastomer.

|     | Property                       | Unit      | Test method, IS specification reference                           | Value of the characteristic specified |
|-----|--------------------------------|-----------|---|---------------------------------------|
| 1   | Maximum Compression Set CR     | Per Cent  | IS: 3400 (Part X) Duration Temperature (h) (degC)+0 to 24.2 100+1 | 35                                    |
| 2   | Accelerated ageing CR          |           | IS: 3400 (Part IV) duration Temperature (h) (deg C 70 100 +1.     |                                       |
| 2.1 | Max change in Hardness         | IRHD      |   | + 15                                  |
| 2.2 | Max Change in Tensile strength | Per cent  |   | - 15                                  |
| 2.3 | Ma change in Elongation        | Per cent. |   | - 40                                  |

#### Workmanship.

#### Welding.

All welding shall conform to IS : 9595 with electrocutted of suitable grade as per IS: 814. Preheating and post weld stress relieving shall be done as per IS : 9595.

#### Cast steel assemblies.



Cast steel for pot bearing assemblies shall conform to requirements of relevant IS. Casting shall be true to the forms and dimensions shown on the drawings, and shall be free from pouring faults, sponginess, cracks, blow holes and other defects affecting their appearance or their strength. Warped or distorted casting shall not be accepted. Exposed surfaces shall be smooth and dense. All irregularities, fins or risers shall be ground off flush with the adjacent surface. Castings with visible cracks, blow holes, or similar blemishes shall be rejected if the imperfections are located on bearing surface or cannot be remedied to the satisfaction of the Engineer in Charge.

Imperfections which are not located on bearings surfaces shall be cleaned out, filled with weld metal of the appropriate composition and ground flush with adjacent surfaces.

### **Structural Steel Assemblies.**

Defects arising from the fabrication of the steel shall be inspected by the Engineer, who will decide whether the materials may be repaired by the Contractor or will be rejected. The cost of repairs or replacement shall be borne by the Contractor. All steel whether fabricated or not, shall be stored above the ground on platforms, skids, or other supports, and adequately protected against corrosion. Excessively rusted, bent or damaged steel shall be rejected. All plates shall be rejected. All plates shall be flat and rolled bars and shapes straight before marking out or being worked. Straightening shall be done by methods which shall not damage the material. Sharp kinks and bends shall be the cause for rejection.

Steel may be flame cut to shape and length so that a regular surface, free from excessive gouges and striations is obtained. Flame cutting by hand shall be done only with the approval of the Engineer in charge.

Exposed corners shall be machined or ground.

### **Tolerances:**

|      |                     |               |
|------|---------------------|---------------|
| I)   | Plan dimensions     | - 0 to + 5 mm |
| II)  | Overall height      | -0 to + 3 mm  |
| III) | Height of elastomer | + 5 per cent. |

|     |  |   |
|-----|--|---|
| IV) | Height of any steel component<br>a) Machined                 | 0 to +1mm<br>Class 2 of IS : 4897   |
| V)  | Stainless sliding surface<br>a) flatness<br>b Surface Finish | 0.004L, where L=Length in direction of measurement.<br><br>Ra <=0.25µm per IS:3073. |

**Painting:**

All non-working surfaces be coated with two coats of epoxy primer and one more coat each of epoxy intermediate and finish, total thickness <= 0.150 mm or any other painting scheme as approved by the Engineer.

Silicon sealers shall be cement coated at the manufacturer's works.

Test.

**Raw Materials**

Necessary test certificates for all raw materials as in above shall be furnished by manufacturers, reference may also be made to for tests on elastomers.

**Test on Casting**

Tests specified in IS: 1030 shall be performed. Castings shall be ultrasonically tested and certificates submitted. Quality level of castings shall be level 3 as per IS: 9565.

**Testing on Welding.**

All welding shall be tested by Dye Penetration method. But welding shall be tested by Ultrasonic method. Soundness of welding shall be certificate by the manufacturer .Acceptance test on bearings.

All bearings shall be checked for overall dimensions.

All bearings shall be load tested to 1.1 times maximum design capacity including seismic force. Bearing tested at higher loads cannot be used.

A pair of bearing selected at random will undergo testing in order to determine the coefficient of friction "u". The coefficient of friction shall be  $\leq 0.05$  at the design load. Two bearings selected at the design load.

Two bearings selected at random shall be tested for permissible rotation.

Installation of POT-cum-PTFE Bearings

General

In-Situ Casting of Superstructure.

**Seating of Bearing.**

Care shall be taken during installation of the bearings to permit their correct functioning in accordance with the design scheme.

To prevent contamination, dismantling of the bearings at site shall not be done.

The total shall be transferred on to the bearings only when the bedding material has developed sufficient strength. The props for the form work shall only be removed after lapse of appropriate time. In special cases, this can be ensured by suitable devices like jacks, etc.

Temporary clamps and shims (introduced to maintain working clearance) shall be removed at an appropriate time, before the bearing is required to permit movement.

Cement based non-shrink grout with air releasing additive and epoxy based grouts, whichever is specified shall be first at the site. For the proprietary grout mixes, appropriate instruction from the manufacturer shall be followed specially with regards of the followings.

Preparation > concrete cleaning, roughening, pre-soaking, etc.

Forms > sturdiness, leak proofing, shape, header funnel vents, etc.

Bearings Base > cleaning, etc.

Placement – curing, consistency, time period, finishing etc.,

Protection > curing, ambient temperature, etc.

Formwork around the bearing shall be carefully sealed to prevent leakage.

Sliding plates shall be fully supported and care taken to prevent tilting, displacement or distortion of the bearings under the weight of wet concrete.

Bearing shall be protected during concreting operation. Any mortar contaminating the bearing shall be completely removed before it sets.

**Using Template.**

Template with required and matching holes corresponding to the base of the bearings shall be used.

All the anchors shall be fitted to the lower face of the template using the anchor screws but with steel washer replacing the elastomer washers. Separate screw may be used in case of inconvenience in the length of the original anchor screws.

The template assembly shall be located with regard to level and alignment. It shall be ensured that the tops of the anchors lie in a horizontal plane at the required elevation. The anchors shall be tied/welded to reinforcements to avoid displacement during concreting.

Concreting of the pedestal / pier cap shall be done to a level leaving a gap of 25-50 mm below the template.

The template and steel washers shall be removed prior to placement of the bearing assembly with temporary clamps. The bearing assembly shall.

The gap below the bearing assembly shall be grouted with cement based grout. Reference may be made to clause 8.17.6.1(VI).

**B. Without Template with Gap.**

Pockets commensurate with the sizes of the anchors shall be kept pedestals during concreting of the same. The pedestal shall be cast approximately 25 mm short of the required finished level.

Anchors shall be fitted to the bearing bottom with elastomer washers and anchor screws. The bearing assembly shall be seated in the location on steel chairs/packs. The anchors fitted below the bearing shall go into pockets in the bed block. Level and alignment of the bearing shall be checked. It shall be ensured that the bearing sits in a horizontal plane.

The gap below the bearing assembly including anchor pockets shall be grouted with cement based grout. Reference may be made to Clause 8.17.6.1. (VI).

**Without Template Without Gap.**

Elongated pockets commensurate with the size of the anchors shall be kept in pedestals during concreting of the same. The geometry and location of the anchor pockets (with tapered funnel extension, if required) shall be such that after placement of the bearing the pockets can be successfully grouted. The pedestal shall be cast 5mm – 15mm short of the required finished level. The required level shall be achieved by chipping before placement of the bearing. Careful control shall be exercised to cast at the exact finished level or 1 mm-3 mm down from the required finished level.

Seating of bearings shall be as per manufacturer's instructions.

**Inspection and Testing.**

Where any patents are used, the manufacturer's certificate with test proof shall be submitted along with the design and got approved by the Engineer In Charge before their use in work.

**Measurement for Payment.**

Bearings shall be measured in numbers, according to their capacities and particular specifications given on the drawings.

The rate given is AS per MT capacity of bearing.

The contract unit rate of bearing shall include the cost of all nuts, bolts, tests, prescribed in the specifications and shown on the drawings. | The cost of supplying and fixing the bearings in position complete as specified on the drawings and as directed by the Engineer in charge. The rate shall also include the cost of samples and their testing when desired by the Engineer-In-Charge.

|                  |   |
|------------------|---|
| <b><u>1.</u></b> | AutoCAD Drawings: Preparation / Alternation and submission of drawings such as general arrangement drawings, phase drawings, scheme plan, structural drawings etc. On Auto Cad as per details and directions given by the Engineer in charge including plotting and submitting in standard inklet film of 50 micron and CD, submitting check prints on A3/A2/A0 size papers and final print complete and as per instructions of Engineer in charge. |
|------------------|---|

Work shall be carried out as per specification / condition mention above.

|    |   |
|----|---|
| 2. | <p>Site Office Providing, arranging, managing and maintaining 500 sq.ft. well-furnished AC office and well equipped Laboratory with 3 tables, 10 chairs, 2 steel Almira, one computer with printer &amp; operator, sufficient number of display etc. to the satisfaction of the Project Manager including Electrical, Water expenses etc. For execution of this item the date of start shall be considered only when the Contractor has actually rented/constructed the required premises established the office &amp; Laboratory as per requirement. This item shall remain valid only for original contract period; no additional payment shall be made for whatsoever reason even if time extension is provided or date of completion is extended. This office and laboratory including furniture and all other equipment shall be property of contractor after completion of Project.</p> |
|----|---|

## **SITE OFFICE FOR EMPLOYER**

1. The Contractor has to provide a reasonable office accommodation of suitable size at each ROB's site (about 500 sqft) as approved by the Engineer as far as possible close to ROB location under this contract for supervisory staff of the Employer and Consultants. The office accommodation shall be maintained by the contractor by providing all required furniture as mentioned in technical specification along with a gas connection for office pantry. The contractor will also provide round the clock watch & ward, one Messenger for communication between site & officers and one for maintaining the pantry etc. the cost is incidental & deemed inclusive in cost to complete the contract and no separate payment shall be made for the above mentioned provisions except relevant SOR item. The rentals along with electrical, water supply and other charges shall be arranged by the contractor for accommodation/s provided by the contractor during entire contract period as directed & decided by the Engineer. The Contractor shall take away all material, furniture & equipment provided at accommodation/s after completion of contract but upon obtaining written approval from the Engineer and/ or as decided by the Engineer.
2. The office, accommodation/s shall be arranged at strategically suitable location as decided by the Engineer at each ROB site.
3. The Contractor shall arrange & provide reasonable furnished office, accommodation/s, good for the Employer's supervisory staff, having with required accessories and compatible UPS/ Inverter power backup. The Contractor shall

provide the office accommodation within one month from the date of LOA. The rentals for accommodation/s provided, Telephone, electric & water charges etc. will be arranged by the contractor on time. The list of furniture and equipment's is given below, which are to be provided and maintained for site office under this contractor package. All Cost towards provision of stationary, photocopy, printing of drawings, record maintenance etc. will be incurred by contractor as part of office maintenance.

4. Following furniture shall be provided and maintained by the contractor at his own cost at each site of ROB to the satisfaction of the Engineer including Electrical, Water expenses etc. for execution.

| <b>Sr.No</b> | <b>Item reqd. at site office</b> | <b>Specification</b>  | <b>Nos. reqd.</b> |
|--------------|----------------------------------|---|-------------------|
| 1            | Office table                     | As approved by Engineer   | 3                 |
| 2            | Office chair                     | As approved by Engineer   | 3                 |
| 3            | Visitor chair                    | As approved by Engineer   | 4                 |
| 4            | Ordinary chair                   | As approved by Engineer   | 6                 |
| 5            | Stools                           | As approved by Engineer   | 2                 |
| 6            | Steel Almirah                    | Make- Godrej store well 1890x900x590 mm plain with locker or equivalent as approved by Engineer   | 1                 |
| 7            | Air Conditioner                  | As approved by Engineer   | 1                 |
| 8            | Telephone & Fax Machine          | Telephone and Fax machine with STD and internet facility.   | 1                 |
| 9            | Laptop (Core-i7 ) with printer   | HP/HCL/DELL/SONY or equivalent including with applicable soft wares as 1Auto CAD, MS Project etc. along with one printer four in one- type print, fac scan & photo copy | 1                 |
| 10           | Refrigerator                     | Make Godrej or equivalent 185 ltr. Minimum  | 1                 |
| 11           | Fire Extinguisher                | As per requirement for Office   | 1 Set             |

5. Site office shall be furnished as per requirement of the Employer. The contractor shall supply new furniture, equipment, pantry utensils, reasonable Crockery & Cutlery etc. as decided by the Engineer. All the furniture etc. shall become the property of the contractor after the completion of the contractor the same shall be taken away by the contractor as decided by the Engineer. The cost for providing & maintenance of office, accommodation is incidental to work & no separate payment shall be made.

|  |   |
|--|---|
| <b><u>Item no.</u></b><br><b><u>NS/3</u></b> | Providing & fixing Safety Screen as per RDSO Drg. No. EL / C / 0068 MOD " E " , on the Parapet with necessary fixtures etc. as per detailed drawing including contractor's own materials, labours, tools and plants, etc. complete. |
|--|---|

This item is for providing, fabricating and fixing in position safety screen conforming to IS: 800-1984 of approved quality/make including painting.

The rate quoted shall be for safety screen with all materials, labour, tools and plants etc. including painting with one coat of red oxide and two coats of synthetic enamel paint of approved make and color as directed by Engineer in charge and approved drawing.

|  |   |
|--|---|
| <b><u>Item no.</u></b><br><b><u>NS/4</u></b> | Making and supplying of check rails of 52 kg/ 60 kg rails of various lengths for level crossing as per approval drawings. |
|--|---|

1. The work of fabricating check rails of any length by machining shall be carried out strictly as per the Railway's standard drawings, instructions laid down in Indian Railway permanent way manual and the instructions of the Engineer in charge whose decisions shall be final and conclusive.
2. The work shall be carried out only under the supervision of the Engineer in charge or his representative.
3. The rails and other fitting will be supplied to the contractor at the nearest PWI depot.
4. The quantities shall be responsible for all P. way material supplied to him till completion of work and properly accounted.



5. The surplus material shall be returned in the depot in good condition and no transportation charges either transporting it to site or returning back shall be payable. Waste material shall be also returned.

### **Mode of payment**

The unit for measurement is each level crossing consist 2 check rails. Payment shall be made as per actual work done at site. Nothing extra shall be paid other than the rate accepted.

|                    |  |
|--------------------|--|
| <b><u>Item</u></b> | Providing, fixing and maintaining MS fabricated traffic barricading of 2.50m height on either side of the carriage way / portion of the carriage way closed to the traffic including provision of all sign boards/ bollards and warning lights etc. as per the Engineer in charge. |
|--------------------|--|

Providing, fixing and maintaining MS fabricated traffic barricading of 2.50 m height on either side of carriage way closed to the traffic including provision of all sign board/bollards and warning lights etc. as per direction of Engineer in charge at site. Rate is inclusive of all labour, materials, tools and plants, taxes, lead & lift and transportation, erection and dismantling etc. Nothing extra shall be payable other than the rate quoted by the contractor.

The barricading shall be got erected just prior to commencement of the work and will remain erected till the work is completed in all respect or as decided by Engineer in charge at site.

The length of barricading shall be decided by Engineer in charge/Site Supervisor at site and shall be final and binding. The design of barricading shall be as approved by competent authority / Engineer in charge.

Measurement shall be for the finished item. Nothing extra shall be payable for overlapping. However, overlapping has to be provided so that GI sheets perfectly anchor to each other.

After completion of the work, all the material utilized in barricading shall be the contractor's property, however, nothing extra shall be paid for transporting including loading and unloading.

Before erection, the material utilized for barricading shall be got approved by the DFCCIL supervisor at site.

Rate is also inclusive of PCC meant for insertion of MS pipe. However, PCC shall not be done in the grade lower than 1:2:4 mix.

Quantity shown above is approximate; however, actual length of barricading may differ as per the site condition. Whatever length of barricading is decided by Engineer in charge/Site supervisor shall be provided by the contractor.

**Note :-**

1. In the event of conflict between special condition /Technical specification /other guidelines, (available in the tender) the decision of the DFCCIL administration is final and binding to the contractor. No claim in this regard shall be entertained.
2. The Contractor and concerned staff, PMC shall ensure that every 1<sup>st</sup>, 3<sup>rd</sup>, 5<sup>th</sup> etc. Running bill & Final Bill shall be technically checked before making payment.
3. Earthwork register, level books, steel registers, Hrs, Test certificates where as required etc. shall be maintained carefully and shall submit along with all Running / final bill for technical checking

**SCHEDULE FOR TESTING OF MATERIALS :-**

| SN | Brief description of materials to be tested | Qty of material | Prescription of test which shall be carried out                  | Frequency at which test shall be carried out  | Total No of test to be taken. |
|----|---|-----------------|--|---|-------------------------------|
| 1] | Coarse Aggregate                            |                 | - Gradation test<br>- Impact value<br>- Flakiness and elongation | 1 to 100 cm 1 test<br>100 to 500 cm 3 test<br>500 to 1500 cm 5 test<br>1500 to 5000 cm 7 test<br>Minimum 1 test/ work |                               |
| 2] | Grit  |                 | - Stripping value  | As above  |                               |
| 3] | Granular                                    |                 | - Gradation  | As above  |                               |

|    |                    |  |  |  |  |
|----|--------------------|--|--|--|--|
|    | materials          |  | - Atterbeg limits  |  |  |
| 4] | Murum              |  | - P I Value  | One test per 50 cum.   |  |
| 5] | Sand/ quarry spall |  | - Silt content<br>- Gradation<br>- CBR test  | One test per work/ season<br><br>One test per 200 cmt.<br><br>One test per work  |  |
| 6] | Asphalt            |  | 1 Penetration test as per IS 1203<br>2 Ductility test as per IS 1208<br>3 Specific gravity test as per IS 1202<br>4 Softening point test as per IS 1204<br>5 Viscosity test as per IS 1206 | 1 to 10 tanker 1 test<br>11 to 20 2 test tanker<br>21 to 50 " 3 test<br>51 to 100 " 4 test<br>1 test<br>Remaining every 50"  |  |
|    |                    |  |  | and 8 test for larger consignment  |  |
| 8] | CC Cubes           |  | - Compressive Strength<br>(I.S. 519 – 1959)  | 1 to 5 cms 1 No<br>6 to 15 cms 2 No<br>16 to 30 cms 3 No<br>30 to 50 cms 4 No<br>51 and above 4 + 1<br><br>(For each additional 50 m <sup>3</sup> or part thereof) |  |
| 9] | Water              |  | - Chemical test  | Once for approval of   |  |

|     |                                       |  |   | source of supply   |  |
|-----|---------------------------------------|--|---|--|--|
| 10] | Steel                                 |  | <ul style="list-style-type: none"> <li>- Tensile Strength</li> <li>- Yield Stress</li> <li>- Elongation</li> <li>- Size</li> </ul>                      | 1 test/ 40 tonnes/ per category  |  |
| 11] | Bricks                                |  | <ul style="list-style-type: none"> <li>- Water absorption</li> <li>- Efflorence</li> <li>- Size</li> <li>- Compressive Strength</li> </ul>              | 1 test per 50,000 bricks   |  |
| 12] | Prime coat/<br>Tack coat              |  | <ul style="list-style-type: none"> <li>- Quality of binder</li> <li>- Binder temperature for application</li> <li>- Rate of spread of binder</li> </ul> | Number of samples per lot and test as per IS:73<br><br>At regular close intervals<br><br>Two test per 500 m <sup>2</sup> and not less than two test per day  |  |
| 13] | Carpet and Seal coat mix/ B.M/ M.S.S. |  | <ul style="list-style-type: none"> <li>- Quality of binder</li> <li>- Grading</li> <li>- Temperature of binder</li> </ul>                               | Number of samples per lot and test as per IS:73<br><br>1 test on individual contents and mix aggregate from the dryer for each 100 tonns of mix subject to minimum of two test per plant per day<br><br>At regular close intervals |  |

- Binder content vide 45 IMD 2172 One test for each 100 tonnes of mix subject to mini. of Two per day
- Rate of spread of mix materials Regular control through checks on layer thickness

|     |                     |       |  |   |  |
|-----|---------------------|-------|--|---|--|
| 14] | Granular Sub-base   | ***** | <ul style="list-style-type: none"> <li>- Gradation</li> <li>- Atterberg limits</li> <li>- Moisture content prior to compaction</li> <li>- Density of compacted layer</li> <li>- Deleterious constituents</li> <li>- C.B.R.</li> </ul>                      | <p>As mentioned under serial number 3</p> <p>As mentioned under serial number 3</p> <p>As mentioned under serial number 3</p> <p>One test per 500 m<sup>2</sup></p> <p>As required</p> <p>As required</p>     |  |
| 15] | Wet Mix Macadam     |       | <ul style="list-style-type: none"> <li>- Aggregate Impact Value</li> <li>- Grading</li> <li>- Flakiness and Elongation Index</li> <li>- Atterberg limits of portion of aggregate passing 425 micron sieve</li> <li>- Density of compacted layer</li> </ul> | <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 1</p> <p>As mentioned under serial number 3</p> <p>One test per 500 m<sup>2</sup></p> |  |
| 16] | Water Bound Macadam |       | <ul style="list-style-type: none"> <li>- Aggregate Impact Value</li> <li>- Grading</li> <li>- Flakiness Index and Elongation</li> </ul>  | <p>As mentioned under serial number 1</p> <p>As mentioned under</p>   |  |

|     |           |  |   |   |  |
|-----|-----------|--|---|---|--|
|     |           |  | index<br>- Atterberg limits of binding material<br>- Atterberg limits of portion of aggregate passing 425 micron sieve  | serial No.1 As mentioned under serial number 1<br><br>As mentioned under serial number 1<br><br>As mentioned under serial number 1  |  |
| 17] | Earthwork |  | - Sand Content [IS: 2720 (Part-4)]<br>- Plasticity Test [IS:2720 (Part-5)]<br>- Density Test [IS:2720 (Part-8)]<br>- Moisture Content Test [IS :2720 (Part-2) ]<br>- CBR Test | 2 tests per 3000 cubic metres of soil<br><br>2 tests per 3000 cub. metres of soil.<br><br>2 tests per 3000 cubic metres of soil.<br><br>One test for every 250 cubic metres of soil.<br><br>One CBR test for every 3000 cum. at least or closer as and when required by the Engineer. |  |

If directed by the Engineer in charge, the materials intended to be used for the work but not included in the above schedule shall also be got tested at Government recognized Laboratory or field Laboratory.

## **DETAILED SPECIFICATIONS AND SPECIAL CONDITIONS**

Initial load test above 100 ton capacity up to 250 ton capacity. USSOR 2011 western railway item no.192103 & 192104

Upto 250 tonne

Extra over 50 t

This work shall include carrying out Initial pile load test on test piles which are not to be incorporated in the work. The methodology of carrying out load tests and of arriving at safe load on piles shall conform to IS:2911 (Part IV).

1. Load test may be carried out as decided by the Engineer-in-charge on one or more working piles. Preloading shall be not less than one and a half times the estimated safe load carrying capacity of the pile in case of sandy soils and two times the estimated safe load in the case of clayey soils.
2. The test shall commence as early as possible after casting/driving of the piles.

The test shall be carried out by applying a series of load on R.C.C. Cap over a pile or a group of piles unaided by any other support. The load shall preferably be applied by means of hydraulic jack reacting against a loaded platform or against heavy R.S. Joists or a suitable load frame held down by anchor piles or other anchorages, which shall be pre-loaded to not less than one and-a-half times the estimated safe load carrying capacity of the pile. The load applied by the jack should be co-axial with the test pile. Wherever tension piles or other suitable anchors are used to sustain the loaded platform, the centre distance between the test pile and anchor pile should be minimum of 5 times the test pile diameter. The hydraulic jack used shall be of adequate capacity and shall have a pressure gauge and a remote control pump.

3. Before load test is performed, the proposed set up and the load frame shall be got approved from the Engineer-in-charge. Readings of settlement and rebound shall be recorded with the help of at least two dial gauges (preferably four) of 0.02 mm. sensitivity and resting on a diametrically opposite ends of the pile cap. The dial gauges shall be fixed in a datum bar whose ends rest upon non-movable supports. The supports for datum bar with reference to which the settlement of the pile would be measured shall be at least 5 'd' away, clear from the piles, where 'd' is the diameter of the pile subject to a minimum of 2 meters for good sandy soils and 5 metres for loose soils.

4. The test load shall be applied in equal increments of about one fifth of the estimated safe load and reduced to smaller increments at the final stages as or directed by the Engineer-in-charge. Alternate loading and unloading of each load increment shall be performed and the elastic and plastic settlement recorded.

5. Each stage of loading or unloading shall be maintained till the rate of movement of the pile top is not more than 0.02 mm. per hour in case of clay soil and 0.1 mm. per hour for

sandy soil..

6. The loading shall be continued upto 1 1/2 times the estimated safe load on the pile or when the total settlement of pile top/cap equals the value specified below.

Assessment of safe load shall be as under:

(a) Two-thirds of the final load at which the total settlement attain a value of 12 mm unless it is established that a total settlement different from 12 mm. is permissible in a given case on the basis of nature and type of the structure, in the latter case the actual total settlement permissible shall be used for assessing the safe load instead of 12 mm.

(b) For a group of piles, two-thirds of the final load at which the total settlement attains a value of 40 mm.

7. Lateral load test:-This test shall be carried out at the cut off level of the piles, Two or more test pile which may be part of the working piles driven to the required depth and spacing shall be used for the tests. The lateral load at the cut off level shall either be applied by a jack inserted between the piles or by some other arrangement capable of facilitating the application of desired pull.

The loading shall be applied in increments of about 20 percent of the estimated safe load, reducing to smaller increments in the final stages of the test. The next increment shall be applied after the rate of displacement is about 0.05 mm. per hour in sandy soils and 0.02 mm. per hour in clayey soils or two hours whichever is earlier.

Lateral displacement shall be recorded by using at least two dial gauges spaced at 30 cm and kept horizontally one above the other on each pile. Where it is not possible to locate the dial gauges in line of the jack axis, then the two dial gauges be kept at a distance of 30 cm. at a suitable height and the displacement at load point, interpolated from similar triangles.

The safe lateral load on the pile shall be taken as the least of the following

(a) 50 per cent of the final load at which total displacement increases to 12 mm.

(b) Final load at which total displacement corresponds to 5 mm and.

(c) Load corresponding to any other specified displacement due to performance requirements.

8. The measurement for payment shall be per number of load test on piles.

9. The Unit includes all materials, labour, equipment plant, platform and gauges for the purpose of recording result to complete the job.

: Routine load test above 100 ton capacity up to 250 ton capacity pile. USSOR 2011 western railway item no.192107.

Upto 250 tonne

Extra over 50 t

The contractor shall be required to carry out routine load tests as directed by the Engineer-in-charge on an individual pile or on a group of piles or on both. The routine load tests shall



be carried out generally as per IS 2911 (Part-IV). Report on routine load tests shall be submitted in an approved format for Department's approval at no extra cost. In case the tests on the routine piles reveal safe capacity less than specified, the contractor shall, at his own cost, provide suitable modifications to the pile or other remedial measures after obtaining approval of the Engineer-in-Charge. In case of an unsatisfactory results being revealed on any routine tests it shall be the contractor's responsibility to carry out additional routine tests, at his own cost till the criteria laid down are fulfilled.

Rate for routine load test shall be inclusive of providing kentledges, making other arrangements for the test loading platforms, providing tools and plants, equipments like hydraulic jack, dial gauges etc. other measuring instruments and all labour involved in carrying out tests.

The measurement for payment shall be per number of load test on piles.

The Unit includes all materials, labour, equipment plant, platform and gauges for the purpose of recording result to complete the job.

**1:** As per specification of IS code: 1888, for plate load test.

**2:** As per specification of IS Code: 2911 (Part IV), for Pile load test.

**3:** Providing and fixing in position of standard performed sealed and slab type or Strip Seal elastomeric Type Expansion Joints (80 mm expansion) for railway bridge or Road over Bridge as per approved drawing and latest MORTH/IRC 69 specification. The rate are inclusive of supplying, fixing with contractor's own materials e.g. inserts, bolts, socket tubes, neoprene sheet/cap etc. equipments, machineries, labour, all taxes,royalty,all lead and lift, transport, testing, surface preparations, complete.

#### **2607.1. Components**

Strip seal expansion joint shall comprise the following items:

- ix) Edge beams - This special claw leg profiled member shall be of extruded rolled steel section combining good weldability with notch toughness.
- x) Strip seal - This shall be of chloroprene with high tear strength, insensitive to oil, gasoline, and ozone. It shall have high resistance to aging. This component, provided to ensure water tightness, shall have bulbous shape of the pan of the

seal which is inserted into the groove, provided in the edge beam. The seal should be vulcanized in single operation for minimum full length of joint.

xi) Rigid Anchorage - This shall be welded to the edge beam at staggered distance.

**xii)** Anchor loops - This shall be made of weld able steel connecting the rigid anchorage with, deck reinforcement

## 2607.2. Material

- i) Edge beams of this special section are at present being directly imported in India. The steel shall conform to steel grade Rst 37-2 of German Standard or equivalent.
- j) Chloroprene of strip seal shall conform to clause 915.1 of RC:83 (Pan II). The properties of chloroprene shall conform to Table 2600-1
- k) Anchorage steel shall conform to IS:2061
- l) Anchor loop shall conform to IS:2062.

**TABLE 2600-1. STRIP SEAL ELEMENT SPECIFICATION**

Sealing element is made of chloroprene and must be a extruded section. The working movement range of the sealing element shall be at least 80 mm with a maximum of 100 mm at right angles to the joint and  $\pm 40$  mm parallel to the joint

| PROPERTY                  | SPECIFIED VALUE         |
|---------------------------|-------------------------|
| Hardness Tensile          | 63 $\pm$ 5 Shore A      |
| Strength Elongation       | Min 11 MPa              |
| at fracture               | Min 350 per cent        |
| Tear Propagation Strength |                         |
| Longitudinal              | Min 10 N/mm             |
| Transverse                | Min 10 N/mm             |
| Shock Elasticity          | Min 25 per cent         |
| Abrasion                  | Min 220 mm <sup>3</sup> |

|   |  |
|---|--|
| Residual Compressive Strain<br>(22 h/70 deg C/30 per cent strain)                           | Max 28 per cent  |
| Ageing in hot air (14<br>days/70 deg C) Change in<br>hardness Change in<br>tensile strength | Max +5 Shore A<br>Max -20 per cent<br>Max -20 per cent |
| Change in elongation at fracture  |  |
| Ageing in ozone<br>(24 h/50pphm/25 deg C/20 per cent<br>strain)                             | No cracks  |
| Swelling behavior in Oil<br>(116 h/25 per cent Q ASTM Oil no.<br>Volume Change              | Max 5 per cent   |
| Change in hardness<br>ASTM Oil no.3   | Max 10 Shore A   |
| Volume Change   | Max 25 per cent  |
| Change in hardness  | Max 20 Shore A   |
| Cold Hardening Point  | Min -35 deg C  |

**26073. Fabrication (Pre-installation)**

- i) Rolled steel profiles for edge beams shall be long enough to cater for a

2-lane carriageway. These shall be cut to size of actual requirements by means of a metre box saw. Alignment of the cut-to-size steel profiles shall then be made in accordance with the actual bridge cross-section on work tablet. For this purpose, the contour of bridge cross-section shall be sketched onto these tables. After the steel profiles are aligned, they will be chucked to the tables by means of screw clamps and tacked by arc welding.

- j) Anchor plates shall be cut to the required size by gas cutting. These shall be welded to the edge beams.
- k) Anchor loops shall be bent to the required shape and welded to anchor plates.
- l) The finally assembled joints shall then be clamped and transported to the work site.

#### **2607.4. Handling and Storage**

- a) For transportation and storage, auxiliary brackets shall be provided to hold the joint assembly together.
- b) The manufacturer shall supply either directly to the Engineer or to the Bridge Contractor all the materials of strip seal joints including sealants and all other accessories for the effective installation of the jointing.
- c) Expansion joint material shall be handled with care. It shall be stored under cover on suitable lumber padding by the Contractor to prevent damage. Any damage occurring after delivery shall be made good at the Bridge Contractor's expense to the satisfaction of the Engineer.

#### **2607.5. Installation**

**2607.5.1.** The width of the gap to cater for movement due to thermal effect, prestress, shrinkage and creep, superstructure deformations (if any) and sub-structure deformations (if any) shall be determined and intimated to the manufacturer. Depending upon the temperature at which the joint is likely to be installed, the gap dimension shall be preset.

**2607.5.2.** Taking the width of gap for movement of the joint into account, the dimensions of the recess in the decking shall be established in accordance with the drawings or design data of the manufacturer. The surfaces of the recess shall be thoroughly cleaned and all dust and debris removed. The exposed reinforcement shall be suitably adjusted to permit unobstructed lowering of the joint into the recess.

**2607.5.3.** The recess shall be shuttered in such a way that dimensions in the joint drawing are maintained. The formwork shall be tight.

**2607.5.4.** Immediately prior to placing the joint, the presetting shall be inspected. Should the actual temperature of the structure be different from the temperature provided for presetting, correction of the presetting shall be done. After adjustment, the brackets shall be tightened again.

**2607.5.5.** The joint shall be lowered in a pre-determined position. Following placement, of the joint in the prepared recess, the joint shall be levelled and finally aligned and the anchor loops on one side of the joint welded to the exposed reinforcement bars of the structure. Upon completion, the same procedure shall be followed for the other side of the joint. With the expansion joint finally held at both sides, the auxiliary brackets shall be released, allowing the joint to take up the movement of the structure.

**2607.5.6.** High quality concrete shall then be filled into the recess. The packing concrete must feature low shrinkage and have the same strength as that of the superstructure, but in any case not less than M 35 grade. Good compaction and careful curing of concrete is particularly important. After the concrete has cured, the movable installation brackets still in place shall be removed.

**2607.5.7.** Rolled up neoprene strip seal shall be cut into the required length and inserted between the edge beams by using a crow bar pushing the bulb of the seal into the steel grooves of the edge beams. A landing to a bead shall be formed in the thickened end of the edges of the seal which would force the thickened end against the steel beam due to wedge effect when the strip seal is buttoned in place.

**2607.5.8.** As soon as the concrete in the recess has become initially set, a sturdy ramp shall be placed over the joint to protect the exposed steel beams and neoprene seals from site traffic. Expansion joint shall not be exposed to traffic loading before the carriageway surfacing is placed.

**2607.5.9.** The carriageway surfacing shall be finished flush with the top of the steel sections. The actual junction of the surfacing/wearing coat with the steel edge section shall be formed by a wedge shaped joint with a sealing compound. The horizontal leg of the edge beam shall be cleaned beforehand. It is particularly important to ensure thorough and careful compaction of the surfacing in order to prevent any premature depression forming in it.

### **Acceptance Test**

- (xiii) All steel elements shall be finished with conform corrosion protection system.
- (xiv) For neoprene seat, the acceptance test shall conform to the requirement & Stipulated in Table 2600-1. It shall also be stretch tested. If a manufacturer is to supply this type of joint, they will have to produce a test certificate accordingly conducted in a recognised laboratory, in India or abroad.
- (xv) In view of the importance of the built up edge beam\*, special investigation of fatigue strength of this section with anchorages to withstand 2x10\* load change cycles without showing signs of damage, will be required. The supplier shall have to produce a test certificate in this regard, conducted in a recognised laboratory, in India or abroad.
- (xvi) The manufacturer shall produce test certificates indicating that anchorage system had been tested in a recognised laboratory to determine optimum configuration of anchorage assembly under dynamic bating.
- (xvii) The manufacturer shall satisfy the Engineer that water tightness test for the type of joint has been carried out in a recognised laboratory to check the water tightness trader a water pressure of 4 bars.
- (xviii) As strip seal type of joint if specialised in nature generally of the proprietary

type, the manufacturer shall be required to produce evidence of satisfactory performance of this type of joint.

**2608. TESTS AND STANDARDS OF ACCEPTANCE**

The materials shall be tested in accordance with these specifications and shall meet the prescribed criteria.

The work shall conform to these specifications and shall meet the prescribed standards of acceptance.

**2609. MEASUREMENTS FOR PAYMENT**

The expansion joint shall be measured in running metres. For filled joints, the rate per running metre shall include the cost of sealant for the depth provided in this drawing.

**2610. RATE**

The contract unit rate shall include the cost of all material, labour, equipment and other incidental charges for fixing the joints complete in all respects as per these specifications in the case of Bridge Contractor supplying the expansion joint. If the manufacturer supplies the expansion joint directly to the Engineer, the cost of installation, handling and fixing shall be borne by the Bridge Contractor.

**Item no.06 to 09:** The work will be executed as the item details and as instructed by engineer-in-charge.

-----

## **PART- IV**

# **MILESTONES AND TIME SCHEDULE**



## **PART-IV**

### **CHAPTER - I MILESTONES AND TIME SCHEDULE**

#### **4.1.1 Time Schedule:**

##### **4.1.1.1 Time of start and completion:**

The time allowed for execution of the works is 15 (Fifteen months) from the date of issue of letter of acceptance from DFCCIL.

The contractor shall be expected to mobilize to the site of works and commence execution of the works within 10(days) from issue of Acceptance Letter by DFCCIL.

The contractor shall be expected to complete the whole work ordered on the contractor within 15 months (Fifteenmonths) from the date of issue of Acceptance Letter by DFCCIL.

If the contractor commits defaults in commencing execution of the works as afore stated, DFCCIL shall without prejudice to any other right to remedy, be at liberty to forfeit fully the Earnest Money Deposit and performance guarantee of the contractor.

##### **4.1.1.2 Progress of works:**

The contractor shall submit a programme of work in the form of a Bar Chart of all the activities in consistence with milestone target envisaged below. In case this bar chart requires to be modified, the Engineer and the contractor shall agree upon a time and progress chart. The chart shall be prepared in direct relation to the time stated as 15 months for the completion of the works as the milestone targets specified below of these special conditions. It shall indicate the forecast of the dates of commencement and completion of various activities of the work and may be amended as necessary by agreements between the Engineer and the contractor within the limitation of 15 months as overall completion period.

##### **4.1.2 Achievement of milestone progress:**

In order to ensure progress during the execution of the work the contractor will be expected to achieve the following milestone targets ahead of dates mentioned against each. Failure to achieve accomplished milestone targets within allocated timeframe, save for reason accepted as laid by the Engineer shall create and constitute the ground for failure on the part of contractor for maintaining progress of the work as per agreed programme.

| <b>Milestone Targets</b>  | <b>Time allocated within which to achieve completion in total 18 (Eighteen) month's Time</b> |
|---|--|
| (a) Physical commencement of work   | D + 10 days  |
| (b) Mobilization of equipment's   | D + 20 days  |
| (c) Full mobilization of plant , machinery, men and material  | D + 30 days  |
| (d)Construction of diversion of Road  | D + 60 days  |
| (e) Construction of foundation  | D + 150 days   |
| (f) Construction of substructure (Abutments & Piers)  | D+150 to D+240 days  |
| (g) Construction of stair cases   | D + 120 to D + 270 days  |
| (h) Fabrication and launching of steel superstructure   | D + 60 to D + 330 days   |
| (i) Construction of deck slab including foot path, crash barrier, RE wall, RCC slab/Girder, railing, etc.                                     | D +330 to D + 390 days   |
| (j)Earthwork in embankment, Asphalted road,rolling etc. complete  | D +390 to D + 450 days   |
| (k) Completion of providing & fixing of protection screens, cables, testing, etc,   | D +390 to D + 470 days   |
| (l)Providing and fixing Road sign boards, Lighting arrangements, painting etc. final Finishing and clearance / tidying up of site completely. | D +470 to D + 540 days   |

**Note:** "D" is the date of issue of Letter of Acceptance by DFCCIL to the contractor.

**PART- IV  
CHAPTER II**

**TENDER FORMS  
(INCLUDING SCHEDULE OF  
PRICES)**

**PART- IV**  
**CHAPTER II****TENDER FORMS**

| <b>FORM No.</b> | <b>SUBJECT</b>  |
|-----------------|---|
| Form No. 1      | Offer Letter  |
| Form No. 2      | Tenderer's Credentials                                    |
| Form No. 2A     | Technical Eligibility Criteria Details                    |
| Form No. 2B     | Financial Eligibility Criteria Details                    |
| Form No. 2C     | Applicant's Party Information Form                        |
| Form No. 3      | Summary of Prices   |
| Form No. 4      | Schedule of Prices and Total Prices                       |
| Form No. 5      | Contract Agreement  |
| Form No. 6      | Performance Guarantee Bond                                |
| Form No. 7      | Standing indemnity bond for on account payment.           |
| Form No. 8      | ECS / NEFT / RTGS   |
| Form No. 9      | Draft MOU for Joint Venture Participation                 |
| FormNo.10       | Draft Agreement for JV                                    |
| FormNo.11       | Pro-forma of Participation from each partner of JV        |
| FormNo.12       | Power of Attorney for authorized signatory of JV Partners |
| FormNo.13       | Power of Attorney to lead partner of JV                   |
| Form No. 14     | Proforma for Time Extension                               |
| Form No. 15     | Certificate of Fitness                                    |
| Form No. 16     | Proforma of 7 days' Notice                                |
| Form No. 17     | Proforma of 48 Hours' Notice                              |
| Form No. 18     | Proforma of Termination Notice                            |
| Form No. 19     | Format of Bank Guarantee for Mobilisation Advance         |
| Form No. 20     | ANTI-PROFOTEERING DECLARATION                             |
| Form No. 21     | Name and Address of the Chartered Accountant              |

**OFFER LETTER**

Tender No.MUM/N/EN/ROB/LC-49

NAME OF WORK:- Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway.

To,  
The Managing Director,  
DFCCIL,  
New Delhi

We, the undersigned, declare that:

- (a) We have examined and have no reservations to the Bidding Documents, including Addenda.
- (b) We offer to execute the Works in conformity with the Bidding Documents;
- (c) Our bid shall be valid for a period of 90days from the date fixed for the bid submission deadline in accordance with the Bidding Documents, and it shall remain binding upon us and may be accepted at any time before the expiration of that period;
- (d) We have not been blacklisted/banned in accordance with para.1.3.13 (ii)(v)(a) of Preamble and General Instructions to tenderers.
- (e) We are neither Bankrupt /Insolvent nor in the process of winding-up nor there is a case pending before any Court on deadline of submission of the Bid in accordance with para.1.3.13 (ii) (v) (b) of Preamble and General Instructions to tenderers.
- (f) If our bid is accepted, we commit to obtain a Performance Guarantee in accordance with the Bidding Documents;
- (g) If our bid is accepted, we commit to deploy key equipment and key personnel consistent with the requirements of the work.
- (h) We understand that this bid, together with your written acceptance thereof included in your notification of award/Letter of Acceptance (LOA), shall constitute a binding contract between us, until a formal contract is prepared and executed; and

- (i) All information, statements and description in this bid are in all respect true, correct and complete to the best of our knowledge and belief and we have not made any tampering or changes in the bidding documents on which the bid is being submitted and if any tampering or changes/incorrect information are detected at any stage, we understand the bid will invite summarily rejection and forfeiture of bid security, the contract will be liable to be terminated along with forfeiture of performance security, even if LOA has been issued.
- (j) We understand that you are not bound to accept the lowest bid or any other bid that you may receive.

Name .....

In the capacity of.....

Signed .....

Duly authorized to sign the Bid for and on behalf of .....

Date.....

**TENDERER'S CREDENTIALS**

| <b>S. No</b> | <b>Description</b>  |
|--------------|---|
| 1.           | For technical experience/competence, give details of similar completed Works during the last three financial years(i.e. current Financial year and three previous Financial Years) in the proforma given in Form-2A   |
| 2.           | For financial capacity and organizational resources, give details of Contractual payments received for the last three financial years( i.e current Financial year and three previous financial years) as per audited balance sheet certified by Chartered Accountant in the proforma given in Form-2B |
| 3.           | Give constitution of your firm. Attach certified copies of legal documents in support thereof. Form-2C  |

FORM No. 2A

**TECHNICAL ELIGIBILITY CRITERIA DETAILS**

**Details of the similar works completed (asper Para 1.3.13 (i) of  
Preamble and General Instructions to Tenderers)**

|   |  |  |
|---|--|--|
| <b>Similar Contract No.</b>   |  |  |
| Contract Identification   |  |  |
| Award date  |  |  |
| Completion date   |  |  |
| Role in Contract  | Prime Contractor<br><input type="checkbox"/> | Member in JV<br><input type="checkbox"/> |
| Total Contract Amount (Rs.)   |  |  |
| If member in a JV, specify participation in total Contract amount             | <i>[insert a percentage amount]</i>          | <i>Total contract amount in Rs.</i>      |
| Employer's Name:<br>Address:<br><br>Telephone/fax number<br><br>E-mail:       |  |  |
| <b>Description of the similarity in accordance with Criteria 1.3.13(i)(A)</b> |  |  |
|   |  |  |

**The bidder shall attach Certified completion certificates issued by the client duly attested by Notary as per Eligibility Criteria of the tender documents.**

Signature of the  
Tenderer with Seal



**FINANCIAL ELIGIBILITY CRITERIA DETAILS**

**Each Bidder or each member of JV must fill in this form separately.**

**Name of Bidder/JV Partner**

Details of contractual payments (Construction only) received during the last three financial years and current financial year

| Contractual payments received (Construction only) |   |
|---|---|
| Year  | Value of payment received in Rs.<br>(Contract Receipts) |
| Current Year (2019-2020)                          |   |
| 2018-2019   |   |
| 2017- 2018  |   |
| 2016- 2017  |   |
| Total Contractual Payment                         |   |

**Note:** The details should be extracted from the audited balance sheet Certified by the Chartered Accountant or form 16-A issued by the Employer as per clause 1.3.13 of Preamble and General Instructions to Tenderers.

**The bidder shall attach necessary documents in support of the above.**

Signature of the  
Tenderer with Seal

**APPLICANT'S PARTY INFORMATION FORM**

|  |
|--|
| Applicant name:<br>[insert full name]  |
| Applicant's Party name:<br>[insert full name of Applicant's Party]   |
| Applicant's Party country of registration:<br>[indicate country of registration]   |
| Applicant Party's year of constitution:<br>[indicate year of constitution]   |
| Applicant Party's legal address in country of constitution:<br>[insert street/number/town or city/country]   |
| Applicant Party's authorized representative information<br>Name:[insert full name]<br>Address:[insert street/number/ town or city/country]<br>Telephone/Fax numbers:[insert telephone/fax numbers, including country and city codes]<br>E-mail address:[indicate e-mail address]   |
| 1.Attached are copies of original documents of<br><input type="checkbox"/> Articles of Incorporation (or equivalent documents of constitution or association), and/or registration documents of the legal entity named above.<br><input type="checkbox"/> In case of a Government- owned enterprise or institution, documents establishing legal and financial autonomy, operation in accordance with commercial law, and absence of dependent status.<br>2.Included are the organizational chart, a list of Board of Directors, and the beneficial ownership. |

Signature of the  
Tenderer with Seal

**SUMMARY OF PRICES**

**(Summary of Prices has been separately attached in Financial Packet "B")**

**SCHEDULE -1  
SCHEDULE OF PRICES & TOTAL PRICES**

**(Schedule of Prices & Total Prices have been separately attached in  
Financial Packet "B").**

FORM No. 5  
SAMPLE

**AGREEMENT**

**CONTRACT AGREEMENT**

THIS AGREEMENT ("Agreement") is made at New Delhi on the \_\_\_\_ day of  
BETWEEN

(1) Dedicated Freight Corridor Corporation of India Limited, incorporated under the laws of India and having its principal place of business at, Pragati Maidan Metro Station Building Complex, New Delhi, India-110001 (hereinafter called '**the Employer**'), and ---  
-----, a company / corporation / JV incorporated under the laws of ----- having its principal place of business at ----- (herein after called '**the Contractor**').

WHEREAS in reference to a call for Tender for Construction of Construction of \_\_ nos ROB's (excluding/including approaches) in lieu of level crossings for LC No. \_\_\_\_\_ as per Tender paper \_\_\_\_\_ at Annexure "A" here to, the Contractor has submitted a Tender here to and where as the said Tender of the contractor has been accepted for Construction of \_\_ nos ROB's (excluding/including approaches) in lieu of level crossings for LC No. \_\_\_\_\_.

As per copy of the Letter of Acceptance of Tender No----- dated ---- complete with enclosure at the accepted rates and at an estimated contract value of Rs. \_\_\_\_\_ (Rupees only). Now the agreement with witness to that in consideration of the premises and the payment to be made by the Employer to the Contractor provided for herein below the Contractor shall supply all equipments and materials and execute and perform all works for which the said Tender of the Contractor has been accepted, strictly according to the various provisions in Annexure 'A' and 'B' here to and upon such supply, execution and performance to the satisfaction of the Purchaser, the Purchaser shall pay to the contractor at the several rates accepted as per the said Annexure 'B' and in terms of the provisions therein.

IN WITNESS WHEREOF the parties hereto have caused their respective Common Seals to be here unto affixed/(or have here unto set the irrespective hands and

seals)the day and year first above written.

For and on behalf of the Contractor

For and on behalf of the Employer

Signature of the authorized official  
Name of the official

Signature of the authorized official  
Name of the official

Stamp/seal of the Contractor

Stamp/Seal of the Employer

**SIGNED, SEALED AND DELIVERED**

By the said

\_\_\_\_\_ Name

By the said

\_\_\_\_\_ Name

On behalf of the Contractor in the  
presence of: \_\_\_\_\_

on behalf of the Employer in the  
presence of: \_\_\_\_\_

Witness \_\_\_\_\_

Witness \_\_\_\_\_

Name \_\_\_\_\_

Name \_\_\_\_\_

Address \_\_\_\_\_

Address \_\_\_\_\_

Enclosures:-

1. Annexure 'A' - Tender Papers No.

2. Annexure 'B' - Letter of Acceptance of Tender No. \_\_\_\_\_ Dated \_\_\_\_\_

Along with Summary of Prices

**SAMPLE**  
**Bank Guarantee for Performance Security**

Bank Guarantee No:  
Amount of Guarantee:  
Bank Guarantee Cover from..... to  
Last Date of Lodgment of Claim:

To,

Chief General Manager / North,  
Dedicated Freight Corridor Corporation of India limited  
7TH Floor, Central Railway New Administrative Building,  
Mumbai-400001 Maharashtra

Reference:-

This deed of Guaranty made this day of .....between ..... having registered office at .....and branch office at .....(hereinafter referred to as "Bank") of the one part and

Dedicated Freight Corridor Corporation of India Limited (hereinafter called the Employer) of the other part .

Whereas Dedicated Freight Corridor Corporation of India Limited has awarded the contract no ..... on dated ..... for .....  
(hereinafter called "the Contract")

To M/ s .....its registered office at .....  
(hereinafter called "the Contractor"). Whereas the contractor is bound by the said Contract to submit to the Employer an irrevocable performance security guarantee bond for a total amount of Rs .....(Rupees ..... ).

Now, we the undersigned (Name of Bank official), of the bank being fully authorized to sign and to incur obligations for and on behalf of the Bank hereby declare that the said Bank will guarantee the Employer the full amount of Rs. .... (Rupees .....). as stated above.

After the Contractor has signed the aforesaid contract with the Employer, the Bank further agree and promise to pay the amount due and payable under this guarantee without any demure merely on a demand from the Employer stating that the amount claimed is due by way of loss or damage cause to or would be caused or suffered by the Employer by reason of any breach by the said contractor of any of the terms or conditions contained in the said agreement or by reason of the contractor failure to perform the said agreement . Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However our liability under this guarantee shall be restricted to an amount not exceeding Rs ..... (Rupees .....).

We ..... further undertake to pay to the Employer any money so demanded notwithstanding any dispute or dispute raised by the contractor in any suit or proceeding pending before any court or Tribunal relating to liability under this present being absolute . and unequivocal.

The payment so made by us (name of Bank) under this bond shall be a valid discharge of our liability for payment there under and the Contractor shall have no claim against us for making such payment.

We ..... to further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said agreement and that it shall continue to be enforceable till all the dues of the Employer under or by virtue of the said agreement have been fully paid and its claims satisfied or discharged by Chief General Manager/North/Mumbai/DFCCIL,7TH Floor, Central Railway New Administrative Building, Mumbai-400001 Maharashtra(Designation & address of contract signing authority) on behalf of Employer certify that the terms and conditions of the said agreement have been fully and properly carried out by the said contractor and accordingly discharges this guarantee.

Notwithstanding anything to the contrary contained herein the liability of the bank under this guarantee will remain in force and effect until such time as this guarantee is discharged in writing by the Employer or until (date of validity/extended validity) whichever is earlier and no claim shall be valid under the guarantee unless notice in writing thereof is given by the Employer within validity/extended validity period of guarantee from the date aforesaid.

Provided always that we ..... unconditionally undertakes to renew this guarantee or to extend the period of guarantee from year to year before the expiry of the period or the extended period of guarantee, as the case may be on being



called upon to do so by the Employer. If the guarantee is not renewed or the period extended on demand, we State Bank of Indian shall pay the Employer the full amount of the guarantee on demand without demur.

We ....., to further agree with the Employer that the Employer shall have the fullest liberty without our consent and without effecting in any manner out of obligation hereunder to vary any of the terms and conditions of the said contract from time to time or to postpone for any time or from time to time any to power exercisable by the Employer against the said contractor and to forbear or enforce any of the terms and conditions of the said agreement and we shall not be relieved from our liabilities by reason of such variation, or extension being granted to the said contractor for any bearance, act or omission on the part of the Employer or any indulgence by the Employer to the said contractor or by any such matter or thing whatsoever which under the law relating to sureties for the said reservation would relieve us from the liability.

The Guarantee hereinbefore contained shall not be affected by any change in the constitution of Bank or of the Contractor.

The expressions "the Employer", "the Bank" and "the Contractor" hereinbefore used shall include their respective successors and assigns.

We ..... lastly undertake not to revoke this guarantee during its currency except with the previous consent of the Employer in writing.

Notwithstanding anything to the contrary contained hereinbefore:

i) Our liability under this Bank Guarantee shall not exceed and restricted to Rs ..... (Rupees .....)

ii) This Bank Guarantee shall be valid up to ....., unless extended on demand by Employer.

iii)The Bank is liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if Employer serve a written claim or demand on or before .....  
.

IN WITNESS WHEREOF we of the Bank have signed and stamped this guarantee on this day of ..... being herewith duly authorized.

**SAMPLE**

Name of the Bank \_\_\_\_\_

Managing Director/ DFCCIL Bank Guarantee Bond No. \_\_\_\_\_

Acting through \_\_\_\_\_ (Designation Dated \_\_\_\_\_ and address of contract signing authority)

**PERFORMANCE GUARANTEE BOND**

In consideration of the Managing Director/ DFCCIL acting through \_\_\_\_\_  
(Designation & Address of Contract Signing Authority), Dedicated Freight Corridor Corporation of India Limited, New Delhi hereinafter called "DFCCIL") having agreed under the terms and conditions of agreement/Contract Acceptance letter No.

\_\_\_\_\_ dated made between \_\_\_\_\_ (Designation & address of contract signing Authority) and \_\_\_\_\_ (hereinafter called "the said contractor(s)" for the work \_\_\_\_\_

(hereinafter called "the said agreement") having agreed for submission of a irrevocable Bank Guarantee Bond for Rs. \_\_\_\_\_ (Rs. \_\_\_\_\_ only) as a performance security Guarantee Bond from the contractor(s) for compliance of his obligations in accordance with the terms & conditions in the said agreement.

1. We (indicate the name of the Bank) hereinafter referred to as the Bank, undertake to pay to the Government an amount not exceeding Rs. \_\_\_\_\_ (Rs. \_\_\_\_\_ only) on demand by the Government.
2. We \_\_\_\_\_ (indicate the name of the bank, further agree that (and promise) to pay the amounts due and payable under this guarantee without any demur merely on a demand from the Government through the GROUP GENERAL MANAGER/ FINANCE Dedicated Freight Corridor Corporation of India Limited, New Delhi or \_\_\_\_\_ (Designation & Address of contract signing authority) DFCCIL, stating that the amount claimed is due by way of loss or damage caused to or would be caused or suffered by the Government by reason of any breach by the said contractor of any of the terms or conditions contained in the said agreement or by reason of the contractor failure to perform the said agreement. Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our liability under this guarantee shall be restricted to an amount not exceeding Rs. \_\_\_\_\_ (Rs. \_\_\_\_\_ only)
- 3 (a) We, \_\_\_\_\_ ( indicate the name of Bank ) further undertake to pay to the Government any money so demanded notwithstanding any dispute or

dispute raised by the contractor (s) in any suit or proceeding pending before any court or Tribunal relating to liability under this present being absolute and unequivocal.

- (b) The payment so made by us under this bond shall be valid discharge of our liability for payment there under and the contractor(s) shall have no claim against us for making such payment.
4. We, \_\_\_\_\_ (indicate the name of bank ) to further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said agreement and that it shall continue to be enforceable till all the dues of the Government under or by virtue of the said agreement have been fully paid and its claims satisfied or discharged by \_\_\_\_\_ (Designation & Address of contract signing authority) on behalf of the Government, certify that the terms and conditions of the said agreement have been fully and properly carried out by the said contractor (s) and accordingly discharges this guarantee.
5. (a) Notwithstanding any thing to the contrary contained herein the liability of the bank under this guarantee will remain in force and effect until such time as this guarantee is discharged in writing by the Government or until ( date of validity/extended validity) whichever is earlier and no claim shall be valid under this guarantee unless notice in writing thereof is given by the Government within validity / extended period of validity of guarantee from the date aforesaid.
- (b) Provided always that we \_\_\_\_\_ (indicate the name of the Bank ) unconditionally undertakes to renew this guarantee to extend the period of guarantee form year to year before the expiry of the period or the extended period of the guarantee, as the case may be on being called upon to do so by the Government. If the guarantee is not renewed or the period extended on demand, we \_\_\_\_\_ (indicate the name of the Bank) shall pay the Government the full amount guarantee on demand and without demur.
6. We, \_\_\_\_\_ (indicate the name of Bank) further agree with the Government that the Government shall have the fullest liberty without our consent and without effecting in any manner out of obligations hereunder to vary any of the terms and conditions of the said contract from time to time or to postpone for any time or from time to time any to the powers exercisable by the Government against the said contractor (s) and to forbear or enforce any of the terms and conditions of the said agreement and we shall not be relieved from our liability by reason of any such variation, or extension being granted to the said contractor (s) or for any

bearance act or omission on the part of the Government or any indulgence by the Government to the said contractor (s) or by any such matter or thing whatsoever which under the law relating to sureties for the said reservation would relive us from the liability.

7. This guarantee will not be discharged by any change in the constitution of the Bank or the Contractor (s).
8. We, \_\_\_\_\_(indicate the name of the Bank) lastly undertake not to revoke this guarantee except with the previous consent of the Government in writing.
9. This guarantee shall be valid upto \_\_\_\_\_(Date of completion plus 60 days beyond that). Unless extended on demand by Government. Notwithstanding anything to the contrary contained herein before, our liability under this guarantee is restricted to Rs. \_\_\_\_\_ (Rs. \_\_\_\_\_only) unless a demand under this guarantee is made on us in writing on or before \_\_\_\_\_ we, shall be discharged from our liabilities under this guarantee thereafter.

Dated \_\_\_\_\_ the day of \_\_\_\_\_ for  
\_\_\_\_\_(indicate the name of bank)

Signature of Bank Authorize official  
(Name):  
Designation:  
Full Address.

Witness:

1. \_\_\_\_\_

2. \_\_\_\_\_

FORM No. 7

**SAMPLE  
STANDINGINDEMNITYBOND FOR “ONACCOUNT” PAYMENTS**

**(On paper of requisite stamp value)**

We, M/s \_\_\_\_\_ hereby undertake that we hold a tour stores Depot/s at \_\_\_\_\_ for and on behalf of the Managing Director/ DFCCIL acting in the premises through the Chief General Manager /North/Mumbai/ DFCCIL or his successor (herein after referred to as “The Employer”) all materials for which “On Account” payments have been made to us against the Contract for ( \_\_\_\_\_ ) on the section \_\_\_\_\_ DFCCIL also referred to as Group/s \_\_\_\_\_ vide letter of Acceptance of Tender \_\_\_\_\_ dated \_\_\_\_\_ and material handed over to us by the employer for the purpose of execution of the said contract, until such time the materials are duly erected or otherwise handed over to him.

We shall be entirely responsible for the safe custody and protection of the said materials against all risk till they are duly delivered as erected equipment to the employer or as he may direct otherwise and shall indemnify the employer against any loss /damage or deterioration what so ever in respect of the said material while in our possession and against disposal of surplus materials. The said materials shall at all times be open to inspection by any officer authorized by the CHIEF GENERAL MANAGER/North/Mumbai/DFCCIL in charge of Dedicated Freight Corridor Corporation of India Limited (Whose address will be intimated in due course).

Should any loss, damage or deterioration of materials occur or surplus material disposed off and refund becomes due, the Employer shall be entitled to recover from us the 85% of supply portion of Part IV, Chapter–II (Form - 4) to the Contract(as applicable)and also compensation for such loss or damage if any long with the amount to be refunded without prejudice to any other remedies available to him by deduction from any sum due or any sum which at any time hereafter be comes due to us under the said or any other Contract.

Dated this day \_\_\_\_ day of \_\_\_\_\_ 2019

for and on behalf of

M/s \_\_\_\_\_ (Contractor)

Signature of witness

Name of witness in Block letter.

Address. \_\_\_\_\_

**ECS / NEFT / RTGS  
MANDATE FORM**

Date :-

To,

GM (F) / GGM (F)

DFCCIL, New Delhi.

Sub : ECS / NEFT / RTGS payments

We refer to the ECS / NEFT / RTGS set up by DFCCIL for remittance of our payments using RBI's NEFT / RTGS scheme, our payments may be made through the above scheme to our under noted account.

|  |  |
|--|--|
| Name of Bank   |  |
| Name of City   |  |
| Bank Code No   |  |
| Name of Bank Branch  |  |
| Branch Code No   |  |
| Address of Bank Branch   |  |
| Telephone Number of Bank Branch  |  |
| Fax No of Bank Branch  |  |
| Name of customer / Tenderer as per account   |  |
| Account Number of Tenderer appearing on cheque book  |  |
| Type of Account (S. B. / Current / Cash credit)  |  |
| IFSC code for NEFT   |  |
| IFSC code for RTGS   |  |
| 9-Digit-code number of the bank and branch appearing on the MICR cheque issued by the bank.  |  |
| Details of Cancelled Cheque leaf   |  |
| Telephone no of tenderer   |  |
| Cell Phone Number of the tenderer to whom details with regard to the status of bill submitted to Accounts Office i.e Co6 & Co7 & Cheque Purchase Orders particulars can be intimated through SMS |  |
| Tenderer's E - mail ID   |  |

Confirmed by Bank signature of tenderer With stamp and address  
Enclose a copy of crossed cheque

**DRAFT MEMORANDUM OF UNDERSTANDING (MOU) For  
JOINT VENTURE PARTICIPATION  
BETWEEN**

M/s.....having its registered office at.....(herein after referred to as ..... ) acting as the Lead Partner of the first part,

**and**

M/s.....having its registered office at.....(herein after referred to as `.....') in the capacity of a Joint Partner of the other part.

**and**

M/s.....having its registered office at.....(hereinafter Referred to as `.....') in the capacity of a Joint Partner of the other part.

The expressions of.....and.....shall wherever the context admits, mean and include the irrespective legal representatives, successors-in-interest and assigns and shall collectively be referred to as "the Parties" and individually as " the Party"

**WHEREAS:**

Dedicated Freight Corridor Corporation of India Limited (DFCCIL) [herein after referred to as "Client"] has invited bids for ... "[Insert name of work]....."

**NOW, THEREFORE, THE PARTIES AGREE AS FOLLOWS:**

1. The following documents shall be deemed to form and be read and construed as an integral part of this MOU.
  - (i) Notice for Bid, and
  - (ii) Bidding document
  - (iii) Any Addendum/ Corrigendum issued by Dedicated Freight Corridor Corporation of India Limited
  - (iv) The bid submitted on our behalf jointly by the Lead Partner.
2. The `Parties' have studied the documents and have agreed to participate in submitting a `bid' jointly.
3. M/s.....shall be the lead member of the JV for all intents and purpose and shall represent the Joint Venture in its dealing with the Client. For the purpose of submission of bid proposals, the parties agree to nominate.....as the leader duly authorized to sign and submit all documents and subsequent clarifications, if any, to the Client. However M/s.....shall not submit any such proposals, clarifications or commitments before securing the written clearance of the other partner which shall be expeditiously given by M/s.....to M/s.....
4. The `Parties' have resolved that the distribution of responsibilities and their proportionate share in the Joint Venture is as under:
  - (a) Lead Partner;
    - (i) .....
    - (ii).....

(iii) .....

(b) Joint Venture Partner

(i) .....

(ii).....

(iii) .....

[Similar details to be given for each partner]

#### **5. JOINT AND SEVERAL RESPONSIBILITY**

The Parties undertake that they shall be jointly and severally liable to the Client in the discharge of all the obligations and liabilities as per the contract with the Client and for the performance of contract awarded to their JV.

#### **6. ASSIGNMENT AND THIRD PARTIES**

The parties shall co-operate through out the entire period of this MOU on the basis of exclusivity and neither of the Parties shall make arrangement or enter into agreement either directly or indirectly with any other party or group of parties on matters relating to the Project except with prior written consent of the other party.

#### **7. EXECUTIVE AUTHORITY**

The said Joint Venture through its authorized representative shall receive instructions, payments from the Client. The management structure for the project shall be prepared by mutual consultations to enable completion of project to quality requirements within permitted cost and time.

#### **8. BID SECURITIES**

Till the award of the work, JV firm/Lead Partner of JV firm shall furnish Bid Security to the Client on behalf of the joint venture which shall be legally binding on all the members of the Joint Venture.

#### **9. BID SUBMISSION**

Each Party shall bear its own cost and expenses for preparation and submission of the bid and all costs until conclusion of a contract with the Client for the Project. Common expenses shall be shared by all the parties in the ratio of their actual participation.

#### **10. INDEMNITY**

Each party here to agrees to indemnify the other party against its respective parts in case of breach/ default of the respective party of the contract works of any liabilities sustained by the Joint Venture.

11. For the execution of the respective portions of works, the parties shall make their own arrangements to bring the required finance, plants and equipment, materials, manpower and other resources.

#### **12. DOCUMENTS & CONFIDENTIALITY**

Each Party shall maintain in confidence and not use for any purpose related to the Project all commercial and technical information received or generated in the course of preparation and submission of the bid.

#### **13. ARBITRATION**



Any dispute, controversy or claim arising out of or relating to this agreement shall be settled in the first instance amicably between the parties. If an amicable settlement cannot be reached as above, it will be settled by arbitration in accordance with the Indian Arbitration and Conciliation Act 1996 or any amendments thereof. The venue of the arbitration shall be Delhi.

#### 14. VALIDITY

This Agreement shall remain in force till the occurrence of the earliest to occur of the following, unless by mutual consent, the Parties agree in writing to extend the validity for a further period.

- a. The bid submitted by the Joint Venture is declared unsuccessful, or
- b. Cancellation/shelving of the Project by the client for any reasons prior to award of work
- c. Execution of detailed JV agreement by the parties, setting out detailed terms after award of work by the Client.

15. This MOU is drawn in.....number of copies with equal legal strength and status. One copy is held by M/s.....and the other by M/s.....& .....M/s.....and a copy submitted with the proposal.

16. This MOU shall be construed under the laws of India.

#### 17. NOTICES

Notices shall be given in writing by fax confirmed by registered mail or commercial courier to the following fax numbers and addresses:

Lead Partner

.....  
(Name & Address)

Other Partner(s)

.....  
(Name & Address)

IN WITNESS WHERE OF THE PARTIES, have executed this MOU the day, month and year first be forewritten.

M/s.....  
.....  
(Seal)

M/s.....  
.....  
(Seal)

Witness

- 1.....(Name & Address)
- 2.....(Name & Address)

**Notes:** (1) In case of existing joint venture, the certified copy of JV Agreement may be furnished.

**DRAFT FORMAT OF JOINT VENTURE AGREEMENT**

To be executed on non-judicial stamp paper of appropriate value in accordance with relevant Stamp Act and to be registered with appropriate authority under Registration Act.

The JV agreement shall be structured generally as per contents list given below:

**A. CONDITIONS AND TERMS OF JV AGREEMENT**

1. Definitions and Interpretation
2. Joint Venture—Include Equity of members, transferability of shareholding of equity of a partner leaving during the subsistence of the contract.
3. Proposal Submission
4. Performance— To indicate scope of responsibility of each member
5. Language and Law
6. Exclusively
7. Executive Authority
8. Documents
9. Personnel
10. Assignment and Third Parties
11. Severability
12. Member in Default
13. Duration of the Agreement
14. Liability and sharing of risks
15. Insurance
16. Sharing of Promotion and Project Costs, Profits, Losses and Remuneration
17. Financial Administration and Accounting
18. Guarantees and Bonds
19. Arbitration
20. Notices
21. Sole Agreement and Variation

**B. SCHEDULES**

1. Project and Agreement Particulars
2. Financial Administration Services
3. Allocation of the obligations
4. Financial Policy and Remuneration

\*\*\*\*\*

**PRO-FORMA LETTER OF PARTICIPATION FROM EACH PARTNER OF JOINT VENTURE (JV)**

(To be executed on non-judicial stamp paper of appropriate value in accordance with relevant Stamp Act and to be registered with appropriate authority under Registration Act.)

No....

Dated

From:

.....  
 .....

To,  
 The Managing Director,  
**Dedicated Freight Corridor Corporation of India Limited**  
 Pragati Maidan Metro Stn. Building Complex.,  
 New Delhi 110001.

Gentlemen,

Re: ... "[Insert name of work].....".

Ref: Your notice for Invitation for Bid No. \_\_\_\_\_  
 dated.....

1. We wish to confirm that our company/ firm has formed a Joint Venture with (i)..... & (ii)..... for the purposes associated with IFB referred to above.

*(Members who are not the lead partner of the JV should add the following paragraph)\*.*

2. 'The JV is led by...whom we hereby authorise to act on our behalf for the purposes of submission of Bid for.....and authorise to incur liabilities and receive instructions for and on behalf of any and all the partners or constituents of the Joint Venture.'

OR

*(Member(s) being the lead member of the group should add the following paragraph)\**

2. 'In this group we act as leader and, for the purposes of applying for Bid, represent the Joint Venture:

3. In the event of our JV being awarded the contract, we agree to be jointly with i) & ii).....(names of other members of our JV) and severally liable to the Dedicated Freight Corridor Corporation of India Limited, its successors and assigns for all obligations, duties and responsibilities arising from or imposed by the contract subsequently entered into between Dedicated Freight Corridor Corporation of India Limited and our JV.
4. **\*I/We, further agree that entire execution of the contract shall be carried out exclusively through the lead partner.**

Yours faithfully,

(Signature)

(Name of Signatory).....

(Capacity of Signatory).....

**Company Seal** \* Delete as applicable

Note: In case of existing joint venture, the certified copy of JV Agreement may be furnished.

**FORMAT FOR POWER OF ATTORNEY FOR AUTHORISED SIGNATORY OF JOINT  
VENTURE (JV) PARTNERS**

**POWER OF ATTORNEY\***

***(To be executed on non-judicial stamp paper of the appropriate value in  
accordance with relevant stamp Act. The stamp paper to be in the name of the  
company who is issuing the power of Attorney)***

Know all men by these presents, we ... do hereby constitute, appoint and authorise Mr/Ms.....who is presently employed with us and holding the position of .....as our attorney, to do in our name and on our behalf, all such acts, deeds and things necessary in connection with or incidental to our bid for the work of ... Including signing and submission of all documents and providing information / responses to Dedicated Freight Corridor Corporation of India Limited, representing us in all matters, dealing with Dedicated Freight Corridor Corporation of India Limited in all matters in connection with our bid for the said project.

We here by agree to ratify all acts, deeds and things lawfully done by our said attorney pursuant to this Power of Attorney and that all acts, deeds and things done by our aforesaid attorney shall and shall always be deemed to have been done by us.

Dated this the.....day of.....2019.

**(Signature of authorised Signatory)**

**Signature of Lead Partner**

**Signature of JV Partner(s)**

.....

.....

**(Signature and Name in Block letters of Signatory)**

**Seal of Company**

Witness

Witness1:

Name:

Address:

Occupation:

Witness2:

Name:

Address:

Occupation:

**\*Notes:**

- i) To be executed by all the partners jointly, in case of a Joint Venture.

**FORMAT FOR POWER OF ATTORNEY TO  
LEAD PARTNER OF JOINT VENTURE (JV)**

***(To be executed on non-judicial stamp paper of the appropriate value in accordance with relevant stamp Act. The stamp paper to be in the name of the company who is issuing the power of Attorney)***

**POWER OF ATTORNEY\***

Whereas Dedicated Freight Corridor Corporation of India Limited has invited Bids for the work of **“Construction of Road Over Bridge at IR km 96/4-10 in lieu of existing LC No. 49 at IR KM 97/18-20 between Palghar-Boisar Railway station of Mumbai-Delhi - Trunk route of Western Railway”**

Whereas, the members of the Joint Venture comprising of M/s. ..., M/s. ..., M/s. ...., and M/s. .... are interested in submission of bid for the work of ...*[Insert name of work]*... in accordance with the terms and conditions contained in the bidding documents.

Whereas, it is necessary for the members of the Joint Venture to designate one of them as the Lead Partner, with all necessary power and authority to do, for and on behalf of the Joint Venture, all acts, deeds and things as may be necessary in connection with the Joint Venture's bid for the project, as may be necessary in connection the Joint Venture's bid for the project.

**NOW THIS POWER OF ATTORNEY WITNESSETH THAT:**

We, M/s. ...., hereby designate M/s. ...., being one of the partners of the Joint Venture, as the lead partner of the Joint Venture, to do on behalf of the Joint Venture, all or any of the acts, deeds or things necessary or incidental to the Joint Venture's bid for the contract, including submission of bid, participating in conferences, responding to queries, submission of information/documents and generally to represent the Joint Venture in all its dealings with the DFCCIL or any other Government Agency or any person, in connection with the Bid/contract for the said work until culmination of the process of bidding till the contract agreement if successful, is entered into with the Dedicated Freight Corridor Corporation of India Limited and thereafter till the expiry of the contract agreement.

\*To be executed by all the members of the JV except the lead member.

The mode of execution of the Power of Attorney should be in accordance with the procedure, if any, laid down by the applicable law and the charter documents of the executant(s) and when it is so required the same should be under common seal affixed in accordance with the required procedure.

We hereby agree to ratify all acts, deeds and things lawfully done by lead member, our said attorney, pursuant to this power of attorney and that all acts deeds and things done by our aforesaid attorney shall and shall always be deemed to have been done by us/ Joint Venture.

Dated this the ..... Day of ..... 2019

.....  
(Signature)

.....  
(Name in Block letters of Executants)  
Seal of Company

|                  |  |
|------------------|--|
| <b>Witness 1</b> |  |
| Name:            |  |
| Address:         |  |
| Occupation:      |  |
| <b>Witness 2</b> |  |
| Name:            |  |
| Address:         |  |
| Occupation:      |  |

**PROFORMA FOR TIME EXTENSION**

No. \_\_\_\_\_ Dated : \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_

Sub : (i) \_\_\_\_\_ (name of work).  
(ii) Acceptance letter no. \_\_\_\_\_  
(iii) Understanding/Agreement no. \_\_\_\_\_

Ref: \_\_\_\_\_ (Quote specific application of  
Contractor for extension to the date received) \_\_\_\_\_

Dear Sir,

1. The stipulated date for completion of the work mentioned above is \_\_\_\_\_. From the progress made so far and the present rate of progress, it is unlikely that the work will be completed by the above date (or 'However, the work was not completed on this date').
2. Expecting that you may be able to complete the work, if some more time is given, the competent authority, although not bound to do so, hereby extends the time for completion from \_\_\_\_\_ to \_\_\_\_\_.
3. Please note that an amount equal to the liquidated damages for delay in the completion of the work after the expiry of \_\_\_\_\_ (give here the stipulated date for completion with/without any penalty fixed earlier) will be recovered from you as mentioned in Clause, 17-B of the Standard General Conditions of Contract for the extended period, notwithstanding the grant of this extension. You may proceed with the work accordingly.
4. The above extension of the completion date will also be subject to the further condition that no increase in rates on any account will be payable to you.
5. Please intimate within a week of the receipt of this letter your acceptance of the extension of the conditions stated above.



6. Please note that in the event of your declining to accept the extension on the above said conditions or in the event of your failure after accepting or acting upto this extension to complete the work by \_\_\_\_\_ (here mention the extended date), further action will be taken in terms of Clause 62 of the Standard General Conditions of Contract.

Yours faithfully

For and on behalf of the Employer

Name of the Official:-

Stamp/Seal of the Employer

### CERTIFICATE OF FITNESS

1. (a) Serial Number \_\_\_\_\_  
(b) Date \_\_\_\_\_
2. Name of person examined \_\_\_\_\_  
I certify that I have personally examined (*name*) \_\_\_\_\_
3. Father's Name: son/daughter of \_\_\_\_\_ ,  
residing at \_\_\_\_\_
4. Sex \_\_\_\_\_
5. Residence: \_\_\_\_\_
6. Date of birth, if available, and/or certified age \_\_\_\_\_
7. Physical fitness \_\_\_\_\_
8. Identification marks \_\_\_\_\_
9. Reasons for:
 

(a) refusal to grant certificate, or \_\_\_\_\_  
 (b) revoking the Certificate \_\_\_\_\_

Who is desirous of being employed in a factory or on a work requiring manual labour and that his / her age as nearly as can be ascertained from my examination, is \_\_\_\_\_ years and that he/she is fit for employment in a factory or on a work requiring manual labour as an adult/child.

\_\_\_\_\_  
Signature or Left Hand  
Thumb Impression of the  
person Examined

\_\_\_\_\_  
Signature of Certifying Surgeon

**Note** :In case of physical disability, the exact details of the cause of the physical disability should be clearly stated

**PROFORMA OF 7 DAYS NOTICE**  
**DFCCIL**  
(Without Prejudice)

To  
M/s \_\_\_\_\_  
\_\_\_\_\_

Dear Sir,

Contract Agreement No. \_\_\_\_\_  
In connection with \_\_\_\_\_

1. In spite of repeated instructions to you by the subordinate offices as well as by this office in various letters of even no. \_\_\_\_\_, dated \_\_\_\_\_; you have failed to start work/show adequate progress and/or submit detailed programme for completing the work.
2. Your attention is invited to this office/Chief Engineer's office letter no. \_\_\_\_\_, dated \_\_\_\_\_ in reference to your representation, dated \_\_\_\_\_.
3. As you have failed to abide by the instructions issued to commence the work/to show adequate progress of work you are hereby given 7 days' notice in accordance with Clause 62 of Standard General Conditions of Contract to commence works / to make good the progress, failing which further action as provided in Clause 62 of the Standard General Conditions of Contract viz. to terminate your Contract and complete the balance work without your participation will be taken.

Kindly acknowledge receipt.

Yours faithfully

For and on behalf of the Employer  
Name of the Official:-  
Stamp/Seal of the Employer

**FORM No. 17**  
Registered Acknowledgement Due

**PROFORMA OF 48 HRS. NOTICE**  
**DFCCIL**  
(Without Prejudice)

To

M/s \_\_\_\_\_  
\_\_\_\_\_

Dear Sir,

Contract Agreement No. \_\_\_\_\_  
In connection with \_\_\_\_\_

1. Seven days' notice under Clause 62 of Standard General Conditions of Contract was given to you under this office letter of even no., dated \_\_\_\_\_; but you have taken no action to commence the work/show adequate progress of the work.
2. You are hereby given 48 hours' notice in terms of Clause 62 of Standard General Conditions of Contract to commence works / to make good the progress of works, failing which and on expiry of this period your above contract will stand rescinded and the work under this contract will be carried out independently without your participation and your Security Deposit shall be forfeited and Performance Guarantee shall also be encashed and consequences which may please be noted.

Kindly acknowledge receipt.

Yours faithfully

For and on behalf of the  
Employer  
Name of the Official:-  
Stamp/Seal of the Employer

**FORM No. 18**  
Registered Acknowledgement Due

**PROFORMA OF TERMINATION NOTICE**  
**DFCCIL**  
(Without Prejudice)

No. \_\_\_\_\_ Dated \_\_\_\_\_

To  
M/s \_\_\_\_\_  
\_\_\_\_\_

Dear Sir,

Contract Agreement No. \_\_\_\_\_  
In connection with \_\_\_\_\_

Forty eight hours (48 hrs.) notice was given to you under this office letter of even no., dated \_\_\_\_\_; but you have taken no action to commence the work/show adequate progress of the work.

Since the period of 48 hours' notice has already expired, the above contract stands rescinded in terms of Clause 62 of Standard General Conditions of Contract and the balance work under this contract will be carried out independently without your participation. Your participation as well as participation of every member/partner in any manner as an individual or a partnership firm/JV is hereby debarred from participation in the tender for executing the balance work and your Security Deposit shall be forfeited and Performance Guarantee shall also be encashed.

Kindly acknowledge receipt.

Yours faithfully

For and on behalf of the Employer  
Name of the Official:-  
Stamp/Seal of the Employer

**SAMPLE  
FORMAT OF BANK GUARANTEE FOR MOBILISATION ADVANCE**

(Clause 1.5.20, Part - I, Chapter - V)

Bank guarantee made on this ..... Between ..... (hereinafter called "**the Bank**") of the One Part and Dedicated Freight Corridor Corporation of India Limited. (hereinafter called "**the Employer**") of the other Part.

WHEREAS Dedicated Freight Corridor Corporation of India Limited has awarded the Contract no..... for "....." (hereinafter called "**the Contractor**"), having its registered office at .....

AND WHEREAS vide Clause 1.5.20 of Part - I, Chapter V , Special Conditions of Contract, Mobilization Advance up to \_\_\_\_% (\_\_\_\_ percent) of the original contract value of Rs..... is payable to the contractor against Bank Guarantees, the contractor hereby applies for Mobilization Advance of \_\_\_\_% (\_\_\_\_ percent) amounting to Rs...../- (Rupees.....) of the Contract Price,

Now, we the undersigned, Bank of ....., being fully authorized to sign and to incur obligations for and on behalf of and in the name of Bank of .....hereby declare that the said Bank will guarantee the Employer the full amount of Rs. ....-/- (Rupees.....) as stated above.

We, Bank of ....., do hereby unconditionally, irrevocably and without demur guarantee and undertake to pay the Employer immediately on demand any or all money payable by the contractor to the extent of Rs. ....-/- (Rupees.....) without any demur, reservation, context, recourse or protest and/or without any reference to the contractor. Any such demand made by the Employer on the Bank shall be conclusive and binding notwithstanding any difference between the Employer and the contractor on any dispute pending before any court, Tribunal, Arbitrator or any other authority. We agree that the guarantee herein contained shall be irrevocable and shall continue to be enforceable till the Employer discharges this guarantee.

This guarantee is valid till .....

At any time during the period in which this guarantee still valid of the contractor fails to fulfil its obligation under the Contract, it is understood that the Bank will extend this guarantee under the same condition for the required time on demand by the Employer at the cost of the contractor.

The Guarantee hereinbefore contained shall not be affected by any change in the constitution of the Bank or of the contractor.

The neglect or forbearance of the Employer in enforcement of payment of any money, the payment whereof is intended to be hereby secured or the giving of time by the Employer for the payment hereof shall in no way relieve the Bank of their liability under this Deed.

The expressions "the Employer", "the Bank" and "the contractor" hereinbefore used shall include their respective successors and assigns.

Notwithstanding anything contained herein:

Our liability under this Bank Guarantee shall not exceed Rs...../-  
(Rupees.....)

this bank Guarantee shall be valid up to.....

We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only and only if you serve upon us a written claim or demand on or before .....(date of expiry of Guarantee).

In witness whereof we of the Bank have signed and sealed this Guarantee on the .....day of ..... being herewith duly authorized.

For and on behalf of the Bank of .....

Signature of Authorized Bank Official

Name .....

Designation .....

Stamp/Seal of the bank .....

Signed, sealed and delivered for and on

Behalf of the bank by the above named

..... in the presence of

Witness 1

Signature .....

Name .....

Address .....

Witness 2

Signature .....

Name .....

Address .....

**ANTI-PROFITEERING DECLARATION**TO WHOMSOEVER IT MAY CONCERN

I, age        years, Soul Daughter of       .  
resident of       

       do solemnly affirm and state as under:

- 1) That I am the        <Designation of the authorized signatory+ of        and I am duly authorized to furnish this undertaking/declaration on behalf of        (Name of the company).
- 2) That        (Name of the company) has been awarded the work        (Name of Work) vide Letter of Award number        dated        by MIs Dedicated Freight Corridor Corporation of India Limited.
- 3) That the Company is fully aware of the anti-profiteering provision under the Goods & Services Tax ("GST") Law(s).
- 4) That the Company        has passed the benefit of input tax credit available on the        (good/services) having HSN        supplied to MIs        Dedicated Freight Corridor Corporation of India Limited which it is getting on account of reduced tax liability and input tax credit because of enactment of GST Laws after introduction of Goods and Service Tax w.e.f. 1<sup>st</sup> July, 2017. The details and amounts being passed on to DFCCIL are provided in Annexure        of this document and are as per applicable GST Laws. These are true and correct to the best of my knowledge, information and belief.
- 5) Further, it is to confirm also that in case        (name of the organization) will receive any further benefit in future after 1<sup>st</sup> July, **2017 by way** of availment of input tax credits which were not allowed to be availed before 1<sup>st</sup> July, 2017 or reduction in tax rates or in any other manner which results in reduction of cost of the goods/services supplied to MIs Dedicated Freight Corridor Corporation of India Limited, then Company will pass that benefit to MIs Dedicated Freight Corridor Corporation of India Limited also.
- 6) That I declare that the foregoing is true and correct and the same is a legal obligation and failure to fulfil it could result in penalties under the IG<sup>or</sup>,



- 7) I confirm that I am aware of the implication of the above undertaking and our liability on account of incorrect/misleading declaration under the GST Laws.

Signature of the Authorised signatory/ person

Name and Designation of the Auth. Sign/person of the person

Name of the Organisation and Seal  
Seal

Executed on a non-judicial stamp paper of Rs. 100/- duly notarised by notary public

---

## Name and Address of the Chartered Accountant

---

### CERTIFICATE

This is with reference to the Impact of GST on a Contract Price for *(Particulars of the Contract)* - hereinafter referred to as the Work, awarded vide Contract Agreement No. ----- dtd ----- to M/s *(Name of the Contractor)* - hereinafter referred to as the Entity, under pre-GST Tax system.

Whereas the Entity is required to submit Declaration u/s 171 of CGST Act duly certified by its Statutory Auditor pursuant to the Circular No. 46 issued by the Employer (DFCCIL), and

I/We, *(Name of Chartered Accountant)*, have been appointed as Statutory Auditor of the Entity vide Resolution of the Board of Directors / all the Partners of the Entity in their meeting held on ----- (enclosed herewith), and

the Management of the Entity has sought from me/us verification of the element of estimated taxes and duties in the pre-GST regime mentioned in the accompanying Statement prepared and approved by it,

I/We conducted my/our examination of the Statement in accordance with the Guidance Note on Report or Certificate for Special Purpose issued by the Institute of Chartered Accountants of India (ICAI) duly complying with the ethical requirement of its Code of Ethics and while carrying out our examination of the relevant records and statements, I/We have placed reliance on the management certified estimates of the future Projections/ transactions.

Based on our examination of relevant records and statements, prepared and approved by the Management of the Entity, showing benefits envisaged on account of Pre-GST tax incidences subsumed under GST in respect of certain cost items included in the Accepted Cost for the Work, and the information and explanations provided to us by the Management of the Entity, *I/We hereby certify that the taxes and duties under pre-GST regime, subsumed under GST, furnished in the Statement have been appropriately computed on the management certified estimated costs and its components using the tax rates prevalent as on (BASE DATE), in all material respects and the Statement showing the difference in amount of total taxes, due to change of Tax regime, arrived in respect of Pre-GST taxes and Post GST taxes, duly considering the ITC availed/refund claimed, are found to be correct.*

Calculation of the Cost as per Pre-GST and Post GST regime is enclosed as Annexure I to this Certificate and the summary of the same is detailed hereunder:

| SN | Particulars   |                     | Amount in Rs crs |
|----|---|---------------------|------------------|
|    | Original Contract Value                               | A                   |                  |
|    | Less:- Advance received till 30th June 2017           | B                   |                  |
|    | Less:- Progress Billing till 30th June 2017           | C                   |                  |
|    | Balance Contractual Billing                           | $D = A - B - C$     |                  |
|    | Less:- Input Tax Credit Pass on ( Pre-GST tax amount) | E                   |                  |
|    | Balance Contractual Billing without pre-GST Taxes     | $F = D - E$         |                  |
|    | GST on Balance Billing @ 12%                          | $G = F \times 12\%$ |                  |
|    | Additional Impact on a/c of GST                       | $H = G - E$         |                  |

I/We further certify that the Declaration u/s 171 of CGST Act duly approved by the Board of Directors / all the Partners of the Entity in their meeting held on ----- enclosed herewith.

This Certificate is issued at the specific request of *(the name of the Entity)* for submission to their Employer, M/s DFCCIL as per the requirements of Circular No. 46. The Certificate should not to be used for any other purpose or by any other person.

For -----

Place:

Chartered Accountants

Date:

(Firm's Registration No. -----)

**PART V**

**DRAWINGS**

**PART V****DRAWINGS****5.1 General Arrangement Drawings with Key Plan:**

| <b>SL. No.</b> | <b>Level Crossing No</b> | <b>Chainage of ROB (km)</b> | <b>Appox Rly. Span configuration (m)</b> | <b>Approx. Approach Span configuration (m)</b> | <b>GAD No.</b>                                  |
|----------------|--------------------------|-----------------------------|--|--|---|
| 1              | 49                       | IR chainage 96/4-10         | 2x36 (Composite girders)                 | 10x24+10x24                                    | 1)Railway portion GAD<br>2)Approach portion GAD |

**Notes:**

1. General Arrangement Drawings of Railway portion and approaches portion are attached as a part of tender document.
2. These GADs are indicative and for reference only.
3. The work shall be done as per final / detailed drawings.

|                                |
|--------------------------------|
| <b>END OF TENDER DOCUMENTS</b> |
|--------------------------------|