OCC ARRANGEMENT
APL-2

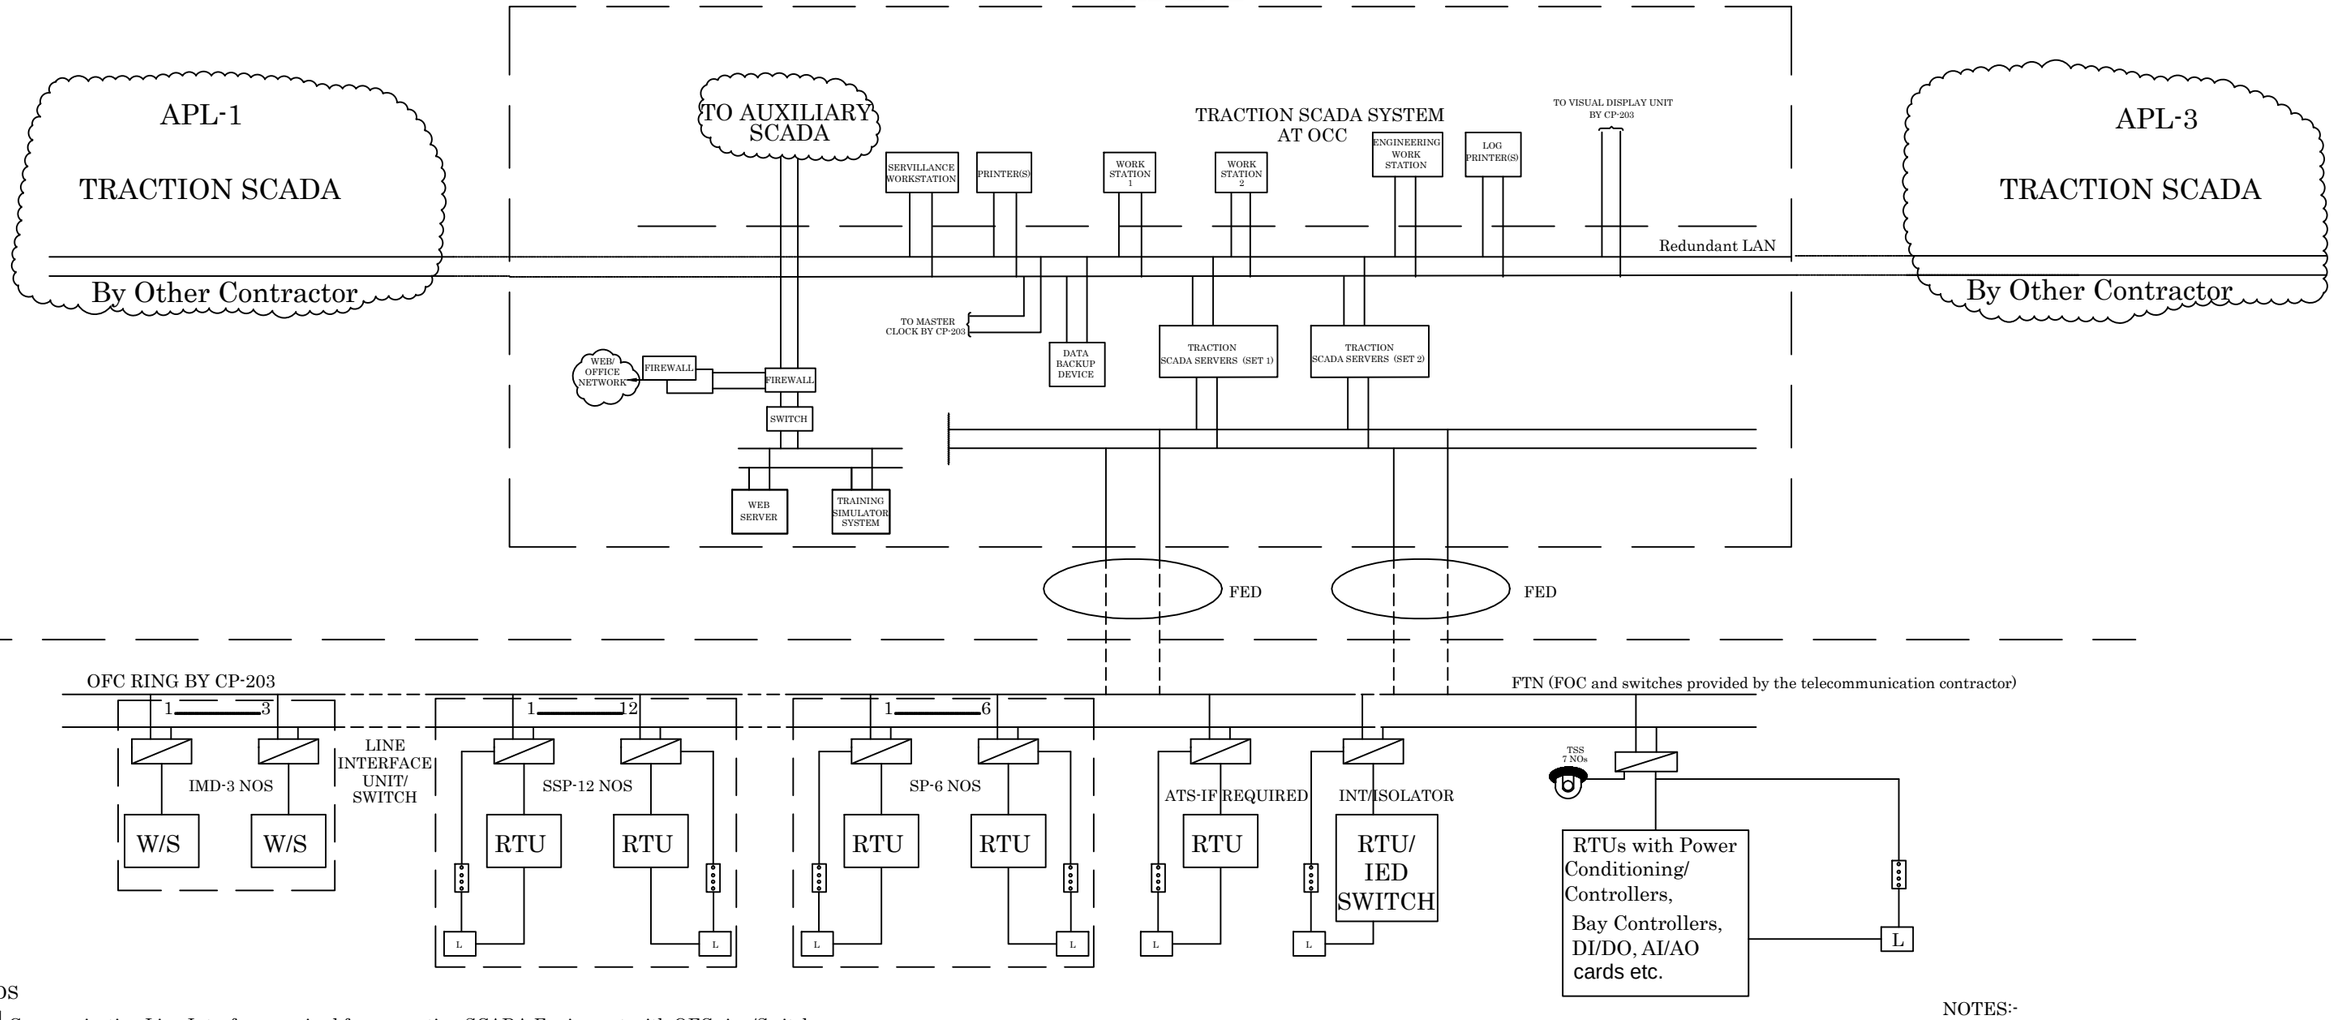

LEGENDS

Communication Line Interface required for connecting SCADA Equipment with OFC ring/Switch

L - FAULT FACTOR

MODEM

NOTES:-

1.The drawing is indicative and shall be read in conjunction with the employer's requirement including Volume 2:PS for Electric Traction and associated works .

SCALE	REV.	DISCRIPTION	DRN.	CHD.	VER.	DATE
NTS	00		K.R.	A.D.	S.S.	08-04-2015
DRG NO.	01		K.R.	A.D.	S.S.	01-06-2015
GC/DFCC/TR/SCADA/701						

OWNER

डेडीकेटेड फ्रेट कोरीडोर

DEDICATED FREIGHT CORRIDOR CORPORATION OF INDIA LTD.

GENERAL CONSULTANT

AECOM

AECOM Asia Co. Ltd.
9TH FLOOR, INFINITY TOWER C DLF CYBER CITY
DLF PHASE II GURGAON 122002, INDIA
T: +91 124 2816000 F: +91 124 2816008

TITLE

(INDICATIVE)
GENERAL ARRANGEMENT
BLOCK DIAGRAM FOR TRACTION
SCADA CONTROL

PROJECT

CONSTRUCTION OF EASTERN DEDICATED FREIGHT CORRIDOR SECTION BETWEEN MUGHAL SARAI (CH: 119550) TO NEW BHAUPUR STATION (CH: 507693.777)